

Exhibit No. CAT-19
Docket UE-152253
Witness: Chad A. Teply

**BEFORE THE WASHINGTON
UTILITIES AND TRANSPORTATION COMMISSION**

WASHINGTON UTILITIES AND
TRANSPORTATION COMMISSION,

Complainant,

v.

PACIFIC POWER & LIGHT
COMPANY,

Respondent.

DOCKET UE-152253

PACIFIC POWER & LIGHT COMPANY

EXHIBIT OF CHAD A. TEPLY

Excerpt from Best Practices in Electric Utility IRP

April 2016



Energy solutions
for a changing world

Best Practices in Electric Utility Integrated Resource Planning

**Examples of State Regulations
and Recent Utility Plans**

Authors

Rachel Wilson

Bruce Biewald



Synapse
Energy Economics, Inc.

June 2013

Introduction

As energy demand across the United States rises and falls and the generation fleet ages, utilities must plan to add and retire resources in the most cost-effective manner while meeting regional reliability standards. Integrated resource planning began in the late 1980s, as states looked for a way to respond to the oil embargos and nuclear cost overruns of the previous decade—and ever since, it has been an accepted way in which utilities can create long-term resource plans. State requirements for resource plans vary in terms, among other things, of planning horizon, the frequency with which plans must be updated, the resources required to be considered, stakeholder involvement, and the actions that public utilities commissions should take in reference to the plan (review, acknowledge, and accept or reject the plan).

As the electric industry began to restructure in the mid-1990s, integrated resource planning rules in many states were repealed or ignored. Some states have since made an effort to update IRP rules to make them applicable to current industry conditions, while other states have continued to use rules that are now out of date. This report describes IRP requirements in three states that have recently updated their regulations governing the planning process, and it reviews the most recent resource plan

from the largest utility in each of those states. Rules from Arizona, Colorado and Oregon are described in detail, in order to demonstrate ways in which states can require comprehensive planning processes and resource plan outcomes from the utilities under their jurisdictions.

These particular states were chosen not only because their rules have recently been updated, but also because the guidance they provide to electric utilities offers examples of best practices in integrated resource planning. The updated rules have been designed to give thoughtful consideration to specific resources that have traditionally been ignored, and to produce outcomes that are in the best interests of both ratepayers and society as a whole. Utility resource plans from Arizona Public Service, Public Service Company of Colorado, and PacifiCorp utilize progressive methodologies and contain modern elements that contribute to the production of high-quality plans that are useful examples of superior resource planning efforts.

This report is intended to be helpful to policymakers, public utility commissions and their staff, ratepayer advocates, and the general public as they each consider the ways in which utility resource planning can best serve the public interest.

the eastern system peak and 1.4% for the western system peak), and that energy requirements will grow by 1.8% per year. Resource deficits will begin in the first year, with PacifiCorp being short 326 MW in 2011. This deficit grows to 3,852 MW by 2020. In the near-term, shortages will be met with DSM, renewables, and market purchases, but new baseload and intermediate generating units begin to be added to the resource mix in 2014.⁶⁹ Figure 7 shows the proposed resource additions.

If PacifiCorp were to proceed with these proposed resource additions, by 2020 its capacity mix would be as shown in Figure 8. In this scenario, traditional thermal resources still make up two-thirds of PacifiCorp’s capacity mix; DSM makes up just over 13%, and renewables make up 2.6%.

As Figure 9 shows, PacifiCorp’s energy mix looks slightly different under its preferred portfolio. The percentage of total energy generated from coal-fired resources drops by 26% between 2011 and 2020, while the amount of

Figure 8


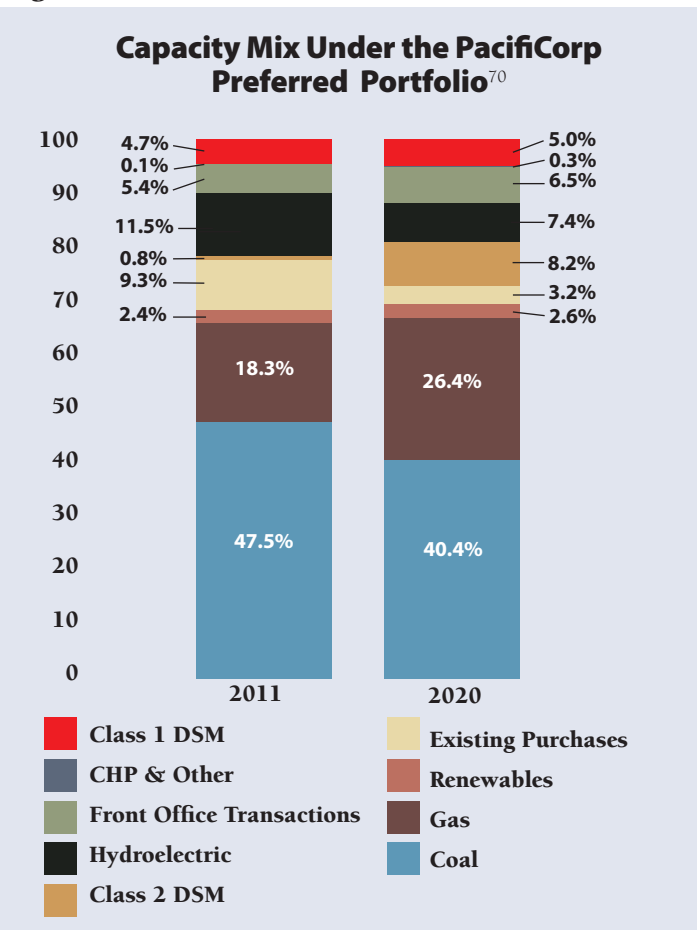


Figure 9

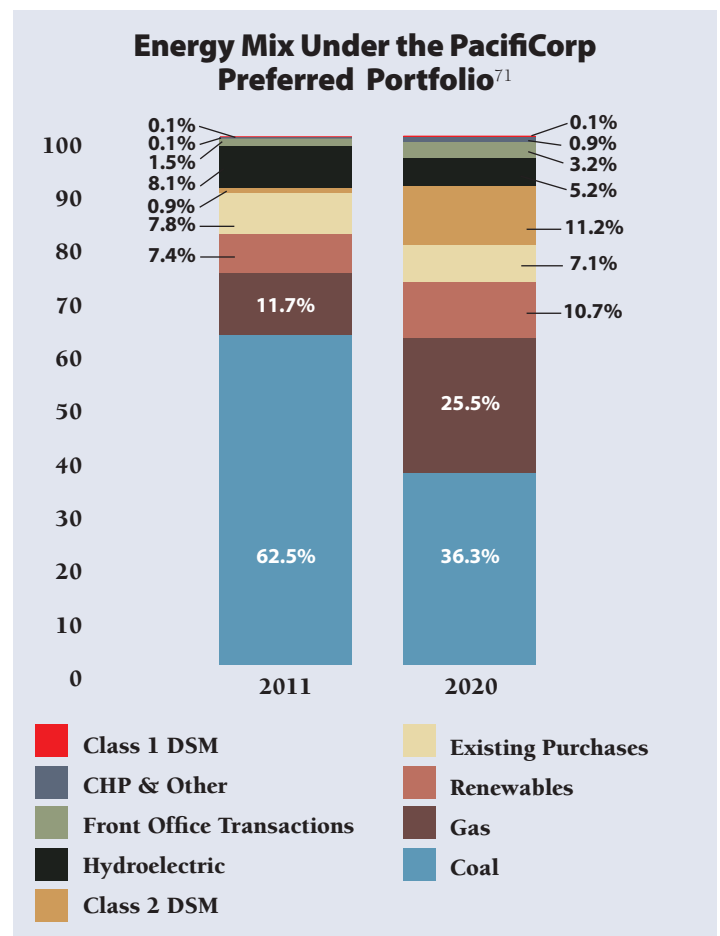

energy from gas-fired resources more than doubles. Even with the significant drop in generation from coal, energy from thermal resources makes up 61% of PacifiCorp’s total energy. DSM makes up 11% of the energy mix, with another 11% coming from renewable resources. Hydroelectric power and energy purchases make up the bulk of the remaining energy.

Of the three utilities examined in this report, PacifiCorp’s portfolio modeling process is the most comprehensive. It uses a model called System Optimizer, which has the capability to determine capacity expansion plans, to run a production cost simulation of each optimized portfolio, and to perform a risk assessment on these portfolios.

69 PacifiCorp. 2011 *Integrated Resource Plan: Volume 1*. March 31, 2011. Page 83.

70 Id. Page 10.

71 Id. Page 13.