


### Shaw Cove August 2015

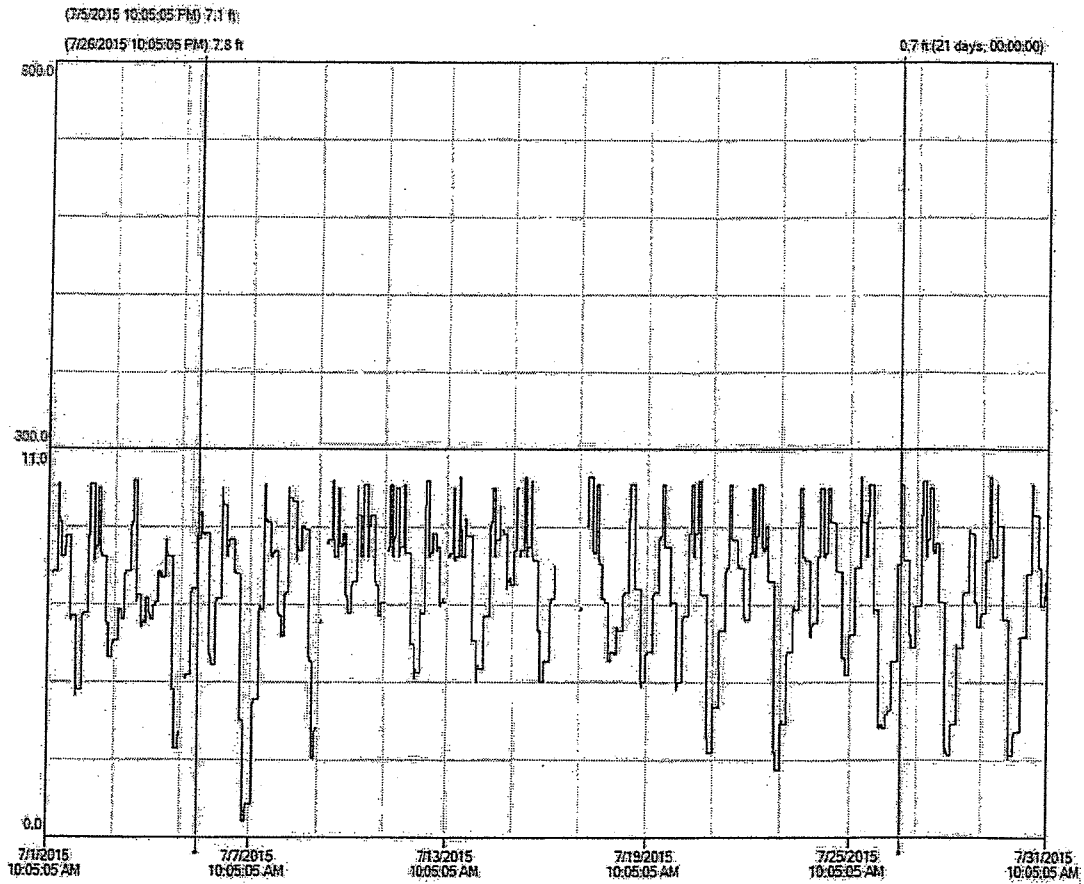

VHIST:ShawCove\_LocalTankLevel.PV (BestFit - 00:04:19:51.520)

Hierarchical Name	Description	Number	Server	Color	Units	Minimum	Maximum	IO-Address
<input checked="" type="checkbox"/> <input type="checkbox"/> ShawCove_LocalTankLevel.Dev.PV	The User Defined object provides a start...	9	VHIST		ft	300.0	300.0	\\VHIST\InSQL_MDAS...
<input checked="" type="checkbox"/> <input type="checkbox"/> ShawCove_LocalTankLevel.PV	Shaw Cove Tank Level	10	VHIST		ft	0.0	11.0	\\VHIST\InSQL_MDAS...

1/6/2016 10:13:21 AM

C:\Users\RWWCuser\Documents\Quality Control\Trends\Shaw CoveAugust 2015.aaTrend