

**EXH. CLS-5HC  
DOCKET UE-20\_\_\_\_  
2020 PSE PCORC  
WITNESS: CINDY L. SONG**

**BEFORE THE  
WASHINGTON UTILITIES AND TRANSPORTATION COMMISSION**

**WASHINGTON UTILITIES AND  
TRANSPORTATION COMMISSION,**

**Complainant,**

**v.**

**PUGET SOUND ENERGY,**

**Respondent**

**Docket UE-20\_\_\_\_**

**FOURTH EXHIBIT (HIGHLY CONFIDENTIAL) TO THE  
PREFILED DIRECT TESTIMONY OF**

**CINDY L. SONG**

**ON BEHALF OF PUGET SOUND ENERGY**

**REDACTED  
VERSION**

**DECEMBER 9, 2020**



# 2018 RFP Evaluation Process Document

*August 2018 – December 2019*



TABLE OF CONTENTS

**Table of Contents**

**1. Executive summary ..... 1**

**2. Resource need ..... 4**

    PSE’s 2017 IRP identified a need for new renewable and capacity resources ..... 4

    Resource need forecasts updated for Phase 2 ..... 5

**3. RFP environment ..... 8**

    Forecast gas prices, power prices and load growth have decreased since the 2017 IRP ..... 8

    PSE analyzed regional resource adequacy in the 2017 IRP ..... 8

    Environmental laws, regulations, policies and tax incentives are changing ..... 9

    Permitting and transmission challenges for development resources ..... 11

**4. Proposals received ..... 15**

    RFP proposals received ..... 15

    Unsolicited proposals received during the RFP process ..... 18

    Self-build proposals ..... 18

    Transmission redirect option ..... 19

**5. Evaluation process overview ..... 20**

    Reporting and transparency ..... 21

**6. Screening process and results (“Phase 1”) ..... 23**

    Phase 1 qualitative analysis: Cross-functional risk screening ..... 23

    Phase 1 quantitative analysis: Economic screening of individual proposals ..... 24

    Key findings by resource type ..... 27

    Phase 1 results: The “candidate” list ..... 31

**7. Optimization and due diligence process and results (“Phase 2”) ..... 33**

    Revised candidate list for Phase 2 evaluation ..... 33

    Phase 2 qualitative analysis: Due diligence evaluation ..... 34

    ..... 36

    Phase 2 quantitative analysis: Individual proposal analysis and portfolio optimization ..... 37

    Phase 2 Results: The short list ..... 40

2018 RFP EVALUATION PROCESS DOCUMENT

TABLE OF CONTENTS

Independent Energy Assessment ..... 41

**8. Re-evaluation of resource alternatives (“Phase 2 Update”) ..... 42**

Phase 2 Update: Optimization analysis ..... 42

Revised short list ..... 43

**9. Next steps ..... 45**

**List of Appendices**

**Proposal list ..... A**

**Evaluation criteria (as filed in RFP solicitation document)..... B**

**RFP Phase 1 results ..... C**

- 1. Phase 1 executive summary
- 2. Phase 1 portfolio analysis results: Individual proposal rankings

**RFP Phase 2 and Re-evaluation (“Phase 2 Update”) results ..... D**

- 1. Phase 2 executive summary
- 2. Phase 2 portfolio analysis results: Individual proposal rankings
- 3. Phase 2 optimization results
- 4. Phase 2 Update: Re-evaluation optimization results

**Quantitative analysis process..... E**

- 1. Models and assumptions
- 2. Phase 1: Screening analysis
- 3. Phase 2: Due diligence and optimization analysis
- 4. Phase 2 Update: Re-evaluation of alternatives

**Presentations.....F**

- 1. Presentations to PSE’s Energy Management Committee
- 2. Presentations to Washington Utilities and Transportation Commission

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 1. EXECUTIVE SUMMARY

The purpose of this document is to provide contemporaneously prepared summary documentation of PSE's evaluation process, results and decision-making related to the 2018 All Resources and Demand Response Requests for Proposals ("2018 RFPs"). Puget Sound Energy's ("PSE" or "the Company") RFP process is guided by rules set forth in Washington Administrative Code Chapter 480-107 ("Chapter 480-107 WAC") and guidance from its most recent Integrated Resource Plan ("IRP").

#### 1. Executive summary

PSE conducted its 2018 RFP evaluation process in an environment of modest but steady economic growth; lower expected load growth, gas and power prices than forecast in the 2017 IRP; and lower than expected capital costs for renewable and storage development resources.<sup>1</sup> At the same time, PSE started to see the impact of declining and expiring tax credits for renewable development projects, as looming deadlines began to put upward pressure on the cost of early development projects unable to meet safe harbor deadlines to lock in higher incentives.<sup>2</sup>

This RFP also took place against a backdrop of changing federal and state environmental policies and regulations. At the federal level, uncertainties included efforts by the current administration to repeal and replace the Clean Power Plan<sup>3</sup> and the potential withdrawal of the U.S. from The Paris Agreement<sup>4</sup> to combat climate change, both of which were announced in 2017. In July 2019, the EPA issued the Affordable Clean Energy rule, which repealed the Clean Power Plan and loosened emissions reductions guidelines for states and power plants. During Phase 1 of the RFP, Initiative 1631 ("I-1631") proposed a Washington state carbon tax that failed to pass at the ballot box in November 2018. However, during Phase 2 of the RFP, the state's legislature passed Senate Bill 5116, The Clean Energy Transformation Act ("CETA"), which sets statewide policy goals for the elimination of coal-fired resources by 2025, 80 percent carbon free generation and overall carbon neutral electricity by 2030, and 100 percent carbon free electricity by 2045.

PSE received nearly 100 proposals from a wide range of resources in response to the 2018 RFPs. Unlike prior RFPs, the vast majority of these proposals were for renewable or non-emitting resources. At the same time, traditional baseload resource options were few in number and faced serious competition on an economic basis from resources capable of contributing to both the renewable resource and peak capacity needs established in the RFP. These "dual value" resources, such as Montana wind and biomass, offered tremendous benefit to the portfolio. Ultimately, three of the four shortlisted proposals offered dual-value contributions to need.

---

<sup>1</sup> See Section 3 for a comparison of 2017 IRP to 2018 RFP gas prices, power prices and load forecasts. See also Appendix E for a more detailed discussion of PSE's key assumptions and how these assumptions have changed since the 2017 IRP.

<sup>2</sup> Declining and expiring federal tax credits for renewable development projects include the production tax credit ("PTC") and the investment tax credit ("ITC"). See Section 3 herein for a discussion of PTCs and ITCs.

<sup>3</sup> In December 2017 the EPA began the process of repealing and replacing the Clean Power Plan by asking the public for input.

<sup>4</sup> President Trump announced that the U.S. would cease participation in the 2015 Paris Agreement on June 1, 2017; however, the White House later clarified that the U.S. would abide by withdrawal terms specified in the agreement, which state that the earliest effective withdrawal date by the U.S. cannot be prior to November 4, 2020, four years after the Agreement became effective in the U.S. and one day after the 2020 U.S. presidential election.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 1. EXECUTIVE SUMMARY

PSE's evaluation team relied upon its experience as a resource owner and evaluator, its familiarity with the region's energy market, and analytical tools used throughout multiple IRP and RFP cycles to identify the lowest reasonable cost resource opportunities to meet PSE's renewable and capacity needs. To do this, PSE's evaluation process involved quantitative analysis using the Aurora model (variable costs and dispatch) and PSE's portfolio screening and optimization model (fixed costs and portfolio analysis) to analyze resource costs and characteristics; and qualitative analysis based on specific evaluation criteria to compare the risks and merits of each proposal. The evaluation criteria are described in Appendix B. PSE updated its load, power and gas price forecasts prior to filing the RFPs in June 2018 and again prior to the due diligence phase of the evaluation ("Phase 2") to reflect the most current information available to us at the time the analysis was conducted. Key inputs to the quantitative analysis are presented in Appendix E.

The results of the RFP analysis led PSE's RFP team to recommend pursuing the following proposals:

- [REDACTED] (#18169), a 25-year fixed price power purchase agreement ("PPA") delivering up to [REDACTED] MW<sup>5</sup> of the output from a Montana wind development project to the [REDACTED] beginning as early as December 2021;<sup>6</sup>
- **Golden Hills Shaped Wind PPA (#18170)**, a 20-year fixed price power purchase agreement ("PPA") delivering to BPAT.PSEI the output from a 200 MW wind development project paired with shaped capacity up to [REDACTED] MW during winter peak hours<sup>7</sup>, beginning in December 2021;
- **SPI Biomass PPA (#18100)**, a 17-year fixed price power purchase agreement ("PPA") delivering 17 MW of firm capacity (and up to an additional 3 MW of variable energy) from a biomass project located on PSE's system to the Fredonia Substation, beginning in January 2021;
- **BPA Peak Capacity Product (#18161)**, a 5-year capacity tolling agreement ("CTA") for firm capacity delivered to BPAT.PSEI that may be scheduled in [REDACTED] increments from [REDACTED] MW on a [REDACTED] basis, beginning in January 2022.

Subsequent to PSE's RFP evaluation, the Company received two new unsolicited proposals. PSE performed a re-evaluation of its resource alternatives (described in Section 8), which confirmed its RFP selections and added the following proposal to the recommended short list:

- **Morgan Stanley System PPA (#UP006)**, a 5-year fixed price system PPA for 100 MW of firm heavy load hour ("HLH")<sup>8</sup> energy delivered in Q1 and Q4 only, beginning in January 2022.<sup>9</sup>

PSE's analysis shows that when combined with the Company's existing electric resource portfolio, the selected RFP proposals represent the most favorable combination of resources to meet PSE's renewable and capacity needs at the lowest reasonable cost and risk. This report describes the 2018 RFP evaluation

---

<sup>5</sup>Actual contract capacity is expected to be dependent upon the outcome of required transmission studies.

<sup>6</sup>Actual contractual commercial operation date ("COD") may be later, depending upon the outcome of required transmission studies.

<sup>7</sup>Shaped schedule: November through February, hours ending (HE) [REDACTED] and [REDACTED]

<sup>8</sup>Heavy load hour ("HLH") means hours ending ("HE") 7-11 Monday through Saturday except NERC holidays.

<sup>9</sup>MSCG is offering a 0 emissions (no RECs) system PPA.

REDACTED  
VERSION

REDACTED  
VERSION

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 1. EXECUTIVE SUMMARY

process, the results it produced, and how PSE considered a variety of qualitative and quantitative criteria to select resources that best meet the needs of its customers.

#### **2019 IRP update since completing the 2018 RFP:**

PSE conducted its 2018 RFP evaluation between August 2018 and July 2019, in parallel with its 2019 integrated resource planning (“IRP”) process. Many of the 2018 RFP modeling assumptions were updated to reflect 2019 IRP assumptions vetted by the IRPs public stakeholder groups, the IRP Advisory Group (“IRPAG”) and the Technical Advisory Group (“IRTAG”). At the time, the 2019 IRP was expected to be filed in January 2020.

Subsequent to completing the 2018 RFPs, PSE was asked by the WUTC to withhold its next IRP until an upcoming rulemaking could incorporate Washington’s new Clean Energy Transformation Act (“CETA”) into Chapter 480-100-238 WAC (“the Integrated Resource Planning rule”) and Chapter 480-107 WAC (“the Resource Acquisition rule”). This document reflects what PSE knew at the time the RFP evaluation was conducted.



SECTION 2. RESOURCE NEED


2. Resource need

PSE’s electric resource acquisition process is guided by our integrated resource planning analysis, which evaluates and establishes the Company’s capacity (physical reliability) and renewable resource (policy driven)<sup>10</sup> needs on a biennial basis, consistent with Chapter 480-100-238 WAC. Our most recent Integrated Resource Plan (“IRP”) includes a detailed discussion of PSE’s electric planning standard and describes our methodology for analyzing the Company’s resource needs. The IRP can be found on PSE’s web site at <http://www.pse.com/irp>.

PSE’s 2017 IRP identified a need for new renewable and capacity resources

After publishing the 2017 IRP, PSE updated the assessment of its capacity and renewable resource needs in its 2018 RFP filings to reflect the company’s 2017 load forecast and 100 MW of Mid-C transmission determined to be available after the IRP was filed. Figures 1 and 2 include these updates and conservation from the 2017 IRP, but do not include demand response. As shown in Figure 1, PSE forecast a modest capacity need prior to 2021 that was expected to increase to a deficit of 272 MW in 2022 after the retirement of Colstrip 1&2.

Figure 1. Phase 1 Capacity Need (as filed)

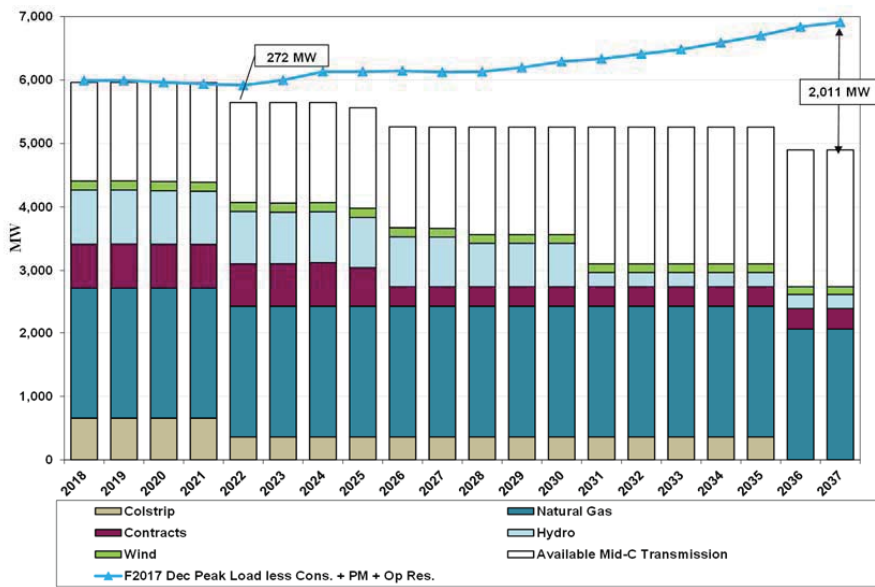


<sup>10</sup> PSE has a legal obligation to meet the requirements of the Energy Independence Act (Chapter 19.285 RCW), also referred to as Washington state’s renewable portfolio standard (RPS). See Section 3 for a discussion of the RPS.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 2. RESOURCE NEED

As shown in Figure 2, the renewable resource need (also known as the “RPS need”) forecast demonstrates a need for 671,000 renewable energy credits (“RECs”) beginning in 2023. This need is driven by an increase in Washington state’s renewable portfolio standard (“RPS”) from 9 percent to 15 percent in 2020. However, PSE’s inventory of banked RECs delays the need for additional resources to meet this incremental increase until 2023.

**Figure 2. Renewable Resource Need (as filed)**

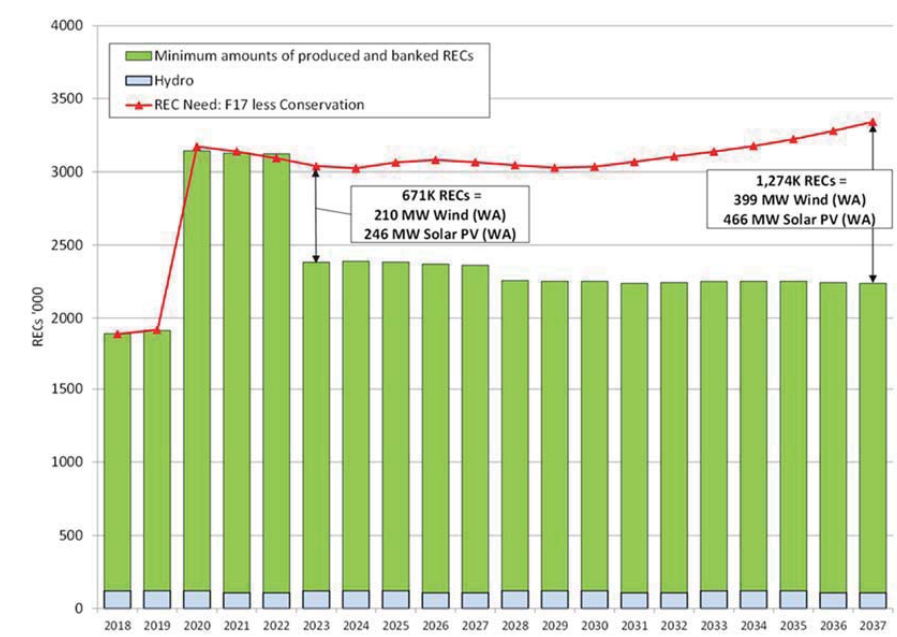


PSE’s 2018 RFPs sought resources capable of meeting one or both of its resource needs. Proposals for resources with the ability to meet both the renewable resource and peak capacity needs offered substantial value to PSE’s electric power portfolio, avoided certain environmental compliance and permitting risks, and aligned well with the state’s clean energy policy goals.

#### Resource need forecasts updated for Phase 2

PSE updated its renewable resource and capacity need assessments before the second phase of the RFP to reflect the most current information available at the time the analysis was performed. Figures 3 and 4 depict the updated need based on the F2019 load forecast and conservation from the 2017 IRP. Figure 3 shows an overall increase in the need for capacity resources over the planning horizon, including an increase of new capacity in 2022 from 272 MW (as filed) to 299 MW (Phase 2).

SECTION 2. RESOURCE NEED

Figure 3. Phase 2 Capacity Need

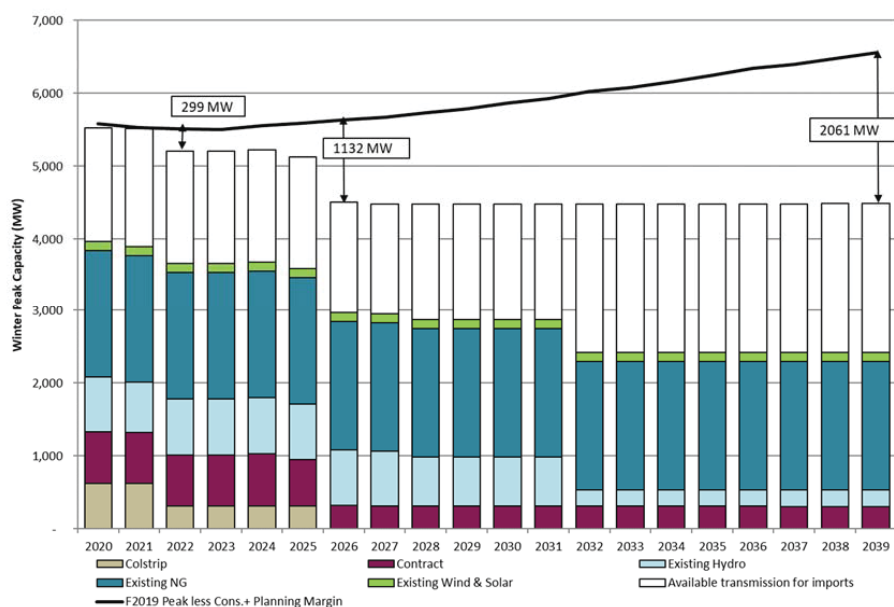

During Phase 2, PSE reached an agreement to decommission Colstrip units 1&2 (“Units 1&2”) by the end of 2019. Prior to this agreement, PSE had planned to shut down these units no later than July 2022. This accelerated timeline is not reflected in Figure 3. Instead, the Company released a separate RFP in May 2019 seeking short-term resources to bridge the gap expected to be created by the early closure of Units 1 &2 until long-term resources from the 2018 All Resources RFP could be secured and deployed.

Figures 3 and 4 do not reflect the impact of Senate Bill 5116, also known as the Clean Energy Transformation Act (“CETA”), which became Washington law during Phase 2 of the RFP.<sup>11</sup> However, consistent with CETA’s mandate to eliminate coal-fired resources after 2025, the Phase 2 capacity need (shown in Figure 3) does reflect the removal of Colstrip units 3&4 from the company’s electric resource portfolio starting in 2026.


Figure 4 shows a reduced renewable need of 233,449 RECs in 2023 (compared to the 671,000 RECs sought in the 2018 RFP filing), which grows to 691,864 RECs in 2024. The renewable resource need is driven by Washington state’s RPS, but delayed by PSE’s banked RECs until 2023.

<sup>11</sup> CETA sets several statewide policy goals, including a requirement to eliminate coal-fired resources after 2025, 80 percent carbon free generation and overall carbon neutral electricity by 2030, and 100 percent carbon free electricity by 2045.

2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 2. RESOURCE NEED

Figure 4. *Phase 2 Renewable Resource Need*

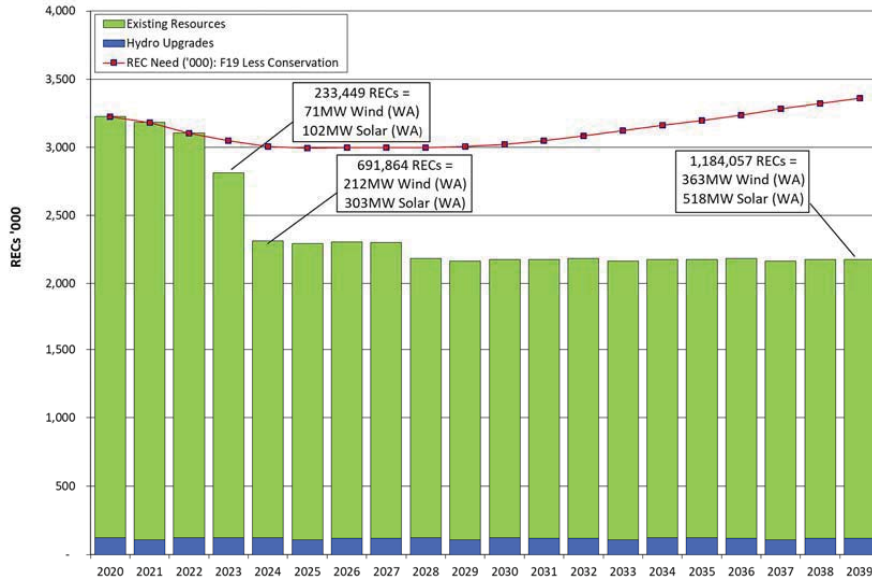

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

### 3. RFP environment

#### Forecast gas prices, power prices and load growth have decreased since the 2017 IRP

PSE filed its most recent Integrated Resource Plan (IRP) in November 2017 and performed its 2018 RFP analysis between August 2018 and June 2019. The Company updated its IRP modeling assumptions for each phase of the RFP evaluation to reflect then-current conditions. Table 1 shows how three key assumptions have changed since the 2017 IRP was filed.

Forecast levelized Mid-C power prices dropped nearly \$17/MWh and gas prices dropped a little more than \$0.50/mmbtu between the IRP and Phase 2 of the RFP. Average annual load growth assumptions also dropped 0.2 percent during the same time period.

Table 1. *Comparison of Key Modeling Assumptions: 2017 IRP and 2018 RFP*

Modeling Assumption	2017 IRP (filed Nov. 2017)	RFP Phase 1 (Aug. 2018 – Mar. 2019)	RFP Phase 2 (Apr. 2019 – Jul. 2019)	Phase 2 Update (Aug. 2019 – Nov. 2019)
Mid-C power prices levelized	\$40.48/MWh	\$33.92/MWh	\$28.75/MWh	\$23.66/MWh
Gas prices levelized	\$4.02/mmbtu	\$3.74/mmbtu	\$3.50/mmbtu	No change
Annual average load growth	0.7%	0.5%	0.5%	No change

Consistent with PSE’s IRP modeling assumptions, the RFP analysis uses power price forecasts from the Aurora dispatch model and gas price forecasts from Wood Mackenzie. Load forecasting modeling and methodologies are consistent with those described in PSE’s most recent Integrated Resource Plan. More information about RFP power and gas price forecasts, load forecasts and other modeling assumptions is provided in Appendix E.

#### PSE analyzed regional resource adequacy in the 2017 IRP

Because PSE relies in part on wholesale market purchases to meet its current and forecast energy and peak demand obligations, PSE’s planning function considers regional resource adequacy in its biennial Integrated Resource Plan. For more than a decade, the Pacific Northwest has experienced a large capacity surplus that has kept wholesale power prices relatively low and made these existing resources a lower cost alternative for filling PSE’s peak capacity need than building new generation. The 2017 IRP was prepared using results and data from three studies of regional load/resource balance published by three regional planning entities: the Northwest Power and Conservation Council (“NPCC”),<sup>12</sup> the Pacific

---

<sup>12</sup> Source: “Pacific Northwest Power Supply Adequacy Assessment for 2021”, published September 27, 2016 by Northwest Power and Conservation Council.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

Northwest Utilities Conference Committee (“PNUCC”)<sup>13</sup> and the Bonneville Power Administration (“BPA”).<sup>14</sup> While the studies differed in certain details, they all generally anticipated that the Pacific Northwest would cross over into deficit at some point over the next decade unless new supply-side or demand-side resources are developed. The plan goes on to say that the region appears to be in the process of adding new resources (mainly in the form of additional investments in conservation) to fill the expected gap.

PSE conducted extensive analysis in its 2017 IRP and ultimately determined that wholesale market purchases above its current 1,600 MW level, when paired with additional firm transmission rights that PSE may have during peak load events, are a reliable and cost-effective way to meet resource need compared to other available new resource alternatives evaluated in the plan. For a discussion of PSE’s analysis of regional resource adequacy in the 2017 IRP and regional studies used in the preparation of the plan, see 2017 IRP Chapter 6 (Electric Analysis), and appendices F (Regional Resource Adequacy Studies) and G (Wholesale Market Risk). An update to this analysis is currently underway for the next IRP, which is expected to be filed in January 2020.

#### Environmental laws, regulations, policies and tax incentives are changing

##### Clean Energy Transformation Act (“CETA”)

During Phase 2 of the RFP, Washington state’s legislature passed Senate Bill 5116, the Clean Energy Transformation Act (“CETA”), which sets statewide policy goals for the elimination of coal-fired resources in 2025, 80 percent carbon free generation and overall carbon neutral electricity by 2030, and 100 percent carbon free electricity by 2045. The Washington Utilities and Transportation Commission (“WUTC”) has launched a rulemaking process to clarify and interpret requirements under the Clean Energy Transformation Act. The first utility milestone under the law is to prepare and submit a clean energy implementation plan by 2022.

PSE will have a clearer view of the impacts of the new law on our planning and acquisition functions as these processes progress. In the meantime, the RFP evaluation team considered a range of social costs of carbon in our quantitative analyses and qualitatively considered the environmental risks associated with proposals. A description of the scenarios tested in the quantitative analysis, including the carbon assumptions associated with each scenario, is provided in Appendix E.

The Company will continue to stay engaged in the progress of the WUTC rulemaking process. Meanwhile, PSE will continue to comply with all existing applicable state and federal regulations, such as Washington’s Clean Air Rule (Chapter 173-442 WAC), Emission Performance Standards (Chapter 80.80.040 RCW) and The Energy Independence Act (Chapter 19.285 RCW).

---

<sup>13</sup> Source: “Northwest Regional Forecast of Power Loads and Resources 2017-2026”, published April 2016 by Pacific Northwest Utilities Conference Committee.

<sup>14</sup> Source: “2016 Pacific Northwest Loads and Resources Study”, published December 22, 2016 by Bonneville Power Administration.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

#### The Energy Independence Act (Washington’s RPS law)

The Energy Independence Act (Chapter 19.285 RCW), also known as Washington state’s renewable portfolio standard (“RPS”), requires electric utilities serving at least 25,000 retail customers to use qualifying renewable energy to meet a percentage of customer load. The target percentage has increased over time from 3 percent in 2012 to 9 percent in 2016, and will increase again to 15 percent in 2020.<sup>15</sup>

To contribute to meeting the state RPS, a qualifying renewable resource located outside the Pacific Northwest<sup>16</sup> must be delivered into Washington state on a real-time basis without shaping, storage or integration service. This requirement applied to several wind development resources located in central and southeastern Montana that were proposed in response to PSE’s 2018 RFP.

#### Tax incentives for renewable development projects

There are two primary federal tax incentives available for utility-scale renewable development projects: production tax credits (“PTC”), the type commonly used for wind projects, and investment tax credits (“ITC”), the type commonly used for solar projects. Both types of tax incentives are designed to ramp down or expire over the next three years.

##### *Production Tax Credits*

The federal PTC is a per kilowatt-hour tax credit based on output from a qualified renewable energy resource. The PTC rate is an inflation-adjusted rate, currently \$25/MWh in 2019. The PTC is available for the first 10 years of production. Starting in 2017, the PTC rate is reduced 20 percent annually through 2019, based on the year construction of a renewable project begins.

Table 2. *PTC rate reduction schedule*

Start of Construction	Production Tax Credit Rate Percentage	Project Completion Date
2016	100%	2020
2017	80%	2021
2018	60%	2022
2019	40%	2023
2020	0%	

The PTC includes certain requirements that must be met to receive the incentive associated with a particular construction start year. One requirement is that a project must be completed within four years of the construction start date. Additionally, the developer must either spend five percent of the total project capital costs (the “safe harbor” provision) or demonstrate that it commenced “physical work of a

<sup>15</sup> A utility is not required to meet a renewable energy target if it spends at least four percent of its retail revenue requirement on the incremental cost of renewable energy and renewable energy credits. The cost cap for a utility that has no load growth is one percent.

<sup>16</sup> The Pacific Northwest is defined in Section 3 of the Pacific Northwest Electric Power Planning and Conservation Act (94 Stat. 2698; 16 U.S.C. Sec. 839a) for the Bonneville Power Administration.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

significant nature” on the facility (the “physical work test”) within the construction start year. Assuming the requirements are met, a project with a construction start date in 2019 that is completed by 2021 would be eligible to receive a tax credit of \$20/MWh (25/MWh\*80 percent).

#### ***Investment Tax Credit***

The ITC is a dollar for dollar reduction in the income taxes that a company would otherwise pay the federal government. The ITC rate applies to the amount of investment in solar property. The current rate is 30 percent, but it ramps down annually beginning in 2020. The 30 percent ITC rate results in a \$30 reduction in taxes paid for a \$100 investment, resulting in a net investment of \$70.

Table 3. *ITC rate reduction schedule*

Start of Construction	Investment Tax Credit Rate	Project Completion Date
2019	30%	2023
2020	26%	2023
2021	22%	2023
2022+	10%	Ongoing

Safe harbor rules for the ITC are similar to the PTC rules, although the ITC rules include a sunset clause that requires an ITC project to be completed by 2023 to qualify for a 30 percent, 26 percent or 22 percent credit. Projects completed after 2023 would receive a 10 percent credit.

#### **Solar equipment tariffs**

In early 2018, the federal government issued a 30 percent solar panel import tariff under section 201 of the Trade Act of 1974. The tariff is designed to decline over a four year period. In late 2018, under Section 301 of the same act, the federal government imposed a 10 percent tariff on certain Chinese imports that include solar module components such as inverters, junction boxes and backsheets.

The impact of these tariffs have been widespread in the solar industry and likely increased the pricing of solar proposals received in response to the 2018 All Resources RFP. At the same time, solar industry cost reductions and technological advancements, such as the development of bifacial solar technology (and its exemption from the Section 201 tariffs), have had a muting effect on the tariff increases. Ultimately, PSE continued to see lower overall solar pricing in the 2018 RFP, despite any weakening in cost reductions that may have been caused by the tariffs.

#### **Permitting and transmission challenges for development resources**

##### **Permitting matters**

Development of traditional carbon-emitting capacity resources (e.g., natural gas-fired combustion turbines) in PSE's western Washington service territory is more challenging than ever politically and from a permitting standpoint. PSE received four proposals for natural gas-fired generation resources in



## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

response to the 2018 RFP, each of which proposed either an existing resource or the expansion of an existing site where PSE would be substantially responsible for the permitting.

There are relatively few “shovel ready” renewable (i.e., wind and solar) projects available in the market today. Nearly all of the proposed renewable resources were development projects. Many were early development projects without site control or any completed permitting work, which have greater potential for unknown risks than more mature alternatives. Additionally, while the processes and mitigations required to site wind projects are relatively well established in this region, large-scale solar projects are newer and require much larger permanent footprints than wind projects. Local jurisdictions and agencies continue to wrestle with how to evaluate and mitigate solar project impacts on native habitat and farm land. PSE looks at a variety of factors to determine the relative risk of development proposals (e.g., site control, permitting progress or well-developed permitting and outreach plans, the experience and qualifications of the development team, etc.) and considers potential mitigation opportunities. For selected proposals, PSE monitors project progress during development and construction to ensure that contractually agreed-upon milestones are met.

Batteries are an attractive capacity option from a permitting perspective because the footprint is small and impacts are generally low. As a result, there is more opportunity to site and build these resources, and the projects typically face fewer challenges than other traditional capacity resource options. Other storage resources, such as pumped hydro storage, require large-scale development and construction projects with a variety of potential risks, including long Federal Energy Regulatory Commission (“FERC”) permitting and construction timelines that could delay already long lead times and impact expected commercial operation dates. Further development of these resources could help reduce potential risks and make the proposals more attractive in future RFPs.

#### **Transmission matters**

##### ***Bonneville Power Administration***

Transmission to PSE’s system is constrained. Although PSE holds transmission rights on the Bonneville Power Administration (“BPA”) system that are not tied to specific resources, these rights are earmarked for PSE’s programmatic hedging program and for meeting winter capacity need on a short-term basis. Until BPA completes upgrades on critical constrained paths, PSE is unlikely to obtain additional firm transmission to the PSE system for new resources. To qualify as a capacity resource, PSE asked RFP bidders proposing resources on the BPA system to identify available long-term firm transmission to PSE’s system or demonstrate that BPA would grant such transmission rights. Therefore, BPAs TSR Study and Expansion Process (“TSEP”), formerly known as Network Open Season (“NOS”), was of particular interest during the 2018 RFP.

In response to increased electric generation resource development in the Northwest, which has been largely driven by wind developers, BPA implemented the TSEP, or Cluster Study, process to help the agency identify and prioritize needed transmission system upgrades. The Cluster Study process eliminated the outdated requests by clearing the existing queue, requiring parties seeking transmission service to submit new requests through TSEP, and obligating all TSEP participants to accept the transmission they request if BPA implements an upgrade. Thus, the TSEP process allowed BPA to prioritize and plan transmission upgrades based on a committed need.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 3. RFP ENVIRONMENT

One of the most critical paths for delivering energy to PSE load centers from resources located east of the Cascade Mountains is the Cross Cascades North (“CCN”) flowgate. In March 2012, a regional planning entity called ColumbiaGrid released the final report created by the CCN study team, indicating that the best alternative for increasing the transmission capacity on the CCN flowgate is through a new 500kV BPA transmission line, estimated to cost over \$1 billion. The report did not specify exactly when a new transmission line would need to be built, and BPA currently does not have such a project in its 10-year plan. There are a few smaller transmission upgrades that will increase the transmission capacity on the CCN flowgate in the near-term; however, PSE expects to have difficulty obtaining new transmission capacity on the CCN flowgate within the next 10 years.

Another critical path for delivering energy is the Cross Cascades South (“CCS”) flowgate. In the 2019 TSEP, BPA identified impacts to third-party transmission systems, in order to grant transmission service that impacts the CCS flowgate. The plan of service, costs, and timelines have yet to be determined.

#### ***Colstrip Transmission System***

Colstrip Units 1&2 were originally planned for closure in July 2022. In May 2019, an announcement was made to expedite the closure date to the end of 2019. PSE’s capacity from Units 1&2 utilize three legs of transmission: (1) Colstrip Transmission System (“CTS”), (2) Eastern Intertie, and (3) BPA main grid. All three segments were analyzed for potential use for a proposed Montana renewables project.

This RFP assumed reuse of all three transmission segments associated with the closure of Units 1&2 for a wind resource in Montana. Two of the transmission segments are contracted through BPA and are periodically renewed. BPA contract costs were considered sunk until the point of contract renewal. After renewal, the cost of the BPA transmission would be borne by the Montana wind project. Costs associated with PSE’s ownership share of the CTS were also considered to be sunk costs.

The RFP analysis assumed that when Colstrip 1&2 are decommissioned, 300 MW of transmission capacity will be available to PSE on the CTS. An additional 83 MW of transmission is currently available from PSE’s transmission provider along the CTS and this capacity could also potentially be used for a resource in Montana.

The transmission capacity available from Units 1&2 along the Eastern Intertie and BPA main grid is also presumed to be 300 MW on each segment. Along the Eastern Intertie, there is a potential to purchase additional transmission from BPA, up to 144 MW.

For the BPA main grid transmission, there is potential to redirect transmission elsewhere in BPA’s network based on available transmission capacity (“ATC”) analysis and BPA system constraints. The redirects could be utilized for resources elsewhere in the Pacific Northwest, or market purchases at the Mid-Columbia marketing hub (“Mid-C”), if the Colstrip transmission is not reused for a Montana wind resource.

Along with the anticipated transmission availability, there has been considerable discussion of the potential impacts on CTS transmission availability and operating characteristics that could result from changing a thermal resource to a wind resource. The variability of a renewable resource may require upgrades on the CTS to mitigate dynamic flows. Most notably, the Montana Renewable Development Action Plan emphasized the potential need for a new Remedial Action Scheme (“RAS”) for Montana wind

**2018 RFP EVALUATION PROCESS DOCUMENT**

**SECTION 3. RFP ENVIRONMENT**

resources. The costs and scope for a new RAS are unknown, and this protection scheme would be critical to delivering renewable energy to PSE's load center.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 4. PROPOSALS RECEIVED

#### 4. Proposals received

##### RFP proposals received

PSE received a total of 97 proposals for new resources in response to the 2018 All Resources and Demand Response RFPs, the largest response ever to an All Resources RFP. Table 4 compares the proposals received in response to past RFPs to those received in response to the current RFPs.

Table 4. *RFP proposals received, 2005 - 2018<sup>17</sup>*

As of 3/25/19	2018 All Resource and Demand Response RFPs		2017 Renewables Only RFP (Green Direct 2.0)		2011 All Source RFP		2010 All Source RFP		2008 All Source RFP		2005 All Source RFP	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW <sup>2</sup>	# Proposals	Max Cap MW
Solar - PV	16	2240	17	574	2	24	1	10				
Solar - PV + BESS	20	2848										
Wind - Off Shore	1	400										
Wind On Shore	16	3303	20	2601	4	369	21	3776	8	862	10	1165
Wind + Winter Sys PPA	1	371										
Wind + Solar and/or BESS	2	464	4	339								
Storage - Battery ("BESS")	17	1265			2	251						
Storage - Pumped Hydro	2	900										
Biomass	2	72			3	61	9	590				
Biomass + BESS	1	15										
Natural Gas-fired Generation	4	1377			10	2624	18	5342	10	2588	17	4307
Geothermal	2	43									1	48
Hydro - Run of River	1	38	2	4	1	77	2	105	3	165	3	139
System PPA / Call Option	1	100			4	400	10	n/a	9	1675	7	400
Unbundled RECs	5						2	n/a				
Demand Response	6	154					1	80			1	34
Coal - Traditional + IGCC					1	500			1	100	6	4950
Cold Fusion					1	1880						
Distributed Generation											1	5
Waste-to-Energy / Landfill Gas					1	23					1	5
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>43</b>	<b>3,518</b>	<b>29</b>	<b>6,209</b>	<b>64</b>	<b>9,903</b>	<b>31</b>	<b>5,390</b>	<b>47</b>	<b>11,053</b>

\*The Max Cap MW column reflects the total combined potential capacity

This table demonstrates the significant increase in total proposals received this cycle and the diversity of the resources offered.

<sup>17</sup> Table 4 does not include the two additional unsolicited proposals received subsequent to selecting the short list at the end of Phase 2, which were considered as part of the Phase 2 Update (the "Reevaluation") process between August and November 2019. See Appendix A for a complete list of the proposals received during the 2018 RFP and those received immediately after, which were included in the Phase 2 Update.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 4. PROPOSALS RECEIVED

Table 5 summarizes the overall resource mix, total offered capacity, offer structure and operating status of the proposed resources. Totals do not include unsolicited proposals received during the RFP evaluation, which are described later in this section. Demand response proposals are not included in the operating status column totals. See Appendix A for a complete list of proposals received, including unsolicited proposals.

Table 5. *2018 RFP proposals by resource type<sup>18</sup>*

Resource Type	# Proposals	Max Cap MW	Offer Structure(s)			Operating Status		
			Own	PPA/Toll/ Other Agmt	Both	Development	Construction	Operating
Solar - PV	16	2,240	1	14	1	16		
Solar - PV + BESS	20	2,848		18	2	20		
Wind - Off Shore	1	400			1	1		
Wind On Shore	16	3,303	3	11	2	15		1
Wind + Winter Sys PPA	1	371		1		1		
Wind + Solar + BESS	2	464	1	1		2		
Storage - Battery ("BESS")	17	1,265	1	8	8	17		
Storage - Pumped Hydro	2	900			2	2		
Biomass	2	72		2				2
Biomass + BESS	1	15		1		1		
Natural Gas CCCT	2	1,020		1	1			2
Natural Gas SCCT	1	245			1	1		
Natural Gas Recip	1	112	1			1		
Geothermal	2	43			2	1	1	
Hydro - Run of River	1	38		1				1
System PPA / Call Option	1	100		1				1
Unbundled RECs	5	n/a		5		5		
DR Direct Load Control	4	109		4				
DR C&I Curtailment	2	44		2				
<b>TOTAL</b>	<b>97</b>	<b>13,589</b>	<b>7</b>	<b>70</b>	<b>20</b>	<b>83</b>	<b>1</b>	<b>7</b>

*\*The Max Cap MW column reflects the total combined potential capacity*

Most RFP proposals included multiple offer options in which one or more of the terms or features varied. Some renewable generation proposals offered configurations including battery storage as a way to align delivery of intermittently produced generation with PSE's load. Two respondents offered hybrid proposals featuring a combination of wind and solar generation with options to include battery storage. Proposals often contained pricing for multiple offer structure options, such as the sale of assets (e.g., existing plant sale, various build and transfer options, or development rights), offtake agreements (e.g., power purchases, capacity tolling or unbundled renewable energy credits ("RECs")), or demand response program agreements. Some proposals offered pricing options adjusted for different transmission delivery points, start dates or resource capacities. Many offtake agreement proposals offered pricing options for different term lengths or price structures (e.g., fixed or escalating pricing). Additionally, some demand response proposals featured a variety of program options and recruitment levels from different customer classes.

<sup>18</sup> Table acronyms include: battery energy storage system ("BESS"), commercial and industrial customers ("C&I"), combined cycle combustion turbine ("CCCT"), demand response ("DR"), power purchase agreement ("PPA"), renewable energy credit ("REC") and simple cycle combustion turbine ("SCCT").


2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 4. PROPOSALS RECEIVED

As shown in Table 5, almost 93 percent of proposals offered at least one offtake agreement option and nearly 28 percent of proposals offered at least one ownership option. Nearly 92 percent proposed development resources, many of which were early stage development projects.

Location is another key criterion affecting transmission and interconnection feasibility and cost, permitting and public support. Figure 5 depicts generally the location of resources proposed in response to the RFP.

Figure 5. *Illustrative Map of Proposed RFP Resources*

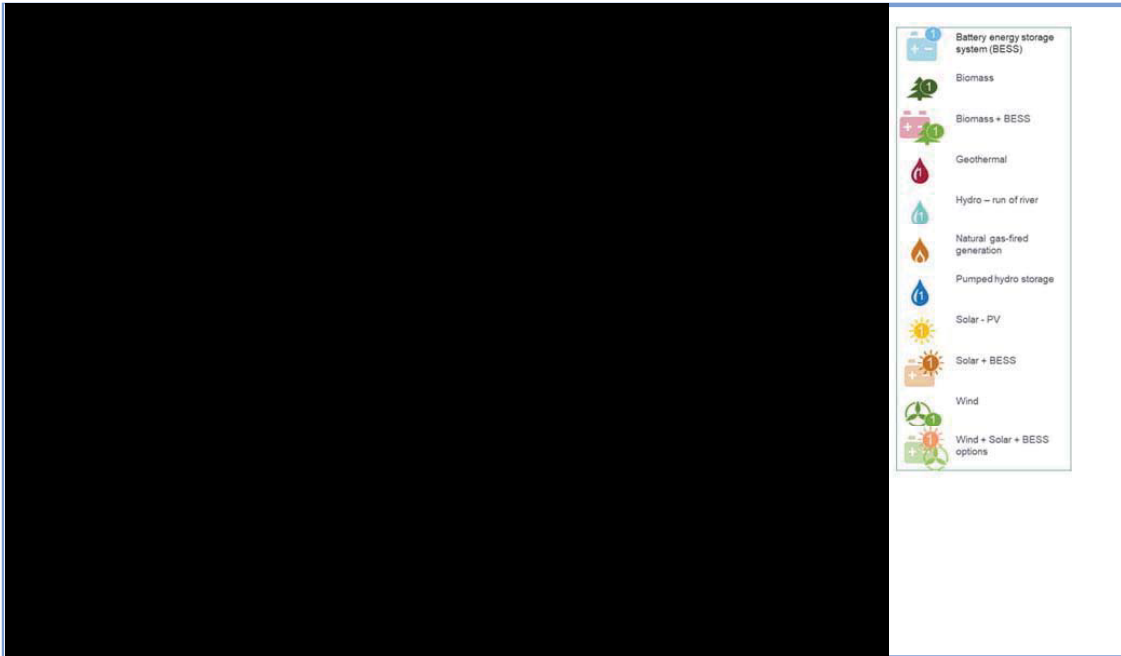

As shown, PSE received proposals for resources located in five states this RFP cycle. Roughly 70 percent of proposed projects representing nearly all proposed resource types were located in Washington. Resources are grouped primarily along the I-5 corridor and in central and southeast Washington. PSE also received proposals for eleven resources located in Oregon and nine resources located in Montana. Oregon proposals included a variety of renewables, hybrid renewables with storage options, and gas-fired generation located primarily in the northeast quadrant of the state. Resources in Montana included six wind projects, a pumped storage project and a pair of solar projects (one with a battery storage option). Additionally, PSE received three proposals for resources located in Idaho and Nevada.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 4. PROPOSALS RECEIVED

#### Unsolicited proposals received during the RFP process

The Company received two unsolicited proposals during the Phase 1 evaluation<sup>19</sup> and three unsolicited proposals during the Phase 2 evaluation.<sup>20</sup> To ensure selection of the lowest reasonable cost and risk options available to PSE, unsolicited proposals received a preliminary cost screening alongside the RFP analysis, consistent with our Phase 1 quantitative analysis. If determined to be competitive on a cost basis with PSE's RFP proposals, an unsolicited proposal would be rolled into the RFP process for a full quantitative and qualitative evaluation.

Subsequent to selecting the RFP short list at the end of the evaluation process and initiating negotiation discussions with selected counterparties, PSE received two new unsolicited proposals.<sup>21</sup> PSE customarily considers new and unsolicited information and re-evaluates its resource decisions to ensure that the Company selects the lowest reasonable cost solutions to meet customer needs, consistent with resource acquisition prudence rules and policies including WAC 480-107. As such, PSE performed a Phase 2 Update (also referred to herein as the "re-evaluation") analysis of its resource options, including the two new proposal. The re-evaluation is discussed in Section 8.

See Appendix A for a complete list of the 2018 RFP and unsolicited proposals received during the RFP evaluation.

#### Self-build proposals

PSE used capital and operational resource costs produced by HDR as part of a study commissioned for the 2019 IRP to approximate self-build resource costs for a variety of renewable and capacity resources. Phase 1 costs were based on a draft report from HDR, which was later revised as a result of feedback from the IRP stakeholder group. PSE updated its resource cost assumptions for Phase 2 based on the final report. Generic resource costs and other key assumptions are presented in Appendix E.

#### Self-build challenges: Renewable resources

Prior to the 2018 RFP, PSE determined that it would be at a competitive disadvantage with renewable developers this RFP cycle. Indicative prices from the Company's 2017 Renewable Resources RFP were low and PSE knew that many of the same sellers would respond to its 2018 RFP. Additionally, many wind developers had already purchased turbines in 2017 and planned to qualify for 80 percent of the PTC by

<sup>19</sup> Unsolicited proposals received during the Phase 1 evaluation included an offer to purchase or offtake power from a [REDACTED] MW pumped hydro storage project to be located in central Washington and an offer to purchase unbundled RECs from an operating solar farm located in Idaho.

<sup>20</sup> Unsolicited proposals received during the Phase 2 evaluation included three solar farms, a [REDACTED] MW development project in southwestern Washington and two development projects in Oregon for between [REDACTED] and [REDACTED] MW of solar power with options to include battery storage.

<sup>21</sup> Unsolicited proposals received during the negotiation process including an offer to purchase or offtake power from [REDACTED] operating natural gas-fired facility, and an up to [REDACTED] MW system power PPA with seasonal and heavy load hour ("HLH") shaping and no emissions (no RECs).

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 4. PROPOSALS RECEIVED

completing construction in 2021.<sup>22</sup> Because PSE is unable to commit financial resources before evaluating alternatives in an RFP, the way a developer might, the Company's earliest opportunity to lock in a PTC rate would have been 2019. A project with a construction start date in 2019 could qualify for just 40 percent of the PTC. Alternatively, PSE would be on equal footing with developers in its ability to capture a higher ITC rate for solar projects. However, while a developer may choose to factor the full benefit of the ITC into its PPA pricing, a benefit to PSE's customers, tax rules provide that a utility's investors must keep a portion of the ITC benefits based on IRS normalization rules. In other words, customers would not receive the full benefit of the ITC for a solar self-build resource.

#### **Self-build challenges: Natural gas-fired resources**

Given the substantial uncertainties surrounding federal and state environmental policies this RFP cycle, a challenging permitting environment and the potential for delays to the commercial operation date of a new resource, PSE did not actively pursue a self-build natural gas-fired peaker or combined cycle project in this RFP. Similar to its approach to renewable self-build, PSE used the generic resource costs developed by HDR for the 2019 IRP as a proxy for self-build gas resources in its RFP analysis.

#### **Transmission redirect option**

The "transmission redirect option" refers to an assumption that when Colstrip Units 1&2 are shut down, the BPA transmission used to deliver the energy to PSE's load could be "redirected" from Garrison-PSEI, to Mid-C-PSEI. This option assumes that the transmission would be available beginning January 2022 for a 50-year term, thereby providing additional firm capacity for market purchases. PSE originally assumed that 300 MW could be redirected from Garrison to Mid-C; however, based on further internal analysis, discussion with BPA, and updated ATC calculations and flowgate constraints within BPA's network, it was determined that only up to 100 MW could be redirected to Mid-C. While redirecting the remaining 200 MW remained potentially feasible, the location, source and cost of this redirect were unclear. As a result, PSE withdrew this portion of the redirect from its analysis and assumed a 100 MW redirect instead.

The 100 MW redirect paired with market option was later eliminated from consideration during Phase 2 based on the standalone portfolio analysis results. The results determined that two of the proposed Montana wind proposals, both of which assumed use of this transmission, offered more favorable portfolio benefits than the transmission redirect option. The results of the Phase 2 standalone portfolio analysis can be found in Appendix D.

---

<sup>22</sup> A developer that either spent five percent of a project's total capital costs (the "safe harbor" provision) or that can demonstrate it commenced "physical work of a significant nature" on the facility (the "physical work test") in 2017 and completes construction within four years of the construction start date would be eligible to receive 80 percent of the PTC, the rate associated with a 2017 construction start date.



2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 5. EVALUATION PROCESS


5. Evaluation process overview

PSE's resource evaluation process is designed to be consistent with guidance set forth in the Washington Administrative Code ("WAC") and the Revised Code of Washington ("RCW"), which encourage utilities to seek resources that provide clean, safe and reliable power to meet their renewable and capacity needs using lowest reasonable cost as a criterion. RCW 19.280.020 defines "lowest reasonable cost" as "the lowest cost mix of generating resources and conservation and efficiency resources determined through a detailed and consistent analysis of a wide range of commercially available resources." Further, WAC 480-107-035 provides guidance regarding the minimum criteria that must be considered when evaluating and comparing resources:

At a minimum, the ranking criteria must recognize resource cost, market-volatility risks, demand-side resource uncertainties, resource dispatchability, resource effect on system operation, credit and financial risks to the utility, the risks imposed on ratepayers, public policies regarding resource preference adopted by Washington state or the federal government, and environmental effects including those associated with resources that emit carbon dioxide. The ranking criteria must recognize differences in relative amounts of risk inherent among different technologies, fuel sources, financing arrangements, and contract provisions. The ranking process must complement power acquisition goals identified in the utility's integrated resource plan.

PSE follows a structured, two-phased evaluation process (shown in Figure 6) to screen and rank individual proposals based on an evaluation of costs, risks and benefits. The first phase includes a preliminary qualitative and quantitative screening designed to identify the most promising proposals and eliminate resources with prohibitive costs, minimal portfolio benefits or excessive risk. The second phase includes a more rigorous due diligence review and portfolio optimization analysis, with the goal of identifying a shortlist of resources representing a combined best-fit, lowest reasonable cost solution to meet the resource needs established in the RFP.


Figure 6. 2018 RFP Evaluation Process Overview

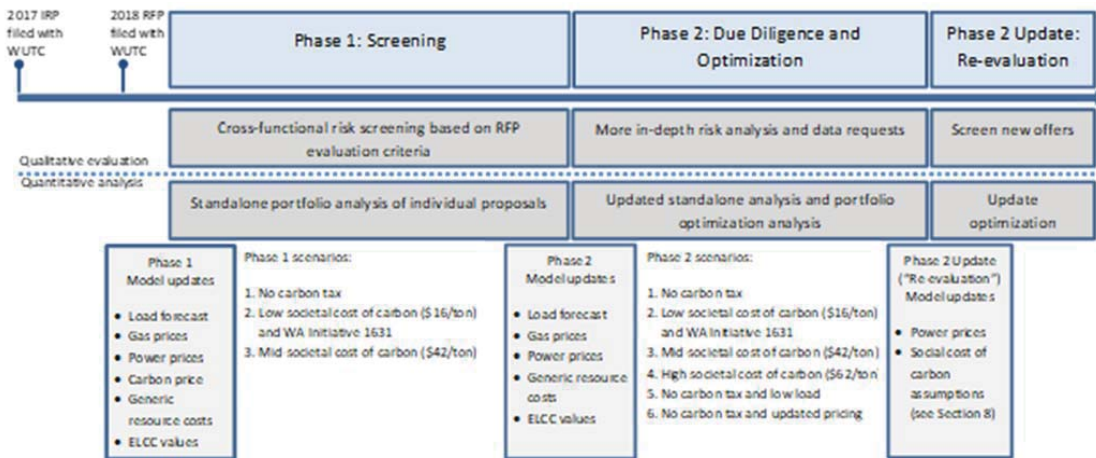

SECTION 5. EVALUATION PROCESS

PSE considers a variety of quantitative and qualitative factors to reasonably compare proposals with diverse attributes. Each proposal is evaluated based on its compliance with either the All Resources or Demand Response RFP, and according to the criteria summarized in Figure 7.

Figure 7. *Summary of RFP evaluation criteria (See Appendix B for a detailed list)*

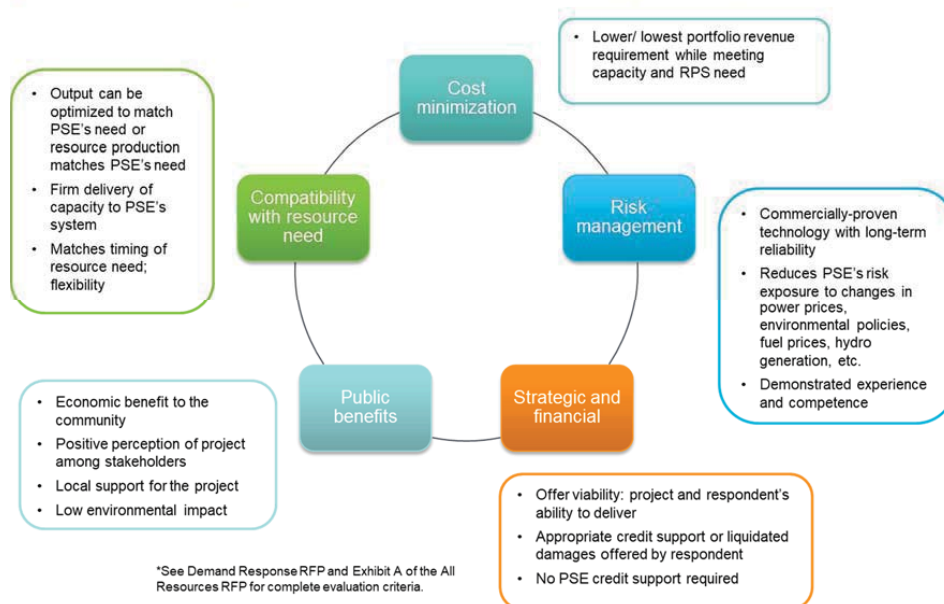

Section 6 (Phase 1) and Section 7 (Phase 2) describe in detail the two phases of PSE's analysis process and results. See also Appendix E for details related to the models, assumptions and scenarios used in PSE's 2018 RFP analysis.

**Reporting and transparency**

The RFP team kept PSE's Energy Management Committee ("EMC") apprised of its progress and decisions throughout the RFP evaluation process. The team presented four updates to the EMC during the RFP evaluation: (1) a summary of proposals received in September 2018, (2) a report on the Phase 1 results in March 2019, (3) an update on Phase 2 in June 2019, and (4) a report on the Phase 2 results in July 2019. Subsequent to the RFP, the team continued to present updates to the EMC as new information became available during the early part of the negotiation process. This included a report on the Phase 2 Update ("Re-evaluation") results in November 2019. The RFP team will continue to update the EMC and PSE's Board of Directors on an as-needed basis as negotiations with selected counterparties continue and will seek appropriate approvals prior to executing contracts with selected counterparties. Copies of updates presented to the EMC during the RFP evaluation are attached as Appendix F.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 5. EVALUATION PROCESS

In addition to its internal reporting, PSE's RFP team kept the WUTC apprised of its progress. Subsequent to filing the draft RFP, PSE engaged in multiple calls with WUTC staff related to the contents of the draft RFPs and to establish a reasonable process for addressing public comments. During the evaluation process, PSE presented updates to WUTC staff on three occasions: (1) a summary of proposals received in September 2018, (2) a report on the Phase 1 results in March 2019, and (3) a report on the Phase 2 and Phase 2 update results in December 2019. PSE also hosted members of the WUTC staff policy team to review the RFP proposals at PSE's Bellevue headquarters in June 2019.

The Resource Acquisition rule, in Chapter 480-107-035 WAC, requires utilities to keep a summary of RFP proposals received available on site for public review once the proposals are opened for ranking. This rule also requires that the summary be updated to include the final ranking for each proposal at the conclusion of the RFP. PSE has complied with this rule and will update the summary with final rankings upon completing the RFP.

SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

## 6. Screening process and results (“Phase 1”)

The Phase 1 evaluation process included an assessment of both the qualitative and quantitative attributes of individual proposals; screened and ranked proposals on an economic basis; and eliminated proposals with prohibitively high cost, lower benefit to PSE’s power portfolio than alternatives, or unacceptable risks (also called “fatal flaws”). Examples of fatal flaws include, but are not limited to: proposals that failed to provide sufficient information to substantiate a viable project, feasibility constraints, the inability to permit the project or deliver energy, commercially unproven technology, excessive counterparty risk, and regulatory or legal risk associated with noncompliance that could adversely affect PSE.

Upon completing the Phase 1 screening, the RFP team identified a “candidate list” of the most promising proposals for a more thorough due diligence analysis and further quantitative scrutiny in Phase 2. The following discussion describes in detail PSE’s Phase 1 analysis and results.

### Phase 1 qualitative analysis: Cross-functional risk screening

The RFP team conducted a qualitative review in Phase 1 to identify, assess and document the risks associated with each RFP proposal. This process included identifying potential risks for more focused examination should a proposal advance to Phase 2 and any fatal flaws that would immediately eliminate a proposal from further consideration. The team also considered the relative likelihood that certain substantial risks might occur.

Throughout Phase 1, the RFP team met weekly with a cross-functional evaluation team of subject matter experts (“SMEs”) to discuss the costs, risks and merits of individual proposals. Each week, SMEs would review and evaluate a subset of proposals (typically four to six per week) based on the evaluation criteria described in Section 5 and Appendix B. During the meetings, SMEs summarized the proposal elements associated with their areas of expertise, described their overall findings and discussed potential risks that might impact PSE as an owner or offtaker. SMEs also prepared follow-up questions for the developers on an as-needed basis. Many of the concerns and questions raised in Phase 1 later became the basis for data requests during Phase 2. At a minimum, the weekly meetings included team discussion of commercial terms, counterparty considerations, development status including site control and permitting matters, technical considerations, operating characteristics, transmission and interconnection matters, community and government relations, and periodic updates on the economic analysis. On an as-needed basis, PSE invited additional SMEs to review certain proposals. For example, when natural gas-fired resources were discussed, PSE included experts from its natural gas fuel supply and environmental compliance teams.

After the weekly review meetings, SME findings were aggregated and documented in a memorandum format. A summary of these findings is presented in the Executive Summary attached to Appendix C.

One of the central challenges this RFP cycle was the proportionally large number of proposals for development projects (nearly 92 percent), most of which were early development projects. This is a shift from prior RFPs, which generally attracted a more balanced mix of operational, mature and early development options. PSE’s analysis found that while some early development offers were competitively priced, they also introduced considerably more uncertainty. In general, existing projects without operational issues and more mature development projects proposed by experienced developers with

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

bankable plans (i.e., site control, secured permits, etc.) were considered to be substantially less risky than early development alternatives.

In Phase 1, PSE tended to give proposals the benefit of the doubt related to unknowns or uncertainties, while documenting potential risks for further review and verification in Phase 2. Additionally, if certain elements of a proposal were either missing or unclear, PSE generally requested supplemental information or clarification from developers. However, two proposals were considered to be extremely underdeveloped. Neither proposal contained the minimum amount of information needed to substantiate or evaluate the viability of the proposed resource, or its associated costs and risks. These two proposals were subsequently removed from consideration. They were the only proposals eliminated during Phase 1 based on qualitative fatal flaws.

#### Phase 1 quantitative analysis: Economic screening of individual proposals

PSE used PSM III and the Aurora dispatch model to perform the quantitative analysis for both phases of its RFP evaluation. Aurora is a forecasting and energy dispatch model used to provide revenue and production inputs to the PSM III model. PSE used Aurora to develop Mid-C market power prices for its pricing scenarios. Other key inputs from Aurora included revenues, energy dispatch, variable costs (such as fuel and variable O&M), emissions related to existing resources, and market purchases and sales.

PSM III is a Microsoft Excel-based financial optimization model developed by PSE to evaluate the incremental cost and risk of a wide variety of resource alternatives and portfolio strategies. At a high level, the model calculates the long-term revenue requirements for PSE’s incremental generic power portfolio based on the 2017 IRP resource strategy and a current outlook on the Company’s capacity, renewable and energy needs. Generic resources are then replaced in the model with a specific proposal from the 2018 RFP to measure the impact on PSE’s overall portfolio cost. This allows PSE to compare the cost of individual RFP offers to the cost of generic resources and each other.

PSM III calculates five metrics used by the RFP team to assess the economic competitiveness of individual proposals: portfolio benefit, levelized net cost per kW or REC, levelized portfolio benefit per kW or REC, levelized cost, and portfolio benefit ratio. A definition for each metric is included in Appendix E. Each metric provides a slightly different perspective on the economic benefits associated with the proposals. The evaluation process used multiple metrics in its resource analysis because no one metric provides a complete view of the relative competitiveness of an individual proposal. As an example, levelized cost of energy is a traditional metric used by the industry for the purposes of comparing proposals; however, it does not take into account whether or how much a resource would contribute to meeting PSE’s capacity or renewable resource needs.

PSE’s Phase 1 screening analyzed each project on a standalone basis and, using the metrics from PSM III, compared the portfolio impact in three potential future scenarios. Each of the scenarios was constructed using base demand, gas price and generic resource cost assumptions; however, carbon assumptions were varied to test a range of potential future carbon costs:

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

- Scenario 1: No carbon tax
- Scenario 2: Low societal cost of carbon (\$16/ton)<sup>23</sup>
- Scenario 3: Mid-societal cost of carbon (\$42/ton)<sup>24</sup>

The 2018 RFP evaluation was performed in parallel with the development of PSE’s 2019 IRP and, as a result, many of the assumptions were evolving throughout the RFP evaluation process. Subsequent to the 2017 IRP, PSE updated a variety of modeling assumptions including gas prices, Mid-C market power prices, load forecasts, generic resource cost assumptions and other key inputs. PSE’s Phase 1 modeling assumptions are presented in Appendix E.

#### Value stream considerations in the quantitative analysis

The Phase 1 quantitative analysis considered the cost of a particular proposal compared to its value within PSE’s electric power portfolio. The primary value streams included the contribution of a resource toward meeting PSE’s renewable resource need, its peak capacity need, or both. The RFP team compiled two distinct lists to rank these values: 1) resources capable of meeting the renewable resource need and 2) resources capable of meeting the peak capacity need. Two metrics were most useful in understanding the contributions of resources with different attributes to each of these resource needs, the portfolio benefit per kW metric (PB/Kw-yr) for capacity need and the portfolio benefit per REC metric (PB/REC) for renewable resource need. In general, most proposals offered either a material peak capacity or renewable resource contribution, but not both. Most renewable resources offered only a very minor contribution to the peak capacity need and, therefore, only appear on the renewable ranking list. However, there were several exceptions, such as Montana wind, Columbia Gorge wind, and biomass, which offered considerable contributions to meeting both the renewable resource and peak capacity needs. These resources appear on both lists. Phase 1 quantitative analysis results and rankings for both the renewable resources and peak capacity needs are presented in Appendix C.

Wind and solar projects, which comprised the bulk of early-development proposals received in the RFP, featured capacity factors ranging between 20 percent and 50 percent, varying due to site-specific attributes and the proposed generation technology. The projected correlation between the hourly and seasonal generation profiles and PSE load projections were important considerations in valuing a project’s contribution to meeting peak capacity need. This metric, represented as percentage, is a fractional quantity based on the characteristics of a resource relative to a “perfect” capacity resource’s contribution to a peak capacity event. This value is closely tied to expected load carrying capability (“ELCC”). ELCC assumptions for the 2018 RFP are described in Appendix E. The methodology for calculating the value of ELCC assumptions is described in Appendix N to PSE’s 2017 IRP.

---

<sup>23</sup> The Scenario 2 low societal cost of carbon assumption (\$16/ton) is based on a Washington state carbon tax proposed in Initiative 1631, which failed to pass at the ballot box in November 2018.

<sup>24</sup> Source of Scenario 3 mid-societal cost of carbon assumption (\$42/ton): “Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12866, Interagency Working Group on Social Cost of Greenhouse Gases,” United States Government, Aug. 2016.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

Because peak capacity resources must be available when and where needed, PSE’s analysis considered the characteristics of the resource, the proposed delivery point and the likely availability of “firm” delivery to PSE’s system when determining the application of ELCC values for resources. Firm delivery to PSE’s system means that the energy output from the proposed project would be delivered on an as-generated basis, with less risk of curtailment due to a transmission constraint.

To qualify as a capacity resource, proposed projects intertied on third-party transmission systems, often BPA, were assessed to determine whether a request for firm, point-to-point transmission to PSE’s system would likely be granted. Since many of the RFP responses proposed early development projects, developers often had not yet secured interconnection and transmission services. Some awaited the outcome of pending analysis and studies performed by the transmission operator. If PSE’s energy delivery team determined that a proposed resource was unlikely to be granted firm delivery to PSE’s system (or if the potential solution was determined to be too difficult or too uncertain), the proposal did not receive the benefit of a contribution to capacity in PSE’s analysis. In Phase 1, PSE’s quantitative analysis generally gave projects the benefit of the doubt regarding the likelihood that transmission would be granted; however, transmission and interconnection availability and cost risks became a common topic in data requests and received more critical consideration in Phase 2.

To allow additional flexibility for developers in the 2018 RFP, PSE considered resource proposals with a variety of delivery points including busbar (typically the project’s point of interconnection (“POI”)), the Mid-Columbia energy delivery point (“Mid-C”) and BPAT.PSEI, or that are located on PSE’s system. Projects located on PSE’s system or delivering to BPAT.PSEI could be analyzed with a contribution to peak capacity, while other projects delivering to busbar or Mid-C generally could not. Proposed resources delivering to Mid-C generally assumed that PSE could leverage existing transmission capacity to the Company’s load center (PSEI.SYSTEM). However, this transmission pathway is often used for short-term transactions in high-load, high-demand scenarios. Because a new resource delivering to Mid-C would supplant an existing capacity asset (market purchases) already counted toward meeting PSE’s peak capacity need, its contribution to peak capacity could not be considered an incremental benefit to PSE’s power portfolio in the RFP analysis.

Project proposals featuring busbar delivery pushed to PSE the risk of securing transmission service from the project’s POI to the Company’s load center (PSEI.SYSTEM). PSE’s analysis assessed on a case-by-case basis the most applicable delivery point, and the likelihood and costs of securing firm point-to-point transmission service to PSE’s system. The nine Montana renewable projects are notable examples of this scenario, in which the sellers proposed to intertie their projects to the Colstrip Transmission System (“CTS”). Montana resource proposals pushed the responsibility for securing transmission for these projects to PSE, assuming that PSE could use 300 MW of existing transmission rights presumed to be available after the closure of Colstrip Units 1&2 to bring wind power from areas along the CTS to BPAT.PSEI. At the time of PSE’s analysis, the relevant transmission operators and affected parties had not yet studied the effect on the transmission system of replacing Units 1&2 with a potential new variable resource generator. As such, PSE’s assessment of projects with interconnection points along this transmission pathway included this risk as part of its Phase 1 qualitative analysis.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

#### Key findings by resource type

##### Energy storage

Of the 97 proposals received in response to the 2018 RFP, two were pumped hydro storage projects, 17 were standalone battery energy storage systems (“BESS”), and another 23 offered renewable generation paired with a BESS resource. PSE’s quantitative analysis applies several value streams to storage resources. Value streams for BESS projects and pumped hydro storage projects include a contribution to peak capacity (with firm energy delivery to PSE’s system) and a flexibility benefit. Additionally, BESS projects located on PSE’s system receive a transmission system deferral value.

The *contribution to peak capacity value* is described in the previous section on pages 25 and 26.

##### **Battery energy storage:**

*Costs declining, but still higher than alternative capacity resources*

	Proposed	Phase 2
Battery only	17	0
Battery + renewable	23	0

The *transmission system deferral value* is an avoided cost metric representing the mitigation benefit of neither building nor retrofitting transmission assets as a result of adding the operational flexibility of a battery to the transmission system. PSE’s analysis assumed a deferral value of \$26/kW-yr escalated at 2.5 percent annually. This proxy value was applied to all BESS proposals in the preliminary quantitative screening. This is conceptually similar to the benefit of the doubt approach applied throughout Phase 1.<sup>25</sup>

The *flexibility value* quantifies the sub-hourly benefits of adding a generation asset to the transmission system. These benefits, which apply to both pumped hydro and battery energy storage resources, include: regulation up and down, voltage control, frequency control, spinning reserves, non-spinning reserves and supplemental reserves. Storage resources with higher maximum output capacities and longer durations offered greater flexibility benefits.

##### **Pumped hydro storage:**

*Very high cost compared to alternatives; large projects with substantial development and/or construction risks*

	Proposed	Phase 2
Pumped hydro storage	2	0

Even with these value streams applied and a significant decrease in pricing over the past several years, BESS proposals were not competitive enough with other capacity alternatives in PSE’s screening analysis to be selected for Phase 2 consideration. The pumped hydro storage proposals had even higher costs than the BESS proposals, very long lead times and considerable development or construction risks;

they were also not selected for Phase 2 consideration. This cycle, PSE received enough proposals with sufficiently attractive capacity contributions to effectively meet its physical reliability need at substantially lower costs than those proposed for storage. However, as traditional capacity resource options become

<sup>25</sup> If any of the BESS proposals had been selected for further consideration in Phase 2, PSE would have evaluated these resources on a site-specific basis.



## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

increasingly scarce, ELCC returns from intermittent resources with common generation profiles diminish, and lithium-ion battery prices continue to drop, it is possible and potentially even likely that BESS resources will be better positioned to compete with other alternatives to meet PSE’s peak capacity needs in future RFPs.

#### Solar resources

Solar project prices in the 2018 RFP continued to decrease on a cost-of-energy basis. As a result, a fairly large number of the proposed solar projects (8 of 16) performed well enough in the screening analysis to be selected for Phase 2 consideration. However, proposals featuring solar and BESS resources combined did not fare as well because most were delivered to Mid-C, negating the capacity value of the BESS. Many of the solar proposals were for early development projects proposed by smaller, less-experienced firms, which introduced more uncertainty and increased the potential for unknown development risks. Often, these proposals had yet to fully secure site control, apply for critical permits, or apply for interconnection and transmission service to initiate system operator studies that determine system and facility impacts.

#### *Solar resources:*

*Cost of energy declining; however, dual-value resources able to meet both capacity and renewable resource needs had higher portfolio values than solar*

*Capacity contribution of solar with storage options negated by Mid-C delivery*

	Proposed	Phase 2
Solar only	16	8
Solar + battery	20	1
Solar + wind + battery	2	0

#### Wind resources

Eight of the 17 wind proposals advanced for further due diligence in Phase 2. Three of the selected proposals were Montana wind proposals and four were located along the Columbia River Gorge (the “Gorge”) in Oregon or Washington.

#### *Wind resources:*

*Montana and Columbia Gorge wind projects benefitted in the analysis due to their ability to help meet renewable and capacity need*

	Proposed	Phase 2
Wind only	17	8
Wind + solar + battery	2	0

Montana wind proposals, in particular, performed very well in the Phase 1 analysis, despite some general early development risks and the risks associated with certain transmission assumptions discussed earlier in this section (namely that PSE would be able to use its existing Colstrip Units 1&2 transmission rights for an intermittent resource). The higher expected capacity factors of these resources combined with seasonal and daily wind shapes that are expected to have a high level of correlation to PSE’s load produced a high ELCC value relative to other intermittent resources. Montana resources ultimately benefitted in PSE’s

analysis from the dual values of contributing to the renewable resource and peak capacity needs established in the RFP. Three of the six proposed Montana wind projects were selected for further evaluation in Phase 2.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

Wind projects located in the Columbia River Gorge (the “Gorge”) area provided dual-value renewable and capacity contribution benefits similar to Montana wind projects, although the ELCC value was lower, due to a lower seasonal correlation between expected production and PSE’s load. One Gorge wind project attempted to alleviate that concern by adding a winter-only, peak-hour capacity agreement to provide guaranteed firm energy delivered to PSE’s system from a pool of the seller’s other resources when PSE’s load is assumed to be at its highest.

Additionally, PSE received a single offshore wind project, which was eliminated because it was extremely high cost and the proposal was underdeveloped. This project did not proceed to Phase 2.

#### **Biomass resources**

Of the three biomass projects proposed into the RFP, only one advanced to Phase 2. In general, the biomass projects were relatively expensive from an energy standpoint. However, the selected biomass resource is already operating and would provide baseload output, which resulted in a higher contribution to capacity value than the other biomass proposals. Similar to the Montana and Gorge wind proposals, the biomass resource selected for Phase 2 benefitted in PSE’s analysis from its contribution to both the renewable resource and peak capacity needs defined in the RFP.

#### ***Biomass resources:***

*Selected proposal is an operating facility that would provide baseload output; project benefitted in the analysis due to its ability to help meet renewable and capacity need*

	Proposed	Phase 2
Biomass	2	1
Biomass + battery	1	0

#### **Demand response programs**

PSE received a total of six demand response proposals in the 2018 RFP. Three targeted residential direct load control opportunities such as smart thermostat and smart water heater technologies, one targeted behavioral demand response technology for residential customers, and two others targeted commercial and industrial curtailment. The capacity offered by the demand response projects was generally modest compared to generation resources, ranging between 9 MW and 40 MW.

#### ***Demand response programs:***

*Selected proposal benefitted in Phase 1 analysis from a substantial T&D deferral value assumption that required further analysis in Phase 2*

	Proposed	Phase 2
Demand response	6	1

ELCC value assumptions were updated in the RFP Phase 1 analysis to align with then-current draft 2019 IRP assumptions. This update resulted in a 40 percent lower demand response ELCC value than assumed in the 2017 IRP. As a result, only one of the demand response proposals performed well enough in the standalone portfolio analysis to be selected for consideration in Phase 2.<sup>26</sup>

<sup>26</sup> ELCC values were again updated in Phase 2 to align with the final 2019 IRP assumptions, resulting in an overall net reduction of about 50 percent compared to the 2017 IRP (from 77 percent in the 2017 IRP to 38 percent in the 2019 IRP). As a result of this

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

Most demand response vendors were unable to demonstrate sufficient experience in a market with a peak load profile similar to the Pacific Northwest, which made it challenging to evaluate the potential for risk in achieving expected results when demand side reductions are most needed. Additionally, PSE is in the process of rolling out advanced metering infrastructure (“AMI”) and implementing a distributed energy resource management (“DERM”) system to utilize the data. None of the demand response vendors had any experience integrating with a DERM system, which introduced potential risk for PSE customers.

#### Natural gas-fired generation resources

Natural gas-fired generation projects have historically represented a high percentage of proposals received in PSE’s All Resources RFPs, averaging about 33 percent of the total proposals received since 2005. This cycle, only four of the 97 proposals received were for natural gas-fired resources. Two of the four advanced to Phase 2 based on their contribution to peak capacity value and their relatively lower cost compared to other capacity resource alternatives available in the RFP. One proposed an operational combined cycle project and the other proposed to install retrofitted aircraft engines at an existing PSE site. Risks for these resources included gas transportation concerns, future clean energy legislation compliance (the Clean Energy Transformation Act became Washington law during Phase 2), and significant reputational risks given changing public and municipal preferences. Additionally, the concept of a thermal expansion project co-located at an operational PSE gas plant site raised significant permitting feasibility questions for the development project and concerns that the operating permit for the existing facility could be reopened, putting existing operating limits at risk.

#### Other resources

PSE received and assessed several other miscellaneous resource proposals in Phase 1, one run-of-river hydro, two geothermal, a system PPA capacity call option, and five unbundled REC proposals. The hydro proposal was selected to advance to Phase 2 because it is an operating plant with a potentially high contribution to capacity. The geothermal proposals were not selected for Phase 2 because they offered relatively expensive energy and little capacity value. The system PPA capacity call option was not selected

#### *Natural gas-fired generation resources:*

*Relatively lower cost capacity option compared to storage; however, dual-value resources able to meet both capacity and renewable resource needs had higher portfolio values than gas-fired resources*

	Proposed	Phase 2
Natural gas resources	4	2

#### *Other resources:*

*Selected resources included an operating run-of-river hydro plant with potentially high contribution to capacity and low cost RECs*

	Proposed	Phase 2
Geothermal	2	0
Run-of-river hydro	1	1
Capacity call option	1	0
Unbundled RECs	5	3

---

*change, the cost of demand response roughly doubled on a per megawatt basis (assuming no change to the pricing) over the course of the RFP because twice as much of the same resource would be required to achieve the same peak capacity contribution.*

**SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)**

for Phase 2 because it delivered to Mid-C, which negated its contribution to capacity value. The unbundled REC proposals posed little general offtake risk, as many of the underlying projects were either operating or soon-to-be constructed. Of the six proposals (one was unsolicited), three proceeded to Phase 2 due to their relatively low costs and small sizes, two potentially valuable attributes for consideration in the Phase 2 portfolio optimization.

**Phase 1 results: The “candidate” list**

PSE completed its Phase 1 evaluation of proposals and presented an update to its Energy Management Committee (“EMC”) in March 2019. At the conclusion of its preliminary screening, PSE selected a list of 25 “candidate” proposals for further evaluation in Phase 2. Selected proposals were generally those that ranked most favorably in the quantitative screening relative to one or both of the resource needs (as defined in the 2018 RFP) and had no known fatal flaws. Projects that provided a contribution to both resource needs were generally selected for Phase 2, due to the relatively high total portfolio benefit produced by the dual value streams. The detailed results of PSE’s Phase 1 qualitative and quantitative analysis are provided in Appendix C.

Overall, the high number of renewable resource projects selected for Phase 2 consideration aligned well with public and state policy preferences and, specifically, the Clean Energy Transformation Act, which became Washington law during PSE’s Phase 2 analysis. In addition to the selected renewables and a handful of low or non-emitting capacity resources, PSE also chose to include two natural gas-fired resources on its candidate list. This decision was made to ensure that there would be sufficient capacity resources in the Phase 2 candidate pool to meet PSE’s physical reliability need. The gas resource proposals added potentially valuable resource and locational diversity to the mix, as well as substantially higher ELCC values than most other alternatives. However, they also carried potentially substantial risks that required additional scrutiny and careful consideration in Phase 2.

After eliminating proposals with prohibitively higher costs than alternatives, PSE recognized that it would have relatively few proposals with significant capacity contributions to compare in Phase 2 without including any thermal generation. The team also recognized that several of the selected candidates proposed development projects that have potentially material risks, which may or may not be acceptable to PSE. Additionally, the selected Montana wind resources, which were some of the most favorable in the Phase 1 quantitative analysis, were all proposing to use the same Colstrip 1&2 transmission rights to bring their power to PSE’s load. In other words, they were mutually exclusive.

2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 6. SCREENING PROCESS AND RESULTS (“PHASE 1”)

Table 6. *Candidate List for Phase 2 evaluation*

ID	Project Name	Resource Type	Nameplate	Counterparty	State
18100	SPI Industrial	Biomass	17 MW	SPI	WA
18201	[REDACTED]	Demand Response	[REDACTED] MW	[REDACTED]	WA
18169	[REDACTED]	MT Wind	[REDACTED] MW	[REDACTED]	MT
18173	[REDACTED]	MT Wind	[REDACTED] MW*	[REDACTED]	MT
18176	[REDACTED]	MT Wind	[REDACTED] MW*	[REDACTED]	MT
18163	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	OR
18165	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	OR
18190	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	WA
18107	[REDACTED]	Run-of-River	[REDACTED] MW	[REDACTED]	ID
18135	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18111	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18122	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18131	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18127	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18114	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18112	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18125	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18139	[REDACTED]	Solar + BESS	[REDACTED] MW BESS	[REDACTED]	OR
18105	[REDACTED]	Thermal	[REDACTED] MW	[REDACTED]	WA
18103	[REDACTED]	Thermal	[REDACTED] MW	[REDACTED]	OR
XXXXX	Transmission Redirect**	Transmission	100 MW	BPA Transmission	N/A
18175	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	WA
18132	[REDACTED]	Wind	[REDACTED] MW*	[REDACTED]	OR
18179	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	WA
18170	Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
18166	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	OR

The “transmission redirect option” in Table 6 refers to an assumption in the analysis that when Colstrip Units 1&2 shut down, the BPA transmission used to deliver the energy to PSE’s load could be “redirected” from Garrison-PSEI, to Mid-C-PSEI. This option assumes that the transmission would be available beginning January 2022 for a 50-year term, thereby providing additional firm capacity for market purchases.

## SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

## 7. Optimization and due diligence process and results (“Phase 2”)

The Phase 2 evaluation process took a more rigorous, in-depth look at the most promising RFP proposals, examining risks identified during Phase 1 and subjecting each proposal to further quantitative scrutiny. In Phase 1, PSE gave proposals the benefit of the doubt with regard to unknown or uncertain qualitative and quantitative risks; in Phase 2, we investigated those risks and verified or adjusted our assumptions. Phase 2 included an updated standalone portfolio analysis for each individual candidate proposal based on the most current information available to PSE. Phase 2 also included portfolio optimization analysis to identify the best combination of resources to meet the renewable and capacity resource needs established in the RFP at the lowest reasonable cost.

At the end of Phase 2, the RFP team considered together the results of the updated standalone portfolio analysis, the optimization analysis and the qualitative findings of its cross-functional evaluation team, and recommended to PSE’s management a shortlist consistent with the optimized resource portfolio. Shortlisted resources advanced to the final phase of the 2018 RFP, negotiations with counterparties.

### Revised candidate list for Phase 2 evaluation

At the end of Phase 1, PSE contacted respondents to provide an update on the status of their proposals. Subsequent to those notifications, PSE received several updates from respondents, adjusting the terms of their proposals. Four of the adjustments resulted in changes to the candidate list, as summarized below.

#### Added to the candidate list:

- Bonneville Power Administration adjusted the delivery point of its BPA Peak Capacity Product proposal (#18161) from the Mid-C to PSE’s load (PSEI.SYSTEM), which allowed PSE to consider the project’s contribution to the peak capacity need.
- [REDACTED] reduced the price of its [REDACTED] unbundled REC proposal (#UP002), which improved its relative ranking in the quantitative analysis. This proposal was originally submitted as an unsolicited proposal partway through the Phase 1 analysis.
- [REDACTED] reduced the price of its commercial and industrial curtailment proposal (#18205), which improved its relative ranking in the quantitative analysis.

#### Removed from the candidate list:

- [REDACTED] withdrew its [REDACTED] Solar proposal (#18112) for unspecified reasons at the beginning of Phase 2.

As a result of these changes, the total number of Phase 2 candidate proposals increased to 27.

SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

Phase 2 qualitative analysis: Due diligence evaluation

The qualitative review began with a goal to investigate the risks and information gaps identified during Phase 1 for each Phase 2 proposal. Risks included development challenges that could delay the proposed commercial operation date of a resource, and issues that could cause operational or reputational harm to PSE, if the Company were to either acquire or enter into an offtake agreement for the proposed resource.

To clarify proposal details and develop a better understanding of perceived risks, the RFP team compiled a series of data requests developed by the subject matter experts (“SMEs”) who performed the Phase 1 qualitative screening. Data requests were organized into the following topics: commercial matters (e.g., counterparty considerations, schedule, proposal terms, etc.), energy delivery (i.e., interconnection and transmission), technical and operations (e.g., technology, operational characteristics, maintenance, etc.), permitting matters (or compliance for existing resources), site control and outreach.

**Sample data requests:**

- **Commercial** – Does seller intend to continue as the long-term owner and operator of the project after COD?
- **Energy Delivery** – Please provide a status update on the Interconnection Agreement negotiations.
- **Technology** – Please provide site suitability analysis documentation showing that the proposed turbine’s design parameters for average wind speed, turbulence, wind shear, etc. are a good fit for the site.
- **Permitting** – Please provide copies (or links) to all baseline environmental and background studies, permit applications/approvals, staff reports and permits that exist for the project.
- **Site Control** – Please provide copies of deeds, leases and easements necessary for the generation tie-line.
- **Outreach** – Detail any plans for government and key stakeholder outreach to garner support for the project.

SMEs also conducted independent investigations to assess the validity of development plans and risk mitigations using publicly available information sources. Examples of public information sources utilized during the evaluation include, but are not limited to, public permitting meetings (e.g., Oregon EFSC), media reports and information posted on transmission provider OASIS sites.

Phase 2 included weekly meetings, in which the RFP team met with evaluation team SMEs to discuss new information received through data request responses and independent investigation, assess its impact on the qualitative risk assessment of the proposals, and determine whether any additional data requests or other follow-up activities would be necessary to complete the qualitative review. On an as-needed basis, the RFP team sent supplemental data requests or arranged phone conversations between respondents and relevant SMEs to clarify or expand upon certain data request responses.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

After completing the Phase 2 qualitative review, SME findings were aggregated and documented in a memorandum format. A summary of these findings is presented in the Executive Summary attached to Appendix D.

#### Key qualitative findings

At the close of the Phase 2 due diligence review, PSE’s evaluation of the candidate proposals was substantially complete and documentation of the evaluation team’s findings took a much more critical view of qualitative risks than it had in Phase 1. In general, existing projects without operational issues and development projects backed by experienced developers with bankable plans (e.g., site control achieved, permits secured, etc.) were considered to be substantially less risky than early development projects.

With the exception of the three unbundled REC proposals and the [REDACTED] Repower proposal (#18132), nearly all of the Phase 2 candidates presented some amount of material risk. Despite this, only two proposals were removed from consideration during Phase 2 based only on qualitative fatal flaws:

- [REDACTED] **Energy Center (#18105)** proposed by [REDACTED] proposed expanding PSE’s existing [REDACTED] plant to include a new aeroderivative peaker. The evaluation team ultimately determined that additional thermal development at this site would be extremely risky for both the expansion project and the existing operational plant, particularly with regard to permitting and reputational risks. In addition to significant risks associated with the development project related to permitting, opposition and energy delivery; attempting to modify an existing site could reopen the operating permit for the [REDACTED] plant and place its existing operating limits under review.
- [REDACTED] **Unbundled RECs (#18190)** proposed by [REDACTED] Energy: PSE eliminated this proposal based on a variety of substantial qualitative concerns, including: interconnection uncertainties that could impact the total REC output of the underlying projects, substantial feasibility risks for the underlying projects, potential legal issues associated with the Energy Facility Siting Evaluation Council permitting decision ([REDACTED] County has applied for judicial review), counterparty risks, and concerns about local opposition related to siting the projects on commercial agricultural land.

These proposals were not included in the Phase 2 portfolio optimization analysis, which is described later in this section, beginning on page 37. Table 7 is an illustrative depiction of the qualitative results associated with the 27 Phase 2 proposals. A more detailed qualitative summary can be found in Appendix D.



2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS ("PHASE 2")

Table 7. *At-a-glance qualitative risk comparison*

Project Counterparty (Project ID)	Operating/ Development status	Delivery point	Counterparty/ Proposal risk	Site control	Permitting risk	Energy delivery risk	Opposition/ reputational risk	Project Counterparty (Project ID)	Operating/ Development status	Delivery point	Counterparty/ Proposal risk	Site control	Permitting risk	Energy delivery risk	Opposition/ reputational risk
SPI Biomass PPA	Operating	BPAT. PSEI						[REDACTED]	Early Develop	[REDACTED]					
Sierra Pacific Ind. (18100)								[REDACTED] (18105)	Early Develop	[REDACTED]					
[REDACTED] MT Wind PPA (18169)	Early Develop	[REDACTED]						[REDACTED] (18103)	Operating (or Busbar)	BPAT.PSEI					
[REDACTED] MT Wind PPA (18173)	Early Develop	[REDACTED]						[REDACTED] Solar REC (18190)	Early Develop	n/a					
[REDACTED] REC (18163)	Mature Develop	n/a						[REDACTED] Solar (opt.) (18163)	Early Develop	Busbar					
[REDACTED] REC (18165)	Mature Develop	n/a						[REDACTED] Solar (18114)	Early Develop	Mid-C					
[REDACTED] (UP002)	Operating	n/a						[REDACTED] Wind (18166)	Early Develop	Busbar					
[REDACTED] Solar (18111)	Early Develop	Mid-C*						[REDACTED] Solar (18122)	Early Develop	Mid-C					
[REDACTED] Solar (18125)	Early Develop	Mid-C						[REDACTED] Wind (18175)	Early Develop	[REDACTED]					
[REDACTED] Solar (18127)	Early Develop	[REDACTED]						[REDACTED] Solar (18131)	Early Develop (or Busbar)	BPAT.PSEI					
[REDACTED] Solar (18135)	Early Develop	[REDACTED]						[REDACTED] Hydro Project (18107)	Operating	[REDACTED]					
BPA Peak Cap Sys PPA BPA (18161)	Operating	BPAT. PSEI						[REDACTED] MT Wind PPA (18176)	Early Develop	[REDACTED]					
[REDACTED] Wind* (18132)	Mature Develop*	Mid-C						[REDACTED] Demand Response (18201)	n/a	n/a	Not cost effective compared to alternatives without identifiable deferred T&D				
[REDACTED] Wind (18179)	Mature Develop	Mid-C						[REDACTED] Demand Response (18205)	n/a	n/a	Not cost effective compared to alternatives without identifiable deferred T&D				
Golden Hills Wind (shaped / unshaped) Avangrid (18170)	Mature Develop	BPAT.PSEI													

Key

- Low Risk
- Acceptable Risk
- Substantial Material Risk
- Fatal Flaw

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

#### Phase 2 quantitative analysis: Individual proposal analysis and portfolio optimization

Similar to Phase 1, PSE used PSM III and the Aurora dispatch model to perform the quantitative analysis for Phase 2. PSE updated a variety of key assumptions in Phase 2 as new information became available, including its load forecast, gas and power price forecasts, effective load carrying capability (“ELCC”) values, and generic resource costs. PSE also updated its pricing scenarios, adding three new scenarios to those it tested in Phase 1, which allowed PSE to stress test proposals in different potential future pricing environments. PSE’s models, key assumptions and scenarios are all described in detail in Appendix E.

As shown in Table 8, PSE utilized six scenarios to help answer several key questions. For example, how might economic conditions and load growth affect resource decisions? What are the key decision points and most important uncertainties in the long-term planning horizon, and when should we make those decisions? What impact might very different levels of carbon prices have on resource decisions?

Table 8. *Modeling scenarios used in Phase 2 analysis*

Scenarios	Phase	WECC /PSE	Gas Price	Generic Resource Costs
		Demand		
1. No carbon tax	1 + 2	Base	Base	Base
2. CO2 (low societal \$16/ton)	1 + 2	Base	Base	Base
3. CO2 (mid-societal \$42/ton)	1 + 2	Base	Base	Base
4. CO2 (high societal \$62/ton)	2	Base	Base	Base
5. No CO2 low load	2	Low	Low	Base
6. No CO2 updated pricing	2	Base	Update	Base

As shown, PSE’s scenarios were designed to test a range of potential future carbon costs, from \$0/ton to as high as \$62/ton. This analysis offered insights into how portfolio costs might be affected by potential carbon legislation. The Scenario 2 low societal cost of carbon assumption (\$16/ton) is based on a Washington state carbon tax proposed in Initiative 1631, which failed to pass at the ballot box in November 2018. The Scenario 3 mid-societal (\$42/ton) and Scenario 4 high societal (\$62/ton) cost of carbon assumptions are based on estimates from the United States Government Interagency Working Group’s technical support document on the social cost of carbon, which was published in August 2016.<sup>27</sup> Scenario 6 reflects updated pricing as a result of California Senate Bill 100, which sets a statewide renewable energy requirement of 100 percent renewables by 2045.

In addition to updating its modeling assumptions and scenarios, PSE hired DNV GL to perform a reasonableness check of the net capacity factors for all Phase 2 wind and solar projects to ensure that

<sup>27</sup> “Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12866, Interagency Working Group on Social Cost of Greenhouse Gases,” United States Government, Aug. 2016.

SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

proposed outputs were not overestimated by developers. Additionally, the consultant developed a stochastic analysis of the hourly outputs for PSE to use in resource adequacy and integration modeling. In general, DNV GL found that the net capacity factors provided by the respondents were reasonable with one exception. DNV GL’s analysis indicated that the [REDACTED] Tribe presented a very optimistic view of the potential output from the proposed [REDACTED] Wind Project (#18176).

**Updated economic analysis of individual proposals**

In Phase 2, PSE updated its standalone portfolio analysis for each candidate proposal based on the most current information available to PSE at the time the analysis was conducted. Changes included updated assumptions and scenarios as described on page 37. PSE also included new proposal information received from respondents through data requests and other updates. Proposals were individually re-ranked in Phase 2 using the key metrics produced by PSM III: portfolio benefit, levelized net cost per kW or REC, levelized portfolio benefit per kW or REC, levelized cost, and portfolio benefit ratio. Overall, the standalone analysis process in Phase 2 was fundamentally the same as the Phase 1 process described in Section 6.

While this analysis is useful for the purposes of comparing and ranking proposals on a standalone basis, it does not consider the benefits of resource combinations to meet the combined resource needs of the RFP. It cannot take into account the efficiencies and economic benefits of pooling resources with complementing attributes or an optimally-sized solution to meet both the renewable and capacity resource needs. In other words, it does not account for the fact that a lower individually ranked resource (from a portfolio benefit perspective) could be part of a lowest reasonable cost, best-fit to need solution in the optimal portfolio because its unique “fit” provides economic savings when paired with other resources. For this reason, PSE uses a portfolio optimization approach to analyze and identify the optimal resource portfolio.

Updated standalone portfolio analysis results and rankings for Phase 2 proposals are presented in Appendix D. See also Appendix E for details about the 2018 RFP models, key assumptions, scenarios and metrics.

**Portfolio optimization analysis**

The Phase 2 quantitative evaluation included optimization analysis to identify the lowest reasonable cost, best-fit solution to meet PSE’s renewable and capacity resource needs with a combination of RFP resources. In the standalone analysis, proposals were compared with each other only indirectly. In that analysis, the portion of any renewable or peak capacity need not supplied by the analyzed project were met with generic resources. In the portfolio optimization analysis, the renewable and peak capacity resource needs are fully met with RFP resources.

Six proposals were eliminated during Phase 2 prior to the optimization analysis. The [REDACTED] Energy Center (#18105) and [REDACTED] Unbundled REC (#18190) proposals were eliminated based on qualitative fatal flaws discussed on page 35. Four additional proposals were eliminated based on a combination of quantitative and qualitative findings, as described below:

- [REDACTED] **Montana Wind Project (#18176)** proposed by the [REDACTED] Tribe: As described above, this proposal was eliminated based on third-party review of net capacity factors

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

provided by the seller, which were determined to be unrealistic. PSE further determined that the seller had not yet erected meteorological towers on site to verify or support the proposed output. This proposal was removed from consideration and was not included in either the Phase 2 standalone portfolio analysis or the optimization analysis.

- **██████████ Hydro (#18107)** proposed by ██████████ Energy: This proposal was eliminated prior to the optimization analysis because the RFP evaluation team determined that the run-of-river asset provided little capacity value and was not RPS-compliant. Furthermore, the proposal left what appeared to be a complex and potentially risky energy delivery strategy to PSE.
- **██████ Demand Response (#18201)** and **██████ Demand Response (#18205)**: PSE updated certain assumptions in Phase 2 as new information became available, which substantially reduced ELCC and T&D deferral values for demand response proposals.<sup>28</sup> Over the course of the RFP, the ELCC value for demand response programs dropped by about 50 percent compared to the 2017 IRP (from 77 percent in the 2017 IRP to 38 percent in the 2019 IRP). This change reflects updates to align 2018 RFP assumptions with current 2019 IRP assumptions.<sup>29</sup> As a result of this change, the cost of demand response roughly doubled on a per megawatt basis (assuming no change to the pricing), because twice as much of the same resource would be required to achieve the same peak capacity contribution. Additionally, in Phase 1 PSE gave demand response programs a substantial T&D deferral benefit consistent with its “benefit of the doubt” approach to preliminary screening; however, the RFP team was unable to validate this benefit in its Phase 2 due diligence evaluation. As a result of these changes, demand response was determined not to be cost effective compared to alternatives in this RFP.

In addition, the demand response proposals had qualitative risks, including uncertainties associated with integrating the programs with PSE’s forthcoming distribution energy resource management (“DERM”) system. The RFP team also had feasibility concerns about the aggressive ramping schedule of the ██████████ program (#18201) and counterparty concerns (i.e., experience and financial performance) with regard to the ██████████ proposal (#18205). The demand response proposals were, therefore, removed from consideration and were not included in either the Phase 2 standalone portfolio analysis or the optimization analysis.

This left 21 proposals for portfolio optimization, six of which were capacity proposals. Due to the limited number of projects featuring a substantial contribution to capacity, filling the peak capacity need was the primary constraint in the optimization analysis. The renewable resource need was filled coincidentally by projects with dual value renewable (RPS-compliant) and capacity attributes. Three of the four proposals selected in the optimal portfolio featured dual value attributes: the ██████████ Wind Project (#18169), the Golden Hills Shaped Wind Project (#18170), the SPI Burlington Biomass Cogen (#18100), and BPA’s Peak Capacity Product (#18161).

<sup>28</sup> Key assumptions used in the RFP analysis, including ELCC and T&D deferral values, are presented in Appendix E.

<sup>29</sup> ELCC assumptions were updated twice during the RFP, first for Phase 1 to align with then-current draft 2019 IRP assumptions and second to align Phase 2 with final 2019 IRP assumptions.

2018 RFP EVALUATION PROCESS DOCUMENT

SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

Optimization analysis results are presented in Appendix D. See also Appendix E for a detailed discussion of the optimization process, findings and results. This appendix also describes the models, key assumptions, scenarios and metrics used in the analysis.

Phase 2 Results: The short list

The RFP team completed its 2018 RFP analysis and presented a recommended shortlist to its Energy Management Committee (“EMC”) in June 2019. At that meeting, the team sought and received officer approval to begin negotiations with the selected counterparties.

Table 9. *Short List Resource Selections*

Project Counterparty (Project ID)	Operating/ Development status	Delivery point	Counterparty/ Proposal risk	Site control	Permitting risk	Energy delivery risk	Opposition/ reputational risk
SPI Biomass PPA Sierra Pacific Ind. (18100)	Operating	BPAT. PSEI	Green	Green	Green	Green	Green
██████████ MT Wind PPA ██████████ (18169)	Early Develop	██████████	Green	Yellow	Yellow	Yellow	Yellow
BPA Peak Cap Sys PPA BPA (18161)	Operating	BPAT. PSEI	Green	Green	Green	Green	Green
Golden Hills Wind (shaped / unshaped) Avangrid (18170)	Mature Develop	BPAT.PSEI	Green	Green	Green	Yellow	Yellow

To mitigate risk exposure and maximize optionality during negotiations, four projects were selected as backup options. These proposals fared well in the analysis, but were not selected as part of the optimal portfolio. Backup options included ██████████ Montana Wind Project (#18173), ██████████ Power Project (#18103), ██████████ Project (#18132) and ██████████ Solar Project (#18131). The RFP team brought forward the ██████████ Power Project (#18103) as a backup in the case risks surrounding the Colstrip Transmission System are realized to an extent that delivery of Montana wind becomes impossible, or prohibitively expensive. These risks were to be realized, both ██████████ (#18169) and ██████████ (#18173) would be removed from consideration as they both plan to interconnect and deliver energy to PSE using this transmission path. Because ██████████ does not contribute to PSE’s renewable need, ██████████ (#18132) and the ██████████ Solar (#18131) would be needed to meet the renewable resource need in the absence of Montana wind.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 7. OPTIMIZATION AND DUE DILIGENCE PROCESS AND RESULTS (“PHASE 2”)

#### Independent Energy Assessment

Three of the four selected proposals were renewable energy projects featuring a contribution to peak capacity. The capacity value from the Golden Hills Wind Project (#18170) was guaranteed via the shaped product and the SPI Burlington Biomass Cogen (#18100) is a baseload resource with a strong operating history. This left [REDACTED] (#18169) as the only selected project featuring a strong promised contribution to peak capacity with little offered security beyond any guarantees that might be built into the agreement.

To obtain third-party verification of the seller’s claims prior to signing agreements, PSE hired DNV GL to perform an independent wind resource assessment. Additionally, DNV GL would determine whether the [REDACTED] (#18169) wind shape matches analysis performed by [REDACTED], a subsidiary of the [REDACTED] parent company. DNV GL was chosen to perform this analysis based on their expertise in conducting bankable energy assessment reports. The deliverables for this analysis were:

- **Energy Assessment** – included to provide an estimation of long-term wind speed, virtual MET data, central estimate of wind speed and energy production, uncertainties and deviations,
- **Transmission Line Loss Estimate** – requested due to the abnormally long [REDACTED]-mile generation tie line, and
- **Stochastic Analysis** – included to provide understanding of uncertainty pertaining to the Energy Assessment; will be used as a basis for contractual guarantees.

The DNV GL analysis obtained in late-September 2019 largely corroborated [REDACTED] claims. [REDACTED] assessed a P50 net capacity factor of [REDACTED] percent; whereas, DNV GL’s analysis resulted in a P50 net capacity factor of [REDACTED] percent.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 8. RE-EVALUATION OF RESOURCE ALTERNATIVES (“PHASE 2 UPDATE”)

#### 8. Re-evaluation of resource alternatives (“Phase 2 Update”)

Subsequent to receiving EMC approval to initiate negotiations discussions for the 2018 RFP shortlisted resources, PSE received two new unsolicited proposals:

- from [REDACTED] on August 29, 2019 (#UP005), an offer to either purchase their interest in the [REDACTED] natural gas-fired combined cycle facility ([REDACTED] percent)<sup>30</sup> or offtake power via a 7-year tolling PPA with delivery to BPA’s [REDACTED] Substation, beginning September 1, 2022; and
- from Morgan Stanley Commodities Group (“MSCG”) on October 23, 2019 (#UP006), a 3 to 5 year seasonally shaped, heavy load hour (“HLH”) PPA with various product structure and pricing options, for up to 100 MW of system power delivered to BPAT.PSEI beginning January 1, 2022.<sup>31</sup>

PSE also received updated pricing for three of the 2018 RFP resources between August and November 2018: the [REDACTED] (#18173) (lower price), the BPA Peak Capacity Product (#18161) (higher price) and the SPI Burlington Biomass Project (#18100) (lower price).

PSE customarily considers new and unsolicited information and re-evaluates its resource decisions to ensure that the Company selects the lowest reasonable cost solutions to meet customer needs, consistent with resource acquisition prudence rules and policies including WAC 480-107. As such, PSE performed an updated optimization analysis of its resource alternatives between August and November 2019. To ensure that the lowest reasonable cost, best fit combination of alternatives available would be selected, PSE included in its updated analysis all of the original RFP Phase 2 optimization resources, the two new proposals and the pricing updates previously described.

#### Phase 2 Update: Optimization analysis

The optimization analysis process followed for the Phase 2 Update was fundamentally the same as the Phase 2 process described in Appendix E, using the same models and metrics, and many of the same assumptions as Phase 2. However, PSE did update certain assumptions on an as-needed basis to reflect the most current information available at the time of the analysis, including the following changes:

- updated peak capacity need consistent with PSE’s revised 2019 IRP Progress Report filed December 10, 2019,
- updated Mid-C power price forecast (a 20 percent reduction from the previous forecast),<sup>32</sup>

<sup>30</sup> [REDACTED]. The facility nameplate capacity is [REDACTED] MW (including 20 MW of duct firing). [REDACTED] 51 percent share amounts to approximately [REDACTED] MW of nameplate capacity.

<sup>31</sup> MSCG is offering a 0 emissions (no RECs) system PPA.

<sup>32</sup> Updated power price forecast is consistent with the September 19, 2019 IRTAG #8 publication, which was presented to the 2019 IRP Technical Advisory Group, the public stakeholder group which helps to provide input and guidance to PSE’s long-term resource planning process.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 8. RE-EVALUATION OF RESOURCE ALTERNATIVES (“PHASE 2 UPDATE”)

- adjusted social cost of carbon assumptions based on guidance from WUTC docket U-190730, dated September 12, 2019 (2.5 percent discount rate scenario, 0.437/ton/MWh market purchase carbon intensity),
- assumed retirement of Colstrip units 1 and 2 by 2020, and
- considered the impact on the capacity need of the sale of Colstrip unit 4, which was announced in December 2019.

The Phase 2 Update optimization analysis results are presented in Appendix D. See also Appendix E for a detailed discussion of the optimization process and results, and the assumptions used in the re-evaluation analysis.

#### Revised short list

PSE completed its re-evaluation analysis in November 2019 and presented its revised recommended short list to the EMC on November 21, 2019. PSE presented the results of its 2018 RFP and re-evaluation to the WUTC on December 20, 2019. The results of the analysis confirmed the selection of the original Phase 2 shortlist and added one additional resource:

- **██████████ Wind PPA (#18169)**, a 25-year fixed price power purchase agreement (“PPA”) delivering up to ████████ MW<sup>33</sup> of the output from a Montana wind development project to the ████████ Substation, beginning as early as December 2021;<sup>34</sup>
- **Golden Hills Shaped Wind PPA (#18170)**, a 20-year fixed price power purchase agreement (“PPA”) delivering to BPAT.PSEI the output from a 200 MW wind development project paired with shaped capacity up to ████████ MW during winter peak hours<sup>35</sup>, beginning in December 2021;
- **SPI Biomass PPA (#18100)**, a 17-year fixed price power purchase agreement (“PPA”) delivering 17 MW of firm capacity (and up to an additional 3 MW of variable energy) from a biomass project located on PSE’s system to the Fredonia Substation, beginning in January 2021;
- **BPA Peak Capacity Product (#18161)**, a 5-year capacity tolling agreement (“CTA”) for firm capacity delivered to BPAT.PSEI that may be scheduled in ████████ increments from ████████ MW on a ████████ basis, beginning in January 2022.
- (New) **Morgan Stanley System PPA (#UP006)**, a 5-year fixed price system PPA for 100 MW of firm heavy load hour (“HLH”) <sup>36</sup>energy delivered in Q1 and Q4 only, beginning in January 2022.<sup>37</sup>

<sup>33</sup>Actual contract capacity is expected to be dependent upon the outcome of required transmission studies.

<sup>34</sup>Actual contractual commercial operation date (“COD”) may be later, depending upon the outcome of required transmission studies.

<sup>35</sup>Shaped schedule: November through February, hours ending (“HE”) ████████ and ████████.

<sup>36</sup>Heavy load hour (“HLH”) means hours ending (“HE”) 7-11 Monday through Saturday except NERC holidays.

<sup>37</sup>MSCG is offering a 0 emissions (no RECs) system PPA.

REDACTED  
VERSION

REDACTED  
VERSION



## 2018 RFP EVALUATION PROCESS DOCUMENT

### SECTION 8. RE-EVALUATION OF RESOURCE ALTERNATIVES (“PHASE 2 UPDATE”)

PSE’s analysis recommends adding the MSCG 5-year system power PPA (#UP006) as part of an optimal portfolio solution to help mitigate remaining need not met by the original short list, including need expected to result from the announced sale of Colstrip Unit 4. Additionally, MSCG offers benefits such as: (1) delivery to PSE’s system, (2) seasonal shaping and heavy load hour shaping to help meet demand when capacity is most needed and minimize surplus off peak, and (3) a zero emission product (without RECs) that is consistent with Washington laws and policy preferences for low and no emission energy resources.

PSE’s analysis shows that when combined with the Company’s existing electric resource portfolio, the revised short list represents the most favorable combination of resources to best meet PSE’s renewable and capacity needs at the lowest reasonable cost and risk.

SECTION 9. NEXT STEPS

## 9. Next steps

PSE has begun to negotiate with counterparties for selected resources. During negotiations, PSE will continue to update its economic and risk analysis on an as-needed basis to reflect any additional or revised factors that may impact the economics of a proposed resource.

At the conclusion of the RFP, the acquisition team intends to engage in a lessons learned analysis to consider how we might introduce new efficiencies, and improve processes and tools while maintaining a high standard of prudent decision-making. This is important because the 2018 RFP was the largest All Resources RFP to date with nearly double the number of proposals received than our next largest RFP. Our need for new resources is expected to grow substantially over the next two and a half decades, due to expected load growth, retiring resources and expiring contracts, and new requirements associated with the Clean Energy Transformation Act. As such, continually striving to increase our ability to make timely, prudent decisions related to resource acquisitions will continue to be a critical piece of our success in meeting the electric resource needs of our customers at the lowest reasonable cost.

*2018 RFP Evaluation Process Document*

## Appendix A. Proposal List

2018 All Resources RFP Proposal List

Status	Project ID	Resource Type (as proposed)	Project Name	RFP county/parity	City / County	State / Province	Status	COD	Term Start Date	Term End Date	Commercial Structure	Capacity (MW)	Storage Resource Duration (MWh)	Facility Capacity (MW)	Generation Technology	Tx Interconnection	Tx Delivery Point
Selected for Phase 2	18100	Biomass	SPI Burlington	Sierra Pacific Industries	M. Vernon	WA	Operating	3/1/07	1/1/21	12/31/37	17-yr Project PPA	17	n/a	28	Directly connected to PSE in Friesland Sub	Same as PDI	
Not selected	18101	Biomass				WA	Operating	7/1/09	7/1/21	9/30/28	7-yr + 3 month Project PPA					Sound Energy	
Not selected	18102	Biomass + BESS				WA	Development	Q2 2022	6/30/2022	Unspecified	Project PPA (term length unspecified)				Interconnected location in potential POI	Unspecified	
Selected for Phase 2	18103	Nat Gas Turbine CCCT				OR	Operating	8/1/02	8/1/22	8/31/02	10-yr Tolling PPA / Asset Purchase				500kV PSE interface territory	PSE interface territory	
Not selected	18104	Nat Gas Turbine CCCT				WA	Operating	12/31/08	2022	TBD	5-yr Tolling PPA / Asset Purchase				200kV Substation	Multiple	
Selected for Phase 2	18105	Nat Gas Turbine CCCT				WA	Development	10/1/21	10/1/21	10/1/26	5-yr Tolling PPA / Asset Purchase						
Not selected	18106	Geothermal				NV	Construction	9/1/19	9/1/19	8/31/09	20-yr Project PPA for output from two projects				NV Energy North System	BPAT PSEI tie point	
Selected for Phase 2	18107	Hydro - Run-of-River				ID	Operating	4/1/93	1/1/19	1/1/39	20-yr Project PPA					Substation	
Not selected	18108	Solar - PV + Solar - PV +				WA	Development	12/15/22	12/15/22	12/15/42	20-yr Project PPA				BPAT PSEI	BPAT PSEI	
Not selected	18109	Solar - PV + BESS				WA	Development	12/15/22	12/15/22	12/15/42	20-yr Project PPA				414kV Main	BPAT PSEI	
Not selected	18110	Solar - PV				WA	Development	8/1/2021	n/a	n/a	Asset Purchase				Substation		
Selected for Phase 2	18111	Solar - PV				WA	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				200kV tie	Substation	
Withdrawn in Phase 2	18112	Solar - PV + BESS				WA	Development	12/1/22	12/1/22	12/1/47	25-yr Project PPA				230 kV tie line	Substation	
Not selected	18113	Solar - PV				WA	Development	9/15/22	9/15/22	8/15/037 or 8/15/42	15/20-yr Project PPA / Asset Purchase				Substation	Substation	
Selected for Phase 2	18114	Solar - PV				WA	Development	12/1/21	12/1/21	12/1/41	20-yr Project PPA				Substation	PSE System	
Not selected	18115	Solar - PV				MT	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				200kV busbar	200kV busbar	
Withdrawn in Phase 1	18116	Solar - PV				WA	Development	12/1/22	12/1/22	12/1/42	20-yr Project PPA				ring busbar substation		
Withdrawn in Phase 1	18117	Solar - PV				WA	Development	12/31/20	12/31/20	12/31/40	20-yr Project PPA				Substation	Point of Interconnection	
Not selected	18118	Solar - PV				OR	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				Substation	PSE System	
Not selected	18119	Solar - PV + BESS				WA	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				Transmission line	BPAT PSE	
Not selected	18120	Solar - PV				WA	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				Substation	BPAT PSE	
Not selected	18121	Solar - PV				WA	Development	12/1/22	12/1/22	12/1/42	20-yr Project PPA				Substation	Point of Interconnection	
Selected for Phase 2	18122	Solar - PV + BESS				WA	Development	12/31/22	12/31/22	12/31/42	20-yr Project PPA				Substation	Substation	

REDACTED VERSION

2018 All Resources RFP Proposal List

Status	Project ID	Resource Type (as proposed)	Project Name	RFP county/city	City / County	State / Province	Status	COD	Term Start Date	Term End Date	Commercial Structure	Capacity (MW)	Storage Services Duration (MWh)	Facility Capacity (MW)	Generation Technology (as proposed)	Tx Interconnection	Tx Delivery Point
Not selected	18123	Solar - PV + BESS			WA	Development	10/31/22	10/31/22	10/31/22	10/31/42	20-yr Project PPA					Substation	Substation
Withdrawn in Phase 1	18124	Solar - PV			WA	Development	12/1/22	12/1/22	12/1/22	12/1/42	20-yr Project PPA					200kV Bus at the Substation	Point of Interconnection
Selected for Phase 2	18125	Solar - PV + BESS			WA	Development	10/31/22	10/31/22	10/31/22	10/31/42	20-yr Project PPA					Substation	Substation
Withdrawn in Phase 1	18126	Solar - PV			WA	Development	12/1/22	12/1/22	12/1/22	12/1/42	20-yr Project PPA					115kV Diesel-Elec Substation to the Substation	
Selected for Phase 2	18127	Solar - PV			WA	Development	12/15/22	12/15/22	12/15/22	12/15/2042 or 12/15/2042	15-20-yr PPA					Subbar	
Not selected	18128	Solar - PV + BESS			WA	Development	6/1/2022	6/1/2022	6/1/2047	6/1/2047	25-year Project PPA					On PSE System	On PSE System
Not selected	18129	Solar - PV			WA	Development	12/29/20	12/29/20	12/29/20	12/29/40	20-yr Project PPA					Proposed location: Subbar, 230 kV [REDACTED] Substation	Proposed location: Subbar, 230 kV [REDACTED] Substation
Not selected	18130	Solar - PV + BESS			WA	Development	12/15/22	12/15/22	12/15/42	12/15/42	20-yr Project PPA					BEAN, N. Bonanza	BPAT PSEI
Selected for Phase 2	18131	Solar - PV			WA	Development	12/31/22	12/31/22	12/31/22	12/31/47	25-yr Project PPA					Part of BPA, 115kV line	BPAT PSEI
Selected for Phase 2	18132	Wind, onshore + Solar - PV + BESS, options			OR	Development	12/7/2020, 9/30/2022, 9/30/2022	12/7/2020, 9/30/2022, 9/30/2022	11/30/2040, 9/30/2042, 9/30/2042	11/30/2040, 9/30/2042, 9/30/2042	20-yr Project PPA					Substation 230 kV Bus	Mid-C Hub
Not selected	18133	Solar - PV + BESS			OR	Development	10/31/22	10/31/22	10/31/22	10/31/42	20-yr Project PPA					115 kV Transmission Line	115 kV Transmission Line
Not selected	18134	Solar - PV			WA	Development	12/31/2022	11/29/23	12/31/2022	12/31/2042	20-yr Project PPA					High-voltage of the GSU transformer from 34.5kV to 230kV is in line, located on [REDACTED] at [REDACTED] sub.	High-voltage of the GSU transformer from 34.5kV to 230kV is in line, located on [REDACTED] at [REDACTED] sub.
Selected for Phase 2	18135	Solar - PV + BESS			WA	Development	12/31/22	12/31/22	12/31/22	12/31/42	20-yr Project PPA					Substation	Substation
Not selected	18136	Solar - PV + BESS			WA	Development	9/1/22	9/1/22	9/1/22	9/1/42	20-yr Project PPA					115 kV Line	115 kV Line
Not selected	18137	Solar - PV + BESS			WA	Development	9/1/22	9/1/22	9/1/22	9/1/42	20-yr Project PPA					115 kV Line	115 kV Line

REDACTED VERSION



2018 All Resources RFP Proposal List

Status	Project ID	Resource Type (as proposed)	Project Name	RFP counterparty	City/County	State/Province	Status	COD	Term Start Date	Term End Date	Commercial Structure	Capacity (MW)	Source: Resource Substation (MW)	Facility Generation Technology (as proposed)	Tx Interconnection	Tx Delivery Point	
Not selected	18156	Storage - Battery				WA	Development	9/30/22	9/30/22	9/30/42	20-yr Tolling PPA / Asset Purchase	n/a			115 KV Substation	115 KV Substation	
Not selected	18157	Storage - Battery				WA	Development	9/30/22	9/30/22	9/30/42	20-yr Tolling PPA / Asset Purchase	n/a			115 KV Substation	115 KV Substation	
Not selected	18158	Storage - Battery				WA	Development	9/30/22	9/30/22	9/30/42	20-yr Tolling PPA / Asset Purchase	n/a			115 KV Substation	115 KV Substation	
Not selected	18159	Storage - Pumped Hydro				WA	Development	10/1/2025	11/2026	12/31/2065	40-yr PPA / Asset Purchase	n/a			500KV yard Substation	500KV yard Substation	
Not selected	18160	Storage - Battery				MT	Development	3/1/2023	3/1/2023	3/1/2043	20-yr Project PPA / Asset Purchase	n/a			115 KV Substation	115 KV Substation	
Not selected	18161	Storage - Battery				WA	Development	n/a	11/22	12/31/26	System specific 20-year REC Purchase Agreement for 100,000 RECs per year	100	n/a	n/a	n/a	115 KV Substation	115 KV Substation
Not selected	18162	Unbounded RECs				OR	Development	11/2022	11/2022	12/31/2031	17-year REC purchase agreement	n/a			n/a	n/a	
Not selected	18163	Unbounded RECs				OR	Development	12/31/2019	11/2022	12/31/2038	17-year REC purchase agreement	n/a			n/a	various	
Not selected	18164	Unbounded RECs				OR	Development	6/1/2017	11/2022	12/31/2038	17-year REC purchase agreement	n/a			n/a	various	
Not selected	18165	Unbounded RECs				OR	Development	12/31/2019	11/2022	12/31/2038	17-year REC purchase agreement	n/a			n/a	various	
Not selected	18166	Wind - on shore				OR	Development	12/31/20	12/31/20	12/31/45	Development Asset purchase BOT / 25-yr PPA / Project PPA	n/a			n/a	various	
Not selected	18167	Wind - off shore				WA	Development	12/31/2029	11/2030	12/31/2054	26-yr Project PPA / Asset purchase	n/a			n/a	various	
Not selected	18168	Wind - on shore				WA	Operating	10/4/10	10/4/20	10/3/25	Assignment of existing PPA (last 5 years)	n/a			n/a	various	
Not selected	18169	Wind - on shore				MT	Development	12/31/20	12/1/20	11/20/40	20-yr Project PPA	n/a			n/a	various	
Not selected	18170	Wind - on shore				OR	Development	12/31/20	12/31/20	12/31/40	20-yr Project PPA + Wheel System PPA	n/a			n/a	various	
Not selected	18171	Wind - on shore				WA	Development	12/31/21	12/31/21	12/31/41	20-yr Project PPA	n/a			n/a	various	
Not selected	18172	Wind - on shore				OR	Development	11/21	11/21	12/31/35	15-yr Project PPA	n/a			n/a	various	
Not selected	18173	Wind - on shore				MT	Development	10/31/22	10/31/22	10/31/42	20-yr Project PPA	n/a			n/a	various	
Not selected	18174	Wind - on shore				MT	Development	12/1/20	12/1/20	12/31/50	Asset Purchase	n/a			n/a	various	
Not selected	18175	Wind - on shore				WA	Development	10/31/20	11/1/20	10/31/45	25-yr Project PPA	n/a			n/a	various	

REDACTED VERSION

REDACTED VERSION

2018 All Resources RFP Proposal List

Status	Project ID	Resource type (as proposed)	Project name	RFP counterparty	City/County	State/Province	Status	COD	Term Start Date	Term End Date	Commercial Structure	Capacity (MW)	Strategic Resource Duration (MO)	Facility Capacity (MW)	Generation Technology (as proposed)	Tx Interconnection	Tx Delivery Point	
Selected for Phase 2	18176	Wind - on shore			MT	Development	12/31/22	12/31/22			20-yr Project PPA							
Not selected	18177	Wind - on shore + Solar - PV + BESS options			WA	Development	12/15/21	12/15/21			Development Asset Purchase / BOT							Preliminary Mid-C BPA 115kV substation
Not selected	18178	Wind - on shore			WA	Development	12/31/22	11/23			20-yr Project PPA							Preliminary Mid-C BPA 115kV substation
Selected for Phase 2	18179	Wind - on shore			WA	Development	12/1/21	12/1/21			20-yr Project PPA							PSE System
Not selected	18180	Wind - on shore			WA	Development	1/1/21	1/1/21			20-yr Project PPA							busbar
Not selected	18181	Wind - on shore			OR	Development	12/31/20	n/a			Asset Purchase							BPAT/PSE
Not selected	18182	Wind - on shore			WA	Development	12/15/22	12/15/22			Development Asset Purchase							Preliminary Mid-C
Not selected	18183	Wind - on shore			MT	Development	6/1/20	6/1/20			10-yr Project PPA / BOT Asset Purchase							BPAT/PSE
Not selected	18184	Solar - PV + BESS			WA	Development	10/31/22	10/31/22			20-yr Project PPA							High-side GSU at your substation
Not selected	18185	Wind - on shore			MT	Development	12/31/20	12/31/20			20-yr Project PPA							Substation
Not selected	18186	Geothermal			ID	Development	1/1/2024	1/1/2024			20-yr Project PPA							Substation
Not selected	18187	Solar - PV + BESS			OR	Development	10/31/22	10/31/22			20-yr Project PPA							Substation
Not selected	18188	Solar - PV + BESS			WA	Development	4/15/21	n/a			Asset purchase - EPC offer							Substation
Not selected	18189	Nat/Gas Turbine - Resp			WA	Development	8/1/20	8/1/20			20-yr Tolling PPA							Substation
Not selected	18190	Storage - Battery			WA	Development	8/1/20	8/1/20			10-year REC purchase agreement (from 5 solar farms totaling 25 MWdc)							Substation
Selected for Phase 2	UP001	Unallocated RECs			WA	Development	10/31/2019	10/31/19			20-year Project PPA							Substation
Unallocated offer	UP002	New offer			WA	Development	12/20/20	12/20/20			Long-term Project PPA / Ownership							Substation
Not selected	UP003	Unallocated Pumped Hydro			WA	Development	2025-2026	Unspecified			10-year REC purchase agreement							Substation
Added to Phase 2 - new lower price	UP004	Unallocated RECs			ID	Operating	2/23/2017	2020			20-yr Project PPA							Substation
Unallocated offer	UP005	Unallocated offer			OR	Development	12/1/2022	12/1/22			25-year Project PPA							Substation
Not cost competitive	UP006	Unallocated offer			OR	Development	12/1/2022	12/1/22			25-year Project PPA							Substation
Not selected	UP007	Unallocated offer			OR	Development	12/1/2022	12/1/22			25-year Project PPA							Substation

REDACTED VERSION



2018 All Resources RFP Proposal List

Status	Project ID	Resource Type	Project Name	RFP Jurisdiction	City/County	State/Province	Status	COD	Term Start Date	Term End Date	Commercial Structure	Capacity (MW)	Storage Duration (MWh)	Facility Capacity (MW)	Generation Technology	Tx Interconnection	Tx Delivery Point
Received after Phase 2 - 09/02/19	UP006 Unspecified Proposal	Non-Cat Turbine	[REDACTED]	[REDACTED]	[REDACTED]	WA	Operating	2002	9/1/22	9/1/29	Asset sale or 7-year Tolling PPA	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
Received after Phase 2 - 10/23/19	UP006 Unspecified Proposal	System PPA - Seasonal HLI (no REC) / RECS	INSG System PPA - Carbon Free	Morgan Stanley Commodities Group	n/a	WA	n/a	n/a	1/1/22	12/31/26	3.5-year system PPA for Seasonal HLI (no REC) / load hour (HLH) delivery	50-100	n/a	100	n/a	n/a	BPAT, FSEI

REDACTED  
VERSION

2018 Demand Response RFP Proposal List

Status	Project ID	Resource type	Project name	RFP counterparty	City	State/Province	Term Start Date	Term End Date	Capacity (MW)
Not selected	18200	Direct Load Control	[REDACTED]	[REDACTED]	[REDACTED]	NC	2019	2023	[REDACTED]
Selected for Phase 2	18201a	Direct Load Control	[REDACTED]	[REDACTED]	[REDACTED]	WA	2023	2028	[REDACTED]
Not selected	18202	Direct Load Control	[REDACTED]	[REDACTED]	[REDACTED]	MN	2019	2028	[REDACTED]
Not selected	18203	Direct Load Control	[REDACTED]	[REDACTED]	[REDACTED]	CA	2019	2023	[REDACTED]
Not selected	18204	C&I Curtailment	[REDACTED]	[REDACTED]	[REDACTED]	Canada	2019	2023	[REDACTED]
Added to Phase 2 - reduced price	18205	C&I Curtailment	[REDACTED]	[REDACTED]	[REDACTED]	MA	2019	2023	[REDACTED]

REDACTED VERSION

*2018 RFP Evaluation Process Document:*

## Appendix B. Evaluation Criteria

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX B. EVALUATION CRITERIA

#### *Evaluation Criteria*

PSE's evaluation of new long-term electric generation resources is based on an assessment of five primary criteria:

- Compatibility with resource need
- Cost minimization
- Risk management
- Public benefits
- Strategic and financial

Each criterion is further delineated into more detailed criteria elements, as described in the following tables.

#### *1. Compatibility with Resource Need*

Criteria Element	Description
1. Timing	<p>PSE prefers proposals that offer:</p> <ul style="list-style-type: none"><li>• energy and/or capacity in a time frame consistent with PSE's needs</li><li>• substantial assurance of being commercially available according to the schedule proposed</li><li>• flexibility in development schedule and/or contract start date to accommodate PSE's timing needs</li></ul>
2. Match to need through ownership	<p>Proposals that offer generation from an underlying asset that closely matches PSE's annual capacity requirements, or that offer output which can be controlled by PSE are preferred to those that rely on shaping through short- or long-term arrangements.</p>
3. Match to need through contract	<p>PSE prefers proposals that provide a fixed annual price and closely match PSE's annual capacity requirements.</p> <p>PSE seeks proposals that provide fixed transmission capacity from BPA's system to PSE's system and closely match PSE's annual capacity requirements.</p>

**2018 RFP EVALUATION PROCESS DOCUMENT**

**APPENDIX B. EVALUATION CRITERIA**

Criteria Element	Description
4. RPS requirement	Proposals in which qualified renewable generation and/or RECs are closely aligned with PSE's renewable need as mandated by the Energy Independence Act, Chapter 19.285 RCW.
5. Operational flexibility	<p>PSE prefers proposals that offer control of project output whereby the Company may respond to seasonal and real-time fluctuations in load/resource balance and system reliability events. This includes, for example, dispatch or displacement of the project in real time and, for jointly-owned projects, the ability for PSE to elect to use generation output that would otherwise be displaced by the other owner for reliability purposes.</p> <p>Additionally, PSE prefers proposals that provide the ability to carry operating reserves.</p>
6. Performance within existing PSE generation portfolio	<p>Analyses will include such factors as:</p> <ul style="list-style-type: none"> <li>• impact on system reliability</li> <li>• system dispatch and displacement</li> <li>• location with respect to the regional transmission system and PSE's electric system</li> <li>• impacts on system reserves, load following, integration costs and other factors</li> </ul>
7. Resource mix/diversity	<p>The diversity of resource technology and fuel types will be considered in a manner consistent with PSE's <i>Integrated Resource Plan</i>.<sup>1</sup> Specific considerations shall include:</p> <ul style="list-style-type: none"> <li>• technology type</li> <li>• fuel supply type</li> <li>• fuel supply source</li> <li>• fuel supply reliability, including control and deliverability</li> </ul>

<sup>1</sup> PSE's most recent *Integrated Resource Plan* can be found at [www.pse.com/irp](http://www.pse.com/irp).

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX B. EVALUATION CRITERIA

2. Cost Minimization

Criteria Element	Description
1. Resource cost	<p>PSE prefers proposals that provide the lowest reasonable cost throughout the project life, taking into account the price of the proposal and other factors that impact PSE's overall cost.</p> <p>Such factors include, but are not limited to:</p> <ul style="list-style-type: none"> <li>• capital cost</li> <li>• financing cost</li> <li>• operation and maintenance cost</li> <li>• expected or potential carbon control or mitigation costs</li> <li>• fuel and fuel transportation cost</li> <li>• fixed and variable power purchase agreement cost</li> <li>• transmission cost</li> <li>• ancillary services</li> <li>• integration costs</li> <li>• transmission system upgrades</li> <li>• cost to rebalance debt/equity ratio for imputed debt and consolidated debt</li> <li>• cost of credit facilities</li> <li>• transaction costs and other management costs, etc.</li> <li>• cost to meet environmental compliance, including capital improvements and/or capacity limitations and restrictions</li> <li>• renewable energy credits or other environmental attributes</li> </ul>
2. Transmission	<p>PSE prefers long-term firm delivery of energy to its service area. In the absence of the assurance of firm delivery at the time of the proposal, PSE prefers proposals that provide a high likelihood of acquiring adequate transmission rights.</p> <p>Proposals that do not include long-term firm transmission to PSE's service area, that would produce congestion or increase PSE's transmission costs will be compared unfavorably with other proposals and/or will be assessed the additional cost to PSE as part of the evaluation process.</p>
3. Portfolio cost impact	<p>PSE prefers proposals and combinations of proposals that result in the lowest impact on PSE's revenue requirements and rates when included in PSE's existing generation resource portfolio.</p>

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX B. EVALUATION CRITERIA

3. Risk Management

Criteria Element	Description
1. Status and schedule	<p>All else being equal, PSE prefers operating projects first, projects under construction second, and development projects third.</p> <p>With respect to development projects, PSE prefers proposals that demonstrate the respondent has the experience and financial resources to complete the project and has made significant progress in securing necessary permits, property rights, equipment, regulatory approvals, water rights, wastewater and disposal rights, project agreements and all other rights or arrangements necessary for a completely commercially operational project within the time frame proposed for commercial operation.</p>
2. Price volatility	<p>Proposals that provide significant long-term control of fixed and variable costs are preferred.</p>
3. Resource flexibility and stability	<p>PSE prefers proposals that provide flexibility for expansion to meet PSE’s growing needs as required.</p> <p>Proposals that include project agreements and all other rights and arrangements coterminous with power purchase delivery periods or project life are preferred.</p>
4. Resource Technology	<p>Proposals based on commercially-proven technology with demonstrated long-term reliability and performance history are preferred.</p> <p>Proposals based on technologies whose output may be controlled are preferred.</p>
5. Long-term flexibility	<p>PSE prefers proposals that offer the Company the flexibility to adjust its position in a resource long term, up to and including termination.</p>
6. Project risk	<p>Proposals that minimize risk for timely plant completion within cost projections are preferred.</p> <p>Proposals that minimize exposure to environmental risk or other potential liability, including expected or potential carbon control or mitigation costs, are preferred.</p>

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX B. EVALUATION CRITERIA

Criteria Element	Description
7. Impact on PSE’s overall risk position	<p>Proposals and combinations of proposals will be evaluated to determine the impact of the proposal(s) on PSE’s overall risk position with respect to PSE’s generation portfolio.</p> <p>Risk scenarios will include factors such as hydroelectric production variation, wind generation variability, fuel price volatility, carbon control costs, and power market price volatility.</p> <p>Additional risk scenarios will examine the correlation between fuel prices and power market prices, and alternative market price scenarios. Other considerations will include exposure to transmission congestion and costs.</p> <p>All else being equal, PSE prefers proposals that result in lower generation portfolio performance risk.</p>
8. Environmental and permitting risk	<p>PSE’s evaluation process will include an assessment of the following criteria:</p> <ul style="list-style-type: none"> <li>• status in acquiring needed permits</li> <li>• risk associated with future environmental regulation and taxes, including greenhouse gas emissions</li> <li>• compliance with state RPS</li> <li>• compliance with regional generator performance standards and import standards</li> </ul>
9. Respondent risk	<p>PSE will consider information requested in <b>Section 4</b> of the RFP document and <b>Exhibit B</b> in determining the risk associated with the financial condition and performance of a respondent and any third parties relied upon by the respondent. Lower-risk respondents are preferred.</p>
10. Ability to deliver as proposed	<p>PSE will use the information provided in response to <b>Exhibit B</b> to evaluate the experience and qualifications of the project team, an important consideration when judging a respondent’s ability to deliver a commercially operable project in the time frame proposed. PSE prefers respondents with proven track records.</p> <p>Information submitted in response to <b>Exhibit B</b>, which addresses project development status and schedule, will also be used to evaluate the respondent’s ability to meet the proposed commercial operation date.</p>



2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX B. EVALUATION CRITERIA

Criteria Element	Description
11. Status of transmission rights	<p>The ability to transmit power from the project site to one or more points on PSE’s electric system is a requirement (particularly to points on the system where the deliveries may be used to serve load with limited or no transmission congestion).</p> <p>PSE will use information provided in <b>Exhibit B</b> and, if necessary, the PowerWorld software tools, to assess whether and to what extent the required transmission will be available, and whether and to what extent the necessary transmission paths are constrained.</p>
12. Security and control	<p>Proposals that supply firm, fixed price fuel supply are preferred.</p> <p>Proposals that offer alternative methods of managing price volatility will be favorably considered.</p> <p>Proposals that supply firm energy and capacity are preferred.</p>
13. Federal regulatory approvals	<p>PSE will consider the effect of any federal regulatory approvals that would result from accepting the proposal, including, but not limited to, requirements under Sections 203 and 205 of the Federal Power Act. Proposals that eliminate or minimize the effect of any such federal regulatory approvals are preferred.</p>

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX B. EVALUATION CRITERIA

#### 4. Public Benefits

Criteria Element	Description
1. Environmental impacts	<p>Proposals that minimize environmental impacts are preferred. Environmental impacts refer to the full range of issues evaluated in an environmental impact statement or environmental assessment.</p> <p>PSE will consider information supplied in response to <b>Exhibit B</b> in its evaluation of the environmental impacts of a proposed acquisition.</p>
2. Resource location	<p>Proposed resources located such that they provide benefits to the regional and PSE transmission systems, or require minimal or no transmission upgrades are preferred.</p> <p>Proposals that are not dependent upon constrained transmission or fuel transportation paths are preferred.</p> <p>Proposed resources located within PSE's service territory are preferred.</p>
3. Community impacts	<p>Proposals that demonstrate support from public, local, state and federal government entities and Native American Tribes, if applicable, as well as other stakeholders, are preferred.</p>

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX B. EVALUATION CRITERIA

5. *Strategic and Financial*

Criteria Element	Description
1. Capital structure impacts	<p>PSE’s quantitative analysis will impute the anticipated equity cost needed to offset any adverse effects on its capital structure associated with accounting requirements (e.g., FASB ASC 810) that may require PSE to consolidate the respondent’s balance sheet.</p> <p>All else being equal, PSE prefers proposals that avoid risks associated with a requirement to consolidate a respondent’s financials with PSE’s financials (e.g., pursuant to FASB ASC 810).</p> <p>All else being equal, proposals are preferred that would not increase PSE’s exposure to adverse impacts on its financial position (e.g., by requiring PSE to impute debt, to account for the transaction as a capital lease (e.g., under FASB ASC 840), to account for or report the transaction as a financial derivative transaction (e.g., pursuant to FASB ASC 815), by otherwise adversely affecting PSE’s financial leverage, operating leverage, credit rating, cash flow, income statement or balance sheet, or by imposing credit requirements or increasing liquidity risk).</p>
2. Future exposure to environmental regulations and/or taxes	<p>Proposals for resources with lower potential exposure to future environmental regulations and/or taxes are preferred.</p>
3. Guarantees and security	<p>PSE will consider information provided in response to <b>Exhibit B</b> to determine whether it will require any additional guarantees or credit support pursuant to <b>Section 5</b> of the RFP document.</p> <p>PSE’s credit risk department may require the seller to provide performance assurance. PSE will expect sellers with sub-investment-grade credit ratings (or being of similar creditworthiness) to provide performance assurance acceptable to the Company.</p> <p>PSE will not accept collateral thresholds, credit ratings triggers, general adequate assurances language or similar language that might require the Company to provide performance assurance.</p>

*2018 RFP Evaluation Process Document*

## Appendix C. Phase 1 Results

*2018 RFP Evaluation Process Document*

## C.1 Phase 1 Executive Summary



## 2018 RFP – Executive Summary\*

Quantitative results are the product of analysis performed in PSM III version 25.10.

### Candidate Short List: Proposals selected for Phase 2 optimization and due diligence (organized alphabetically by project name)

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18100</b> <b>SPI Burlington Biomass</b> Sierra Pacific Industries PPA Operational Biomass 17 MW nameplate PPA start: 01/01/2021 17 years capacity		<ul style="list-style-type: none"> <li>Relatively inexpensive REC producing</li> <li>Proportionally high contribution to the capacity need.</li> <li>Existing operational site</li> <li>Interconnected with PSE system</li> <li>Minimal risks all-around</li> </ul>	<ul style="list-style-type: none"> <li>Sierra Pacific Industries is a privately held company so less financial information is available than if it had been public</li> </ul>	<b>Selected</b> - The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the high levelized portfolio benefit over renewable energy credit ("REC") ranking, and due to the relatively high levelized portfolio benefit over kilowatt year ranking and low qualitative risks.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18103</b>  CTA or Asset Transfer Operational Combined Cycle MW** of  MW Start: 06/01/2022 Term: 10 year (PPA)		<ul style="list-style-type: none"> <li>Second least expensive thermal proposal currently in RFP</li> <li>Existing operational site (rather than new build)</li> <li>Strong presence in the community</li> <li>Expansion opportunity on adjacent land</li> </ul>	<ul style="list-style-type: none"> <li>Would likely be impacted by carbon legislation currently being considered in Olympia</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, there would likely be considerable reputational risk.</li> <li>Is not clear whether there is firm gas transport to plant, which would be required to count as a capacity resource</li> </ul>	<b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
 CTA** and BTS MW** of  MW COD: 01/01/2022 5, 15, and 20** year term		<ul style="list-style-type: none"> <li>Least expensive thermal proposal in RFP</li> <li>Expansion of existing site rather than a new thermal facility.</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate with other sites.</li> <li> MW proposal could likely be facilitated with firm gas supply with existing facilities.</li> </ul>	<ul style="list-style-type: none"> <li>Air permit path is complex and possibly not feasible.</li> <li>The likely-to-be-required air permit modification could bring more operational constraints for the existing generation units.</li> <li>PSE will experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's thermal generation portfolio.</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, the proposed schedule and general project feasibility seem to be in question.</li> </ul>	<b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.



**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18107</b>  PPA Operational Hydro start: 1/1/2021 (assumed) Term: 20 year (assumed)		<ul style="list-style-type: none"> <li>Existing operational site (rather than new build)</li> <li>Clean energy (although not RPS compliant)</li> <li>Run-of-river hydro can be less environmentally impactful than standard hydro</li> <li>Little to no permitting or real estate risk due to current operational status</li> </ul>	<ul style="list-style-type: none"> <li>Not RPS compliant (although clean energy)</li> <li>Proposal is missing important details regarding pricing, term length, term, etc.</li> <li>Although PSE has worked with this counterparty before, possible risks remain</li> </ul>	<b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>18111</b>  PPA** or BTS Development solar Solar: MW/ac COD: 12/31/2022 Term: 20 year (PPA)		<ul style="list-style-type: none"> <li>Relatively high quantitative score for solar project</li> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Site control has been achieved</li> <li>Permitting status is sufficient at this stage</li> <li>Located on PSEs system in County avoids community concerns in County</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C however, may be difficult given projects proximity to the substation</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18112</b>  PPA**, Optional BESS Development solar Solar: BESS:  /  / 2 HR COD: 12/31/2022 Term: 25 year		<ul style="list-style-type: none"> <li>Developer has solar development experience (primarily on a smaller scale)</li> <li>Located on PSE's system in  County avoids community concerns in  County</li> </ul>	<ul style="list-style-type: none"> <li>Developer has primarily small scale solar development experience and no experience in the northwest</li> <li>Project acreage appears to be too small for proposed nameplate capacity</li> <li>Permitting information provided is insufficient</li> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18114</b>  PPA Solar Generation  COD: Q4 2020 20 year term		<ul style="list-style-type: none"> <li> is assessed to be a relatively strong parent company</li> <li>Site as proposed doesn't have major implications on agricultural land</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Need specifics on parent company support, or financing otherwise</li> <li>Solar facilities are under contention in  County</li> <li>Permitting will require a transfer of an EFSEC permit, which will bring a viability and reputation risk to the project and PSE</li> <li>Transmission and energy delivery may be overly expensive or otherwise not feasible</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

**Common acronyms:**




BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18122</b>  PPA**, Optional BESS Development Wind MW, AC** & MW 1 Hr BESS COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash.</li> <li>Relatively inexpensive solar energy with potential for battery storage.</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Significant viability issues delivering to PSE</li> <li>Solar development not positively looked at in this area</li> <li>Site may block the view of a local real estate development.</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18125</b>  PPA Development Solar MW, AC COD: 10/31/2022 Term: 15 year or 20 year**	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Site control appears to be more than adequate given proposed size of project</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to MidC</li> <li>Site permitting is in a relatively early state of development</li> <li>Minimal information provided regarding community relations and or support</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18127</b>  PPA Development Solar MW, AC COD: 12/31/2022 Term: 15 year or 20 year**	<ul style="list-style-type: none"> <li>Extensive solar energy development experience including <b>REDACTED</b> developed, currently owning and operating <b>REDACTED</b> solar project in Washington State.</li> <li>Location on existing project site may provide economy of scale in development and operation of project.</li> <li>County has expressed support in the project</li> </ul>	<ul style="list-style-type: none"> <li>May be siting concerns given proximity to wind turbines with required setbacks</li> <li>Assumes use of PSE site control with current <b>REDACTED</b> landowners</li> <li>CUP required to permit project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	




\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

**REDACTED  
VERSION**



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18131</b>  PPA** or BTS Development Wind IMW** or IMW COD: 12/1/2022 25 year term	<ul style="list-style-type: none"> <li>Credit support in the form of a parent guarantee, letter of credit, or cash</li> <li>Long-term site control secured</li> <li>Permitting likely to meet proposed timeline</li> <li>Community relations plan was strong when compared to other proposals</li> </ul>	<ul style="list-style-type: none"> <li>Less experience when compared to other counterparties</li> <li>IMW option would possibly run into available transmission capacity issues</li> <li>Tribe may request compensation from project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18132</b>  PPA** Development Wind**, Solar, BESS IMW** COD: 01/01/2021 Term: 20 year	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Wind is an existing site, therefore little concern for site control or community relations</li> </ul>	<ul style="list-style-type: none"> <li>May be concern for permitting required for a repower</li> <li>Mid-C delivery negates any capacity value brought by the BESS Option</li> <li>Repowered project may not create as much excitement given the lack of an incrementally new project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18135</b>  PPA** or BTS Development Solar IMW** or IMW Solar Optional IMW 4 Hr BESS COD: 12/1/2022 20 year term PPA	<ul style="list-style-type: none"> <li>Large counterparty with experience all over the world</li> <li>Letter of intent with an option to lease has been signed</li> </ul>	<ul style="list-style-type: none"> <li>Minimal detail regarding creditworthiness or financing was included in the proposal</li> <li>Transmission directly to PSE appears to be overly expensive or infeasible. Mid-C delivery with no contribution to peak capacity is likely the best offer configuration</li> <li>Permitting plan is underdeveloped</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18139</b>  PPA Development Solar MW** or MW 1.82 Hr BESS COD: 12/31/2022 10 year term PPA		<ul style="list-style-type: none"> <li>Large multi-national counterparty with greater-than-average renewable development experience</li> </ul>	<ul style="list-style-type: none"> <li>Site control not-yet secured, and no indication of pending agreement was provided</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Permitting process has not yet begun, and presents minimal evidence that they have the ability to identify and secure all permits</li> <li>Community relations was not covered sufficiently, and tribal support may be required</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.
<b>18163</b>  Consulting REC purchase Underlying solar projects RECS per year Start of term: 1/1/2022 18 year term		<ul style="list-style-type: none"> <li>Interconnection at distribution voltage dictates that each as-generated MWh produce two Washington State RECs.</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facilities</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18165</b>  REC purchase Underlying solar project RECS per year Start of term: 1/1/2022** or 2024 16 or 18** year term	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facility</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18166</b>  DAS, BTS, or PPA** Development Wind MW COD: 12/1/2020, 2021, or 2022** 25 year term	<ul style="list-style-type: none"> <li>Long-term site control established</li> </ul>	<ul style="list-style-type: none"> <li>Significant concerns regarding the counterparty's ability to develop, finance, and construct the facility</li> <li>Relatively small counterparty with inconclusive rights to the project's developmental assets</li> <li>Timing of project is contingent on BPA infrastructure upgrades to enable transmission capacity</li> <li>Project owner, [REDACTED] seemed uninterested in furthering project development via first-hand experience at 2/22/19 public hearing</li> <li>Timeline as-proposed is likely not feasible and pricing is likely contingent on timing due to PTC safe harbor</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18169</b>  PPA** or 50% Ownership + PPA Development Wind MW** or MW COD: 12/31/2020 or 2021** 20 or 25** year term	<ul style="list-style-type: none"> <li>Relatively cost efficient way to meet REC and contribution to peak capacity need</li> <li>Large and experienced counterparty</li> <li>Site control is reportedly achieved, but supporting documentation was not included in proposal</li> <li>Public has been notified of the project as a [REDACTED] MW facility</li> <li>Shape of wind based on 6 operating MET towers appears to fit well with PSE's needs</li> </ul>	<ul style="list-style-type: none"> <li>Minimal experience in the Pacific Northwest</li> <li>Large generation-tie transmission line is required</li> <li>There is a potential issue with sage grouse habitat</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.




**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18170</b> <b>Golden Hills Wind</b> Avangrid Renewables PPA, PPA-shaped**, BTS Development Wind 200 MW** COD: 12/1/2020** Term: 20 year**		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Shaped product offers capacity contribution during peak winter months</li> <li>Likely low risk to real estate given advanced level</li> <li>Permitting well advanced with EFSC permit application already amended</li> </ul>	<ul style="list-style-type: none"> <li>Complex energy delivery will require additional vetting</li> <li>Complexity of shaped product will require additional vetting</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18173</b>  PPA** Development Wind IMW or IMW COD: 10/31/2022** Term: 20**		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>May only need single landowner which would indicate little real estate challenges</li> <li>Favorable state support, however local level of support unknown</li> </ul>	<ul style="list-style-type: none"> <li>Possibly require DNRC land which could complicate site control and permitting</li> <li>Permitting is relatively early in development, however there may be concerns for meeting scheduled COD</li> <li>Use of  is under ongoing review, however may be problematic</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18175</b>  PPA, BTS, or WSPP Shaped** Development Wind IMW COD: 10/1/2020 25 year term		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Western Systems Power Pool ("WSPP") schedule C delivery is a unique value</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty and financing details will require data requests</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Mid-C delivery will likely be necessarily, which would negate a contribution to peak capacity</li> <li>Permitting plan seems either underdeveloped or underrepresented in the proposal</li> <li>Outreach plan is underdeveloped</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18176</b>  PPA** Development Wind MW** or MW COD: 12/31/2022 Term: N/A		<ul style="list-style-type: none"> <li>Indications of strong local, state and environmental support</li> <li>Potential to partner with a local Native American tribe</li> <li>Located near [redacted] and in the same County</li> <li>Counterparty has indicated a plan to partner and/or otherwise engage an experienced renewable energy developer on the project</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty does not have experience designing, financing, building, owning or operating a large scale renewable or other energy projects</li> <li>Use of [redacted] is under ongoing review, however may be problematic</li> <li>Additional detail needed regarding the real estate and permitting considerations necessary for the site</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18179</b>  PPA** , DBS Development Wind MW** COD: 12/31/2021 Term: 20 year		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate appears adequate and relatively low risk</li> <li>Project sizing has been altered in order to address some local viewshed concerns</li> </ul>	<ul style="list-style-type: none"> <li>History of considerable local and County level opposition to the project</li> <li>Counterparty bypassed the County permitting process by pursuing permit approval through the state's EFSEC process</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18190</b>  REC Offer Underlying proposed solar facilities RECs / year COD: 01/01/2022 12, 15**, or 20 years		<ul style="list-style-type: none"> <li>Inexpensive RECs</li> <li>Site control is secured</li> <li>EFSEC projects have been approved by Governor In steel</li> </ul>	<ul style="list-style-type: none"> <li>Realizing full REC-output of underlying projects is unlikely due to interconnection issues</li> <li>[redacted] is currently in litigation with [redacted] over interconnection issues with the underlying projects</li> <li>[redacted] County opposes the EFSEC decision and has applied for judicial review</li> <li>Major feasibility concerns with some of the underlying projects, and schedule concerns for all projects sited in commercial agricultural land and many stakeholders in the County oppose development on these lands</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18201</b>  Direct load control Bring your own thermostat, smart water heater IMW COD: 1/1/2023 Term: 6 years		<ul style="list-style-type: none"> <li>Industry leader by Navigant study</li> <li>PSE DR RFP finalist</li> <li>Iron manages all program implementation</li> <li>Strong financial, WA based</li> <li>The IMW option makes it a small scale project to test out</li> </ul>	<ul style="list-style-type: none"> <li>No convincing reason provided to suggest a ramp up in DR deployment just in a year in 2023</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>XXXXX</b>  N/A Transmission Redirect IMW** IMW COD: 01/01/2022 Term: 55 year book life		<ul style="list-style-type: none"> <li>If feasible, redirect to MidC would provide a strong capacity resource</li> </ul>	<ul style="list-style-type: none"> <li>Increased exposure to market prices (for redirect to MidC)</li> <li>Ambiguity regarding how much redirect is possible to MidC (IMW assumed), therefore how much would be required to redirect elsewhere on BPAs system</li> <li>If greater than IMW were to be redirected, the amount above IMW would have to redirect to another PSEI node, e.g. PGE, etc. Source of energy at second redirect point unknown</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**





Resources eliminated during the Phase 1 screening (organized alphabetically by project name)

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18101</b>  PPA Operating Biomass Start of Term: 07/01/2021 7.25 Year Term		<ul style="list-style-type: none"> <li>The project is already operational, and therefore has viability issues largely solved</li> <li>Transmission and energy delivery options seem viable on initial review</li> </ul>	<ul style="list-style-type: none"> <li>Local community is fairly charmed and might lump this project in with the nearby [REDACTED] facility in their protests, even though it is a REC generating facility</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18102</b>  PPA Proposed Biomass Start of Term: 01/01/2022 Unknown term duration		<ul style="list-style-type: none"> <li>Site control is allegedly secured via reserved land on existing property</li> </ul>	<ul style="list-style-type: none"> <li>Most qualitative details required to be addressed in the 2018 RFP, including counterparty, permitting, energy delivery, and community relations were not adequately covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project to proceed to Phase 2 of the 2018 RFP due to a significant lack of detail in the proposal that resulted in the inability to analyze the proposal on a quantitative or qualitative basis.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18104</b>  CTA, 50%** or 100% Asset Sale, or HRCO Operating CC Thermal Plant  MW Start of Term: 01/01/2022 3 to 10 Year Term		<ul style="list-style-type: none"> <li>This was one of two already-operating thermal facilities proposed into the 2018 RFP</li> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Counterparty has strong renewable energy portfolio</li> <li>Site control and permitting should not represent issues to PSE or </li> </ul>	<ul style="list-style-type: none"> <li>Heat rate call option ("HRCO") at  MMBTU represents a poor value requiring significant additional pipeline capacity</li> <li>Energy delivery is expensive and complex</li> <li>Singling a new deal with a thermal resource represents a potentially significant reputational risk with governmental agencies, NGOs, activists, as well as typical energy consumers</li> <li>Combined cycle turbine starts up slower than other thermal proposals</li> <li>Ownership would likely involve significant facility upgrades not included in phase 1 quantitative analysis</li> <li>May not qualify for Washington State RPS due to location in Nevada, relatively far away from Washington.</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking as well as the potentially significant reputational risk with signing a new long-term agreement with a thermal generation resource.</p>
<b>18106</b>  PPA** Development Geothermal  MW** COD: 09/01/2021** Term: 20 year**		<ul style="list-style-type: none"> <li>Geothermal asset may provide clean capacity product</li> </ul>	<ul style="list-style-type: none"> <li>May not qualify for Washington State RPS due to location in Nevada, relatively far away from Washington.</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>
<b>18108</b>  PPA Developmental Solar  MW Solar* and optional MW 4 Hour BESS COD: 12/15/2022 15 or 20* year term		<ul style="list-style-type: none"> <li> is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>Permitting timeline seems feasible for COD, but not for the proposed start of construction</li> </ul>	<ul style="list-style-type: none"> <li>Site control is not established, and presents a feasibility risk to the project since the land is being sold via auction</li> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>Solar proposals in  County present some reputational risk</li> <li> MW capacity seems to facilitate PURPA considerations</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low-leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18109</b>  PPA Developmental Solar IMW Solar* and optional IMW 4 Hour BESS COD: 12/15/2022 15 or 20* year term		<ul style="list-style-type: none"> <li>• [REDACTED] is an experienced renewable energy developer, specifically in the solar production</li> <li>• Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>• Long-term site control is achieved</li> <li>• Permitting timeline seems feasible</li> </ul>	<ul style="list-style-type: none"> <li>• Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>• [REDACTED] MW capacity seems to facilitate PURPA considerations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>
<b>18110</b>  BTS or DAS Developmental Solar IMW Solar* and optional IMW 4 Hour BESS COD: 12/15/2022 15 or 20* year term		<ul style="list-style-type: none"> <li>• Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>• Counterparty has minimal project development and construction experience</li> <li>• Project financing plan has very minimal detail</li> <li>• Expensive energy delivery to PSE or Mid-C due to available transmission capacity limitations</li> <li>• Minimal detail in community relations plan</li> <li>• Solar proposals in [REDACTED] County present some reputational risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18113</b>  PPA** Developmental Solar IMW** COD: 12/31/2022** 15** or 20 year term		<ul style="list-style-type: none"> <li>• Extensive solar energy development experience including [REDACTED] developed, currently owning and operating [REDACTED] solar project in Washington State.</li> <li>• Site control has been achieved</li> <li>• ODOE certificate secured</li> </ul>	<ul style="list-style-type: none"> <li>• Complex delivery to PSE requires multiple transmission legs at additional cost</li> </ul>	<p><b>Not selected</b> – The RFP evaluation team does not recommend [REDACTED] proposal for phase 2 consideration in the 2018 All Resource RFP due to its low quantitative score.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18115</b>  PPA Developmental Solar IMW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control is secured for a wind project, and can likely be altered to allow for Solar development</li> </ul>	<ul style="list-style-type: none"> <li>Solar energy in Montana does not appear to provide the same cost efficiency, net capacity factor, or contribution to peak capacity when compared to the larger wind projects in the region</li> <li>Energy delivery has been left to PSE and will be infeasible or expensive</li> <li>Minimal details regarding a permitting plan of action</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 All-Resource RFP due to the relatively low leveledized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18116</b>  PPA Development Solar IMW COD: 12/1/2022 20** or 25 year term	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>	
<b>18117</b>  15-yr/20-yr PPA, Development Wind Up to IMW COD: 1/1/2021 Term:	<ul style="list-style-type: none"> <li>Project was withdrawn from the 2018 All Resources RFP</li> </ul>	<ul style="list-style-type: none"> <li>Project withdrawn from the 2018 All Resources RFP</li> </ul>	<p><b>Not selected</b> - Project withdrawn from the 2018 All Resources RFP</p>	

**Common acronyms:**




BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18118</b>  PPA Developmental Solar IMW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control has been secured via land leases</li> <li>Permitting has been largely secured via Oregon EFSC in [REDACTED]</li> </ul>	<ul style="list-style-type: none"> <li>Long-point to point transmission is unlikely to be feasible</li> <li>Lack of cohesive community relations plan coupled with EFSC permit presents some reputational risk to the project and to PSE</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 All Resources RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18119</b>  PPA Developmental Solar IMW Solar with Optional IMW 1 Hr BESS COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control for the project is achieved</li> <li>While energy delivery was largely left to PSE, on initial review, it appears to be feasible</li> </ul>	<ul style="list-style-type: none"> <li>Generation-tie line still requires land-use rights</li> <li>Relatively insufficient permitting plan</li> <li>Potential issues with proximity to nearby airport</li> <li>Minimal details regarding a community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18120</b>  PPA Developmental Solar IMW COD: 12/31/2022 20 year term	<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control appears to be obtained imminently, however, minimal detail was included in the proposal</li> </ul>	<ul style="list-style-type: none"> <li>BPA transmission would require significant network upgrades which indicate cost and schedule risk</li> <li>Relatively insufficient permitting plan</li> <li>Minimal details regarding a community relations plan</li> </ul>	<ul style="list-style-type: none"> <li>BPA transmission would require significant network upgrades which indicate cost and schedule risk</li> <li>Relatively insufficient permitting plan</li> <li>Minimal details regarding a community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18121</b> PPA Developmental Solar MW COD: 12/1/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Letters of intent have been signed with potential lessors, and there should be plenty of time to finalize lease agreements</li> <li>Community relations plan appears to be adequate</li> </ul>	<ul style="list-style-type: none"> <li>Three of four proposals into the 2018 RFP were withdrawn due to infeasibility in January 2018</li> <li>Transmission plan is undeveloped and reliant on PSE being a network customer of BPA, which is not and will not be the case</li> <li>Permitting plan is relatively insufficient and undeveloped</li> <li>██████████ presents a risk to the ongoing operation of the site</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18123</b> PPA Developmental Solar + BESS MW Solar & optional MW, 2, 4**, 6 Hr BESS COD: 10/31/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Site control projected to be achieved by Q2 2019</li> </ul>	<ul style="list-style-type: none"> <li>Generation-tie line not included in proposed site control</li> <li>Interconnection queue position was described in the proposal, but could not be confirmed by RFP team</li> <li>Relatively insufficient information provided in the proposal</li> <li>██████████ County generally interested in renewables, including solar, but some nearby communities have opposed development</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18124</b> Operating Status & Offer PPA Development Solar MW or MW COD: 12/1/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18126</b>  PPA** Development Solar MW of MW COD: 12/1/2022 20- or 25 year term	This proposal was removed from consideration by the developer on January 11 <sup>th</sup> 2018.	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<b>Not selected</b> – This proposal was removed from consideration by the developer on January 11 <sup>th</sup> 2018.
<b>18128</b>  PPA**, Optional BESS Development solar BESS: MW/ MWVac** MW / 2 HR COD: 06/01/2022 Term: 25 year	<ul style="list-style-type: none"> <li>Location in [redacted] County, [redacted] relatively favorable location within the county.</li> <li>Real estate appears to be of an advanced stage and sufficient for proposed project size</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty solar experience exclusively small scale.</li> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> <li>Developer withholds the rights to pursue state EFSEC permitting process, which would circumvent the county/local concerns, possibly engendering local hostility to the project</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty solar experience exclusively small scale.</li> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> <li>Developer withholds the rights to pursue state EFSEC permitting process, which would circumvent the county/local concerns, possibly engendering local hostility to the project</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.
<b>18129</b>  PPA** Development Solar MWVac** COD: 01/01/2021 or 01/01/2023** Term: 15 or 20** year term	<ul style="list-style-type: none"> <li>Developer appears to have experience in the solar industry developing utility scale solar projects</li> <li>Relatively advanced stage of permitting with comprehensive permitting matrix provided by developer</li> <li>Real estate appears to be more than sufficient for the proposed project size</li> </ul>	<ul style="list-style-type: none"> <li>Proposed plan for energy delivery includes multiple transmission segments that would be costly</li> </ul>	<ul style="list-style-type: none"> <li>Proposed plan for energy delivery includes multiple transmission segments that would be costly</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18130</b>  PPA Development Solar + BESS MW Solar & MW 4 Hr BESS COD: 12/15/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>•  is an experienced renewable energy developer, specifically in the solar production</li> <li>• Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> </ul>	<ul style="list-style-type: none"> <li>• Long-term site control is not yet obtained</li> <li>• A BPA cluster study will likely be required to fixed point to point delivery to PSE's system, which brings cost and schedule variability</li> <li>• Permitting progress has not yet begun as of the date of proposal submission</li> <li>• Nameplate of  MW, a multiple of  MW, indicates developer consideration for PURPA eligibility</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>
<b>18133</b>  PPA Development Solar + BESS MW Solar & MW or MW, 2** or 4 Hr. BESS COD: 12/15/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>• Experienced renewable developer, especially with wind assets</li> <li>• Project expected to be financed on balance sheet</li> <li>• Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>• Proposed energy delivery plan is potentially not feasible, or overly expensive</li> <li>• Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18134</b>  PPA Development Solar MW COD: 1/1/2023 20 year term		<ul style="list-style-type: none"> <li>• Financial support through  and other long-term debt partners</li> <li>• Long-term site control is not yet achieved, but is reportedly close</li> </ul>	<ul style="list-style-type: none"> <li>•  only has moderate renewable development, construction, and operational experience</li> <li>• Energy delivery plan as proposed is likely infeasible, and transmission will need to be wheeled through BPA and Mid-C</li> <li>• Community relations was not sufficiently covered in the proposal and solar development in  County is  unpopular</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18136</b>  PPA Development Solar + BESS 4 Hr BESS COD: 9/31/2022 20 year term	<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>is a newer company with minimal construction and operational experience</li> <li>Transmission left to PSE (busbar delivery) and will likely route to Mid-C, removing any contribution to capacity</li> <li>Relatively immature permitting plan</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18137</b>  PPA Development Solar + BESS 4 Hr BESS COD: 9/31/2022 20 year term	<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>is a newer company with minimal construction and operational experience</li> <li>Transmission left to PSE (busbar delivery) and will likely route to Mid-C, removing any contribution to capacity</li> <li>Relatively immature permitting plan</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking as well as insufficient progress and level of detail provided when compared to other proposals in the RFP, especially regarding Transmission and Energy Delivery.</p>	
<b>18138</b>  PPA Development Solar + BESS 4, or 6 Hr BESS COD: 3/31/2022 20 year term	<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> <li>Significant efforts identifying and securing State and Federal permits</li> </ul>	<ul style="list-style-type: none"> <li>is listed as a primary partner to [REDACTED] has had ongoing issues meeting construction schedule commitments with an in-construction wind farm [REDACTED]</li> <li>Solar energy in Montana does not appear to provide the same cost efficiency, net capacity factor, or contribution to peak capacity when compared to the larger wind projects in the region</li> <li>Minimal time has apparently been spent regarding local County permits</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18140</b> PPA Development Solar + BESS MW Solar & MW 4 Hr BESS COD: 12/15/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>Long-term site control has been secured</li> <li>Generic, but relatively comprehensive, community relations plan</li> </ul>	<ul style="list-style-type: none"> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>The permitting plan is not far along and there are potential schedule issues with the permitting as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18141</b> PPA** Development Solar + BESS MW Solar** MW / MWh / 4 Hr BESS** COD: 9/30/2022** Term: 25 year**		<ul style="list-style-type: none"> <li>Located on existing windfarm location may ease development efforts</li> <li>Developer has experience in the region and with</li> <li>Purchase option (pricing undefined) offers some flexibility for asset purchase</li> </ul>	<ul style="list-style-type: none"> <li>Developer does not provide much financial information therefore financial credit worthiness is difficult to assess.</li> <li>Not apparent what value project brings with use of existing</li> <li>Little permitting work has been completed</li> <li>Use of transmission may be problematic and/or crowd out a future wind expansion at the site.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18142</b> PPA Development Solar + BESS or MW Solar & MW, 4 Hr BESS COD: 9/30/2022 20 or 25** year term		<ul style="list-style-type: none"> <li>Large publicly traded counterparty with strong financial performance and much experience in renewable development, construction, and operation</li> <li>Long-term site control is not yet achieved as of the proposal submission, but indications were that it would occur soon</li> </ul>	<ul style="list-style-type: none"> <li>There is apparently insufficient transmission capacity to secure firm point-to-point capacity</li> <li>Energy delivery plan as proposed requires PSE to be a network customer with BPA, which is not and will not be the case</li> <li>Permitting will require amendments, and not enough specifics on the plan was included in the proposal</li> <li>There was a relatively low amount of detail provided regarding the community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18143</b> Development BESS IMW, 2** or 4 Hr. Lithium Ion or IMW, 4 or 6 Hr. Flow BESS COD: 12/31/2020		<ul style="list-style-type: none"> <li>Long-term site control secured</li> <li>[REDACTED] is a Seattle-based company that should be able to engage the local community effectively</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Newer developer who recently lost a court battle regarding PURPA eligibility</li> <li>Site is in a location that has medium risk for gopher indicator soils, which has caused issues for PSE in the past</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18144</b> Development BESS IMW, 4 Hr. Lithium Ion BESS COD: 12/31/2021 10 or 20** year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Site is on Invenenergy-owned land</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Transmission queue position with PSE has not yet been applied for</li> <li>Firm available transmission capacity is likely not obtainable</li> <li>Permitting process is relatively immature</li> <li>Community relations was not covered in proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18145</b> CTA or BTS Development BESS IMW, 2** or 4 Hr. Li-Ion BESS COD: 12/31/2021 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Long-term site control is not secured</li> <li>Site appears to be part of an active gravel pit</li> <li>Permitting process is early in development</li> <li>Community relations is not discussed in proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18146</b> <p>CTA or BTS Development BESS IMW, 4 Hr Li-Ion BESS COD: 09/30/2022 20 year term</p>	<ul style="list-style-type: none"> <li>Large multinational counterparty with experience in renewable and green power</li> <li>Strong financial performance and credit rating, and project would be financed on balance sheet</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Long-term site control is not yet secured</li> <li>Project is not yet in transmission queue, and would likely require significant network upgrades</li> <li>Community relations plan is lacking and is very necessary as the site is located in a commercial and industrial load center of PSE's service territory</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>	
<b>18147</b> <p>CTA Development BESS IMW, 4 Hr Li-Ion BESS COD: 09/30/2022 10 year term</p>	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>█ is a newer company with minimal construction and operational experience</li> <li>Site control has not yet been obtained</li> <li>Project is not yet in transmission queue</li> <li>Permitting for site is immature</li> <li>Community relations was not addressed in proposal and will be required as the site is in a major suburban load center in PSE's service territory</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>	
<b>18148</b> <p>CTA or BTS** Development BESS IMW, IMWh / 2 hr BESS** COD: 08/01/2022** Term: 20 year (CTA)**</p>	<ul style="list-style-type: none"> <li>Extensive solar energy development experience including having developed, currently owning and operating █ solar project in Washington State.</li> <li>Strong management team, with storage experience</li> <li>Location on existing project site may provide economy of scale in development and operation of project.</li> <li>Would be located on existing PSE owned property</li> </ul>	<ul style="list-style-type: none"> <li>May be siting concerns given proximity to wind turbines with required setbacks</li> <li>There may be permitting concerns at this location.</li> <li>Relatively low risk regarding community engagement; optics would fit well at location given the existing wind, solar and visitors center</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18149</b>  CTA** or BTS Development BESS for MW, 4 Hr Li-Ion BESS COD: 09/30/2022 20 or 25 year CTA term		<ul style="list-style-type: none"> <li>█ would likely be excited about energy storage solutions</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Site is presumed to be located on PSE property, but the site may or may not be utilized by PSE system development in the future</li> <li>Counterparty has defaulted on an agreement in the past with PSE</li> <li>Interconnection and energy delivery plan is early on in process and contingent on PSE development</li> <li>Permitting plan is early in development</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18150</b>  CTA** or BTS Development BESS for MW, 4 Hr Li-Ion BESS COD: 09/30/2022 20 or 25 year CTA term		<ul style="list-style-type: none"> <li>Site is on developer-owned property</li> <li>City of █ would likely allow battery storage outright</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Counterparty has defaulted on an agreement in the past with PSE</li> <li>Interconnection and energy delivery was left to PSE</li> <li>Community relations was not addressed in proposal, and the existing BESS installed in area had technical and communications challenges</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18151</b>  CTA** Development BESS for MW / 4 hr MW / 4 hr COD: 09/31/2022 Term: 20 year		<ul style="list-style-type: none"> <li>Developer presents minimal relative risk, having previously developed large utility scale BESS systems</li> <li>May be minor permitting risks</li> </ul>	<ul style="list-style-type: none"> <li>It is unclear whether project is intended to be interconnected to PSE's █ distribution substation (as stated) or BPA's █ transmission substation (as depicted in the project documentation)</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18152</b> [REDACTED] CTA** or BTS Development BESS [REDACTED] MW, 4 Hr Li-Ion BESS COD: 09/30/2022 20 or 25 year CTA term		<ul style="list-style-type: none"> <li>[REDACTED] is assessed to be a relatively strong parent company</li> <li>Project is proposed to be located on PSE-owned land</li> <li>Interconnection with [REDACTED] substation unlikely to cause major upgrades</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Permitting process is extremely immature, and it is unknown how the County will treat BESS projects</li> <li>Community relations was not sufficiently covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18154</b> [REDACTED] CTA** Development BESS Multiple options: [REDACTED] MW / [REDACTED] MWh / 2 hr [REDACTED] MW / [REDACTED] MWh / 4 hr** [REDACTED] MW / [REDACTED] MWh / 4 hr COD: 01/01/2022 or 01/01/2023** Term: 16 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Site control should already be obtained</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any projects built or operational to date</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Possibly wetland concerns for the site</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18155</b> [REDACTED] CTA** Development BESS Multiple options: [REDACTED] MW / [REDACTED] MWh / 2 hr [REDACTED] MW / [REDACTED] MWh / 4 hr** [REDACTED] MW / [REDACTED] MWh / 4 hr COD: 01/01/2022 or 01/01/2023** Term: 16 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Site control currently in negotiations with land owner</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any projects built or operational to date</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Permitting is in an early stage, however relatively further along than other BESS proposals</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18156</b>  Development BESS Multiple options: 1MW / 4 hr 1MW / 4 hr 1MW / 4 hr** COD: 09/30/2022** Term: 20 year**	<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on PSE property</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any BESS experience or projects built to date</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18157</b>  Development BESS Multiple options: 1MW / 4 hr 1MW / 4 hr 1MW / 4 hr** COD: 09/30/2022** Term: 20 year**	<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on private property adjacent to PSE substation</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any BESS experience or projects built to date</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18158</b>  Development BESS Multiple options: 1MW / 4 hr 1MW / 4 hr 100 MW / 4 hr** COD: 09/30/2022** Term: 20 year**	<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on PSE property</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any BESS experience or projects built to date</li> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.






**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18159</b>  CTA** or BTS Development Pumped Hydro  MW, 6.4 Hr daily storage COD: 03/30/2023 20 CTA term	<ul style="list-style-type: none"> <li>Counterparty has worked with reputable engineering firm for project development</li> </ul>	<ul style="list-style-type: none"> <li>Capital costs are significant and financing will be difficult and complex</li> <li>Technology is very new to PSE and North America and requires significant investigation</li> <li>Significant issues involving permitting and ongoing operation of the facility</li> <li>Transmission left to PSE would likely be very complex due to large capacity and bidirectional requirements</li> <li>Site control status is unknown</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18160</b>  CTA** or BTS Development Pumped Hydro  MW, 8.5 Hr COD: 03/30/2023 20 CTA term	<ul style="list-style-type: none"> <li>Major permitting hurdles, including FERC licensing, have been secured</li> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>Technology is very new to PSE and North America and requires significant investigation</li> <li>Transmission left to PSE would likely be very complex due to large capacity and bidirectional requirements</li> <li>Interconnecting resource into  might drive limitations on renewable energy development in Montana serving PSE load</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18161</b> <b>BPA Peak Capacity</b> Bonneville Power Administration PPA** Operational portfolio of projects 1000 MW** COD: 01/01/2022** Term: 5 year**	<ul style="list-style-type: none"> <li>Counterparty is well known with existing ties to PSE and therefore very limited risk for this proposal</li> <li>There are no permitting, real estate or community relations concerns as the proposal is based on currently operational projects</li> </ul>	<ul style="list-style-type: none"> <li>Delivery to Mid-C presents a major concern as delivery to Mid-C negates any incremental capacity value, as energy would have to rely on current Mid-C BPAT/PSEI paths to get back to PSE system.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	

\*\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

**REDACTED  
VERSION**





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18162</b>  REC purchase Operational portfolio of projects Start of term: 1/1/2022 10 year term		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Underlying projects are operational therefore no real estate, permitting, or community relations concerns</li> </ul>	<ul style="list-style-type: none"> <li>Other than low quantitative ranking, there are no major concerns with this proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized energy credit (“REC”) ranking.</p>
<b>18164</b>  REC purchase Underlying solar projects Start of term: 1/1/2026 13 year term		<ul style="list-style-type: none"> <li>Full site control for underlying projects is assumed</li> <li>Interconnection is secured</li> <li>REC delivery through WREGIS</li> </ul>	<ul style="list-style-type: none"> <li>Low-risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized energy credit (“REC”) ranking.</p>
<b>18167</b>  PPA Development Wind (Offshore) MW COD: 12/31/2029 Term: 25 year		<ul style="list-style-type: none"> <li>Developer demonstrates a relative high level of acumen in offshore wind development on the west coast</li> <li>West coast offshore wind could prove to be a viable resource in the future</li> <li>Developer has conducted extensive community and tribal outreach for this project</li> </ul>	<ul style="list-style-type: none"> <li>Considerable counterparty risk, including questionable ability to finance the project without considerable commitment and risk by PSE</li> <li>Leases are through the federal BOEM with a long process for obtaining and uncertain outcome</li> <li>Permitting is through the federal BOEM with a long process for obtaining and uncertain outcome</li> <li>Interconnection and energy delivery would be complex and will require extensive vetting</li> <li>Start of offer is well outside of the time scope of PSE’s 2018 All Resource RFP</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized energy credit (“REC”) ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE’s Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18168</b>  AAA Operating Wind IMW COD: 10/4/2020 5-year term	<ul style="list-style-type: none"> <li>Project is operating</li> </ul>	<ul style="list-style-type: none"> <li>Low-risk</li> <li>Start of term and duration do not match PSE's need as stated in the IRP and RFP</li> <li>Counterparty is potentially facing bankruptcy</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18171</b>  PPA Development Wind IMW COD: 12/31/2020** or 12/31/2021 Term: 20 year	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate and permitting appear to be sufficient at this stage of development</li> </ul>	<ul style="list-style-type: none"> <li>Proposal has expired as per the original proposal documentation (expired on 1/1/2019)</li> <li>Complicated delivery to PSE likely required</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18172</b>  PPA Developmental Wind IMW COD: 1/1/2021 15 or 20** year term	<ul style="list-style-type: none"> <li>is a large publically traded company with a solid balance sheet and solid credit rating</li> <li>Long-term site control is secured</li> <li>Community relations was well addressed in the proposal and well-exceeds the EFSC requirements</li> </ul>	<ul style="list-style-type: none"> <li>Relative to most of their endeavors, is relatively inexperienced with renewable energy</li> <li>Permitting schedule is aggressive and will be difficult to achieve as proposed</li> <li>has reportedly been a difficult interconnection counterparty to work with</li> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18174</b>  PPA** or BTS Developmental Wind for  MW COD: 1/1/2020** or 2021 30 year term		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>County will likely be supportive of wind development</li> </ul>	<ul style="list-style-type: none"> <li> is owned by  a vertically integrated company in  that has experienced significant financial issues</li> <li>CTS option was not quantified, and energy delivery and REC creation will be difficult as proposed</li> <li>Proposal does not adequately address permitting requirements</li> <li>It is unclear as to whether proposer has engaged local land owners</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low realized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18177</b>  DAS or BTS Developmental Wind for  MW COD: Q4 2020		<ul style="list-style-type: none"> <li>Long-term site control has been achieved</li> <li>Mid-C delivery seems viable</li> <li>Community relations was well-addressed in the proposal</li> <li>The permitting process seemed relatively mature</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to quantitatively assess the project</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this proceed past Stage 1 of the RFP. There are several qualitative concerns evaluated in this proposal regarding the counterparty, financing, interconnection, and energy delivery. However, the primary fatal flaw is that capital and ongoing O&amp;M costs are assumed to be facilitated directly by PSE, but no capital cost estimates were issued with the proposal. Without this information, the RFP team is unable to sufficiently assess the proposal quantitatively.</p>
<b>18178</b>  PPA Developmental Wind for  MW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Balance sheet financing is great, assuming parent company is willing to guarantee the project</li> <li>Long-term site control is secured</li> <li>Interconnection studies through BPA are complete</li> <li>Community relations plan seems sufficient, but requires more detail</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery left to PSE and appears to be overly expensive or otherwise infeasible</li> <li>Permitting plan requires significant development</li> <li>Company is relatively unknown to PSE and not much background information was provided</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low realized portfolio benefit over renewable energy credit ("REC") ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18180</b>  PPA Developmental Wind IMW COD: 1/1/2021 or 2022 20 year term	<ul style="list-style-type: none"> <li>Long-term site control is apparently secured</li> <li>Interconnection studies through BPA are complete</li> <li>Project received Washington State EFSEC in 2012 after a contentious permitting process</li> </ul>	<ul style="list-style-type: none"> <li>This would be [REDACTED] first experience in the Pacific Northwest</li> <li>Insufficient detail regarding company financial health and project financing strategy was included in the proposal</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Significant reputational issues with proximity to local fisheries as well as blocking a view of the Columbia River Gorge</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18181</b>  PPA** or BTS Developmental Wind IMW COD: 12/12/2020 20 year term	<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control is secured</li> <li>Interconnection process with BPA is well underway</li> <li>There are nearby wind farms, not many residential neighbors, and the RFP team believes the local community and government support solar development</li> <li>Permitting plan has minimal detail and represents a schedule and feasibility risk for the project</li> </ul>	<ul style="list-style-type: none"> <li>Long-term firm point-to-point transmission appears to not be feasible</li> <li>Community relations was not addressed in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18182</b>  PPA**, DAS, or BTS Developmental Wind IMW COD: 12/01/2022 20 year term	<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Permitting is early in process but presents little schedule or viability risk</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Community and government relations is supposedly strong, but little detail was provided to support it</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18183</b>  PPA** Developmental Wind MW COD: June 2020 10 or 15 year term		<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to quantitatively or qualitatively assess the project</li> </ul>	<b>Not selected</b> – Beyond a discussion of potential agreement terms, the proposal did not include enough detail to sufficiently assess on either a qualitative or quantitative basis. The RFP team does not recommend this proposal move beyond the first phase of the RFP process.
<b>18184</b>  PPA Developmental Solar + BESS MW & optional MW or MW MW, 2 or 4** Hr, BESS COD: 10/31/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Site control projected to be achieved by Q2 2019</li> </ul>	<ul style="list-style-type: none"> <li>RFP team could not confirm interconnection queue position asserted in the proposal</li> <li>Energy delivery would likely need to be periodically curtailed</li> <li>The permitting plan is largely undeveloped, and there are potential issues with wetlands and Mazama Pocket Gophers that threaten project viability and schedule</li> <li>There are potential glare issues with local roadway in the City of [REDACTED]</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.
<b>18185</b>  PPA Developmental Wind MW COD: 12/31/2020 20 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Letter of intents have indicated likely site control in the near future</li> <li>Backup point of interconnection at [REDACTED] is likely a feasible energy delivery option</li> <li>Permitting is in the early stages, but since only construction permits will be required it represents a low risk</li> </ul>	<ul style="list-style-type: none"> <li>[REDACTED] intends to secure [REDACTED] point-to-point transmission with [REDACTED] and [REDACTED] but have not yet taken steps to secure it</li> <li>Community and government relations was not adequately assessed in the proposal, but presents only a minor risk for the project as renewable energy is seen in a generally positive light</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.




**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18186</b>  15-yr/20-yr PPA, Development, Wind Up to 1MW COD: 1/1/2021 Term:		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Interconnection studies with BPA are complete, and an engineering and procurement agreement is soon to be secured</li> <li>Real-time delivery to PSE will not be necessary to secure RECs since the project is within BPA's regional territory</li> <li>Project appears to be fully permitted, with the exception of ministerial approvals</li> </ul>	<ul style="list-style-type: none"> <li>Developer is relatively inexperienced at developing, permitting, construction, and operating generation sites</li> <li>Impact to local prime agricultural land might cause some local tension</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized energy credit ("REC") ranking.</p>
<b>18187</b>  PPA, Developmental Solar + BESS, 1MW Solar & optional 1MW, 2** or 4 Hr, BESS COD: 10/31/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility or cost risk</li> <li>Permitting process has not appreciably started, but represents a slight schedule and feasibility risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized energy credit ("REC") ranking.</p>
<b>18188</b>  EPC, Development Reciprocating Thermal, 1MW Dual Fuel or 1MW Single Fuel COD: 4/15/2021		<ul style="list-style-type: none"> <li>Expansion of existing site rather than a new thermal facility.</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate with other sites.</li> <li>Project could likely be facilitated with firm gas supply with existing facilities.</li> </ul>	<ul style="list-style-type: none"> <li>Air permit path is complex and possibly not feasible.</li> <li>The likely-to-be-required air permit modification could bring more operational constraints for the existing generation units.</li> <li>PSE will experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's thermal generation portfolio.</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, the proposed schedule and general project feasibility seem to be in question.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18189</b> 	<ul style="list-style-type: none"> <li>Developer has experience in BESS projects, particularly with integration and control software</li> <li>Location at [REDACTED] site may offer development synergies, however, [REDACTED] may be complicated with location [REDACTED]</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone BESS proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18200</b> 	<ul style="list-style-type: none"> <li>Detailed project implementation plan and schedule provided</li> <li>Minimum PSE engagement</li> <li>Seamless customer interruption</li> <li>Strong parent company financials</li> <li>Past [REDACTED] program experience (90,000 units)</li> </ul>	<ul style="list-style-type: none"> <li>Lack of demonstrated winter peaking experience</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18202</b> 	<ul style="list-style-type: none"> <li>Vendor can also monitor and control load control switches: EVs, Solar PV, energy storage, building controls, HVAC and other demand side assets</li> </ul>	<ul style="list-style-type: none"> <li>Solution seems limited in its initial deployment</li> <li>Seems optimistic as to resource availability</li> <li>Lack of demonstrated program experience</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18203</b> Behavioral demand response 100% Residential IMW COD: 1/1/2019 Term: 5 years	<ul style="list-style-type: none"> <li>Existing working relationship with PSE on other energy efficiency projects</li> <li>Cumulative 1.5M utility customer</li> </ul>	<ul style="list-style-type: none"> <li>Program is day-ahead and limits peak capacity contribution</li> <li>Lack of demonstrated winter peaking experience</li> <li>Aggressive program benefit assumption to roll out 375k customers to achieve [redacted] MW of savings</li> </ul>	<ul style="list-style-type: none"> <li>Heavy PSE involvement for marketing, Data, Customer Service</li> <li>Program is day-ahead and limits peak capacity contribution</li> <li>High counter-party risk as being a small private consulting company</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18204</b> EMIS and traditional demand response programs IMW COD: 1/1/2019 Term: 5 years	<ul style="list-style-type: none"> <li>EMIS technology and program has longer term impact and savings averaging 3.5% across the board due to behavioral changes</li> <li>Experience with Winter DR programs</li> </ul>	<ul style="list-style-type: none"> <li>Mixed program contribution to peak capacity could limit program effectiveness</li> <li>Very expensive pricing</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18205</b> Commercial & industrial direct install ahead, and 10-min ready MWs COD: 1/1/2019 Term: 5 Years	<ul style="list-style-type: none"> <li>Utilize existing relationship</li> <li>Over [redacted] MW DR under management (self-claimed)</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>		

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Bid to sell  
 DAS Development asset sale  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit



\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results in Section C.2]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>UP001</b>  CTA or BTS** Development Pumped Hydro 100 MW, 6.4 Hr daily storage COD: 03/30/2023 20 CTA term	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to qualitatively assess the project</li> <li>Insufficient data to quantitatively assess CTA</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>	
<b>UP002</b>  REC purchase Underlying operating solar project RECS per year Start of term: 2020 9-year or 14-year term	<ul style="list-style-type: none"> <li>Not applicable<sup>1</sup></li> </ul> <p><sup>1</sup>Proposal was submitted late in Phase 1 (Feb. 7, 2018) when PSE was finalizing its Phase 1 results. PSE quantitatively screened the two offers, but neither offer was quantitatively competitive with PSE's other renewable resource alternatives. Had the proposal fared better in the quantitative analysis, an assessment of its qualitative merits and risks would have followed.</p>	<ul style="list-style-type: none"> <li>Price is higher and volume is smaller than other REC offers received in response this RFP.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>	

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
DAS	Development asset sale
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**

*2018 RFP Evaluation Process Document*

## C.2 Phase 1 Standalone Portfolio Analysis Results

2018 RFP Phase I Quantitative Results Summary - Renewable Resource (results as of 4/2/2019)

Project ID	Project Nameplate	Levelized Cost \$/MWh	Allscenarios \$/MWh	Net Cost	Portfolio Benefit / REC			Portfolio Benefit / Ratio			Net Cost / REC				
					NO CO2 \$/REC	Societal \$/REC	NO CO2 Rank	NO CO2 Rank	Societal Rank	NO CO2 \$/REC	Societal \$/REC	NO CO2 Rank	NO CO2 \$/REC	Societal \$/REC	NO CO2 Rank
18169		18	5	1	2	1	7.9	-2.7	-1.6	9	39	103	5	4	3
18170		3	5	2	9	13	-6.7	-3.3	-1.5	10	37	112	5	9	10
18171		3	5	3	4	6	-11.8	-4.8	-1.8	25	23	112	5	12	5
18172		3	5	4	11	16	-14.2	-5.2	-2.2	36	16	112	5	17	5
18173		3	5	5	6	10	-15.8	-5.2	-3.1	20	36	112	5	16	6
18174		3	5	6	3	5	-10.8	-2.2	-1.4	8	43	114	5	2	6
18175		3	5	7	10	18	-12.8	-3.1	-1.4	6	38	118	5	7	8
18176		3	5	8	41	45	-5.9	-4.4	-6.0	39	19	118	5	23	104
18177		3	5	9	17	15	-22.1	-6.6	-1.1	21	47	109	5	11	106
18178		3	5	10	6	13	-9.9	-3.6	-1.7	27	31	109	5	11	106
18179		3	5	11	6	13	-9.9	-3.6	-1.7	27	31	109	5	11	106
18180		3	5	12	1	2	5.0	-2.6	-1.5	43	40	108	5	3	2
18181		3	5	13	45	136	6.1	4.8	1.5	37	78	160	5	120	185
18182		3	5	14	29	137	6.1	5.3	1.4	36	76	164	5	113	184
18183		3	5	15	14	64	-1.1	-3.1	-1.1	4	86	111	5	11	111
18184		3	5	16	15	26	-8.8	-3.6	-1.4	3	34	113	5	11	111
18185		3	5	17	12	15	52.6	-3.6	-1.5	21	35	111	5	10	12
18186		3	5	18	13	14	27.2	-3.8	-1.5	22	30	105	5	15	13
18187		3	5	19	84	133	3.7	-4.4	-1.7	41	86	137	5	112	181
18188		3	5	20	1	1	-4.1	-4.1	-4.1	1	1	1	5	1	1
18189		3	5	21	7	5	-2.0	11.0	11.0	75	61	127	5	83	175
18190		3	5	22	151	134	6.5	1.4	1.7	34	138	136	5	110	179
18191		3	5	23	54	49	3.3	-21.9	-1.8	51	7	91	5	39	37
18192		3	5	24	18	21	18.2	-4.3	-1.6	24	27	104	5	17	16
18193		3	5	25	3	1	3.1	-1.6	-1.6	2	1	1	5	1	1
18194		3	5	26	80	35	11.1	-4.4	-1.6	26	26	106	5	22	22
18195		3	5	27	14	7	8.7	-3.6	-1.5	29	32	106	5	13	14
18196		3	5	28	27	29	3.1	7.8	-3.2	55	65	39	5	98	67
18197		3	5	29	26	101	4.3	-11.8	-1.1	45	8	119	5	34	35
18198		3	5	30	2	2	8.4	-4.1	-1.1	4	1	1	5	1	1
18199		3	5	31	28	74	1.5	94.6	-2.2	49	55	544	5	64	49
18170	COMMON III SUBJECT														
18170		19	5	32	37	27	8.5	-9.8	-1.7	12	112	94	5	30	21
18171		3	5	33	24	110	6.3	-5.7	-4.5	35	21	36	5	21	111
18172		3	5	34	39	111	6.0	-8.4	-4.7	38	14	28	5	28	113
18173		3	5	35	11	11	8.1	-4.1	-1.1	11	1	1	5	1	1
18174		3	5	36	69	25	8.5	-4.7	-1.6	48	39	63	5	138	26
18175		3	5	37	68	56	28.8	4.7	-3.1	58	80	44	5	115	75
18176		3	5	38	38	34	8.6	-8.9	-1.5	30	13	107	5	29	18
18177		3	5	39	72	97	1.4	3.7	-3.6	63	36	3	5	132	84
18178		3	5	40	1	1	-1.0	0.0	0.0	10	10	10	5	1	1
18179		3	5	41	43	36	1.1	2.0	22.9	101	123	124	5	134	102
18180		3	5	42	62	36	2.5	20.5	-1.8	64	57	92	5	87	12
18181		3	5	43	21	32	1.8	6.0	-2.2	81	71	72	5	102	58
18182		3	5	44	48	44	2.5	-10.5	-1.7	65	9	97	5	33	31
18183		3	5	45	73	77	3.7	3.1	-1.1	11	11	11	5	106	125
18184		3	5	46	58	13	1.1	3.0	-17.3	91	101	101	5	106	125
18185		3	5	47	87	135	5.4	4.3	1.6	42	87	138	5	113	182
18186		3	5	48	40	123	3.8	-8.0	-12.4	48	16	5	5	26	124
18187		3	5	49	65	28	7.7	-10.1	-1.6	32	11	98	5	35	20
18188		3	5	50	52	72	2.5	11.6	2.5	66	60	10	5	91	59
18189		3	5	51	11	11	11.1	-4.1	-1.1	4	1	1	5	1	1
18190		3	5	52	38	65	3.8	-6.6	-1.6	47	18	102	5	7	8
18191		3	5	53	51	54	1.1	2.6	-2.7	116	112	59	5	147	80
18192		3	5	54	95	159	1.2	1.6	N/A	109	130	5	5	167	78
18193		3	5	55	61	40	2.5	22.9	-2.1	61	36	5	5	85	48
18194		3	5	56	11	11	11.1	-4.1	-1.1	4	1	1	5	1	1
18195		3	5	57	88	66	1.5	2.4	-5.3	93	115	22	5	149	107
18196		3	5	58	73	47	2.0	8.2	-1.9	72	63	5	5	92	46
18197		3	5	59	60	68	2.2	6.3	-3.6	70	69	5	5	100	90
18198		3	5	60	38	124	4.0	-7.5	-9.8	46	17	2	2	25	122
18199		3	5	61	11	11	11.1	-4.1	-1.1	4	1	1	5	1	1
18200		3	5	62	64	48	2.1	6.1	-2.9	71	70	5	5	101	69
18201		3	5	63	53	19	1.8	3.8	-2.7	82	91	5	5	137	52
18202		3	5	64	82	61	2.6	-16.9	-2.4	59	1	67	5	43	51
18203		3	5	65	122	141	2.5	1.6	0.1	61	131	102	5	157	191
18204		3	5	66	10	10	10.1	-4.1	-1.1	4	1	1	5	1	1
18205		3	5	67	135	135	3.0	4.4	N/A	124	137	88	5	172	88
18206		3	5	68	128	148	1.0	1.1	N/A	123	144	5	5	173	77
18207		3	5	69	49	52	2.9	-69.7	-1.8	57	2	87	5	41	44
18208		3	5	70	67	53	2.6	-65.7	-1.9	60	3	84	5	42	46
18209		3	5	71	9	9	9.1	-4.1	-1.1	4	1	1	5	1	1
18210		3	5	72	89	58	2.2	4.8	-2.1	69	79	5	5	104	95
18211		3	5	73	93	71	1.2	1.8	-11.7	107	125	5	5	163	118
18212		3	5	74	81	77	1.7	4.3	-2.8	86	88	5	5	31	31
18213		3	5	75	74	46	2.2	16.1	-2.1	68	56	5	5	88	88
18214		3	5	76	36	36	3.0	3.0	3.0	115	126	5	5	167	79
18215		3	5	77	25	74	1.9	10.8	-2.1	78	62	5	5	90	90

REDACTED  
VERSION

REDACTED  
VERSION

Project ID	Project	Nameplate	Levelized Cost \$/MWh	Portfolio Benefit / REC			Portfolio Benefit Ratio			Net Cost/REC			Societal Rank
				NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	
18162			5	118	78	118	2.5	1.8	1.5	62	126	101	150
18163			5	79	90	82	1.9	5.8	-2.3	77	72	91	70
18164			5	80	66	67	1.5	4.5	-3.0	92	84	81	95
18165			5	101	5	77	1.9	3.3	-2.2	79	117	102	117
18166			5	81	77	84	1.9	3.3	-2.2	79	117	102	117
18167			5	82	104	96	2.0	3.0	-2.5	73	102	83	122
18168			5	83	104	96	2.0	3.0	-2.5	73	102	83	122
18169			5	105	5	70	1.5	4.5	-3.1	94	85	94	99
18170			5	84	59	70	1.5	4.5	-3.1	94	85	94	99
18171			5	85	91	85	1.9	5.5	-2.3	80	74	74	73
18172			5	86	20	30	1.9	5.5	-2.3	80	74	74	73
18173			5	87	20	30	1.9	5.5	-2.3	80	74	74	73
18174			5	88	79	75	1.0	2.0	-0.0	117	122	111	84
18175			5	88	79	75	1.0	2.0	-0.0	117	122	111	84
18176			5	111	5	80	1.2	6.3	-2.4	106	67	65	107
18177			5	90	92	80	1.2	6.3	-2.4	106	67	65	107
18178			5	114	5	11	1.1	5.0	-2.2	111	77	74	116
18179			5	91	46	11	1.1	5.0	-2.2	111	77	74	116
18180			5	115	5	115	1.0	4.0	-1.5	119	116	101	123
18181			5	93	42	5	0.8	1.0	N/A	139	81	78	128
18182			5	94	25	28	0.9	5.4	-2.8	127	75	50	118
18183			5	95	135	78	1.0	3.4	-2.1	122	96	70	127
18184			5	96	94	98	1.3	3.3	-0.0	102	107	96	124
18185			5	97	104	106	1.1	3.3	-0.0	102	107	96	124
18186			5	98	85	83	1.1	2.4	-5.2	115	116	105	127
18187			5	99	32	27	0.9	4.1	-4.9	130	89	139	139
18188			5	100	30	41	0.9	4.6	-4.7	129	82	126	126
18189			5	101	96	89	1.4	4.6	-2.3	96	81	74	103
18190			5	102	96	89	1.4	4.6	-2.3	96	81	74	103
18191			5	103	111	154	1.3	2.3	N/A	103	119	144	144
18192			5	104	120	147	1.3	1.7	N/A	105	128	154	154
18193			5	105	98	91	0.9	1.5	-1.7	132	134	165	165
18194			5	106	69	72	1.3	3.4	-3.4	104	95	24	95
18195			5	107	73	68	1.4	2.9	-2.7	107	87	100	100
18196			5	108	106	97	1.4	2.9	-2.7	107	87	100	100
18197			5	109	107	87	0.9	2.7	-5.7	131	109	135	135
18198			5	110	86	62	1.1	4.6	-2.5	113	83	66	66
18199			5	111	99	99	1.1	3.1	-2.8	110	101	101	97
18200			5	112	100	100	1.1	2.9	-4.0	114	104	104	104
18201			5	113	100	100	1.1	2.9	-4.0	114	104	104	104
18202			5	114	105	86	1.0	2.8	-2.3	118	108	70	105
18203			5	115	108	105	1.0	2.6	-3.6	121	113	135	135
18204			5	116	55	51	3.4	-30.1	-1.9	50	6	38	45
18205			5	117	110	100	1.0	2.3	-3.6	119	118	103	103
18206			5	118	110	100	1.0	2.3	-3.6	119	118	103	103
18207			5	119	101	155	0.9	2.9	N/A	128	106	133	133
18208			5	120	141	116	1.0	1.0	-6.0	120	147	116	116
18209			5	121	121	95	0.8	1.7	-2.7	135	127	58	58
18210			5	122	115	104	0.7	1.7	-11.7	140	141	171	168
18211			5	123	115	104	0.7	1.7	-11.7	140	141	171	168
18212			5	124	123	109	0.8	1.6	-5.5	134	129	156	156
18213			5	125	130	117	0.4	0.7	5.9	151	158	182	173
18214			5	126	112	68	0.7	1.3	-7.0	141	140	170	109
18215			5	127	126	107	0.6	1.1	-15.3	143	145	175	169
18216			5	128	127	106	0.5	1.0	-10.0	147	148	176	172
18217			5	129	150	136	0.8	0.7	-5.2	137	137	131	81
18218			5	130	129	112	0.3	0.4	1.1	158	148	166	120
18219			5	131	145	120	0.9	0.8	-0.8	133	154	164	123
18220			5	132	138	126	0.3	0.4	1.1	154	166	186	187
18221			5	133	144	124	0.3	0.4	1.1	154	166	186	187
18222			5	134	117	78	1.4	1.9	-1.6	95	59	86	87
18223			5	135	125	103	0.6	1.2	-11.0	146	142	169	119
18224			5	136	136	121	0.6	1.0	-36.4	142	149	168	126
18225			5	137	127	106	0.5	1.0	-10.0	147	148	176	172
18226			5	138	138	122	0.5	1.0	-10.0	147	148	176	172
18227			5	139	134	114	0.5	1.1	-8.9	149	146	166	120
18228			5	140	132	114	0.3	0.5	1.4	155	162	166	166
18229			5	141	137	119	0.3	0.7	2.8	157	155	179	188
18230			5	142	83	140	0.2	0.6	0.1	163	159	180	178
18231			5	143	139	132	0.3	0.5	3.0	162	161	191	195
18232			5	144	147	131	0.3	0.5	2.2	156	161	177	176
18233			5	145	149	131	0.3	0.5	2.2	160	164	180	180
18234			5	146	124	129	0.4	1.3	-8.5	153	139	180	178
18235			5	147	142	139	0.6	1.4	-0.2	144	124	176	176
18236			5	148	138	125	0.3	0.8	-1.0	151	148	183	183
18237			5	149	146	114	0.3	0.9	-5.6	153	153	188	188
18238			5	150	143	146	0.1	0.5	1.9	166	169	197	197
18239			5	151	133	152	N/A	0.3	N/A	188	188	194	194
18240			5	152	153	149	N/A	0.1	N/A	188	188	194	194
18241			5	153	154	142	N/A	0.1	N/A	188	188	194	194
18242			5	154	154	142	N/A	0.1	N/A	188	188	194	194
18243			5	155	155	144	N/A	0.0	N/A	188	188	194	194
18244			5	156	156	149	N/A	N/A	N/A	188	188	194	194
18245			5	157	157	149	N/A	N/A	N/A	188	188	194	194
18246			5	158	158	146	N/A	N/A	N/A	188	188	194	194
18247			5	159	159	146	N/A	N/A	N/A	188	188	194	194
18248			5	159	158	146	N/A	N/A	N/A	188	188	194	194

REDACTED  
VERSION

REDACTED  
VERSION



# 2018 RFP Phase I Quantitative Results Summary - Capacity Resource (results as of 4/2/2019)

Project ID	Project	NAMEPLATE	Levelized Cost		Portfolio Benefit / kW-yr			Net Cost / kW-yr			
			All Scenarios \$/MWh	Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-Societal \$/kW-yr	NO CO2 Rank	CO2 Fee Rank	Societal Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-Societal \$/kW-yr
18169			\$	16	1	2	2	1	1	2	2
18169			\$	27	2	3	3	10	3	3	3
18173			\$	50	3	1	1	6	1	1	1
18176			\$	32	4	4	4	3	4	4	6
18173			\$	47	5	5	5	4	5	5	4
18100			\$	98	6	6	6	46	28	7	7
18105			\$	150	7	10	9	2	8	11	11
18105			\$	162	8	9	15	5	12	18	18
18105			\$	160	9	8	8	7	9	9	9
18105			\$	157	10	14	11	12	15	12	15
18170			\$	42	11	11	12	9	15	12	15
18105			\$	161	12	7	8	8	7	10	10
18201			\$	25	13	13	16	13	16	19	19
18201			\$	25	14	17	17	11	10	14	14
18201			\$	117	15	17	20	15	10	14	14
18104			\$	117	16	16	18	14	17	16	16
18202			\$	114	17	21	25	17	25	13	13
18104			\$	114	18	19	19	18	19	21	21
18201			\$	151	19	24	26	16	22	29	29
18105			\$	154	20	20	21	19	22	29	29
18105			\$	154	21	23	23	20	24	25	25
18104			\$	155	22	27	22	21	30	26	26
18104			\$	155	23	26	24	23	27	27	27
18104			\$	156	24	28	28	24	33	34	34
18145			\$	92	25	31	29	22	32	32	32
18104			\$	38	26	57	53	26	38	28	28
18104			\$	156	27	57	53	26	38	28	28
18159			\$	156	29	37	27	25	40	33	33
UP001			\$	156	30	36	30	27	41	37	37
18203			\$	156	31	51	37	30	48	5	5
18156/18158			\$	156	32	46	34	28	47	40	40
18157			\$	158	33	45	34	29	46	42	42
18145			\$	158	34	44	61	32	52	48	48
18156/18158			\$	158	35	80	74	31	59	51	51
18188			\$	158	36	42	62	33	56	49	49
18157			\$	158	37	52	36	33	42	46	46
18157			\$	158	38	41	63	35	56	49	49
18156/18158			\$	158	39	48	80	36	54	47	47
18157			\$	158	40	66	61	37	55	50	50
18156/18158			\$	158	41	35	82	39	55	50	50
18145			\$	158	42	95	71	48	66	66	66
18157			\$	158	43	62	83	41	66	66	66
18156/18158			\$	158	44	34	56	40	60	64	64
18188			\$	159	45	56	45	43	60	64	64
18157			\$	159	46	38	58	42	59	51	51
18107			\$	114	47	29	7	38	26	8	8
18144			\$	114	48	53	42	44	49	53	53
18147			\$	114	49	49	32	45	53	39	39
18157			\$	114	50	43	77	47	43	35	35
18157			\$	114	51	61	79	49	44	38	38
18156/18158			\$	114	52	54	87	52	66	76	76
18156/18158			\$	114	53	25	104	63	18	87	87
18156/18158			\$	114	54	88	70	53	99	77	77
18156/18158			\$	114	55	59	33	51	64	61	61
18200			\$	114	56	81	50	50	84	44	44
18152			\$	114	57	58	38	54	62	54	54
18147			\$	114	58	30	97	55	62	54	54
18156/18158			\$	114	58	30	97	55	62	54	54

REDACTED VERSION

REDACTED VERSION

Project ID	Project	NAMEPLATE	Levelized Cost All Scenarios \$/MWh	Portfolio Benefit / kW-yr			Net Cost / kW-yr		
				NO CO2 \$/kw-yr	CO2 Fee \$/kw-Societal \$/kw-yr	NO CO2 Rank	NO CO2 \$/kw-yr	CO2 Fee \$/kw-Societal \$/kw-yr	NO CO2 Rank
18157				59	103	86	65	63	65
18157				60	99	98	57	71	68
18156 / 18158				61	22	99	58	23	70
18147				62	60	39	60	65	55
18157				63	93	72	70	77	67
18157				64	97	100	61	73	72
18152				65	87	35	56	58	44
18155				66	64	40	62	68	57
18205				67	72	49	59	72	71
18155				68	65	41	64	69	60
18156 / 18158				69	19	95	66	21	56
18157				70	96	96	69	61	58
18146				71	63	67	68	14	62
18145				72	40	68	67	92	17
18155				73	71	44	71	74	63
18143				74	76	47	73	80	75
18151				75	83	65	72	85	84
18154				76	75	46	74	79	69
18157				77	106	102	80	82	82
18154				78	77	48	76	81	74
18152				79	90	57	75	94	86
18152				80	70	76	79	78	79
18148				81	79	69	77	34	73
18146				82	82	51	78	87	78
18154				83	86	52	81	93	81
18155				84	89	54	83	95	85
18143				85	66	43	82	67	59
18152				86	84	55	84	91	83
18154				87	92	60	86	98	88
18154				88	91	64	88	97	89
18154				89	94	73	91	100	91
18204				90	67	101	90	75	94
18149				91	98	66	90	101	92
18155				92	73	105	97	86	99
18149 / 18153				93	100	75	92	102	93
18154				94	101	78	94	103	96
18143				95	55	90	93	57	95
18149				96	47	88	95	45	97
18149				97	104	93	96	106	109
18160				98	33	89	98	35	103
18189				99	69	103	99	70	100
18149 / 18153				100	78	85	100	83	101
18150				101	105	106	101	89	102
18149 / 18153				102	102	84	102	104	98
18160				103	74	91	103	76	80
18150				104	85	92	104	88	104
18150				105	90	94	105	88	104
18189				106	107	107	104	50	108
18159							107	107	107
18161	BPA Peak Capacity Product								
18143									

REDACTED VERSION

REDACTED VERSION

Notes  
1. Ranking color scheme: green is high ranking, red is low ranking.  
2. Grayed out lines at towards the bottom of the list indicate either withdrawn proposals or proposals with fatal flaws.  
3. Energy storage proposals have N/A value for levelized cost since the energy storage proposal is net user of energy it does not have levelized cost in \$/MWh.

*2018 RFP Evaluation Process Document*

## Appendix D. Phase 2 Results and Phase 2 Update Results (the “Re-evaluation”)



*2018 RFP Evaluation Process Document*

## D.1 Phase 2 Executive Summary



## 2018 RFP – Executive Summary\*

Quantitative results are the product of analysis performed in PSM III version 25.13.

### Phase 2 Candidate Short List: Proposals selected for contracting phase of RFP

Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18100</b> <b>SPI Burlington Biomass</b> Sierra Pacific Industries PPA Operational biomass 17 MW nameplate PPA start: 01/01/2021 Term: 17 years capacity	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$14.132 M Levelized PB/REC: \$ [REDACTED] *** Peak capacity PB / kW-Yr: [REDACTED] Net cost PV: \$33.613 M Peak capacity contribution (MW): 16.4 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Existing/operating facility so no development risk</li> <li>Biomass project is REC producing</li> <li>High effective load-carrying capability (ELCC), i.e. contribution to peak capacity need</li> <li>Interconnected onto PSE's system</li> </ul>	<ul style="list-style-type: none"> <li>Sierra Pacific Industries is a privately held company, so less financial information is available than if it were public</li> <li>A disruption of mill operations would likely impact long-term operation of the facility</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.

REDACTED VERSION

<b>Common acronyms:</b>	
BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
DAS	Development asset sale
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18161</b> <b>BPA Peak Capacity</b> Bonneville Power Administration PPA** Operational portfolio of projects 100 MW** PPA start: 01/01/2022** Term: 5 years**	Levelized cost: \$ / MWh Portfolio benefit: \$(8,028 M) Peak capacity PB / kW-Yr: \$ / kW-Yr Net cost PV: \$25,426 M Peak capacity contribution (MW): 100 Annual REC contribution: 0	<ul style="list-style-type: none"> <li>Counterparty is well known with existing ties to PSE and, therefore, very limited risk for this proposal</li> <li>There are no permitting, real estate or community relations concerns as the proposal is based on currently operational projects</li> <li>As a response to data requests, Bonneville Power Administration (BPA) moved their delivery/location from Mid-C to BPA-T,PSEI</li> </ul>		<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.
<b>18169</b> [Redacted] PPA** or 50% ownership+PPA Development wind [Redacted] MW** or [Redacted] MW COD: 12/31/2021** Term: 20 or 25** years	Levelized cost: \$ / MWh Portfolio benefit: \$417,294 M Levelized PB/REC: \$ / MWh Peak capacity PB / kW-Yr: \$ / kW-Yr Net cost PV: \$24,422 M Peak capacity contribution (MW): [Redacted] Annual REC contribution: [Redacted]	<ul style="list-style-type: none"> <li>Relatively cost efficient way to contribute towards both the REC and contribution to peak capacity need</li> <li>Large and experienced counterparty</li> <li>Site control is reportedly achieved, but supporting documentation was not included in proposal</li> <li>Public has been notified of the project as a MW facility</li> <li>Shape of wind based on 6 operating meteorological towers appears to fit well with PSE's needs</li> </ul>	<ul style="list-style-type: none"> <li>Lengthy gen-tie line for which site-control has not yet been fully obtained</li> <li>Transmission from [Redacted] to PSE brings both schedule and cost risk to PSE as the potential energy offtaker</li> <li>There is a potential permitting issue with sage grouse habitat</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to limitations between [Redacted] and [Redacted] projects are considered mutually exclusive.
<b>18170</b> <b>Golden Hills Wind</b> Avangrid Renewables [Redacted] PPA-shaped or Development wind 200 MW** COD: 12/31/2020** Term: 20 years**	Levelized cost: \$ / MWh Portfolio benefit: \$106,924 M Levelized PB/REC: \$ / MWh Net cost PV: \$74,948 M Peak capacity contribution (MW): 51.6 Annual REC contribution: [Redacted]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Shaped product offers capacity contribution during peak winter months</li> <li>Site control is achieved</li> <li>Permitting well advanced with Oregon Energy Facility Siting Council (EFSC) permit application already amended</li> </ul>	<ul style="list-style-type: none"> <li>Complex energy delivery will require additional vetting</li> <li>Complexity of shaped product will require additional vetting</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED VERSION

REDACTED VERSION



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<p>18173</p> <p>PPA** Development wind MW of MW COD: 10/31/2022** Term: 20 years**</p>	<p>Levelized cost: \$ / MWh</p> <p>Portfolio benefit: \$280.504 M</p> <p>Levelized PB/REC: ***</p> <p>Peak capacity PB / kW-Yr: [redacted]</p> <p>Net cost PV: \$116.358 M</p> <p>Peak capacity contribution (MW): [redacted]</p> <p>Annual REC contribution: [redacted]</p>	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Project may be sited on a single landowner's property, which would likely minimize real estate complexity</li> <li>Favorable state support; however, local level of support unknown</li> </ul>	<ul style="list-style-type: none"> <li>Project site may include Montana Department of Natural Resources and Conservation (DNRC) land, which could complicate site control and permitting</li> <li>Permitting is in a relatively early stage of development; risk of potential delay to scheduled COD</li> <li>Assumed use of [redacted] brings both schedule and cost risk to PSE as the potential energy off-taker</li> </ul>	<p><b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to available transmission capacity limitations between [redacted] and [redacted] land PSE, the [redacted] and [redacted] projects are considered mutually exclusive.</p>

REDACTED VERSION

REDACTED VERSION

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
DAS	Development asset sale
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Phase 2 proposals not selected for contracting phase of RFP

Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18103</b> <p>CTA** or asset transfer Operational combined cycle MW** or MW Start: 06/01/2022 Term: 10 years</p>	<p>Levelized cost: \$ / MWh</p> <p>Portfolio benefit: (\$29.120 M)</p> <p>Peak capacity PB / kW-Yr: [redacted]</p> <p>Net cost PV: \$163.748 M</p> <p>Peak capacity contribution (MW): [redacted]</p> <p>Annual REC contribution: [redacted]</p>	<ul style="list-style-type: none"> <li>Existing/operating facility (rather than new build) therefore no development risk</li> <li>Existing presence in the community with local opposition unlikely</li> </ul>	<ul style="list-style-type: none"> <li>High social cost of carbon adversely impacts project economics in certain quantitative scenarios</li> <li>In light of recently passed Clean Energy Transition Act (SB5116), advancement of this and other fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Lack of firm delivery of natural gas is a risk to the effective load-carrying capability (ELCC) of the project</li> </ul>	<p><b>Not Selected</b> – Project not selected during portfolio optimization process.</p>
<b>18105</b> <p>CTA** or BTS MW** or MW COD: 01/01/2022 Term: 5, 15, or 20** years</p>	<p>Levelized cost: \$ / MWh</p> <p>Portfolio benefit: (\$16.898 M)</p> <p>Peak capacity PB / kW-Yr: [redacted]</p> <p>Net cost PV: \$85.973 M</p> <p>Peak capacity contribution (MW): [redacted]</p> <p>Annual REC contribution: [redacted]</p>	<ul style="list-style-type: none"> <li>Proposed expansion of existing [redacted] may bring O&amp;M cost savings on a per-kW basis (versus an entirely new thermal facility)</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate at other sites</li> <li>MW proposal would likely be facilitated with firm gas supply from existing facilities</li> </ul>	<ul style="list-style-type: none"> <li>In light of recently passed Clean Energy Transition Act (Washington State Bill 5116), advancement of new fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Proposed project would require extensive integration with existing [redacted] the viability of which is unknown at this time</li> <li>Would require review and likely modification of air permit for co-located generation facility. Process expected to be exceedingly difficult and the outcome uncertain, with possible impacts to existing facility operational permits</li> <li>PSE will likely experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's CO<sub>2</sub> emitting portfolio</li> <li>Strong likelihood of considerable delays to COD due to expected public protest, litigation and permit process</li> </ul>	<p><b>Not Selected</b> – Project not selected due to qualitative risks.</p>

**Common acronyms:**  
 BESS Battery energy storage system  
 BtS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

*\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.*

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18107</b>  PPA** Operational hydro MW Start: 1/1/2021 (assumed) Term: 20 years (assumed)	Levelized cost: \$ / MWh Portfolio benefit: (\$36.163 M) Levelized PB/REC: ** Net cost PV: \$38.677 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>No development risk; project is an existing operating facility</li> <li>Clean energy (although not RPS compliant)</li> <li>Run-of-river hydro can be less environmentally impactful than standard hydro</li> <li>Little to no permitting or real estate risk due to current operational status</li> </ul>	<ul style="list-style-type: none"> <li>Run-of-river asset provides little capacity value. Not RPS compliant (although clean energy)</li> <li>Energy delivery strategy has been left to PSE, and appears to be complex</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and did not show potential during standalone quantitative analysis.
<b>18111</b>  PPA** Development solar Solar: MWac COD: 12/31/2022 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$107.686 M Levelized PB/REC: ** Net cost PV: \$51.359 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Relatively high quantitative score for solar project</li> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Site control has been achieved</li> <li>Permitting status is sufficient at this stage</li> <li>Located on PSE's system in County; avoids community concerns in County</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to available transmission capacity (ATC) constraints in area. Delivery is possible to Mid-C; however, may be difficult given project's proximity to the Rocky Reach substation</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18112</b>  PPA** Development solar Solar: n/a COD: n/a Term: n/a	Levelized cost: Portfolio benefit: N/A Levelized PB/REC: Net cost PV: N/A Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<b>Not Selected</b> – Project withdrawn by applicant.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 B1S Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18114</b>  PPA Solar generation Development Wind COD: 12/1/2021 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$45.772 M Levelized PB/REC: \$ / MWh Net Cost PV: \$36.011 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li> is assessed to be a relatively strong parent company</li> </ul>	<ul style="list-style-type: none"> <li>Environmental permitting not yet begun.</li> <li>Permitting will require the transfer of a Washington Energy Facility Site Evaluation Council (EFSEC) permit, which introduces a viability and reputational risk to the project and PSE</li> <li>Transmission and energy delivery may be overly expensive or otherwise infeasible</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Current site leases were executed for wind projects; it is not yet known whether or not land owners would be amenable to solar leases</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18122</b>  PPA**, optional BESS Development Wind MW** & MW 1 Hr BESS COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$32.877 M Levelized PB/REC: \$ / MWh Net Cost PV: \$35.687 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control for project site is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Solar development is viewed with skepticism in this area; history of active local opposition</li> <li>Site may block the view of a local real estate development</li> <li>Contribution to the peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18125</b>  PPA Development solar MW COD: 1/1/2023 Term: 15 or 20** years	Levelized cost: \$ / MWh Portfolio benefit: \$55.283 M Levelized PB/REC: \$ / MWh Net Cost PV: \$32.311 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> </ul>	<ul style="list-style-type: none"> <li>While interconnected to PSE's system, complex delivery due to available transmission capacity (ATC) constraints in the area</li> <li>Site permitting is in a relatively early stage of development</li> <li>Minimal information provided regarding community relations and or support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTIS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18127</b>  PPA Development solar MW <sub>s</sub> COD: 12/31/2022 Term: 15* or 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$119,579 M Levelized PB/REC: \$ / MWh *** Net Cost PV: \$60,272 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Extensive solar energy development experience; developed, currently owns and operates solar installation in Washington State</li> <li>Location on existing project site may provide economies of scale in developing and operating project</li> <li>County has expressed support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Potential siting risks given proximity to wind turbines with required setbacks</li> <li>Assumes use of with current landowners</li> <li>Interconnection and energy delivery assume use of PSE existing infrastructure and analysis assumes no coincidental curtailment due to overproduction between existing wind and proposed solar</li> <li>Conditional Use Permit (CUP) required to permit project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18131</b>  PPA** or BTS Development wind MW** or MW COD: 12/31/2022 Term: 25 years	Levelized cost: \$ / MWh Portfolio benefit: \$11,525 M Levelized PB/REC: \$ / MWh ** Net Cost PV: \$20,124 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Proposes to provide credit support in the form of a parent guarantee, letter of credit, or cash</li> <li>Long-term site control for most of the site is secured</li> <li>Community relations plan is strong compared to other proposals</li> </ul>	<ul style="list-style-type: none"> <li>Less experienced than other counterparties</li> <li>MW offer configuration would likely exceed available transmission capacity</li> <li>tribe may request compensation from project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18132</b>  PPA** Development wind MW COD: 01/01/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$61,479 M Levelized PB/REC: \$ / MWh *** Net Cost PV: \$20,702 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Repower of existing wind project; site control and community relations risks are unlikely</li> <li>Oregon Energy Facility Siting Council (EFSC) amendment secured during Phase 2 of the RFP</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Built to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

*\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.*





Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18135</b>  PPA** or BTS Development solar MW of solar Optional MW, 4-hr BESS COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$123.395 M Levelized PB/REC: \$ / REC Net Cost PV: \$5,724 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Large counterparty with experience all over the world</li> <li>Letter of intent with an option to lease has been signed for project lands</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Permitting plan is underdeveloped</li> <li>There is no site control for current generation-tie line alignment</li> <li>Project is on irrigated farmland--mitigation strategy not included in proposal, but developer has retained a "Seattle PR firm" for support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18139</b>  PPA Development solar MW solar* with optional MW of solar MW, 1.82-hr BESS COD: 1/1/2023 Term: 10 years	Levelized cost: \$ / MWh Portfolio benefit: \$26.120 M Levelized PB/REC: \$ / REC Net Cost PV: \$15.659 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Large multi-national counterparty with greater-than-average renewable development experience</li> </ul>	<ul style="list-style-type: none"> <li>Site control not yet secured and copy of anticipated letter of intent has not been provided</li> <li>Energy delivery has been left to PSE, appears to be complicated, and may pose a feasibility risk</li> <li>Respondent provided little to no evidence of a successful permitting strategy</li> <li>Community relations matters were not covered sufficiently, and tribal support may be required</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18163</b>  REC purchase Underlying solar projects RECS per year Start of term: 1/1/2022 Term: 18 years	Levelized cost: \$ / MWh Portfolio benefit: \$19.635 M Levelized PB/REC: \$ / REC Net Cost PV: \$2,412 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Interconnection at distribution voltage dictates that each as-generated MWh produces two Washington State RECs</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facilities</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED  
VERSION

REDACTED  
VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18165</b>  REC purchase underlying solar project PPA** Start of term: 1/1/2022** or 2024 Term: 16 or 18** years	Levelized cost: \$ / MWh Portfolio benefit: \$13.181 M Levelized PB/REC: \$*** Net Cost PV: \$1.755 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facility</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18166</b>  Development asset sale, BTS or PPA** Development wind MW COD: 12/1/2020, 2021*, or 2022 Term: 25 years	Levelized cost: \$ / MWh Portfolio benefit: \$114.836 M Levelized PB/REC: \$*** Net Cost PV: \$121.737 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Long-term site control established</li> </ul>	<ul style="list-style-type: none"> <li>Significant concerns regarding the counterparty's ability to develop, finance, and construct the facility</li> <li>Relatively small counterparty with inconclusive rights to the project's developmental assets</li> <li>Timing of project is contingent on Bonneville Power Administration (BPA) infrastructure upgrades to enable transmission capacity</li> <li>Project owner, [REDACTED], seemed uninterested in furthering project development via first-hand experience at [REDACTED] public hearing</li> <li>Timeline as-proposed is likely infeasible and pricing is likely contingent on timing due to production tax credit (PTC) safe harbor</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18175</b>  PPA, BTS**, or WSPF shaped Development wind MW COD: 1/1/2021 Term: 25 years	Levelized cost: \$ / MWh Portfolio benefit: \$176.514 M Levelized PB/REC: \$*** Peak capacity PB / kW-Yr: \$ Net Cost PV: \$177.135 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Western Systems Power Pool (WSPF) schedule C delivery is a unique value</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty and financing details will require data requests</li> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Mid-C delivery will likely be necessary, which would negate a contribution to PSE's peak capacity</li> <li>Permitting plan seems either underdeveloped or underrepresented in the proposal</li> <li>Outreach plan is underdeveloped</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED  
VERSION

REDACTED  
VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18176</b> 	Levelized cost: \$ [redacted] / MWh Portfolio benefit: \$135,600 M Levelized PB/REC: \$ [redacted] *** Peak capacity PB / kW-Yr: \$75.00 Net Cost PV: \$242524 M Peak capacity contribution (MW): [redacted] Annual REC contribution: [redacted]	<ul style="list-style-type: none"> <li>Indications of strong local, state and environmental support</li> <li>Counterparty has indicated a plan to partner and/or otherwise engage an experienced renewable energy developer on the project</li> <li>Potential to partner with a local Native American tribe</li> <li>Located near [redacted] and in the same County</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty does not have experience designing, financing, building, owning or operating a large scale renewable or other energy project</li> <li>Assumed use of [redacted] may be problematic for full proposed output</li> <li>Additional detail needed regarding the real estate and permitting considerations necessary for the site</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18179</b> 	Levelized cost: \$ [redacted] / MWh Portfolio benefit: \$70,371 M Levelized PB/REC: \$ [redacted] *** Net Cost PV: \$28,121 M Peak capacity contribution (MW): [redacted] Annual REC contribution: [redacted]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate appears adequate and relatively low risk</li> <li>Project size has been altered to address some local viewshed concerns</li> </ul>	<ul style="list-style-type: none"> <li>History of considerable local and county-level opposition to the project</li> <li>Counterparty bypassed the County permitting process by pursuing permit approval through the state's Washington Energy Facility Site Evaluation Council (EFSEC) process</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18190</b> 	Levelized cost: \$ [redacted] / MWh Portfolio benefit: \$46,975 M Levelized PB/REC: \$ [redacted] *** Net Cost PV: \$5,948 M Peak capacity contribution (MW): [redacted] Annual REC contribution: [redacted]	<ul style="list-style-type: none"> <li>Inexpensive RECs</li> <li>Site control is secured</li> <li>Washington Energy Facility Site Evaluation Council (EFSEC) projects have been approved by Governor Insee</li> </ul>	<ul style="list-style-type: none"> <li>Realizing full REC-output of underlying projects is unlikely due to interconnection issues</li> <li>[redacted] is currently in litigation with [redacted] over interconnection issues with the underlying projects</li> <li>[redacted] County opposes the EFSEC decision and has applied for judicial review</li> <li>Major feasibility concerns with some and schedule concerns for all of the underlying projects</li> <li>Projects sited on commercial agricultural land and many stakeholders in the county oppose development of these lands</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
DAS	Development asset sale
PPA	Power purchase agreement
REC	Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18201</b>  Direct load control Bring your own thermostat, smart water heater MW COD: 1/1/2023 Term: 6 years	Not applicable, please see selection recommendation & rational section to the right	<ul style="list-style-type: none"> <li>Described as an industry leader in a recent Navigant study</li> <li></li> <li> manages all program implementation</li> <li>Excellent financial strength, Washington based</li> <li>The  MW option makes it a small scale project well suited for conceptual testing</li> </ul>	<ul style="list-style-type: none"> <li>Proposal schedule includes significant ramp up of customer participation in first program year (2023); unclear if this is feasible</li> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.
<b>18205</b>  Commercial & industrial curtailment MW COD: 1/1/2021 Term: 5 years	Not applicable, please see selection recommendation & rational section to the right	<ul style="list-style-type: none"> <li>Winter peak experience</li> <li>Commercial and Industrial segment provides a diversification benefit</li> </ul>	<ul style="list-style-type: none"> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> <li>Counterparty has only been established since 2016, and has not been financially profitable.</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.
<b>UP002</b>  REC purchase RECs / year COD: 1/1/2020 Term: 15 years	<div style="border: 1px solid yellow; padding: 2px;">           Levelized cost: \$  / MWh            Portfolio benefit: \$4,502 M            Levelized PB/REC: \$  ***            Net Cost PV: \$1,155 M         </div> <div style="border: 1px solid blue; padding: 2px; margin-top: 5px;">           Peak capacity contribution (MW):             Annual REC contribution:  </div>	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Price is higher and volume is smaller than other REC offers received in response this RFP.</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTIS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 DAS Development asset sale  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<p>XXXXX  <b>Colstrip Transmission System Redirect</b>            Puget Sound Energy            N/A            Transmission redirect            MW: [REDACTED]            COD: 01/01/2022            Term: 55-year book life</p>	<p>Levelized cost: [REDACTED]            Portfolio benefit: \$57,274 M            Peak Capacity PB / kW-Yr: [REDACTED]***            Net Cost PV: \$27,905 M            Peak capacity contribution (MW): [REDACTED]            Annual REC contribution: [REDACTED]</p>	<ul style="list-style-type: none"> <li>If feasible, redirect to Mid-C would provide a strong capacity resource</li> </ul>	<ul style="list-style-type: none"> <li>Increased exposure to market prices (for redirect to Mid-C)</li> <li>Redirects require Available Transmission Capacity (ATC) between the new points of receipt and delivery. With no ATC between Mid-C and BPA/ PSEI, a redirect to Mid-C is unfeasible.</li> <li>Redirecting elsewhere on BPA's system would require appropriate ATC as well as an energy source at the redirect point, which may nullify contribution to peak capacity.</li> </ul>	<p><b>Not Selected</b> – Proposal withdrawn from consideration due to lack of Available Transmission Capacity (ATC).</p>

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
DAS	Development asset sale
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION

REDACTED  
VERSION

*2018 RFP Evaluation Process Document*

## D.2 Phase 2 Standalone Portfolio Analysis Results

# 2018 RFP Phase II Quantitative Results Summary- CAPACITY PROPOSALS

As of July 23, 2019

Primary Funding Classes  
Secondary Classes  
Credit Line

ID	Capacity Proposal Project Name	Technology	Term Start	Bank Contract Term	Nameplate Capacity (MW)	Peak Capacity Credit	Levelized PE (Peak Capacity kW - 1R)			Banking Levelized PE / yr			Net Cost/MW-yr			Rising Light Cost/MW-yr		
							NO CO2 (Low Use)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Use)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Cost)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Cost)	NO CO2 (Mid-Social)	NO CO2 (High-Social)
1	18170 Golden Hills Shared	WT	Dec-20	25	200 MW	78.8												
2	18109	WT	Dec-20	25	200 MW	78.8												
3	18100 SPI Industrial Biomass	Biomass	Jan-21	17	17.3 MW	16.4												
4	18173	WT Wind	Oct-22	20	MW													
5	18173	WT Wind	Oct-22	20	MW													
6	16161 BPA Peak Capacity Product	Capacity	Jan-22	5	100 MW	54.0												
7	18105	Thermal	Jan-22	20	W													
8	18103	Thermal	Jun-22	10	MW													
9	18105	Thermal	Jan-22	20	W													
10	18201	DR	Jan-23	6	W													
11	18205	DR	Jan-21	5	W													
12	18205	WT Wind	Dec-22	20	MW													
13	18205	WT Wind	Dec-22	20	MW													
14	18205	WT Wind	Dec-22	20	MW													
15	18205	WT Wind	Dec-22	20	MW													
16	18205	WT Wind	Dec-22	20	MW													
17	18205	WT Wind	Dec-22	20	MW													
18	18205	WT Wind	Dec-22	20	MW													
19	18205	WT Wind	Dec-22	20	MW													
20	18205	WT Wind	Dec-22	20	MW													

Notes:

- The metric shown - Levelized PE / (Peak Capacity kW - 1R) - is the portfolio benefit attributable to peak capacity service divided by the average peak capacity.
- Generation Resources with a peak capacity contribution (as described by ELCC, or Effective Load Carrying Contribution) of 30% or higher were considered "Capacity Resources".
- Generation Resources with Mid-C delivery are **not** considered Capacity Resources regardless of ELCC.
- Capacity-specific contracts and products such as Demand Response, Transmission Redirect, and BPA Capacity are considered alongside generation resources.
- None of the demand response projects in Phase II were selected, as there was no identifiable deferred TBD value that would have made it a cost effective solution. In addition, the providers' lack of experience in integrating with PG&E DERM (Distributed Energy Resource Management) system was deemed to be a critical hindrance to implementation.
- Transmission Redirect has been eliminated as a viable option to meet capacity need.
- All of the Demand Response projects were eliminated as viable options to meet capacity need.
- None of the Demand Response projects were eliminated as viable options to meet capacity need.

REDACTED VERSION

REDACTED VERSION

# 2018 RFP Phase II Quantitative Results Summary- RENEWABLE PROPOSALS

As of July 23, 2019



ID	Renewable Proposal Project Name	Technology	Form Name	Base Life Renewable Capacity (MW)	Verified PPA REC		Renewable PPA REC		Levelized PPA REC		Fixed PPA REC		Net Cost/REC		Renewable PPA REC					
					NO22 NO22 Low w/300 load	NO22 NO22 High w/300	NO22 NO22 Low w/300	NO22 NO22 High w/300	NO22 NO22 Low w/300	NO22 NO22 High w/300	NO22 NO22 Low w/300	NO22 NO22 High w/300	NO22 NO22 Low w/300	NO22 NO22 High w/300	NO22 NO22 Low w/300	NO22 NO22 High w/300				
1	18165	REC Only	Jan-22	18			1	3	24	34	36			8	3	15	26	32	31	
2	18166	REC Only	Jan-22	18			2	2	4	23	33	35			12	6	18	28	35	33
3	18190	REC Only	Jan-20	20			3	3	1	20	33	33			7	2	13	24	31	29
4	18190	MT Wind	Dec-21	25			24	4	6	1	1	1			1	1	1	1	1	1
5	18190	REC Only	Jan-20	15			19	5	14	26	32			9	4	16	27	33	32	
6	18190	REC Only	Jan-20	12			21	6	1	20	31	31			11	5	13	24	34	29
7	18178	MT Wind	Dec-21	20			30	7	18	13	4	2			7	20	19	10	4	2
8	18190	REC Only	Jan-20	20			5	8	10	15	20	19			13	13	13	13	13	13
9	18190	REC Only	Jan-20	20			6	6	10	11	4	3	5		6	6	6	6	6	6
10	18111	Solar	Dec-22	20			6	10	11	4	3	5			4	11	9	4	3	5
11	18127	Solar	Dec-22	15			11	11	24	6	8	7			10	15	24	6	7	8
12	18135	Solar	Jan-23	20			8	12	7	9	9	8			13	17	3	7	9	10
13	18125	Solar	Jan-23	20			10	10	13	8	10	10	11		14	18	4	8	10	11
14	18127	Solar	Dec-21	15			4	4	4	4	4	4			15	16	25	11	12	14
15	18132	Solar	Jan-23	20			4	15	12	2	5	4			11	11	11	11	11	11
16	18125	Solar	Jan-23	15			14	16	13	14	17	15			16	19	5	13	14	17
17	18178	MT Wind	Oct-21	20			27	17	23	19	14	13			21	21	21	21	21	21
18	18111	Solar	Dec-22	20			12	18	9	7	2				7	9	3	5	4	
19	18190	Solar	Jan-23	20			18	19	17	17	15	18			1	1	1	1	1	1
20	18132	Wind	Jan-21	10			9	20	15	5	13	14			7	7	7	7	7	7
21	18144	Solar	Dec-21	20			18	21	16	16	18	9			12	12	12	12	12	12
22	18144	Solar	Dec-21	20			18	21	16	16	18	9			12	12	12	12	12	12
23	18144	Solar	Dec-21	20			20	23	15	25	21	21			23	23	23	23	23	23
24	18152	Wind	Jan-21	25			13	24	20	11	16	17			22	22	22	22	22	22
25	18170	Wind	Dec-20	20			22	26	29	8	6	3			3	3	3	3	3	3
26	18170	Wind	Dec-20	20			22	26	29	8	6	3			15	15	15	15	15	15
27	18166	Wind	Jan-23	25			17	27	21	18	19	20			14	14	14	14	14	14
28	18166	Wind	Jan-23	25			23	28	30	30	26	26	2		29	29	29	29	29	29
29	18139	Solar + RES	Jan-23	10			35	29	22	22	22	22			19	19	19	19	19	19
30	18176	Wind	Jan-21	25			26	30	28	27	24	25			16	16	16	16	16	16
31	18166	Wind	Jan-22	25			34	31	33	33	29	29			27	27	27	27	27	27
32	18170	Wind	Dec-20	20			25	32	32	32	27	27			28	28	28	28	28	28
33	18170	Wind	Dec-20	20			29	33	19	28	17	16			24	24	24	24	24	24
34	18100 SPT Industrial Biomass	Biomass	Jan-21	17			31	34	35	34	23	28			30	30	30	30	30	30
35	18100 Gasbon Hill Solar	Wind	Dec-20	25			28	25	27	31	29	24			20	20	20	20	20	20
36	18170	Wind	Dec-20	20			28	25	27	31	29	24			20	20	20	20	20	20
37	18170	Wind	Dec-20	20			36	36	36	36	36	31			33	33	33	33	33	33
38	18190	MT Wind	Jan-21	20			36	36	36	36	36	31			34	34	34	34	34	34

Notes:  
 1. The metric shown--Levelized PPA / REC-- is the portfolio benefit attributable divided by RECs generated.  
 2. For generation resources with a peak capacity contribution (as described by ELCC, or Effective Load Carrying Contribution) of 3.2% or higher, the Renewable Portfolio Benefit was recomputed by isolating the portfolio benefit attributable to REC generation. Resources with an ELCC of 3.2% or higher are considered to have zero capacity value.  
 3.1. [Redacted] available option due to various qualitative factors, including indeterminate production capacity figures.

REDACTED VERSION

REDACTED VERSION



*2018 RFP Evaluation Process Document*

## D.3 Phase 2 Portfolio Optimization Analysis Results

# Portfolio Optimization Summary: as of 7.23.2019

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)	(N)
Project ID	Resource	Project	Nameplate	Peak Capacity	RECs <sup>1</sup>	Preferred Optimized Portfolio: MW + Renewables	As Proposed Optimized Portfolio: MW + Renewables	Optimized Lowest Cost Portfolio to Solve for 0 Capacity Deficit with Generic Battery	Contingency Portfolio: No MT Wind	Optimized Lowest Cost Portfolio with Carbon Consideration	Optimized Lowest Cost Portfolio with Carbon Consideration	Optimized Lowest Cost Portfolio with Carbon Consideration	Optimized Lowest Cost Portfolio with Carbon Consideration
1	18100	Biomass	SPI	17 MW	16 MW	X	X	X	X	X	X	X	X
2	18161	Call Option	BPA Peak Capacity Product	100 MW	53 MW	X	X	X	X	X	X	X	X
3a.	18169	MT Wind				X	X	X	X	X	X	X	X
3b.	18169	MT Wind				X	X	X	X	X	X	X	X
4a.	18173	MT Wind				X	X	X	X	X	X	X	X
4b.	18173	MT Wind				X	X	X	X	X	X	X	X
5a.	18170	Wind	Golden Hill Shaped	200 MW	77 MW	X	X	X	X	X	X	X	X
5b.	18170	Wind				X	X	X	X	X	X	X	X
6	18132	Wind				X	X	X	X	X	X	X	X
7	18179	Wind				X	X	X	X	X	X	X	X
8	18166	Wind				X	X	X	X	X	X	X	X
9	18175	Wind				X	X	X	X	X	X	X	X
10	18125	Solar				X	X	X	X	X	X	X	X
11	18111	Solar				X	X	X	X	X	X	X	X
12	18127	Solar				X	X	X	X	X	X	X	X
13	18135	Solar				X	X	X	X	X	X	X	X
14	18139	Solar				X	X	X	X	X	X	X	X
15	18131	Solar				X	X	X	X	X	X	X	X
16	18114	Solar				X	X	X	X	X	X	X	X
17	18122	Solar				X	X	X	X	X	X	X	X
18	18163	REC-only				X	X	X	X	X	X	X	X
19	18165	REC-only				X	X	X	X	X	X	X	X
20	UP-002	REC-only				X	X	X	X	X	X	X	X
21	18103	Thermal				X	X	X	X	X	X	X	X
22	XXXXX	Generic	Generic Peaker	237 MW	224 MW	X	X	X	X	X	X	X	X
23	XXXXX	Generic	Generic Battery	61 MW	23 MW	X	X	X	X	X	X	X	X
24						X	X	X	X	X	X	X	X
25						X	X	X	X	X	X	X	X
26						X	X	X	X	X	X	X	X
27						X	X	X	X	X	X	X	X
28						X	X	X	X	X	X	X	X
29						X	X	X	X	X	X	X	X
30						X	X	X	X	X	X	X	X
31						X	X	X	X	X	X	X	X

Peak Capacity and REC Need	2022	2023	2024	2025
Peak Capacity Need	289 MW	291 MW	328 MW	457 MW
REC Need	0	2,352,449	891,684	700,452

1. The annual project RECs in column I does not include 0.2X accreditation multiplier.  
 2. The optimization model chose a portfolio with [REDACTED] submitted proposals for both [REDACTED] MW and [REDACTED] MW, but no [REDACTED] MW. The [REDACTED] MW option based on available transmission capacity. The 350MW option will have to be negotiated with NextEra. Current indicative results reflect pricing based on the 300MW offer.  
 3. The current project COD for [REDACTED] is Dec 2024. There has been perceived timing risks for PSE to secure long-term transmission rights to bring the energy home. If the COD is delayed to Dec 2022 to mitigate this risk, NPV of \$35M increase in total PPA costs is projected. The next highest ranked portfolio [REDACTED] is [REDACTED] M more expensive than the recommended portfolio, yet sharing the same timing risks on transmission.  
 4. Final Portfolio EICC reduces the sum of individual project peak capacity contribution by 6 MW. It could potentially be mitigated by 1) short-term capacity purchase for [REDACTED] per year; 2) a [REDACTED] MW battery for [REDACTED] M.  
 5. Social cost of carbon at \$96/metric ton in 2010 dollars plus escalation is added to total portfolio costs as fixed cost.

REDACTED VERSION

REDACTED VERSION

*2018 RFP Evaluation Process Document*

## D.4 Phase 2 Update Portfolio Optimization Analysis Results

# Portfolio Optimization Summary: as of 11.21.2019

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)
List ID	Project Resource	Project Nameplate	Peak Capacity Credit	REC's	Recommended Portfolio: Renewables	Backup Portfolio: Renewables	Contingency Portfolio: No MT Wind	Optimized Least Cost Portfolio with NO Carbon Consideration	Optimized Least Cost Portfolio with Carbon Consideration		
1	18100 Biomass	SPI	17 MW	18 MW	X	X	X	X	X		
2	18161 Call Option	BPA Peak Capacity Product	100 MW	53 MW	X	X	X	X	X		
3a.	18169 MT Wind				X	X	X	X	X		
3b.	18169 MT Wind				X	X	X	X	X		
4a.	18173 MT Wind				X	X	X	X	X		
4b.	18173 MT Wind				X	X	X	X	X		
5a.	18170 Wind	Golden Hills Shaped	200 MW	77 MW	X	X	X	X	X		
5b.	18170 Wind				X	X	X	X	X		
6	xxxx System PPA	Morgan Stanley Sys PPA	100 MW	81 MW	X	X	X	X	X		
7	18132 Wind				X	X	X	X	X		
8	18179 Wind				X	X	X	X	X		
9	18106 Wind				X	X	X	X	X		
10	18175 Wind				X	X	X	X	X		
11	18125 Solar				X	X	X	X	X		
12	18111 Solar				X	X	X	X	X		
13	18127 Solar				X	X	X	X	X		
14	18135 Solar				X	X	X	X	X		
15	18139 Solar				X	X	X	X	X		
16	18131 Solar				X	X	X	X	X		
17	18114 Solar				X	X	X	X	X		
18	18122 Solar				X	X	X	X	X		
19	18163 REC-only				X	X	X	X	X		
20	UP-002 REC-only				X	X	X	X	X		
21	18103 Thermal				X	X	X	X	X		
22	XXXXX Thermal				X	X	X	X	X		
23	XXXXX Generic	Generic Peaker	237 MW	N/A							
24	XXXXX Generic	Generic Battery	175 MW	N/A							
25											
26											
27											
28											
<b>Total Peak Capacity Credits - MWs</b>					2,189,656	1,773,109	1,297,005	1,419,658	2,405,449		
<b>Portfolio Benefits - \$M</b>					\$879	\$619	\$739	\$926	\$658		
<b>Portfolio Benefits w/ Carbon Costs as an Adder - \$M</b>					\$1,179	\$945	\$827	\$1,046	\$1,206		

Peak Capacity and REC Need 2022-2025	2022	2023	2024	2025
Peak Capacity Need	299 MW	292 MW	358 MW	477 MW
REC Need	0	233,449	691,864	700,482

1. The annual project REC's in column G do not include 0.2X apprenticeship multiplier.  
 2. The social cost of carbon at \$62/metric ton in 2007 dollars plus escalation is added to the total portfolio costs as a fixed cost. Sources: UTC docket U-190730, Sept 12, 2019.  
 3. Emission rate of 0.437 metric tons of CO2/MWh for market purchases is included in social cost of carbon calculation.



REDACTED VERSION

REDACTED VERSION

*2018 RFP Evaluation Process Document*

## Appendix E. Quantitative Evaluation Process

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

#### **2019 IRP update since completing the 2018 RFP:**

PSE conducted its 2018 RFP evaluation between August 2018 and July 2019, in parallel with its 2019 integrated resource planning (“IRP”) process. Many of the 2018 RFP modeling assumptions were updated to reflect 2019 IRP assumptions vetted by the IRPs public stakeholder groups, the IRP Advisory Group (“IRPAG”) and the Technical Advisory Group (“IRTAG”). At the time, the 2019 IRP was expected to be filed in January 2020.

Subsequent to completing the 2018 RFPs, PSE was asked by the WUTC to withhold its next IRP until an upcoming rulemaking could incorporate Washington’s new Clean Energy Transformation Act (“CETA”) into Chapter 480-100-238 WAC (“the Integrated Resource Planning rule”) and Chapter 480-107 WAC (“the Resource Acquisition rule”). This document reflects what PSE knew at the time the RFP evaluation was conducted.

PSE’s 2018 RFP evaluation process includes a two-step approach designed to identify and evaluate the most promising proposals in the context of the utility’s overall portfolio of assets. Each phase has a qualitative and a quantitative component, and each proposal is evaluated in a manner designed to consider the benefits, risks and costs of the proposal. This appendix describes the quantitative analysis components of the RFP evaluation process.

## **1. Models and Assumptions**

### **Models and metrics**

PSE used two primary models to perform the quantitative analysis for its 2018 RFP: PSE’s portfolio screening and optimization model (PSM III) and the Aurora dispatch model. This section describes at a high level our models and metrics. For a more robust discussion of the models, how they interact and help us to evaluate resources, see Appendix N to the 2017 IRP.

#### **Aurora dispatch model**

The Aurora dispatch model analyzes the western power market to produce hourly electricity price forecasts of potential future market conditions and resource dispatch. PSE used Aurora to develop Mid-Columbia (“Mid-C”) market power prices for its pricing scenarios (described on pages 6 and 7). Power prices were based on capacity expansion power price run modeled for the entire WECC region, which included assumptions for gas prices, regional load, renewable portfolio standards for multiple states, carbon taxes, resource assumptions and hydro shaping. The resulting prices were used in the Aurora input price run to isolate PSE’s portfolio as a price taker.

The Aurora results provide several key inputs for PSM III, including estimates of energy output by resource, variable costs or dispatch costs (fuel and variable O&M), emissions, and market purchases and sales.

APPENDIX E. QUANTITATIVE EVALUATION PROCESS


**Portfolio Screening Model (PSM III)**

PSM III is a Microsoft Excel-based capacity expansion model developed by PSE to evaluate the incremental cost and risk of a wide variety of resource alternatives and portfolio strategies. At a high level, the model calculates the long-term revenue requirements of PSE’s incremental generic power portfolio based on the 2017 IRP resource strategy and a current outlook on the Company’s capacity, renewable and energy needs. Generic resources are then replaced in the model with a specific proposal or combination of proposals from the 2018 RFP to measure the impact on PSE’s overall portfolio cost. Step 1 (individual proposal screening) evaluates the incremental cost and benefit impact on the portfolio of replacing a generic resource (or resources) with a single RFP proposal, and ranks the results for that proposal compared to all other RFP alternatives. Step 2 (portfolio optimization) evaluates the incremental impact on the portfolio of replacing all generic resources with a combination of RFP resources to meet the resource needs established in the RFP. The results of different combinations of resources are compared and the model identifies an optimal portfolio that best meets both the Company’s RPS-driven renewable and capacity resource needs at the lowest reasonable cost.

**Incremental cost includes:** (i) the variable fuel cost and emissions for PSE’s existing fleet, (ii) the variable cost of fuel emissions and operations and maintenance for new resources, (iii) the fixed depreciation and capital cost of investments in new resources, (iv) the market purchases or sales in hours when resources are deficient or surplus to PSE’s need, and (v) end effects with replacement resources.

Figure 1 is a flow chart diagram depicting the information flow between PSM III and Aurora to calculate the optimal portfolio within PSM III. The diagram depicts both the financial component and the optimization component of PSM III. The financial component aggregates the cost and calculates the unique revenue requirement for each individual project. The optimization function identifies the optimal portfolio to meet PSE’s resource needs at the lowest reasonable cost.

Figure 1. *Information flow between PSM III and Aurora*

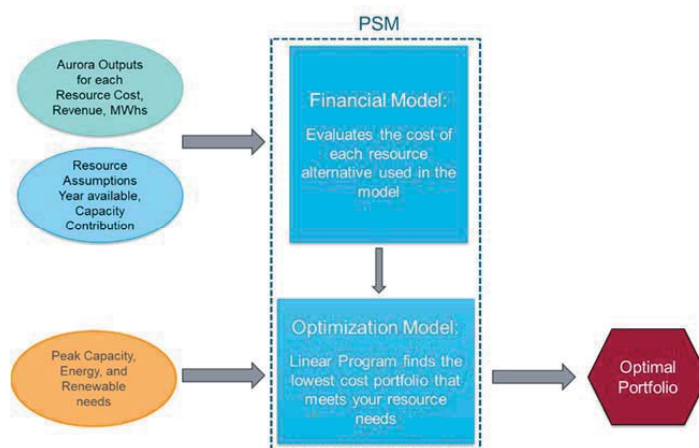

The interaction between PSM III and Aurora can also be described in terms of the costs they account for in the analysis. Figure 2 depicts the cost inputs analyzed by PSM III and Aurora.

## APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Figure 2. *Cost inputs analyzed by PSM III and Aurora*

PSM <i>Fixed costs</i>	Aurora <i>Variable costs</i>
<ul style="list-style-type: none"> <li>• Capital costs               <ul style="list-style-type: none"> <li>• Return on capital (rate base)</li> <li>• Depreciation</li> </ul> </li> <li>• Fixed O&amp;M</li> <li>• PPA pricing</li> <li>• Transmission</li> <li>• Avoided T&amp;D costs</li> <li>• Pipeline costs</li> <li>• Property taxes</li> <li>• Insurance</li> <li>• Federal income tax               <ul style="list-style-type: none"> <li>• Tax incentives (PTC &amp; ITC)</li> <li>• Tax depreciation</li> <li>• Deferred taxes</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>• Fuel costs</li> <li>• Variable O&amp;M</li> <li>• Variable transmission</li> <li>• Carbon pricing</li> <li>• Startup costs</li> <li>• Plant technical information               <ul style="list-style-type: none"> <li>• Capacity (ISO &amp; 23<sup>rd</sup>)</li> <li>• Heat rates</li> <li>• Forced and planned outages</li> <li>• Renewable output</li> <li>• Emissions</li> </ul> </li> </ul>

**Frontline Systems Risk Solver Platform**

PSE's analysis is designed to produce a least-cost mix of resources using a linear programming, dual-simplex method that minimizes the present value of portfolio costs subject to meeting capacity and renewable portfolio standard constraints. PSE uses the Frontline Systems Risk Solver Platform ("Risk Solver") for the linear programming optimization. Risk Solver is an Excel add-in that pairs with PSM III. Key inputs used by Risk Solver include:

- Variable fuel cost, O&M and market value offset for output from existing and new resources (from Aurora)
- Fixed O&M
- Capital cost of new resources
- Book and Tax depreciation
- Transmission costs
- Gas transportation costs
- Social cost of carbon
- Peak capacity credit
- Renewable energy credit
- Market power purchases and sales
- Taxes and tax incentives for production tax credits and investment tax credits
- End effects after 20-year for resources added to the portfolio
- Financial assumptions (i.e., cost of capital, depreciation and escalation rates)
- Emissions



APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Specific details about the PSM III model are presented in Appendix N to the 2017 Integrated Resource Plan.

**Screening model metrics**

PSM III calculates five metrics used by PSE to assess the relative competitiveness of individual proposals: portfolio benefit,<sup>1</sup> levelized cost, levelized portfolio benefit per kW-yr or REC, levelized net cost per kW-yr or REC. Figure 3 defines each of the five metrics used to screen and rank the proposals.

PSE’s analysis relies on multiple metrics because each metric provides a slightly different perspective on the economic benefits associated the proposals. No one metric fully reflects all of the costs and benefits of an individual proposal, or allows us to compare resources with different attributes on an apples to apples basis. For example, levelized cost of energy is a traditional metric used by the industry to compare resource costs; however, this metric does not take into account a resource’s contribution toward meeting PSE’s physical capacity or renewable energy resource needs.

Figure 3. *Key metrics produced by PSM III*

- **Portfolio Benefit (\$):** difference between the net present value portfolio revenue requirement with the proposed project in the portfolio replacing an equivalent amount of generic resource, and the net present value portfolio revenue requirement of the all generic portfolio. (Higher is better. Useful for comparing projects with the same winter capacity value or the same contribution to meeting PSE’s renewable energy target.)
- **Levelized Cost (\$/MWh):** the net present value of the proposed project’s revenue requirement divided by the net present value of the proposed project’s generation. (Lower is better. Useful for comparing projects that have the same or similar operating characteristics.)
- **Levelized portfolio benefit per Renewable Energy Credit (\$PB/REC):** a project’s portfolio benefit divided by the net present value of the project’s contribution to PSE’s renewable energy target. (Higher is better. Useful for comparing different project sizes and technologies.)
- **Levelized portfolio benefit per unit of Levelized Peak Capacity (\$PB/Peak Capacity kW-yr):** A project’s portfolio benefit divided by the present value of the peak capacity contribution. (Higher is better. Useful for comparing different project sizes and technologies.)
- **Levelized net cost per Renewable Energy Credit (\$/kW-yr or \$/REC):** difference between the net present value project revenue requirement and the net present value market revenue of the project’s generation divided by the net present value of the project’s capacity contribution. If a renewable project is being considered, then the numerator is divided by the net present value of the project’s contribution to PSE’s renewable energy target. (Lower is better. Useful for comparing different project sizes and technologies.)

---

<sup>1</sup> PSE’s analysis calculated the portfolio benefit with and without the social cost of carbon. Carbon cost assumptions are discussed on pages 9 and 10.

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Key Assumptions

The Company filed its most recent integrated resource plan with the Washington Utilities and Transportation Commission (“WUTC”) in November 2017 and performed its 2018 RFP analysis between August 2018 and June 2019. The RFP team performed its RFP analysis in parallel with the development of PSE’s anticipated 2019 IRP. As a result, many of the modeling assumptions used in the RFP analysis evolved during the evaluation process. Subsequent to completing its RFP analysis in June and receiving management approval in July 2019 to begin negotiation discussions with selected, PSE received two new unsolicited proposals and several pricing updates from 2018 RFP respondents. PSE performed a re-evaluation of its resource alternatives between August and November 2019, which included updated optimization analysis, as shown in Figure 4.

PSE updated its modeling assumptions for each phase of the RFP evaluation to reflect then-current conditions. In general, key assumptions were refreshed on an as-needed basis prior to each phase of the RFP, although, some assumptions were updated during the phases as new information became available. Figure 4 depicts generally the timing and nature of these updates relative to the RFP timeline.

Figure 4. *Timing of key assumptions updates during the RFP evaluation process*

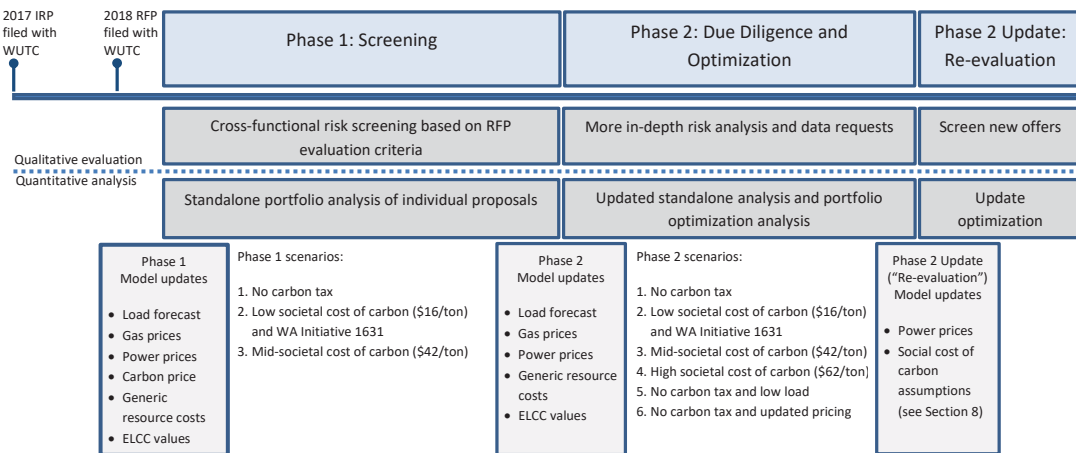


Table 1 shows how three key assumptions—gas prices, power prices and load forecasts—have changed since the 2017 IRP was filed. Forecast levelized Mid-C power prices dropped nearly \$17/MWh between the 2017 IRP and completion of the RFP analysis. Forecast levelized gas prices dropped a little more than \$0.50/mmbtu between the 2017 IRP and the end of the RFP. Overall, average annual load growth assumptions also dropped 0.2 percent between the 2017 IRP filing and the end of the RFP.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Table 1. *Comparison of Key Modeling Assumptions: 2017 IRP and 2018 RFP*

Modeling Assumption	2017 IRP (filed Nov. 2017)	RFP Phase 1 (Aug. 2018 – Mar. 2019)	RFP Phase 2 (Apr. 2019 – Jul. 2019)	Phase 2 Update (Aug. 2019 – Nov. 2019)
Mid-C power prices levelized	\$40.48/MWh	\$33.92/MWh	\$28.75/MWh	\$23.66/MWh
Gas prices levelized	\$4.02/mmbtu	\$3.74/mmbtu	\$3.50/mmbtu	No change
Annual average load growth	0.7%	0.5%	0.5%	No change


The underlying forecasts for these assumptions are presented in the discussion that follows. Additional assumptions discussed in this appendix include carbon costs, generic resource costs, generic peak capacity contributions by resource type and general location, transmission system deferral values assumed for storage and demand response proposals, and flexibility values assumed for storage resources.

#### Power Price Forecasts

As described on page 1 of this appendix, the 2018 RFP analysis uses the Aurora dispatch model to forecast wholesale power prices for the WECC region and the Mid-C. Power prices for the 2018 RFP were developed using the same methodology used by the Company in its integrated resource planning process. A description of this methodology is provided in Appendix N to PSE’s 2017 IRP.

PSE updated its power prices subsequent to the 2017 IRP three times during the RFP analysis process: prior to Phase 1, prior to Phase 2 and again for its Phase 2 Update (the “re-evaluation”). The last forecast includes in its assumptions the adoption of Washington state SB 5116, the Clean Energy Transformation Act (“CETA”). Figure 5 compares the 2017 IRP forecast to those used in the RFP analyses.

Figure 5. *Comparison of IRP and RFP power price assumptions*

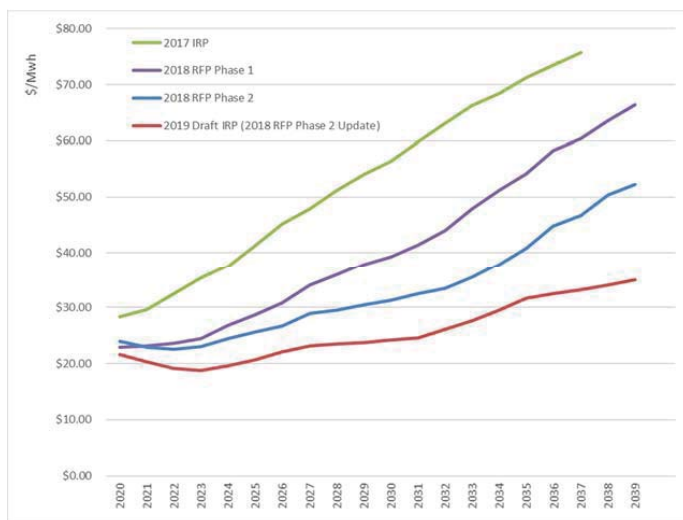


## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

In Phase 2, PSE added two additional power price forecasts to its base forecast to test the impact of different power prices on proposals. Figure 6 shows the range of Phase 2 power prices tested, which were consistent with then-current draft 2019 IRP power price assumptions. The *RFP Phase 1 – No Carbon* power price is consistent with the draft 2019 IRP *Base + No CO2* price scenario. The *RFP Phase 2 - Low* price is consistent with the draft 2019 IRP *Low* price scenario. The *RFP Phase 2 - No Carbon Price Update* includes updated natural gas prices and California Senate Bill 100 (“SB 100”), which mandates 100 percent renewable power generation in the state by 2045. The 2018 RFP prices assume a 50 percent renewable portfolio standard (“RPS”) for California by 2030.

Figure 6. *Range of power price forecasts tested in Phase 2*

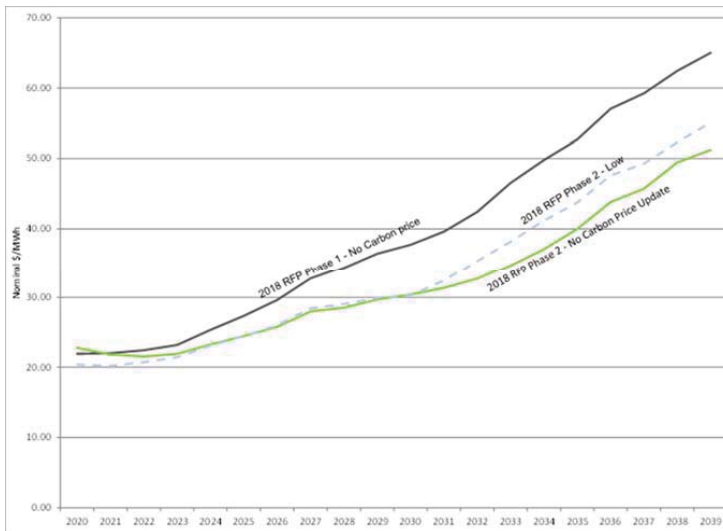


#### Natural Gas Price Forecasts

The 2018 RFP analysis used Wood Mackenzie gas price forecasts. Gas prices were updated twice subsequent to the 2017 IRP filing, prior to RFP Phase 1 and again prior to RFP Phase 2. Figure 7 compares the 2017 IRP gas prices to the draft 2019 IRP gas prices, which were also used in the 2018 RFP analysis.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Figure 7. *Comparison of 2017 and draft 2019 IRP gas prices*

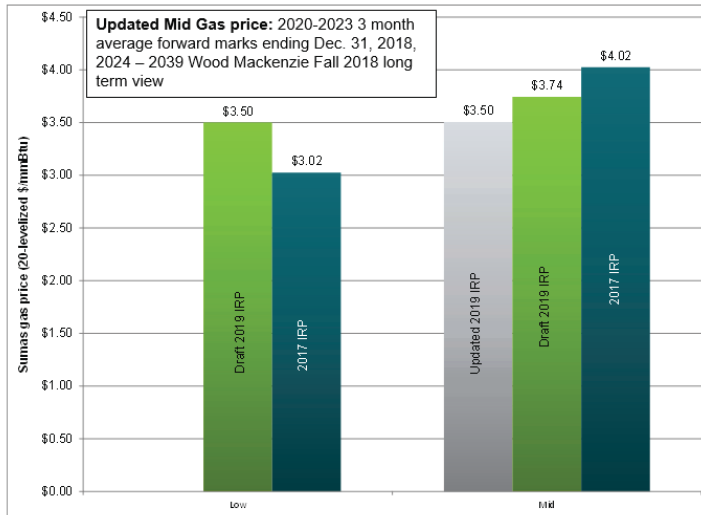

PSE's RFP gas price assumptions were based on then-current 2019 IRP gas price forecasts as described below.

- The **2017 IRP gas prices** were based on 2018 to 2021 three-month average forward marks ending November 27, 2016, and on the 2022 to 2037 Wood Mackenzie Fall 2016 long-term forecast.
- The **2019 draft IRP gas prices (also used for RFP Phase 1)** were based on 2020 to 2023 three-month average forward marks ending June 29, 2018, and on the 2024 to 2039 Wood Mackenzie Spring 2018 long-term forecast.
- The **2019 IRP updated gas price (also used for RFP Phase 2)** was based on 2020 to 2023 three-month average forward marks ending December 31, 2018, and on the 2024 to 2039 Wood Mackenzie Fall 2018 long-term forecast.


## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

#### Load forecasts

Load forecast modeling and methodologies are consistent with those described in Appendix E to PSE's 2017 IRP. Prior to each phase of the RFP, PSE updated its model to reflect the Company's most current load forecast information. PSE used the F2018 load forecast in its Phase 1 analysis and the F2019 load forecast in its Phase 2 analysis.

Figure 8. *Load forecast assumptions*

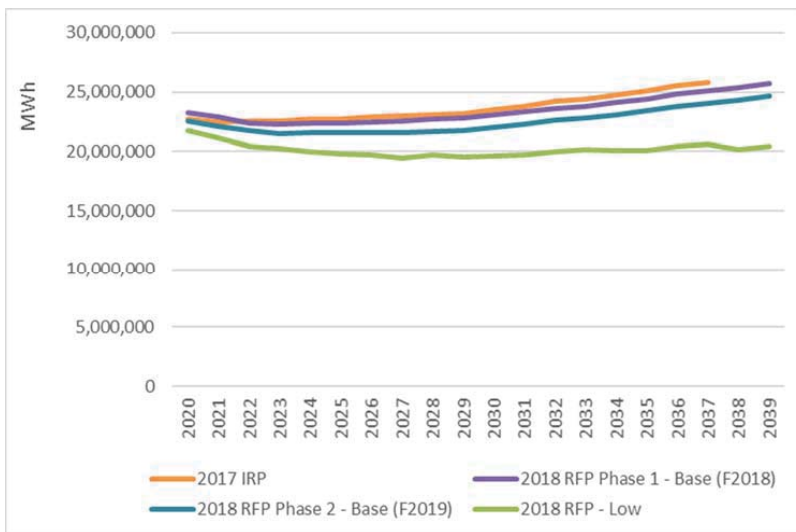

#### Carbon price forecasts


The carbon price forecasts used in the 2018 RFP are consistent with those used for the 2017 IRP. The Base + Washington Carbon forecast is based on a state carbon tax proposed in Initiative 1631, which failed to pass at the ballot box in November 2018. The Base + Social CO2 Mid forecast and Base + Social CO2 High forecasts are based on analysis presented in the U.S. Government's Interagency Working Group on Social Cost of Greenhouse Gases' 2016 report.<sup>2</sup>

<sup>2</sup> "Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis Under Executive Order 12866, Interagency Working Group on Social Cost of Greenhouse Gases," United States Government, Aug. 2016.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Figure 9. *2018 RFP carbon price assumptions*

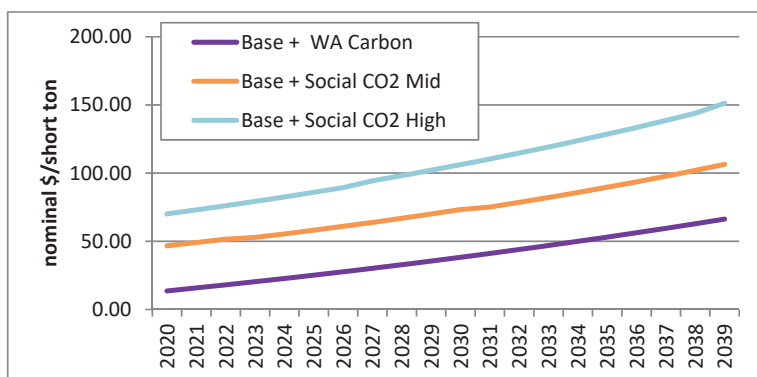

PSE updated its social cost of carbon assumptions in its Phase 2 Update analysis (the “re-evaluation”), which was conducted between August and November 2019. These updates were made to incorporate Washington Utilities and Transportation Commission (“WUTC”) guidance in WUTC docket U-190730, dated September 12, 2019.

The updates include a 2.5 percent discount rate scenario and 0.437 ton/MWh market purchase carbon intensity, consistent with guidance from the U.S. Government’s 2016 *Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis Under Executive Order 12866*. Figure 10 is an excerpt from the technical support document (originally Figure ES-1). The highlighted column reflects assumptions used in re-evaluation analysis.

Figure 10. *Social Cost of CO<sub>2</sub>, 2010 – 2050 (in \$2007 per metric ton of CO<sub>2</sub>)*

Year	5% Average	3% Average	2.5% Average	High Impact (95 <sup>th</sup> Pct at 3%)
2010	10	31	50	86
2015	11	36	56	105
2020	12	42	62	123
2025	14	46	68	138
2030	16	50	73	152
2035	18	55	78	168
2040	21	60	84	183
2045	23	64	89	197
2050	26	69	95	212

#### Generic resource cost assumptions

Generic resource capital costs are updated biennially as part of PSE’s integrated resource planning process. The planning team hired HDR to perform a cost analysis to develop generic resource costs for its 2019 IRP. HDR produced its report (referred to in tables 2 and 3 below as the “draft report”) prior to the beginning of the 2018 RFP. The RFP Phase 1 generic resource cost assumptions are based on the costs

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

reflected in this report. Table 2 compares the generic resource costs assumed in the 2017 IRP to those assumed in draft 2019 IRP (also used for Phase 1 of the 2018 RFP).

Table 2. *Generic resource costs: 2017 IRP vs. draft 2019 IRP (also used for RFP Phase 1)*

2018 \$/kW	2017 IRP			Draft 2019 IRP			Cost change from 2017 IRP to Draft 2019 IRP		
	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	All in Costs
CCCT	\$1,020	\$358	\$1,378	\$898	\$269	\$1,167	(\$122)	(\$89)	(\$211)
Frame Peaker (Fuel Fuel)	\$526	\$172	\$698	\$554	\$271	\$825	\$28	\$99	\$127
Recip Engine (NG only)	\$1,030	\$312	\$1,341	\$842	\$350	\$1,192	(\$188)	\$38	(\$149)
WA Wind	\$1,548	\$656	\$2,204	\$1,656	\$386	\$2,042	\$108	(\$270)	(\$162)
MT Wind	\$1,471	\$1,312	\$2,783	\$1,633	\$1,111	\$2,744	\$162	(\$201)	(\$39)
Solar	\$1,497	\$874	\$2,371	\$1,352	\$570	\$1,922	(\$145)	(\$304)	(\$449)
Biomass	\$4,084	\$207	\$4,291	\$7,036	\$2,659	\$9,695	\$2,952	\$2,452	\$5,404
Offshore Wind	\$5,717	\$1,795	\$7,512	\$5,000	\$1,547	\$6,547	(\$717)	(\$248)	(\$965)
Li-Ion Battery 2-hr	\$1,313	\$342	\$1,655	\$1,331	\$599	\$1,930	\$18	\$257	\$275
Li-Ion Battery 4-hr	\$2,116	\$552	\$2,668	\$2,346	\$708	\$3,054	\$230	\$156	\$386
Flow Battery 4-hr	\$1,870	\$674	\$2,544	\$1,493	\$618	\$2,111	(\$377)	(\$56)	(\$433)
Flow Battery 6-hr	\$2,447	\$882	\$3,329	\$2,050	\$708	\$2,758	(\$397)	(\$174)	(\$571)
Pumped Storage	\$2,503	\$127	\$2,630	\$1,800	\$879	\$2,679	(\$703)	\$752	\$49

The HDR report was subsequently presented to the IRP advisory group (“IRPAG”), a group of external stakeholders representing various interest groups, WUTC staff and PSE subject matter experts who participate in PSE’s long-term resource planning process. Based on feedback from the IRPAG, HDR updated certain costs (shown in Table 3) in a revised final report. PSE updated the generic resource cost assumptions in its RFP Phase 2 analysis to reflect these changes.

Table 3. *Comparison of RFP Phase 1 and Phase 2 generic resource costs*

	Solar capital cost (\$/kW)	MT wind capital cost (\$/kW)	WA wind capital cost (\$/kW)	Frame Peaker FOM <sup>3</sup> (\$/kW-yr)
RFP Phase 1 (draft HDR report)	\$1,922	\$2,744	\$2,042	\$3.93
RFP Phase 2 (final HDR report)	\$1,614	\$1,617	\$1,633	\$11.40 <sup>4</sup>

#### Electric load carrying capability assumptions

Effective load carrying capability (“ELCC”) is an approach to comparing the relative peak capacity contribution of resources with different operating characteristics. The ELCC, or peak capacity benefit, is defined as the relative contribution of a resource to meeting a utility’s peak capacity need, compared to

<sup>3</sup> Fixed O&M costs (“FOM”)

<sup>4</sup> HDR’s updated frame peaker FOM assumption (\$11.40/kw-yr) shown in Table 3 above includes \$3.93/kw-yr FOM + \$7.47/kw-yr for 48 hours of oil stored on site.



## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

that of a gas-fired peaking plant with an equivalent nameplate capacity. Because ELCC values are highly dependent on the load characteristics and mix of resources owned by a utility, they are unique to each utility.

Given the large volume of offers received, PSE’s Phase 1 screening applied generic ELCC value assumptions to RFP resources based on the resource type, nameplate capacity and general location.<sup>5</sup> ELCC values used in Phase 1 of the 2018 RFP are generally consistent with 2017 IRP assumptions,<sup>6</sup> with the exception of the values used for storage and demand response resources. Values for these resources were updated to align with draft 2019 IRP assumptions, because the new values for these resources had dropped materially compared to the 2017 assumptions.

In Phase 2, PSE updated its generic ELCC value assumptions for all resource types (shown in Table 4) to align with expected 2019 IRP assumptions.

Table 4. *Updated Phase 2 generic ELCC modeling assumptions by resource type*

Resource	Nameplate (MW)	IRP 2017 Peak Capacity Solve to 5% LOLP Relative to New Peaker	IRP 2019 Peak Capacity Solve to 5% LOLP Relative to Perfect Capacity
Existing Wind	823	11%	9.7%
Skookumchuck	131	40%	36.0%
Generic Montana Wind	100	49%	51.4%
Generic Washington Wind	100	16%	6.4%
Generic Offshore WA Wind	100	51%	47.6%
Generic Washington Solar	100	0%	1.0%
Lund Hill Solar	150	N/A	2.4%

Storage Resources	Nameplate (MW)	IRP 2017 Peak Capacity EUE at 5% LOLP	IRP 2019 Peak Capacity EUE at 5% LOLP
Lithium-Ion 2 hr, 82% RT efficiency	25	60%	19.2%
Lithium-Ion 4 hr, 87% RT efficiency	25	88%	38.4%
Flow 4 hr, 73% RT efficiency	25	76%	36.0%
Flow 6 hr, 73% RT efficiency	25	N/A	46.4%
Demand Response	100	77%	38.2%

<sup>5</sup> Because peak capacity resources must be available when and where needed, PSE’s analysis considered the characteristics of the resource, the proposed delivery point and the likely availability of “firm” delivery to PSE’s system when determining the application of ELCC values for resources.

<sup>6</sup> The 2018 RFP ELCC values included one small change related to the solar ELCC. The 2017 IRP assumed an ELCC of 0 percent for a 50 MW Washington solar facility. The All Resources RFP assumed an ELCC of 2 percent for a 50 MW Washington solar facility.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Storage Resources	Nameplate (MW)	IRP 2017 Peak Capacity EUE at 5% LOLP	IRP 2019 Peak Capacity EUE at 5% LOLP
3 hr duration, 6 hr delay, 10 calls per year			

In addition to updating its generic ELCC value assumptions, PSE applied a more critical eye to each proposal that advanced to Phase 2 and developed a project-specific ELCC value for each resource based on its unique attributes. The RFP team began its Phase 2 due diligence review by requesting missing data from respondents, clarifying uncertainties and obtaining an independent reasonableness assessment of wind and solar production values (via third-party consultant DNV-GL). The team used this information to study the proposals and determine the ELCC value, or peak capacity benefit, of each Phase 2 project. Project-specific ELCC values are presented and discussed in Section 3.

#### Additional value stream assumptions for storage and demand response resources

##### **Transmission system deferral value**

The transmission system deferral value is an avoided cost metric representing the mitigation benefit of neither building nor retrofitting transmission assets as a result of adding either the operational flexibility of a battery or peak savings from demand response resources. PSE’s analysis assumed a generic deferral value of \$26/kW-yr escalated at 2.5 percent annually based on a proxy value used for regional planning in the Northwest Power and Conservation Council’s *Seventh Power Plan*.<sup>7</sup> This proxy value was applied to all proposed battery energy storage systems (“BESS”) located on PSE’s system and proposed demand response programs in the preliminary quantitative screening. This is conceptually similar to the “benefit of the doubt” approach applied throughout Phase 1.

No on-system BESS proposals were selected for further consideration in Phase 2 due to their higher costs compared to other capacity alternatives, even with the assumed transmission system deferral value. If any of these resources had been selected for Phase 2 analysis, PSE would have evaluated these resources on a site-specific basis.

PSE did select two demand response proposals for Phase 2 analysis. As part of its due diligence review, the RFP team took a closer look at the transmission system deferral value assumed for demand response proposals in Phase 1 and ultimately determined that it could not confirm the validity of the assumption. The net result of this change combined with the updated ELCC value (described in the previous section), meant that the cost to acquire the same level of peak demand response roughly doubled on a per megawatt basis (assuming no change to the pricing). Demand response proposals were subsequently eliminated from Phase 2 consideration.

---

<sup>7</sup> “Appendix J: Demand Response Resources - Background Information,” *Seventh Northwest Conservation and Electric Power Plan*, Feb. 2016, p. J-4.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

#### Flexibility value

The flexibility value quantifies the sub-hourly benefits of adding a generation asset to the transmission system. These benefits, which apply to both pumped hydro and battery energy storage resources, include: regulation up and down, voltage control, frequency control, spinning reserves, non-spinning reserves and supplemental reserves. Storage resources with higher maximum output capacities and longer durations offered greater flexibility benefits.

#### Scenarios

PSE's Phase 1 screening analyzed each project on a standalone basis and, using the metrics from PSM III, compared the incremental portfolio cost and benefit impact in three potential future pricing scenarios. Each of the scenarios was constructed using base demand and gas price forecasts, as well as base generic resource cost assumptions; however, carbon costs varied as follows:

- Scenario 1: No carbon tax
- Scenario 2: Low societal cost of carbon (\$16/ton)<sup>8</sup>
- Scenario 3: Mid-societal cost of carbon (\$42/ton)<sup>9</sup>

The Phase 2 evaluation included an update of the standalone analysis to test the incremental impact of individual RFP proposals on the power portfolio. Phase 2 also included optimization analysis to test the incremental impact of combinations of proposals on the portfolio. In this phase, PSE added three new scenarios to those it tested in Phase 1, allowing PSE to stress test the proposals in different future pricing environments. Table 5 summarizes the key assumptions associated with each of the six scenarios tested.

Table 5. *Modeling scenarios used in both phases of the RFP analysis*

Scenarios	Phase	WECC /PSE	Gas Price	Generic Resource Costs
		Demand		
1. No carbon tax	1 + 2	Base	Base	Base
2. CO2 (low societal \$16/ton)	1 + 2	Base	Base	Base
3. CO2 (mid-societal \$42/ton)	1 + 2	Base	Base	Base
4. CO2 (high societal \$62/ton)	2	Base	Base	Base
5. No CO2 low load	2	Low	Low	Base
6. No CO2 updated pricing	2	Base	Update	Base

<sup>8</sup> The Scenario 2 low societal cost of carbon assumption (\$16/ton) is based on a Washington state carbon tax proposed in Initiative 1631, which failed to pass at the ballot box in November 2018.

<sup>9</sup> Source of Scenario 3 mid-societal cost of carbon assumption (\$42/ton): "Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12866, Interagency Working Group on Social Cost of Greenhouse Gases," United States Government, Aug. 2016.

## 2018 RFP EVALUATION PROCESS DOCUMENT

### APPENDIX E. QUANTITATIVE EVALUATION PROCESS

As shown, PSE's scenarios were designed to test a range of potential future carbon costs, from \$0/ton to as high as \$62/ton. This analysis offered insights into how portfolio costs might be affected by carbon legislation. Scenario 6 also reflects updated pricing as result of California Senate Bill 100 ("SB 100"), which mandates 100 percent renewable power generation in the state by 2045.

This analysis allows PSE to ask key questions. For example, how might economic conditions and load growth affect resource decisions? What are the key decision points and most important uncertainties in the long-term planning horizon, and when should we make those decisions? What impact might very different levels of carbon prices have on resource decisions? In this way, PSE can use this analysis to quantify how sensitive portfolio and resource costs and benefits are to our planning assumptions.

## 2. Phase 1: Screening Analysis

### Standalone portfolio analysis for each individual proposal

The RFP process began with a Phase 1 preliminary analysis designed to screen and rank proposals on an individual economic basis, eliminate resources with prohibitively high cost or risk, and identify a list of the most promising candidates for more focused scrutiny in Phase 2. Altogether, PSE received 97 proposals representing a combined total of 13,589 MW of operating capacity. Many proposals offered a variety of offer options, varying features and terms, such as start date or commercial operation date, contract term duration, maximum capacity, energy delivery point, offer structure (e.g., ownership, development assets, offtake agreement, etc.) or pricing structure (e.g., fixed or escalating). Some proposals also offered combinations of resources, pairing renewable generation with battery energy storage to better align generation output with PSE's peak capacity need. In all, PSE analyzed more than 282 offer options in its Phase 1 analysis.

The RFP team used PSM III to analyze each RFP proposal on a standalone basis in three potential future pricing scenarios, using the five key metrics produced by the model (presented in Figure 3 on page 4). As described in Section 1, the model calculates the long-term revenue requirements for PSE's incremental generic power portfolio based on the 2017 IRP resource strategy and a current outlook on the Company's capacity, renewable and energy needs. Generic resources are then replaced in the model with a proposal from the 2018 RFP to measure the impact on PSE's overall portfolio cost. Individual RFP offer results can then be compared to the cost of generic resources and each other.

PSE's analysis considered each proposal's ability to help meet the Company's physical reliability need ("capacity need"), renewable resource need ("RPS need"), or both. To compare and rank individual proposal results, the RFP team compiled the results for all RFP proposals into two categories: (1) those that helped meet the RPS need, and (2) those that help meet peak capacity need. In general, most proposals offered either peak capacity or renewable attributes. Most renewable resources had very little impact on PSE's peak capacity need and, therefore, only appear on the renewable ranking list. However, in several cases renewable resources offered a significant contribution toward meeting PSE's peak capacity. Some examples of this include Montana and Columbia Gorge wind, and biomass resources. In such cases, the resource appeared on both lists.

The detailed results of PSE's Phase 1 quantitative analysis are provided in Appendix C. The RFP team primarily used the portfolio benefit per kW-yr metric to rank capacity proposals and the portfolio benefit per REC metric to rank renewable proposals. Proposals with a positive portfolio benefit ranked more favorably than a generic resource. Proposals with a negative portfolio benefit ranked less favorably than a generic resource.

### The Candidate List

At the end of Phase 1, the RFP team identified a "candidate list" of the most promising resources for further due diligence and optimization analysis in Phase 2. Selected proposals were generally those that ranked most favorably in the quantitative screening relative to one or both of the resource needs and had

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

no known fatal flaws. Projects that provided a contribution to both resource needs were generally selected, due to the relatively high total portfolio benefit produced by the dual value streams.

Table 6. *Candidate List for Phase 2 Evaluation*

ID	Project Name	Resource Type	Nameplate	Counterparty	State
18100	SPI Industrial	Biomass	17 MW	SPI	WA
18201	[REDACTED]	Demand Response	[REDACTED] MW	[REDACTED]	WA
18169	[REDACTED]	MT Wind	[REDACTED] MW	[REDACTED]	MT
18173	[REDACTED]	MT Wind	[REDACTED] MW*	[REDACTED]	MT
18176	[REDACTED]	MT Wind	[REDACTED] MW*	[REDACTED]	MT
18163	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	OR
18165	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	OR
18190	[REDACTED]	REC Only	[REDACTED] REC	[REDACTED]	WA
18107	[REDACTED]	Run-of-River	[REDACTED] MW	[REDACTED]	ID
18135	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18111	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18122	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18131	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18127	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18114	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18112	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18125	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA
18139	[REDACTED]	Solar + BESS	[REDACTED] + [REDACTED] MW BESS	[REDACTED]	OR
18105	[REDACTED]	Thermal	[REDACTED] MW	[REDACTED]	WA
18103	[REDACTED]	Thermal	[REDACTED] MW	[REDACTED]	OR
XXXXX	[REDACTED]**	Transmission	[REDACTED] MW	[REDACTED]	N/A
18175	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	WA
18132	[REDACTED]	Wind	[REDACTED] MW*	[REDACTED]	OR
18179	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	WA
18170	Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
18166	[REDACTED]	Wind	[REDACTED] MW	[REDACTED]	OR

### 3. Phase 2: Due Diligence and Optimization Analysis

As PSE transitioned to the second phase of its evaluation, it was important to consider not only the individual risks and merits of each proposal, but also the portfolio impacts of potential resource combinations. With this goal in mind, PSE updated its standalone portfolio analysis of individual proposals and performed an optimization analysis to identify the best combination of proposals to best meet the Company’s resource needs at the lowest reasonable cost.

Phase 2 also involved a more in-depth assessment of the most favorable proposals from Phase 1. Whereas Phase 1 generally gave proposals the benefit of the doubt with regard to uncertainties or minor omissions, Phase 2 took a more critical view of each individual proposal, closely examining the details, seeking clarification or supplemental information when needed, and updating or validating our modeling assumptions as needed.

#### Adjustments to the candidate list

Early in Phase 2, PSE received a number of proposal updates from respondents. Four of the updates resulted in changes to the candidate list. These changes are summarized in Table 7.

Table 7. *Changes to Candidate List in early Phase 2*

ID	Project name	Resource Type	Nameplate	Counterparty	State	Summary of change
<b>Added to Phase 2 candidate list</b>						
18161	BPA Peak Capacity Product	Call option/ Sys PPA	100 MW	BPA	WA	Adjusted delivery point from Mid-C to PSEI.SYSTEM
UP002	[REDACTED]	REC Only	[REDACTED] RECs	[REDACTED]	ID	Price reduction
18205	[REDACTED]	Demand Response	[REDACTED] MW	[REDACTED]	WA	Price reduction
<b>Removed from Phase 2 candidate list</b>						
18112	[REDACTED]	Solar	[REDACTED] MW	[REDACTED]	WA	Withdrawn by seller

#### Updated standalone portfolio analysis for each individual proposal

In this phase, PSE updated its standalone portfolio analysis and individually re-ranked each candidate proposal using the same models (Aurora and PSM III) and metrics (see Figure 3 on page 4) that were used in Phase 1. While the tools and processes were fundamentally the same, PSE did update its models to reflect new proposal information received from respondents and updates to PSE’s assumptions (presented in detail in Section 1) including, but not limited to, gas and power price forecasts, load forecasts, generic resource cost assumptions and ELCC values. To ensure that Phase 2 modeling assumptions would be as current as possible, the team delayed completion of its evaluation

<sup>10</sup> Commercial and industrial customers (“C&I”)

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

and resource selection to incorporate a new lower natural gas price scenario (Scenario 6 in Table 5 on page 14) and the Company’s new F2019 load forecast.

In addition to updating its generic ELCC assumptions, PSE also took a closer look at the specific capacity contributions of each individual RFP proposals. In Phase 1, the analysis applied a generic ELCC proxy value to the proposals based on each project’s resource type, nameplate capacity and general location. In Phase 2, PSE’s planning group performed a study to determine the ELCC of each individual RFP project, based on its unique characteristics and attributes, its nameplate capacity and its specific location. Table 8 summarizes the project-specific ELCCs generated for the Phase 2 intermittent renewable generation resources.

Table 8. *Phase 2 project-specific ELCCs for intermittent generation resources*

Resource	Peak Capacity [MW]	Nameplate [MW]	ELCC
			45.00%
			5.40%
			44.90%
			1.71%
			31.92%
			1.82%
			0.69%
			1.49%
			46.07%
			2.00%
			0.75%
			1.56%
			19.90%
			16.00%
			1.00%
			1.13%

Because peak capacity resources must be available when and where needed, both phases of PSE’s analysis also considered the proposed delivery point and the likely availability of “firm” delivery to PSE’s system when determining the application of ELCC values for resources. Not all proposals listed in Table 8 received the benefit of an ELCC value in PSE’s analysis. Proposals delivering to Mid-C that assumed use of PSE’s existing transmission resources did not receive an ELCC value. This existing transmission capacity is currently used for short-term resources to meet peak need in high demand scenarios. Because a new resource proposing to leverage this transmission would supplant an existing capacity resource (market purchases), the proposed resource’s contribution to capacity cannot be considered an incremental benefit to PSE’s power portfolio. Additionally, proposals featuring busbar delivery (typically a project’s point of interconnection) were analyzed on a case-by-case basis to identify the most applicable delivery point, and the likelihood and costs of securing firm point-to-point



APPENDIX E. QUANTITATIVE EVALUATION PROCESS

transmission service to PSE’s system. Projects unable to deliver generation output to PSE’s system on a firm basis did not receive an ELCC benefit in PSE’s analysis. For more on this topic, see Section 6 of the 2018 RFP Evaluation Process Document.

PSE also updated its pricing scenarios to stress test proposals in different potential pricing environments. The Phase 2 analysis included three new scenarios (for a total of six, as shown in Table 5 on pages 14) to those it tested in Phase 1, including: a scenario to test the impact of higher carbon costs (\$62 per ton) compared to those in tested in phase 1 (a range of \$0 to \$42 per ton), a scenario to test the impact of lower load and gas prices, and a scenario to test the impact of the updated draft 2019 gas price.

While this standalone portfolio analysis is useful for comparing and ranking proposals on an individual basis, it does not consider the benefits of resource combinations to meet the combined resource needs of the RFP. It cannot take into account the efficiencies and economic benefits of pooling resources with complementing attributes or an optimally-sized solution to meet both the renewable and capacity resource needs. In other words, it does not account for the fact that a lower individually ranked resource (from a portfolio benefit perspective) could be part of a lowest reasonable cost, best-fit to need solution in the optimal portfolio because its unique “fit” provides economic savings when paired with other resources. For this reason, PSE uses a portfolio optimization approach to analyze and identify the optimal resource portfolio.

Updated standalone portfolio analysis results and rankings for Phase 2 proposals are presented in Appendix D.

**Proposals included in the optimization analysis**

The RFP team eliminated six proposals during the Phase 2 evaluation prior to the optimization analysis. Proposals were eliminated for a variety of quantitative and qualitative reasons, as described in Section 7 of the 2018 RFP Evaluation Process Document. This left a total of 21 proposals for portfolio optimization analysis, six of which were capacity resources.

**Portfolio optimization analysis**

In both RFP phases, the RFP team analyzed and individually ranked proposals using five metrics, including the benefit per kw-year metric for projects providing a peak capacity contribution, and the portfolio benefit per REC metric for projects providing a renewable energy credit (“REC”) contribution. This analysis is useful for comparing resources on a standalone basis; however, combining the highest ranked capacity resource and the highest ranked renewable resource will not necessarily result in an optimal solution to meet both resource needs at the most substantial cost savings to customers. In

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

fact, this simple approach could result in the selection of either too much or too little resources to meet PSE’s needs.<sup>11</sup>

Instead, the RFP team used the PSM III financial model and the Risk Solver optimizing module (described in Section 1) to analyze combinations of candidate proposals to determine the best resource solution to meet both of PSE resource needs at the lowest reasonable cost, while accounting for various constraints. Due to the limited number of proposals featuring a substantial contribution to capacity (6 total), filling the peak capacity need was the primary constraint in the optimization analysis. Additionally, the model took other constraints and considerations into account. For example, there were three Montana wind projects all ranking relatively highly on a standalone basis at the end of Phase 2; however, all three Montana wind developers proposed to interconnect their projects to the Colstrip Transmission System (“CTS”), which had limited available transmission capacity. As a result, only one of three Montana wind projects could be selected in the optimized portfolio. In another example, Avangrid proposed two offers to offtake power from its Golden Hills wind project (#18170): (1) [REDACTED] and (2) an as-produced wind product paired with winter peak capacity. While both offer options were evaluated in Phase 2, they relied on wind output from the same project and were mutually exclusive; only one of the two offers could be selected in the optimized portfolio.

The model creates optimal, integrated portfolios for each scenario considered in the analysis. In this case, optimization was performed in two market price scenarios, (1) market with social cost of carbon and (2) market without social cost of carbon. A portfolio with a high portfolio benefit in the market without social cost of carbon scenario may not perform well in the market with social cost of carbon scenario, and vice versa. This occurred in the 2018 RFP analysis with a portfolio that included a combined cycle natural gas plant. Due to its high peak capacity contribution compared to renewable resources, the portfolio performed well in the market with no social cost of carbon scenario; however, the portfolio costs increased significantly when carbon costs were introduced. A different situation occurred with the portfolio that provided the highest portfolio benefit in the market with social cost of carbon scenario. In this case, the model selected an unnecessary solar project in excess of PSE’s RPS-driven renewable need because it was speculating on the price of RECs and the value of selling excess RECs into the market, potentially reducing overall portfolio costs.

Once the model identified the optimal portfolio, the RFP team assessed the portfolio’s combined ELCC value to identify any diversification benefits or saturation reductions caused by similarities or differences in the expected generation profiles of the selected resources. For example, two 100 MW Washington wind projects, on an individual basis, are assumed to each provide 16 MW of peak capacity credit (for a total of 32 MW of peak capacity value); however, on a combined portfolio basis, the same two Washington wind projects would only provide 30 MW of total peak capacity credit, due to the value erosion caused by the similarity of their generation profiles.

Optimization analysis results are presented in Appendix D.

---

<sup>11</sup> See Section 2 of the RFP Evaluation Process Document for a discussion of the peak capacity and renewable (RPS-compliant) resource needs defined in the 2018 RFP.

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

The optimal portfolio

PSE completed Phase 2 in July 2019 and presented an optimal portfolio of four proposals to its Energy Management Committee (“EMC”): (1) a 17-year PPA to offtake power from the SPI Biomass facility (#18100) offered by Sierra Pacific Industries, (2) a 25-year PPA to offtake power from the [REDACTED] wind project (#18169) in Montana offered by [REDACTED] (3) a 20-year PPA to offtake power from the Golden Hills wind project (#18170) in Oregon paired with a winter peak shaping product offered by Avangrid, and a 5-year peak capacity call option (#18161) for system resources offered by BPA. Table 9 shows the optimal portfolio, including its portfolio benefit, contribution to peak capacity and contribution to meet RPS requirements.

Table 9. *Optimal portfolio as determined by Phase 2 optimization analysis*

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	
List	Project ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Preferred Optimized Portfolio	As Proposed Optimized Portfolio	
1	18100	Biomass	SPI	17 MW	16 MW	[REDACTED]	X	X	
2	18161	Call Option	BPA Peak Capacity Product	100 MW	53 MW	[REDACTED]	X	X	
3	18169	MT Wind	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	X		
4	18169	MT Wind	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]		X	
5	18170	Wind	Golden Hill Shaped	200 MW	77 MW	[REDACTED]	X	X	
6	Total Peak Capacity Credits - MWs							[REDACTED] MW	[REDACTED] MW
7	Peak Capacity Surplus / (Deficit) in 2022 <sup>4</sup>							[REDACTED] MW	[REDACTED] MW
8	Total Annual RECs							2,189,656	1,986,862
9	Portfolio Benefits - \$M							\$408	\$397
10									
11	With Consideration of Social Cost of Carbon:								
12	Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>5</sup>							\$1,038	\$934
13	Portfolio Benefits w/ Carbon Costs in Dispatch Costs - \$M							\$959	\$937

Peak Capacity and REC Need 2022-2025	2022	2023	2024	2025
Peak Capacity Need	299 MW	291 MW	328 MW	457 MW
REC Need	0	233,449	691,864	700,482

Table notes:

- The annual project RECs in column I does not include 0.2X apprenticeship multiplier.
- The optimization model chose a portfolio with [REDACTED] MW from [REDACTED] (#18169). [REDACTED] submitted proposals for both [REDACTED] MW and [REDACTED] MW, but not [REDACTED] MW. The 350 MW size of the project is reduced from the proposed [REDACTED] MW option based on available transmission capacity. The [REDACTED] MW option will have to be negotiated with [REDACTED]. Current indicative results reflect pricing based on the [REDACTED] MW offer.
- The current project COD for [REDACTED] (#18169) is Dec 2021. There has been perceived timing risks for PSE to secure long-term transmission rights to bring the energy home. If the commercial operation date is delayed to Dec 2022 to mitigate this risk, the net present value of the PPA cost will increase by up to \$35M. Without [REDACTED] (#18169), the next lowest cost portfolio is \$123M more expensive than the recommended portfolio and it would have the same timing risks related to transmission, because the next lowest cost portfolio includes the [REDACTED] project (#18173), which uses the same Colstrip transmission path.
- Final Portfolio ELCC reduces the sum of individual project peak capacity contribution by 8 MW. It could potentially be mitigated by (1) short-term capacity purchase for \$720k per year; or (2) a 20 MW battery for \$41M.
- The social cost of carbon at \$62/metric ton in 2020 dollars plus escalation is added to total portfolio costs as a fixed cost.

REDACTED VERSION

REDACTED VERSION

**2018 RFP EVALUATION PROCESS DOCUMENT**

**APPENDIX E. QUANTITATIVE EVALUATION PROCESS**

All four resources selected by the model included a substantial capacity benefit. Three of the four selected proposals—SPI biomass (#18100), [REDACTED] wind (#18169) and Golden Hills shaped wind (#18170)—offered a contribution to help meet both the renewable and capacity needs. The fourth proposal for the BPA peak capacity product (#18161), offered a call option in winter peak months for BPA system resources, which are primarily non-emitting hydro resources.

PSE's EMC approved for negotiation a short list composed of the four resources selected in the model as the optimal portfolio at its July 2019 meeting.

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

4. Phase 2 Update: The re-evaluation process

Subsequent to the EMC approving the RFP short list in July 2019, PSE received two new proposals and three pricing updates from RFP respondents. To ensure selection of the best-fit combination of renewable and capacity resources to meet customer needs at the lowest reasonable cost, PSE ran an updated optimization analysis to reflect these changes. This updated analysis is alternately referred to in PSE’s documentation as “the re-evaluation process” and “the Phase 2 Update”.

Table 10 summarizes the RFP proposal updates and new unsolicited proposals received after the completion of Phase 2.

Table 10. Offer updates and new unsolicited proposals received after short list selection

Date Received	Project name	Resource Type	Nameplate Capacity	Counterparty	State	Summary of change
<b>New unsolicited proposals</b>						
8/29/19	[REDACTED] (#UP005)	Asset sale/ 7-year project PPA	[REDACTED] MW	[REDACTED]	WA	New proposal for power from [REDACTED] share of natural gas-fired CCCT facility (51%) delivered to PSEI.SYS beginning Sept. 1, 2022
10/23/19	MSCG System PPA (#UP006)	3 to 5-year system PPA	100 MW	Morgan Stanley Capital Group (“MSCG”)	WA	New proposal for 0 emissions (no RECs) system power delivered to PSEI.SYS in Q1 and Q4 HLH beginning Jan. 1, 2022
<b>RFP proposal updates</b>						
9/9/19	BPA Peak Capacity Product (#18161)	5-year system PPA	100 MW	Bonneville Power Association (“BPA”)	WA	Increased price by email
8/29/19	[REDACTED] (#18173)	20-year sroject PPA	300 MW	[REDACTED]	MT	Lowered price by email
10/30/19	SPI Burlington Biomass Project (#18100)	17-year project PPA	17 MW	Sierra Pacific Industries (“SPI”)	WA	Lowered price verbally during a meeting

Portfolio optimization analysis

The Phase 2 Update optimization analysis process was fundamentally the same as the Phase 2 process described in Section 3. PSE used the same models and metrics, and many of the same assumptions used in Phase 2. However, PSE did update certain assumptions on an as-needed basis to reflect the most current information available at the time the analysis was performed, including the following changes:

- updated peak capacity need consistent with PSE’s revised 2019 IRP Progress Report filed December 10, 2019,

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

- updated Mid-C power price forecast (a 20 percent reduction from the previous forecast),<sup>12</sup>
- adjusted social cost of carbon assumptions based on guidance from WUTC docket U-190730, dated September 12, 2019 (2.5 percent discount rate scenario, 0.437 ton/MWh market purchase carbon intensity),
- assumed retirement of Colstrip units 1 and 2 by 2020, and
- considered the impact on the capacity need of the sale of Colstrip unit 4, which was announced in December 2019 (shown in Table 12 below).

The optimal portfolio

PSE completed its re-evaluation analysis in November 2019, resulting in a revised optimal portfolio. The revised results confirmed the selection of the original Phase 2 short list resources and added one additional resource, the MSCG system power PPA (#UP006). Table 11 shows how the updated assumptions impacted the Phase 2 optimal portfolio. Detailed optimization results are presented in Appendix D.

Table 11. Updated portfolio optimization<sup>13</sup>

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)
List	Project ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Recommended Portfolio
1	18100	Biomass	SPI	17 MW	16 MW		X
2	18161	Call Option	BPA Peak Capacity Product	100 MW	53 MW		X
3	18169	MT Wind					X
4	18169	MT Wind					X
5	18170	Wind	Golden Hills Shaped	200 MW	77 MW		X
6	xxxxx	System PPA	Morgan Stanley Sys PPA	100 MW	81 MW		X
7		Total Peak Capacity Credits - MWs					MW
8		Total Annual RECs					2,189,656
9		Portfolio Benefits - \$M					\$679
10		Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>2,3</sup>					\$1,179

<sup>12</sup> Updated power price forecast is consistent with the September 19, 2019 IRTAG #8 publication, which was presented to the 2019 IRP Technical Advisory Group, the public stakeholder group which helps to provide input and guidance to PSE's long-term resource planning process.

<sup>13</sup> The notes on this table mean the following:

Note 1: The portfolio benefit change includes the benefits compared to the re-established baseline generic portfolio when key assumptions were changed.

Note 2: In addition to note 1, the portfolio benefit with carbon costs change reflects updated social cost of carbon pricing and market purchase carbon intensity, per UTC docket U-190730, dated 9-12-2019.

REDACTED VERSION

REDACTED VERSION

2018 RFP EVALUATION PROCESS DOCUMENT

APPENDIX E. QUANTITATIVE EVALUATION PROCESS

Table 12 shows the updated peak capacity need, less the original shortlist, less the newly added MSCG System PPA, with and without the announced sale of Colstrip Unit 4.

Table 12. *Updated portfolio capacity need with revised short list resources<sup>14</sup>*

<b>Peak Capacity Need 2022-2026</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
Need before Colstrip Transaction	299 MW	292 MW	358 MW	477 MW	1124 MW
July EMC Resources Contributed Peak Capacity					
Need / (Surplus) without MSCG					
MSCG Contributed Peak Capacity	79 MW	79 MW	79 MW	79 MW	79 MW
Need / (Surplus) with MSCG					
Additional Need from Colstrip Transaction	95 MW	95 MW	95 MW	95 MW	0 MW
Peak Need / (Surplus) after Resources					

As shown in Table 12, the addition of the MSCG 5-year system power PPA (#UP006) is expected to help meet a portion of PSE’s resource needs in 2025 and 2026 not met by the original short list. Additionally, the MSCG System PPA would help mitigate need resulting from the announced sale of Colstrip Unit 4. MSCG offers additional benefits such as delivery to PSE’s system, seasonal shaping to help meet need in Q1 and Q4 during heavy load hours, and a 0 emission product (without RECs. The seasonal and heavy load hour shaping helps to meet deficits in the hours and months when capacity is most needed while minimizing surplus off peak. The zero emission product is consistent with Washington laws and policy preferences for emission reductions from energy resources.

PSE presented the revised optimization results to its EMC in November 2019 and recommended adding MSCG to its short list for negotiation.

<sup>14</sup> Table 2 provides a snapshot of the resource need between 2022 and 2026. Once the Colstrip 4 transaction is approved, resource need will increase by 95 MW from 2020 to 2025.

*2018 RFP Evaluation Process Document*

## Appendix F. Presentations



*2018 RFP Evaluation Process Document*

## F.1 Presentations to PSE's Energy Management Committee ("EMC")

# 2018 All Resources and Demand Response RFP



## *EMC Informational*

September 20, 2018

**Cindy Song**

*Manager Business Initiatives*

**CONFIDENTIAL**

## Nearly 100 proposals received

Resource type	# Proposals	Size range (MW / RECs, roughly)
Solar	36	35 – 290 MW
Wind	20	45 – 500 MW
Storage – battery	17	10 – 200 MW / 30 – 800 MWh
Storage – pumped hydro	2	330 – 500 MW
Biomass	3	10 – 55 MW
Natural Gas-fired Gen.	4	50 – 620 MW
Geothermal	2	15-25 MW
Hydro - run of river	1	40 MW
System PPA / Call Option	1	100 MW
Unbundled RECs	4	35,000 – 130,000 RECs
Demand Response	6	20-40 MW
<b>Total</b>	<b>96</b>	



# Largest response to an All Source RFP to date

As of 9/20/2018	2018 All Resource and Demand Response RFPs			Past RFP's											
	Resource Type	# Proposals	Max Cap MW	2017 Renewables Only RFP (Green Direct 2.0) <sup>1</sup>		2011 All Source RFP		2010 All Source RFP		2008 All Source RFP		2005 All Source RFP			
Solar - PV	16	2240		17	574	2	24	1	10						
Solar - PV + BESS	20	2848													
Wind - Off Shore	1	400													
Wind On Shore	16	3303		20	2601	4	369	21	3776	8	862	10	1165		
Wind + Winter Sys PPA	1	371		4	339										
Wind + Solar and/or BESS	2	464				2	251								
Storage - Battery ("BESS")	17	1265													
Storage - Pumped Hydro	2	900													
Biomass	2	72				3	61	9	590						
Biomass + BESS	1	15													
Natural Gas-fired Generation <sup>2</sup>	4	1377				10	2624	18	5342	10	2588	17	4307		
Geothermal	2	43										1	48		
Hydro - Run of River	1	38		2	4	1	77	2	105	3	165	3	139		
System PPA / Call Option	1	100				4	400	10	n/a	9	1675	7	400		
Unbundled RECs	4							2	n/a						
Demand Response	6	154						1	80			1	34		
Coal - Traditional + IGCC						1	500			1	100	6	4950		
Cold Fusion						1	1880								
Distributed Generation															
Waste-to-Energy / Landfill Gas						1	23					1	5		
<b>TOTAL</b>	<b>96</b>	<b>13,590</b>		<b>43</b>	<b>3,518</b>	<b>29</b>	<b>6,209</b>	<b>64</b>	<b>9,903</b>	<b>31</b>	<b>5,390</b>	<b>47</b>	<b>11,053</b>		

[1] The 2017 Green Direct RFP sought large and small (<5 MW) renewable resources to serve multiple voluntary green power programs.

[2] Natural gas-fired generation may include CCTs, SCCTs, reciprocating engines, combined heat and power facilities and gas turbine equipment sales.

## 92% of proposals offered a PPA option, 29% of proposals offered an ownership option

Resource Type	# Proposals	Max Cap MW <sup>1</sup>	Offer Structure(s)		
			Own	PPA/Toll/ Other Agmt	Both
Solar - PV	16	2,240	1	14	1
Solar - PV + BESS	20	2,848		18	2
Wind - Off Shore	1	400			1
Wind On Shore	16	3,303	3	11	2
Wind + Winter Sys PPA	1	371		1	
Wind + Solar + BESS	2	464	1	1	
Storage - Battery ("BESS")	17	1,265	1	8	8
Storage - Pumped Hydro	2	900			2
Biomass	2	72		2	
Biomass + BESS	1	15		1	
Natural Gas CCCT	2	1,020		1	1
Natural Gas SCCT	1	245			1
Natural Gas Recip	1	112	1		
Geothermal	2	43			2
Hydro - Run of River	1	38		1	
System PPA / Call Option	1	100		1	
Unbundled RECs	4	n/a		4	
DR Direct Load Control	4	109		4	
DR C&I Curtailment <sup>2</sup>	2	44		2	
<b>TOTAL</b>	<b>96</b>	<b>13,589</b>	<b>7</b>	<b>69</b>	<b>20</b>

- 90% of proposed projects are in development stage
- Many proposals included multiple offer options, such as:
  - Multiple structure options:
    - development rights
    - asset purchase
    - PPA, Toll or other agreement
  - Fixed/escalating PPA pricing
  - Various term lengths and/or start dates
  - Hybrid options to include storage, or to pair solar with wind
  - Transmission delivery points

[1] MW column reflects total combined potential capacity.

[2] Commercial & Industrial Curtailment (C&I Curtailment).

# 70% of projects proposed are located in Washington



REDACTED  
VERSION

# 2018 RFP timeline



# RFP Phase 1 Results



*EMC Informational*

March 21, 2019

*Cindy Song*

*Manager Business Initiatives*


**CONFIDENTIAL**




# PSE filed RFPs for capacity and renewable resources in June 2018

- RFPs were filed to meet renewable energy credit (REC) and capacity needs beginning in 2021 and 2022 respectively
- Proposals were due August 2018
- RFPs produced a record response with nearly 100 proposals received in a wide variety of resource and technology options

REC need

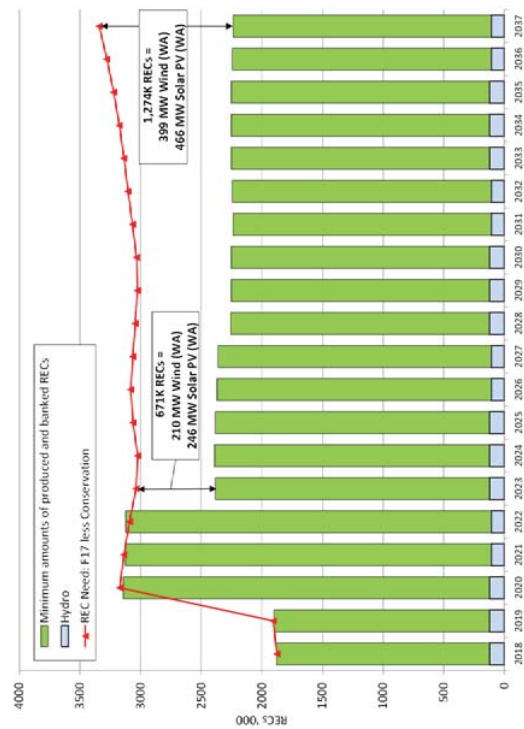

Capacity need

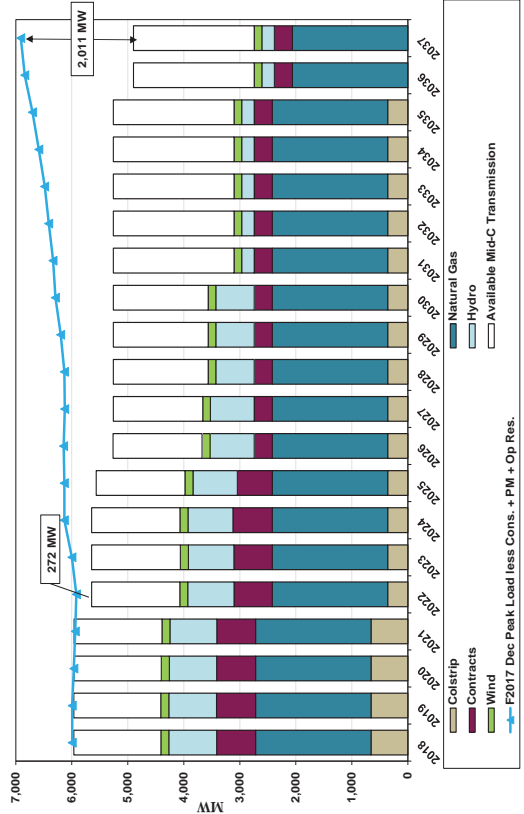

# Observations from Phase 1

- Solar prices have dramatically declined compared to other resource types
- Battery storage prices have also considerably declined and show potential, but are not yet competitive with alternatives available to PSE in this RFP
- Of 97 total proposals, 40 included battery storage configurations, while only 4 offered gas-fired generation
- Phase 1 analysis suggests many renewables are beating our current projections for Mid-C transmission redirects

Proposals selected for Phase 2 evaluation reflect resource and technology diversity

Resource Type	Proposals Received <sup>1</sup>		Phase 2 Candidate List	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW
Solar - PV	16	2240	8	1050
Solar - PV + BESS	20	2848	1	100
Wind - Off Shore	1	400	0	0
Wind On Shore	16	3303	7	1642
Wind + Winter Sys PPA	1	371	1	200
Wind + Solar and/or BESS	2	464	0	0
Storage - Battery ("BESS")	17	1265	0	0
Storage - Pumped Hydro	2	900	0	0
Biomass	2	72	1	17
Biomass + BESS	1	15	0	0
Natural Gas-fired Generation	4	1377	2	348
Geothermal	2	43	0	0
Hydro - Run of River	1	38	1	38
System PPA / Call Option	1	100	0	0
Unbundled RECs	5	n/a	3	n/a
Demand Response	6	154	1	8.7
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>25</b>	<b>3,404</b>

<sup>1</sup>PSE also received two unsolicited proposals during Phase 1, one REC-only and one pumped hydro storage. While the proposals are not included in the table count above, they were evaluated as part of the Phase 1 analysis.

# Candidate list for Phase 2

(results are a snap shot in time, subject to change)

ID	Project Name	Resource Type	Nameplate	Counterparty	State
18100	SPI Industrial	Biomass	17 MW	SPI	WA
18201		Demand Response	MW		WA
18169		MT Wind	MW		MT
18173		MT Wind	MW*		MT
18176		MT Wind	MW*		MT
18163		REC Only	IREC		OR
18165		REC Only	IREC		OR
18190		REC Only	IREC		WA
18107		Run-of-River	MW		ID
18135		Solar	MW		WA
18111		Solar	MW		WA
18122		Solar	MW		WA
18131		Solar	MW		WA
18127		Solar	MW		WA
18114		Solar	MW		WA
18112		Solar	MW		WA
18125		Solar	MW		WA
18139		Solar + BESS	+ MW BESS		OR
18105		Thermal	MW		WA
18103		Thermal	MW		OR
XXXXX		Transmission	MW		N/A
18175		Wind	MW		WA
18132		Wind	MW*		OR
18179		Wind	MW		WA
18170	Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
18166		Wind	MW		OR


\* Numbers shown are rounded to the nearest 5MW.

\*\* Reflects a redirect of 100MW of BPA transmission from [REDACTED] available January, 2022 for a 50-year term, and using Mid-C forecast for energy pricing. [REDACTED] MW may be available for redirect on BPA's system, however it is likely only [REDACTED] MW is possible for redirect to Mid-C. Redirects are assessed given the most current data and are a snap shot of the present system. The results are subject to change and may vary in the future based on updated ATC calculations and flow gate constraints within BPA's network. While redirect of the remaining [REDACTED] MW is feasible, the location, source and cost of this redirect remains under review, therefore not included in this analysis.

Proposals shown here are best offers from each proposal.

REDACTED VERSION

# Phase 2 next steps

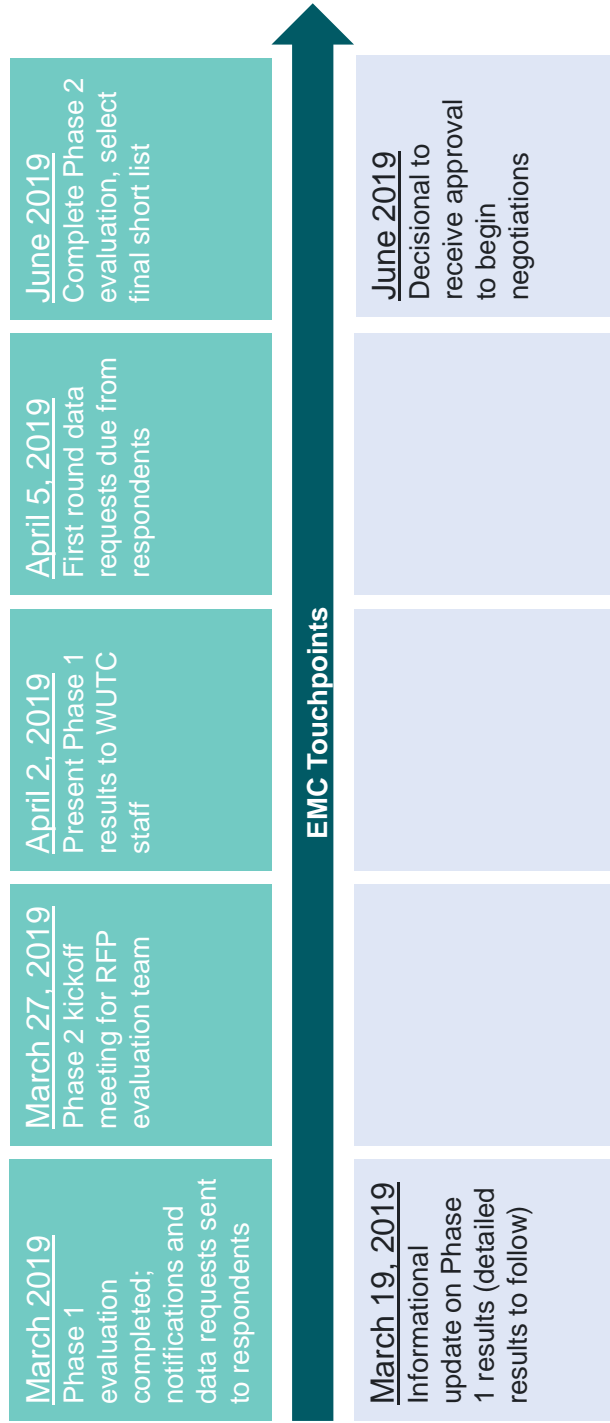

## Phase 2 considerations:

- Detailed, cross-functional due diligence to evaluate costs, risks and merits of each proposal
- Additional scenario testing in portfolio screening model
- Update ELCC assumptions to match most current IRP assumptions
- Potential impacts of Clean Energy Bill (anticipated April 2019)

**RFP Phase 1 Results:**

*Appendix to EMC informational presentation on  
March 21, 2019*

**EMC Informational**  
April 5, 2019



**Cindy Song**  
Manager Business Initiatives


**CONFIDENTIAL**

# Appendix


---

- Phase 1 resource need assumption
- Quantitative screening metrics definitions
- Phase 1 price scenarios
- Phase 1 detailed results
  - Quantitative analysis results
  - Executive summary of qualitative results

# Phase 1: Peak need updated to F2018 demand forecast

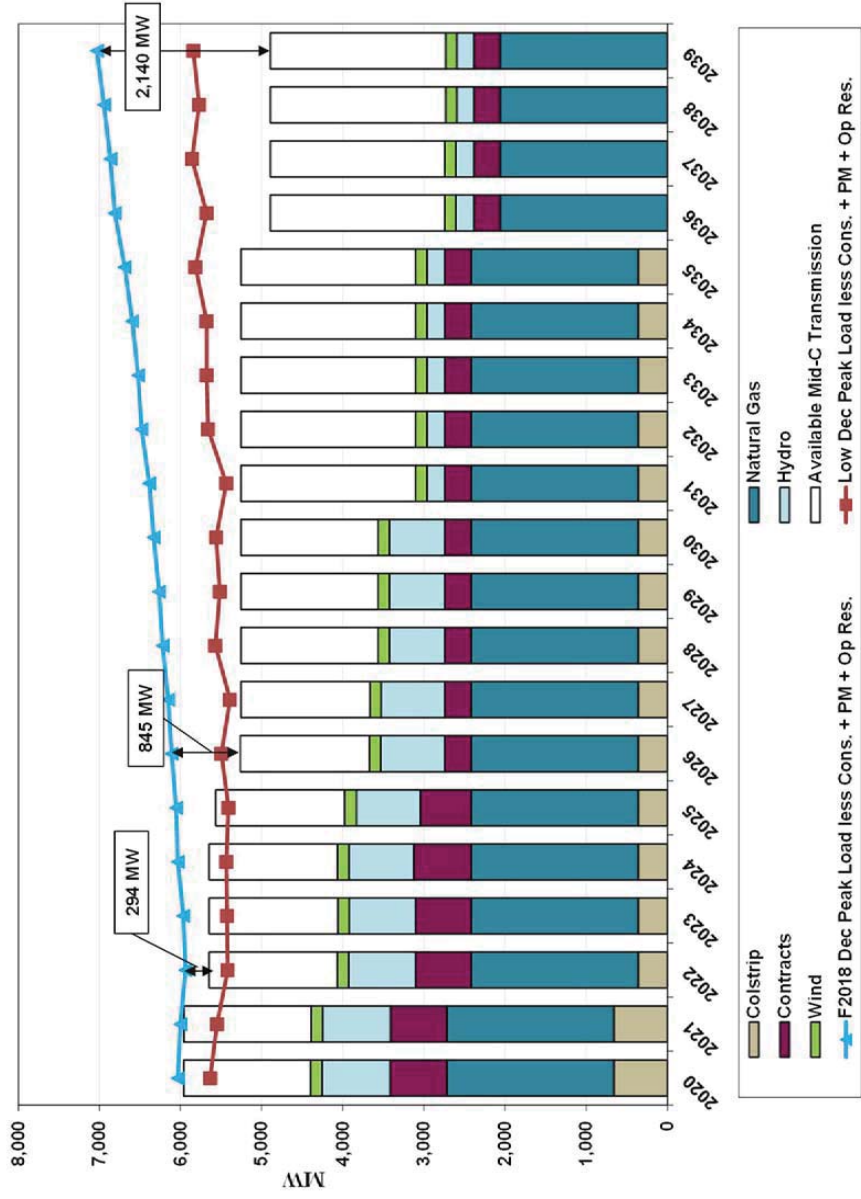

# Phase 1: Renewable need updated to F2018 demand forecast

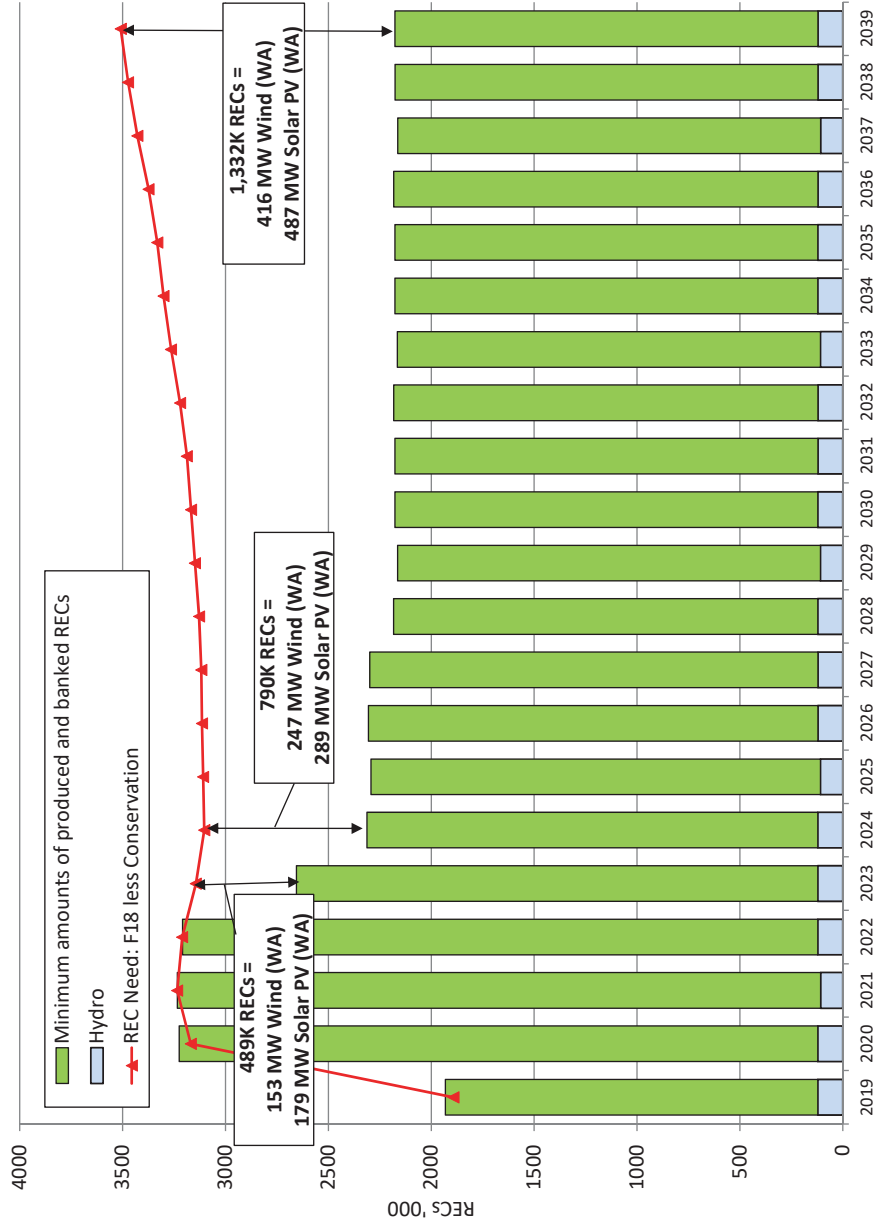

Source: 2017 IRP renewable need forecast updated based on F2018 demand forecast (August 2018)



## Quantitative screening metrics allow PSE to compare and rank resources with different characteristics and capacities

### Portfolio benefit (\$)

*Useful for comparing projects with the same winter capacity value*

Difference between net present value portfolio revenue requirement of proposed project (replaces a generic resource), and the net present portfolio revenue requirement of the generic portfolio strategy.

### Levelized cost (\$/MWh-REC)

*Useful for comparing projects with the same or similar operating characteristics*

A resource's net present value revenue requirement of the 20-year period with end effects, divided by the net present value generation.

### Portfolio benefit/REC (\$/MWh-REC)

*Useful for comparing projects with the same or similar operating characteristics*

Provides a slightly different view than the above metric by taking the portfolio benefit divided by RECs.

### Levelized portfolio benefit/Unit of contribution to need (\$PB/kW-yr):

*Useful for comparing different capacity resource types and sizes*

A project's portfolio benefit divided by the present value of the project's capacity contribution.

## Additional screening metrics

---

### **Net cost/REC** (\$/MWh-REC)

*Useful for comparing  
renewable projects of different  
sizes*

Present value of the cost less the market value of the energy divided by the RECs.

### **Portfolio benefit ratio**

*Useful for comparing projects  
with the same or similar  
operating characteristics;  
removes size bias*

Portfolio benefit divided by the net present value of the proposed revenue requirement. Allows projects of different capacities to be compared by eliminating bias for size.

### **Net cost/peak capacity credit** (\$/kw)

*Useful for comparing cost of  
peak capacity credit across  
technologies*

Present value of the cost less the market value of the energy divided by peak capacity credit.

# Phase 1 price scenarios

---

1. **No carbon tax** – Base case from the 2017 IRP with no carbon tax
2. **CO2 (Initiative 1631)** – Scenario 1 + \$16/ton carbon price
3. **CO2 (WECC-wide social cost)** – Scenario 1 + \$42/ton carbon price

2018 RFP Phase I Quantitative Results Summary - Renewable Resource (results as of 4/2/2019)

Project ID	Project	Nameplate	All Scenarios \$/MWh	Levelized Cost Rank	Portfolio Benefit / REC			Portfolio Benefit Ratio			Net Costs/REC																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
					NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
181609					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100	101	102	103	104	105	106	107	108	109	110	111	112	113	114	115	116	117	118	119	120	121	122	123	124	125	126	127	128	129	130	131	132	133	134	135	136	137	138	139	140	141	142	143	144	145	146	147	148	149	150	151	152	153	154	155	156	157	158	159	160	161	162	163	164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187	188	189	190	191	192	193	194	195	196	197	198	199	200	201	202	203	204	205	206	207	208	209	210	211	212	213	214	215	216	217	218	219	220	221	222	223	224	225	226	227	228	229	230	231	232	233	234	235	236	237	238	239	240	241	242	243	244	245	246	247	248	249	250	251	252	253	254	255	256	257	258	259	260	261	262	263	264	265	266	267	268	269	270	271	272	273	274	275	276	277	278	279	280	281	282	283	284	285	286	287	288	289	290	291	292	293	294	295	296	297	298	299	300	301	302	303	304	305	306	307	308	309	310	311	312	313	314	315	316	317	318	319	320	321	322	323	324	325	326	327	328	329	330	331	332	333	334	335	336	337	338	339	340	341	342	343	344	345	346	347	348	349	350	351	352	353	354	355	356	357	358	359	360	361	362	363	364	365	366	367	368	369	370	371	372	373	374	375	376	377	378	379	380	381	382	383	384	385	386	387	388	389	390	391	392	393	394	395	396	397	398	399	400	401	402	403	404	405	406	407	408	409	410	411	412	413	414	415	416	417	418	419	420	421	422	423	424	425	426	427	428	429	430	431	432	433	434	435	436	437	438	439	440	441	442	443	444	445	446	447	448	449	450	451	452	453	454	455	456	457	458	459	460	461	462	463	464	465	466	467	468	469	470	471	472	473	474	475	476	477	478	479	480	481	482	483	484	485	486	487	488	489	490	491	492	493	494	495	496	497	498	499	500	501	502	503	504	505	506	507	508	509	510	511	512	513	514	515	516	517	518	519	520	521	522	523	524	525	526	527	528	529	530	531	532	533	534	535	536	537	538	539	540	541	542	543	544	545	546	547	548	549	550	551	552	553	554	555	556	557	558	559	560	561	562	563	564	565	566	567	568	569	570	571	572	573	574	575	576	577	578	579	580	581	582	583	584	585	586	587	588	589	590	591	592	593	594	595	596	597	598	599	600	601	602	603	604	605	606	607	608	609	610	611	612	613	614	615	616	617	618	619	620	621	622	623	624	625	626	627	628	629	630	631	632	633	634	635	636	637	638	639	640	641	642	643	644	645	646	647	648	649	650	651	652	653	654	655	656	657	658	659	660	661	662	663	664	665	666	667	668	669	670	671	672	673	674	675	676	677	678	679	680	681	682	683	684	685	686	687	688	689	690	691	692	693	694	695	696	697	698	699	700	701	702	703	704	705	706	707	708	709	710	711	712	713	714	715	716	717	718	719	720	721	722	723	724	725	726	727	728	729	730	731	732	733	734	735	736	737	738	739	740	741	742	743	744	745	746	747	748	749	750	751	752	753	754	755	756	757	758	759	760	761	762	763	764	765	766	767	768	769	770	771	772	773	774	775	776	777	778	779	780	781	782	783	784	785	786	787	788	789	790	791	792	793	794	795	796	797	798	799	800	801	802	803	804	805	806	807	808	809	810	811	812	813	814	815	816	817	818	819	820	821	822	823	824	825	826	827	828	829	830	831	832	833	834	835	836	837	838	839	840	841	842	843	844	845	846	847	848	849	850	851	852	853	854	855	856	857	858	859	860	861	862	863	864	865	866	867	868	869	870	871	872	873	874	875	876	877	878	879	880	881	882	883	884	885	886	887	888	889	890	891	892	893	894	895	896	897	898	899	900	901	902	903	904	905	906	907	908	909	910	911	912	913	914	915	916	917	918	919	920	921	922	923	924	925	926	927	928	929	930	931	932	933	934	935	936	937	938	939	940	941	942	943	944	945	946	947	948	949	950	951	952	953	954	955	956	957	958	959	960	961	962	963	964	965	966	967	968	969	970	971	972	973	974	975	976	977	978	979	980	981	982	983	984	985	986	987	988	989	990	991	992	993	994	995	996	997	998	999	1000	1001	1002	1003	1004	1005	1006	1007	1008	1009	1010	1011	1012	1013	1014	1015	1016	1017	1018	1019	1020	1021	1022	1023	1024	1025	1026	1027	1028	1029	1030	1031	1032	1033	1034	1035	1036	1037	1038	1039	1040	1041	1042	1043	1044	1045	1046	1047	1048	1049	1050	1051	1052	1053	1054	1055	1056	1057	1058	1059	1060	1061	1062	1063	1064	1065	1066	1067	1068	1069	1070	1071	1072	1073	1074	1075	1076	1077	1078	1079	1080	1081	1082	1083	1084	1085	1086	1087	1088	1089	1090	1091	1092	1093	1094	1095	1096	1097	1098	1099	1100	1101	1102	1103	1104	1105	1106	1107	1108	1109	1110	1111	1112	1113	1114	1115	1116	1117	1118	1119	1120	1121	1122	1123	1124	1125	1126	1127	1128	1129	1130	1131	1132	1133	1134	1135	1136	1137	1138	1139	1140	1141	1142	1143	1144	1145	1146	1147	1148	1149	1150	1151	1152	1153	1154	1155	1156	1157	1158	1159	1160	1161	1162	1163	1164	1165	1166	1167	1168	1169	1170	1171	1172	1173	1174	1175	1176	1177	1178	1179	1180	1181	1182	1183	1184	1185	1186	1187	1188	1189	1190	1191	1192	1193	1194	1195	1196	1197	1198	1199	1200	1201	1202	1203	1204	1205	1206	1207	1208	1209	1210	1211	1212	1213	1214	1215	1216	1217	1218	1219	1220	1221	1222	1223	1224	1225	1226	1227	1228	1229	1230	1231	1232	1233	1234	1235	1236	1237	1238	1239	1240	1241	1242	1243	1244	1245	1246	1247	1248	1249	1250	1251	1252	1253	1254	1255	1256	1257	1258	1259	1260	1261	1262	1263	1264	1265	1266	1267	1268	1269	1270	1271	1272	1273	1274	1275	1276	1277	1278	1279	1280	1281	1282	1283	1284	1285	1286	1287	1288	1289	1290	1291	1292	1293	1294	1295	1296	1297	1298	1299	1300	1301	1302	1303	1304	1305	1306	1307	1308	1309	1310	1311	1312	1313	1314	1315	1316	1317	1318	1319	1320	1321	1322	1323	1324	1325	1326	1327	1328	1329	1330	1331	1332	1333	1334	1335	1336	1337	1338	1339	1340	1341	1342	1343	1344	1345	1346	1347	1348	1349	1350	1351	1352	1353	1354	1355	1356	1357	1358	1359	1360	1361	1362	1363	1364	1365	1366	1367	1368	1369	1370	1371	1372	1373	1374	1375	1376	1377	1378	1379	1380	1381	1382	1383	1384	1385	1386	1387	1388	1389	1390	1391	1392	1393	1394	1395	1396	1397	1398	1399	1400	1401	1402	1403	1404	1405	1406	1407	1408	1409	1410	1411	1412	1413	1414	1415	1416	1417	1418	1419	1420	1421	1422	1423	1424	1425	1426	1427	1428	1429	1430	1431	1432	1433	1434	1435	1436	1437	1438	1439	1440	1441	1442	1443	1444	1445	1446	1447	1448	1449	1450	1451	1452	1453	1454	1455	1456	1457	1458

Project ID	Project	Nameplate	Levelized Cost All Scenarios \$/MWh	Portfolio Benefit / REC				Portfolio Benefit Ratio				Net Cost\$/REC			
				NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank	Societal Rank	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank	Societal Rank
181303			57	79	96	118	154	1.5	1.3	1.5	62	106	141	165	186
181304			58	80	97	119	155	1.9	1.8	1.9	72	116	151	181	201
181305			59	81	98	120	156	1.5	1.4	1.5	92	136	171	196	216
181306			60	82	99	121	157	1.5	1.4	1.5	92	136	171	196	216
181307			61	83	100	122	158	1.9	1.8	1.9	72	116	151	181	201
181308			62	84	101	123	159	1.3	1.2	1.3	100	140	175	205	225
181309			63	85	102	124	160	2.0	1.9	2.0	73	117	152	182	202
181310			64	86	103	125	161	1.9	1.8	1.9	73	117	152	182	202
181311			65	87	104	126	162	1.5	1.4	1.5	80	124	159	189	209
181312			66	88	105	127	163	1.9	1.8	1.9	74	118	153	183	203
181313			67	89	106	128	164	1.5	1.4	1.5	76	120	155	185	205
181314			68	90	107	129	165	1.9	1.8	1.9	74	118	153	183	203
181315			69	91	108	130	166	1.5	1.4	1.5	80	124	159	189	209
181316			70	92	109	131	167	1.9	1.8	1.9	76	120	155	185	205
181317			71	93	110	132	168	1.4	1.3	1.4	110	140	170	190	210
181318			72	94	111	133	169	1.3	1.2	1.3	110	140	170	190	210
181319			73	95	112	134	170	1.3	1.2	1.3	110	140	170	190	210
181320			74	96	113	135	171	1.3	1.2	1.3	110	140	170	190	210
181321			75	97	114	136	172	1.3	1.2	1.3	110	140	170	190	210
181322			76	98	115	137	173	1.3	1.2	1.3	110	140	170	190	210
181323			77	99	116	138	174	1.3	1.2	1.3	110	140	170	190	210
181324			78	100	117	139	175	1.3	1.2	1.3	110	140	170	190	210
181325			79	101	118	140	176	1.3	1.2	1.3	110	140	170	190	210
181326			80	102	119	141	177	1.3	1.2	1.3	110	140	170	190	210
181327			81	103	120	142	178	1.3	1.2	1.3	110	140	170	190	210
181328			82	104	121	143	179	1.3	1.2	1.3	110	140	170	190	210
181329			83	105	122	144	180	1.3	1.2	1.3	110	140	170	190	210
181330			84	106	123	145	181	1.3	1.2	1.3	110	140	170	190	210
181331			85	107	124	146	182	1.3	1.2	1.3	110	140	170	190	210
181332			86	108	125	147	183	1.3	1.2	1.3	110	140	170	190	210
181333			87	109	126	148	184	1.3	1.2	1.3	110	140	170	190	210
181334			88	110	127	149	185	1.3	1.2	1.3	110	140	170	190	210
181335			89	111	128	150	186	1.3	1.2	1.3	110	140	170	190	210
181336			90	112	129	151	187	1.3	1.2	1.3	110	140	170	190	210
181337			91	113	130	152	188	1.3	1.2	1.3	110	140	170	190	210
181338			92	114	131	153	189	1.3	1.2	1.3	110	140	170	190	210
181339			93	115	132	154	190	1.3	1.2	1.3	110	140	170	190	210
181340			94	116	133	155	191	1.3	1.2	1.3	110	140	170	190	210
181341			95	117	134	156	192	1.3	1.2	1.3	110	140	170	190	210
181342			96	118	135	157	193	1.3	1.2	1.3	110	140	170	190	210
181343			97	119	136	158	194	1.3	1.2	1.3	110	140	170	190	210
181344			98	120	137	159	195	1.3	1.2	1.3	110	140	170	190	210
181345			99	121	138	160	196	1.3	1.2	1.3	110	140	170	190	210
181346			100	122	139	161	197	1.3	1.2	1.3	110	140	170	190	210
181347			101	123	140	162	198	1.3	1.2	1.3	110	140	170	190	210
181348			102	124	141	163	199	1.3	1.2	1.3	110	140	170	190	210
181349			103	125	142	164	200	1.3	1.2	1.3	110	140	170	190	210
181350			104	126	143	165	201	1.3	1.2	1.3	110	140	170	190	210
181351			105	127	144	166	202	1.3	1.2	1.3	110	140	170	190	210
181352			106	128	145	167	203	1.3	1.2	1.3	110	140	170	190	210
181353			107	129	146	168	204	1.3	1.2	1.3	110	140	170	190	210
181354			108	130	147	169	205	1.3	1.2	1.3	110	140	170	190	210
181355			109	131	148	170	206	1.3	1.2	1.3	110	140	170	190	210
181356			110	132	149	171	207	1.3	1.2	1.3	110	140	170	190	210
181357			111	133	150	172	208	1.3	1.2	1.3	110	140	170	190	210
181358			112	134	151	173	209	1.3	1.2	1.3	110	140	170	190	210
181359			113	135	152	174	210	1.3	1.2	1.3	110	140	170	190	210
181360			114	136	153	175	211	1.3	1.2	1.3	110	140	170	190	210
181361			115	137	154	176	212	1.3	1.2	1.3	110	140	170	190	210
181362			116	138	155	177	213	1.3	1.2	1.3	110	140	170	190	210
181363			117	139	156	178	214	1.3	1.2	1.3	110	140	170	190	210
181364			118	140	157	179	215	1.3	1.2	1.3	110	140	170	190	210
181365			119	141	158	180	216	1.3	1.2	1.3	110	140	170	190	210
181366			120	142	159	181	217	1.3	1.2	1.3	110	140	170	190	210
181367			121	143	160	182	218	1.3	1.2	1.3	110	140	170	190	210
181368			122	144	161	183	219	1.3	1.2	1.3	110	140	170	190	210
181369			123	145	162	184	220	1.3	1.2	1.3	110	140	170	190	210
181370			124	146	163	185	221	1.3	1.2	1.3	110	140	170	190	210
181371			125	147	164	186	222	1.3	1.2	1.3	110	140	170	190	210
181372			126	148	165	187	223	1.3	1.2	1.3	110	140	170	190	210
181373			127	149	166	188	224	1.3	1.2	1.3	110	140	170	190	210
181374			128	150	167	189	225	1.3	1.2	1.3	110	140	170	190	210
181375			129	151	168	190	226	1.3	1.2	1.3	110	140	170	190	210
181376			130	152	169	191	227	1.3	1.2	1.3	110	140	170	190	210
181377			131	153	170	192	228	1.3	1.2	1.3	110	140	170	190	210
181378			132	154	171	193	229	1.3	1.2	1.3	110	140	170	190	210
181379			133	155	172	194	230	1.3	1.2	1.3	110	140	170	190	210
181380			134	156	173	195	231	1.3	1.2	1.3	110	140	170	190	210
181381			135	157	174	196	232	1.3	1.2	1.3	110	140	170	190	210
181382			136	158	175	197	233	1.3	1.2	1.3	110	140	170	190	210
181383			137	159	176	198	234	1.3	1.2	1.3	110	140	170	190	210
181384			138	160	177	199	235	1.3	1.2	1.3	110	140	170	190	210
181385			139	161	178	200	236	1.3	1.2	1.3	110	140	170	190	210
181386			140	162	179	201	237	1.3	1.2	1.3	110	140	170	190	210
181387			141	163	180	202	238	1.3	1.2	1.3	110	140	170	190	210
181388			142	164	181	203	239	1.3	1.2	1.3	110	140	170	190	210
181389			143	165	182	204	240	1.3	1.2	1.3	110	140	170	190	210
181390			144	166	183	205	241	1.3	1.2	1.3	110	140	170	190	210
181391			145	167	184	206	242	1.3	1.2	1.3	110	140	170	190	210
181392			146	168	185	207	243	1.3	1.2	1.3	110	140	170	190	210
181393			147	169	186	208	244	1.3	1.2	1.3	110	140	170	190	210
181394			148	170	187	209	245	1.3	1.2	1.3	110	140	170	190	210
181395			149	171	188	210	246	1.3	1.2	1.3	110	140	170	190	210
181396			150	172	189	211	247	1.3	1.2	1.3	110	140	170	190	210
181397			151	173	190	212	248	1.3	1.2	1.3	110	140	170	190	210
181398		</													

Project ID	Project	Nameplate	Levelized Cost All Scenarios \$/MWh	Portfolio Benefit / REC			Portfolio Benefit Ratio			Net Cost/REC											
				NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank	Societal Rank	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank	Societal Rank						
18116																					
18116																					
18131																					
18116																					
18116																					
18126																					
18126																					
18126																					
18124																					
18124																					
18124																					
18124																					
18169																					
18182																					
18182																					
18102																					

CONFIDENTIAL

Notes

1. Ranking color scheme: green is high ranking, red is low ranking.
2. Engaged our firms at the bottom of the list indicate either withdrawn proposals or proposals with final flaws.
3. Some proposals have N/A values for portfolio benefit. The reason is that if the portfolio benefit ratio calculation breaks down and is meaningless.
4. Some proposals have N/A values for portfolio benefit. The reason is that if the portfolio benefit ratio calculation breaks down and is meaningless.

REDACTED  
VERSION

REDACTED  
VERSION

# 2018 RFP Phase I Quantitative Results Summary - Capacity Resource (results as of 4/2/2019)

Project ID	Project	NAME/PLATE	Levelized Cost			Portfolio Benefit / kW-yr			Net Cost / kW-yr			
			All Scenarios \$/MWh	Rank	Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-yr	Societal \$/kW-yr	NO CO2 \$/kW-yr	CO2 Fee \$/kW-yr	Societal \$/kW-yr	
18169		MW	\$	16	2	1	2	1	1	1	2	2
18169		MW	\$	27	3	2	3	2	2	10	3	3
18173		MW	\$	50	5	3	1	1	6	1	1	1
18176		MW	\$	32	4	4	4	4	3	4	4	6
18173		MW	\$	47	6	5	5	4	4	5	4	4
18100	SPI Industrial Biomass	17 MW	\$	98	6	6	6	6	46	28	7	7
18105		MW	\$	150	7	10	10	10	2	8	11	11
18105		MW	\$	162	8	9	15	15	5	12	18	18
XXXXX		MW	\$	160	9	8	9	9	7	9	9	9
18105		MW	\$	152	10	14	11	11	9	15	12	12
18105		MW	\$	152	11	11	12	12	12	11	11	15
18170	Golden Hill - Shaped	200 MW	\$	42	7	8	7	8	8	7	10	10
18105		MW	\$	161	13	13	16	16	13	16	19	19
18201		MW	\$	161	14	12	17	17	11	10	14	14
18103		MW	\$	25	15	17	20	20	15	16	24	24
18201		MW	\$	117	16	16	18	18	14	17	16	16
18104		MW	\$	117	17	21	25	25	17	25	13	13
18202		MW	\$	114	18	18	19	19	18	19	21	21
18104		MW	\$	114	19	24	26	26	16	22	29	29
18201		MW	\$	151	20	20	21	21	19	20	23	23
18105		MW	\$	154	21	23	23	23	20	24	25	25
18105		MW	\$	154	22	23	22	22	21	30	26	26
18105		MW	\$	155	24	26	24	24	23	27	27	27
18104		MW	\$	92	25	28	28	28	22	34	34	34
18145		MW	\$	38	26	31	29	29	22	32	32	32
18104		MW	\$	156	27	57	53	53	26	38	28	28
18159		MW	\$	156	29	37	27	27	25	40	33	33
UP001		MW	\$	156	30	36	30	30	27	41	37	37
18203		MW	\$	156	31	51	37	37	30	48	5	5
18156 / 18158		MW	\$	158	32	46	34	34	28	47	40	40
18157		MW	\$	158	33	45	39	39	29	46	42	42
18145		MW	\$	158	34	44	44	44	32	52	43	43
18156 / 18158		MW	\$	158	35	80	74	74	31	29	22	22
18188		MW	\$	158	36	42	62	62	33	42	46	46
18157		MW	\$	158	37	52	36	36	35	56	49	49
18156 / 18158		MW	\$	158	38	41	63	63	34	54	47	47
18157		MW	\$	158	39	48	48	48	36	51	48	48
18156 / 18158		MW	\$	158	40	68	81	81	37	55	50	50
18145		MW	\$	158	41	35	82	82	39	13	51	51
18157		MW	\$	158	42	95	71	71	48	31	20	20
18145		MW	\$	158	43	62	83	83	41	59	52	52
18156 / 18158		MW	\$	158	44	34	56	56	40	37	30	30
18188		MW	\$	158	45	56	45	45	43	60	64	64
18157		MW	\$	158	46	38	58	58	42	39	31	31
18107		MW	\$	114	47	29	7	7	38	26	8	8
18144		MW	\$	114	48	53	42	42	44	49	53	53
18147		MW	\$	114	49	49	32	32	45	53	39	39
18156 / 18158		MW	\$	114	50	43	77	77	47	43	35	35
18157		MW	\$	114	51	61	79	79	49	44	36	36
18156 / 18158		MW	\$	114	52	54	87	87	52	66	76	76
18156 / 18158		MW	\$	114	53	25	104	104	63	18	87	87
18156 / 18158		MW	\$	114	54	88	70	70	53	89	77	77
18200		MW	\$	114	55	59	33	33	51	64	61	61
18152		MW	\$	114	56	81	50	50	50	84	44	44
18147		MW	\$	114	57	58	38	38	54	62	54	54

REDACTED VERSION

REDACTED VERSION

Project		NAMEPLATE	Levelized Cost All Scenarios \$/MWh	Portfolio Benefit / kW-yr			Net Cost / kW-yr			
Project ID	Project			NO CO2 \$/kw-yr	Societal \$/kw-yr	NO CO2 Rank	CO2 Fee \$/kw-yr	Societal \$/kw-yr	NO CO2 Rank	CO2 Fee Rank
18156 / 18158		MW		58	30	97		55	36	66
18157		MW		59	103	86		65	63	65
18156 / 18158		W		60	99	98		57	71	68
18147		W		61	22	99		58	23	70
18157		W		62	60	39		60	60	55
18157		W		63	93	72		70	77	67
18157		W		64	97	100		61	73	72
18152		W		65	87	35		56	58	44
18155		W		66	64	40		62	68	57
18205		MW		67	72	49		59	72	71
18155		MW		68	65	41		64	69	60
18156 / 18158		MW		69	19	95		66	21	56
18157		MW		70	96	96		69	61	58
18146		MW		71	63	67		68	14	62
18145		MW		72	40	68		67	92	17
18145		MW		73	71	44		71	74	63
18143		MW		74	76	47		73	80	75
18151		MW		75	83	65		72	85	84
18154		MW		76	75	46		74	79	69
18157		MW		77	106	102		80	82	82
18154		MW		78	77	48		76	81	74
18152		MW		79	90	57		75	94	86
18148		MW		80	70	76		79	79	79
18146		MW		81	79	69		77	34	73
18154		MW		82	82	51		78	87	78
18155		MW		83	86	52		81	93	81
18143		MW		84	89	54		83	95	85
18152		MW		85	66	43		82	67	59
18155		MW		86	84	55		84	91	83
18154		MW		87	92	60		86	98	88
18154		MW		88	91	64		88	97	89
18204		MW		89	94	73		89	100	91
18149		MW		90	67	101		91	75	94
18155		MW		91	98	66		90	101	92
18149 / 18153		MW		92	73	105		97	86	99
18154		MW		93	100	75		92	102	93
18143		W		94	101	78		94	103	96
18149		W		95	55	90		93	57	95
18149		W		96	47	88		95	45	97
18160		MW		97	104	93		96	106	105
18189		MW		98	33	89		98	35	103
18149 / 18153		W		99	69	103		99	70	100
18150		W		100	78	85		100	83	101
18149 / 18153		W		101	105	106		101	89	102
18160		MW		102	102	84		102	104	98
18150		W		103	74	91		103	76	80
18150		W		104	85	92		104	88	104
18189		W		105	50	94		104	50	106
18159		MW		106	107	107		107	107	107
18161	BPA Peak Capacity Product	100 MW								
18143		W								

REDACTED VERSION

REDACTED VERSION

Notes

- Ranking color scheme: green is high ranking, red is low ranking.
- Grayed out lines at towards the bottom of the list indicate either withdrawn proposals or proposals with fatal flaws.
- Energy storage proposals have N/A value for levelized cost since the energy storage proposal is net user of energy (it does not have levelized cost in \$/MWh).





## 2018 RFP – Executive Summary\*

Quantitative results are on pages 8-12 herein.

### Candidate Short List: Proposals selected for Phase 2 optimization and due diligence (organized alphabetically by project name)

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18100</b> <b>SPI Burlington Biomass</b> Sierra Pacific Industries Power Purchase Agreement ("PPA") Operational Biomass 17 MW nameplate Commercial Operation Date (COD): 01/01/2021 17 years capacity		<ul style="list-style-type: none"> <li>Relatively inexpensive REC producing</li> <li>Proportionally high contribution to the capacity need.</li> <li>Existing operational site</li> <li>Interconnected with PSE system</li> <li>Minimal risks all-around</li> </ul>	<ul style="list-style-type: none"> <li>Sierra Pacific Industries is a privately held company so less financial information is available than if it had been public</li> </ul>	<p><b>Selected</b> - The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the high levelized portfolio benefit over renewable energy credit ("REC") ranking, and due to the relatively high levelized portfolio benefit over kilowatt year ranking and low qualitative risks.</p>
<b>18103</b> [REDACTED] Capacity Tolling Agreement ("CTA") or Asset Transfer Operational Combined Cycle [REDACTED] MW** or [REDACTED] MW Start: 06/01/2022 Term: 10 year (PPA)		<ul style="list-style-type: none"> <li>Second least expensive thermal proposal currently in RFP</li> <li>Existing operational site (rather than new build)</li> <li>Strong presence in the community</li> <li>Expansion opportunity on adjacent land</li> </ul>	<ul style="list-style-type: none"> <li>Would likely be impacted by carbon legislation currently being considered in Olympia</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, there would likely be considerable reputational risk.</li> <li>Is not clear whether there is firm gas transport to plant, which would be required to count as a capacity resource</li> </ul>	<p><b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18105</b> [REDACTED] CTA** and Build to Sell ("BTS") Thermal Expansion [REDACTED] MW** of [REDACTED] MW COD: 01/01/2022 5, 15, and 20** year term		<ul style="list-style-type: none"> <li>Least expensive thermal proposal in RFP</li> <li>Expansion of existing site rather than a new thermal facility.</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate with other sites.</li> <li>[REDACTED] MW proposal could likely be facilitated with firm gas supply with existing facilities.</li> </ul>	<ul style="list-style-type: none"> <li>Air permit path is complex and possibly not feasible.</li> <li>The likely-to-be-required air permit modification could bring more operational constraints for the existing generation units.</li> <li>PSE will experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's thermal generation portfolio.</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, the proposed schedule and general project feasibility seem to be in question.</li> </ul>	<p><b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>
<b>18107</b> [REDACTED] PPA Operational Hydro [REDACTED] MW start: 1/1/2021 (assumed) Term: 20 year (assumed)		<ul style="list-style-type: none"> <li>Existing operational site (rather than new build)</li> <li>Clean energy (although not Renewable Portfolio Standard ("RPS") compliant)</li> <li>Run-of-river hydro can be less environmentally impactful than standard hydro</li> <li>Little to no permitting or real estate risk due to current operational status</li> </ul>	<ul style="list-style-type: none"> <li>Not RPS compliant (although clean energy)</li> <li>Proposal is missing important details regarding pricing, term length, term, etc.</li> <li>Although PSE has worked with this counterparty before, possible risks remain</li> </ul>	<p><b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>
<b>18111</b> [REDACTED] PPA** or BTS Development solar Solar: [REDACTED] MW/Vac COD: 12/31/2022 Term: 20 year (PPA)		<ul style="list-style-type: none"> <li>Relatively high quantitative score for solar project</li> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Site control has been achieved</li> <li>Permitting status is sufficient at this stage</li> <li>Located on PSE's system in [REDACTED] County avoids community concerns in [REDACTED] County</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to available transmission capacity ("ATC") constrains in area. Delivery is possible to Mid-C however may be difficult given projects proximity to the [REDACTED] substation</li> </ul>	<p><b>Selected</b> - The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered [REDACTED]  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18112</b> [REDACTED] PPA** and Optional Energy Storage System Development solar Solar: [REDACTED] MW/ac** Storage: [REDACTED] MWh / [REDACTED] MW / 2 HR COD: 12/31/2022 Term: 25 year		<ul style="list-style-type: none"> <li>Developer has solar development experience (primarily on a smaller scale)</li> <li>Located on PSE's system [REDACTED] County avoids community concerns in [REDACTED] County</li> </ul>	<ul style="list-style-type: none"> <li>Developer has primarily small scale solar development experience and no experience in the northwest</li> <li>Project acreage appears to be too small for proposed nameplate capacity</li> <li>Permitting information provided is insufficient</li> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18114</b> [REDACTED] PPA Solar Generation [REDACTED] MW <sub>ac</sub> COD: Q4 2020 20 year term		<ul style="list-style-type: none"> <li>[REDACTED] is assessed to be a relatively strong parent company</li> <li>Site as proposed doesn't have major implications on agricultural land</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Need specifics on parent company support, or financing otherwise</li> <li>Solar facilities are under contention in [REDACTED] County</li> <li>Permitting will require a transfer of an Energy Facility Site Evaluation Council ("EFSEC") permit, which will bring a viability and reputation risk to the project and PSE</li> <li>Transmission and energy delivery may be overly expensive or otherwise not feasible</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18122</b> [REDACTED] PPA** , Optional Energy Storage System Development MWh [REDACTED] MW <sub>ac</sub> ** & [REDACTED] MW 1 Hr Energy Storage System COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash.</li> <li>Relatively inexpensive solar energy with potential for battery storage.</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Significant viability issues delivering to PSE area</li> <li>Solar development not positively looked at in this area</li> <li>Site may block the view of a local real estate development.</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION






**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18125</b> PPA Development Solar MW <sub>ac</sub> COD: 10/31/2022 Term: 15 year or 20 year**	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Site control appears to be more than adequate given proposed size of project</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> <li>Site permitting is in a relatively early state of development</li> <li>Minimal information provided regarding community relations and or support</li> </ul>	<ul style="list-style-type: none"> <li>May be siting concerns given proximity to wind turbines with required setbacks</li> <li>Assumes use of [REDACTED] with current [REDACTED] landowners</li> <li>CUP required to permit project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18127</b> PPA Development Solar MW <sub>ac</sub> COD: 12/31/2022 Term: 15 year or 20 year**	<ul style="list-style-type: none"> <li>Extensive solar energy development experience including having developed, currently owning and operating [REDACTED] solar project in Washington State.</li> <li>Location on existing project site may provide economy of scale in development and operation of project.</li> <li>County has expressed support in the project</li> </ul>	<ul style="list-style-type: none"> <li>Less experience when compared to other counterparties</li> <li>MMW option would possibly run into available transmission capacity issues</li> <li>[REDACTED] tribe may request compensation from project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next phase of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18131</b> PPA** or BTS Development Wind MW COD: 12/1/2022 25 year term	<ul style="list-style-type: none"> <li>Credit support in the form of a parent guarantee, letter of credit, or cash</li> <li>Long-term site control secured</li> <li>Permitting likely to meet proposed timeline</li> <li>Community relations plan was strong when compared to other proposals</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>		

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18132</b>  PPA** Development Wind**, Solar, Energy Storage System ■ IMW** COD: 01/01/2021 Term: 20 year	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Wind is an existing site, therefore little concern for site control or community relations</li> </ul>	<ul style="list-style-type: none"> <li>May be concern for permitting required for a repower</li> <li>Mid-C delivery negates any capacity value brought by the Energy Storage System Option</li> <li>Repowered project may not create as much excitement given the lack of an incrementally new project</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>	
<b>18135</b>  PPA** or BTS Development Solar ■ IMW** or ■ MW Solar Optional ■ MW 4 Hr Energy Storage System COD: 12/1/2022 20 year term PPA	<ul style="list-style-type: none"> <li>Large counterparty with experience all over the world</li> <li>Letter of intent with an option to lease has been signed</li> </ul>	<ul style="list-style-type: none"> <li>Minimal detail regarding creditworthiness or financing was included in the proposal</li> <li>Transmission directly to PSE appears to be overly expensive or infeasible. Mid-C delivery with no contribution to peak capacity is likely the best offer configuration</li> <li>Permitting plan is underdeveloped</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>	
<b>18139</b>  PPA Development Solar ■ IMW Solar with optional Storage System ■ MW** or ■ MW 1.82 Hr Energy COD: 12/31/2022 10 year term PPA	<ul style="list-style-type: none"> <li>Large multi-national counterparty with greater-than-average renewable development experience</li> </ul>	<ul style="list-style-type: none"> <li>Site control not-yet secured, and no indication of pending agreement was provided</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Permitting process has not yet begun, and presents minimal evidence that they have the ability to identify and secure all permits</li> <li>Community relations was not covered sufficiently, and tribal support may be required</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high leveled portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18163</b>  REC purchase Underlying solar projects [Redacted] RECS per year Start of term: 1/1/2022 18 year term		<ul style="list-style-type: none"> <li>Minimal risk regarding underlying projects</li> <li>Interconnection at distribution voltage dictates that each as-generated MWh produce two Washington State RECs.</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facilities</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>18165</b>  REC purchase Underlying solar project [Redacted] RECS per year Start of term: 1/1/2022** or 2024 16 or 18** year term		<ul style="list-style-type: none"> <li>Minimal risk regarding underlying project</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facility</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>18166</b>  Developmental Asset Sale ("DAS"), BTS, or PPA** Development Wind [Redacted] MW COD: 12/1/2020, 2021, or 2022** 25 year term		<ul style="list-style-type: none"> <li>Long-term site control established</li> </ul>	<ul style="list-style-type: none"> <li>Significant concerns regarding the counterparty's ability to develop, finance, and construct the facility</li> <li>Relatively small counterparty with inconclusive rights to the project's developmental assets</li> <li>Timing of project is contingent on BPA infrastructure upgrades to enable transmission capacity</li> <li>Project owner, [Redacted] seemed uninterested in furthering project development via first-hand experience at [Redacted] public hearing</li> <li>Timeline as-proposed is likely not feasible and pricing is likely contingent on timing due to PTC safe harbor</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18169</b>  PPA** or 50% Ownership + PPA Development Wind MW** or  MW COD: 12/31/2020 or 2021** 20 or 25** year term		<ul style="list-style-type: none"> <li>Relatively cost efficient way to meet REC and contribution to peak capacity need</li> <li>Large and experienced counterparty</li> <li>Site control is reportedly achieved, but supporting documentation was not included in proposal</li> <li>Public has been notified of the project as a  MW facility</li> <li>Shape of wind based on 6 operating MET towers appears to fit well with PSE's needs</li> </ul>	<ul style="list-style-type: none"> <li>Minimal experience in the Pacific Northwest</li> <li>Large generation-tie transmission line is required</li> <li>There is a potential issue with sage grouse habitat</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>18170</b> <b>Golden Hills Wind</b> <b>Avangrid Renewables</b> PPA, PPA-shaped**, BTS Development Wind 200 MW** COD: 12/1/2020** Term: 20 year**		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Shaped product offers capacity contribution during peak winter months</li> <li>Likely low risk to real estate given advanced level</li> <li>Permitting well advanced with Oregon Energy Facility Siting Council ("EFSC") permit application already amended</li> </ul>	<ul style="list-style-type: none"> <li>Complex energy delivery will require additional vetting</li> <li>Complexity of shaped product will require additional vetting</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.
<b>18173</b>  PPA** Development Wind MW or  MW COD: 10/31/2022** Term: 20**		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>May only need single landowner which would indicate little real estate challenges</li> <li>Favorable state support, however local level of support unknown</li> </ul>	<ul style="list-style-type: none"> <li>Possibly require DNRC land which could complicate site control and permitting</li> <li>Permitting is relatively early in development, however there may be concerns for meeting scheduled COD</li> <li>Use of Colstrip Transmission System is under ongoing review, however may be problematic</li> </ul>	<b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18175</b>  PPA, BTS, or WSPP Shaped** Development Wind MW COD: 10/1/2020 25 year term		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Western Systems Power Pool ("WSPP") schedule C delivery is a unique value</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty and financing details will require data requests</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Mid-C delivery will likely be necessary, which would negate a contribution to peak capacity</li> <li>Permitting plan seems either underdeveloped or underrepresented in the proposal</li> <li>Outreach plan is underdeveloped</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18176</b>  PPA** Development Wind MW** or MW COD: 12/31/2022 Term: N/A		<ul style="list-style-type: none"> <li>Indications of strong local, state and environmental support</li> <li>Potential to partner with a local Native American tribe</li> <li>Located near  and in the same County</li> <li>Counterparty has indicated a plan to partner and/or otherwise engage an experienced renewable energy developer on the project</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty does not have experience designing, financing, building, owning or operating a large scale renewable or other energy projects</li> <li>Use of  is under ongoing review, however may be problematic</li> <li>Additional detail needed regarding the real estate and permitting considerations necessary for the site</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18179</b>  PPA**, BTS Development Wind MW** COD: 12/31/2021 Term: 20 year		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate appears adequate and relatively low risk</li> <li>Project sizing has been altered in order to address some local viewshed concerns</li> </ul>	<ul style="list-style-type: none"> <li>History of considerable local and County level opposition to the project</li> <li>Counterparty bypassed the County permitting process by pursuing permit approval through the state's EFSEC process</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION





Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18190</b> REC Offer Underlying proposed solar facilities RECs / year COD: 01/01/2022 12, 15**, or 20 years		<ul style="list-style-type: none"> <li>Inexpensive RECs</li> <li>Site control is secured</li> <li>EFSEC projects have been approved by Governor Insee</li> </ul>	<ul style="list-style-type: none"> <li>Realizing full REC-output of underlying projects is unlikely due to interconnection issues</li> <li>██████████ is currently in litigation with PSE over interconnection issues with the underlying projects</li> <li>██████████ County opposes the EFSEC decision and has applied for judicial review</li> <li>Major feasibility concerns with some of the underlying projects, and schedule concerns for all</li> <li>Projects sited in commercial agricultural land and many stakeholders in the County oppose development on these lands</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>18201</b> Direct load control Bring your own thermostat, smart water heater MW COD: 1/1/2023 Term: 6 years		<ul style="list-style-type: none"> <li>Industry leader by Navigant study</li> <li>2016 PSE Demand Response ("DR") RFP finalist</li> <li>Iron manages all program implementation</li> <li>Strong financial, WA based</li> <li>The MW option makes it a small scale project to test out</li> </ul>	<ul style="list-style-type: none"> <li>No convincing reason provided to suggest a ramp up in DR deployment just in a year in 2023</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>
<b>XXXXX</b> N/A Transmission Redirect MW** COD: 01/01/2022 Term: 55 year book life		<ul style="list-style-type: none"> <li>If feasible, redirect to Mid-C would provide a strong capacity resource</li> </ul>	<ul style="list-style-type: none"> <li>Increased exposure to market prices (for redirect to Mid-C)</li> <li>Ambiguity regarding how much redirect is possible to Mid-C (MW assumed), therefore how much would be required to redirect elsewhere on BPAs system</li> <li>If greater than MW were to be redirected, the amount above MW would have to redirect to another PSEI node, e.g. PGE, etc. Source of energy at second redirect point unknown</li> </ul>	<p><b>Selected</b> – The RFP team recommends this project proceed to the next of the 2018 all-resource RFP due to the relatively high levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Resources eliminated during the Phase 1 screening (organized alphabetically by project name)

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18101</b>  PPA Operating Biomass Start of Term: 07/01/2021 7.25 Year Term		<ul style="list-style-type: none"> <li>The project is already operational, and therefore has viability issues largely solved</li> <li>Transmission and energy delivery options seem viable on initial review</li> </ul>	<ul style="list-style-type: none"> <li>Local community is fairly charged and might lump this project in with the nearby [redacted] facility in their protests, even though it is a REC generating facility</li> </ul>	<b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-Resource RFP due to the low levelized portfolio benefit over renewable energy credit ("REC") ranking.
<b>18102</b>  PPA Proposed Biomass Start of Term: 01/01/2022 Unknown term duration		<ul style="list-style-type: none"> <li>Site control is allegedly secured via reserved land on existing property</li> </ul>	<ul style="list-style-type: none"> <li>Most qualitative details required to be addressed in the 2018 RFP, including counterparty, permitting, energy delivery, and community relations were not adequately covered in the proposal</li> </ul>	<b>Not selected</b> - The RFP team does not recommend this project to proceed to Phase 2 of the 2018 RFP due to a significant lack of detail in the proposal that resulted in the inability to analyze the proposal on a quantitative or qualitative basis.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18104</b> [REDACTED] CTA, 50%** or 100% Asset Sale, or HRCO Operating CC Thermal Plant [REDACTED] MW to [REDACTED] MW Start of Term: 01/01/2022 3 to 10 Year Term		<ul style="list-style-type: none"> <li>This was one of two already-operating thermal facilities proposed into the 2018 RFP</li> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Counterparty has strong renewable energy portfolio</li> <li>Site control and permitting should not represent issues to PSE or Invenegy</li> </ul>	<ul style="list-style-type: none"> <li>Heat rate call option ("HRCO") at [REDACTED] MMBTU represents a poor value requiring significant additional pipeline capacity</li> <li>Energy delivery is expensive and complex</li> <li>Singing a new deal with a thermal resource represents a potentially significant reputational risk with governmental agencies, NGOs, activists, as well as typical energy consumers</li> <li>Combined cycle turbine starts up slower than other thermal proposals</li> <li>Ownership would likely involve significant facility upgrades not included in phase 1 quantitative analysis</li> <li>May not qualify for Washington State RPS due to location in Nevada, relatively far away from Washington.</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking as well as the potentially significant reputational risk with signing a new long-term agreement with a thermal generation resource.</p>
<b>18106</b> [REDACTED] PPA** Development Geothermal [REDACTED] MW** COD: 09/01/2021** Term: 20 year**		<ul style="list-style-type: none"> <li>Geothermal asset may provide clean capacity product</li> </ul>		<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>
<b>18108</b> [REDACTED] PPA Developmental Solar [REDACTED] MW Solar* and optional [REDACTED] MW 4 Hour Energy Storage System COD: 12/15/2022 15 or 20 year term		<ul style="list-style-type: none"> <li>[REDACTED] is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>Permitting timeline seems feasible for COD, but not for the proposed start of construction</li> </ul>	<ul style="list-style-type: none"> <li>Site control is not established, and presents a feasibility risk to the project since the land is being sold via auction</li> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>Solar proposals in [REDACTED] County present some reputational risk</li> <li>[REDACTED] MW capacity seems to facilitate Public Utility Regulatory Policies Act ("PURPA") considerations</li> </ul>	<p><b>Not selected</b> - The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18109</b> Developmental Solar [REDACTED] MW Solar* and optional [REDACTED] MW 4 Hour Energy Storage System COD: 12/15/2022 15 or 20* year term	<ul style="list-style-type: none"> <li>[REDACTED] is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter-of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>Long-term site control is achieved</li> <li>Permitting timeline seems feasible</li> </ul>	<ul style="list-style-type: none"> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>[REDACTED] MW capacity seems to facilitate PURPA considerations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>	
<b>18110</b> BTS or DAS Developmental Solar [REDACTED] MW Solar* and optional [REDACTED] MW 4 Hour Energy Storage System COD: 12/15/2022 15 or 20* year term	<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty has minimal project development and construction experience</li> <li>Project financing plan has very minimal detail</li> <li>Expensive energy delivery to PSE or Mid-C due to available transmission capacity limitations</li> <li>Minimal detail in community relations plan</li> <li>Solar proposals in [REDACTED] County present some reputational risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18113</b> Developmental Solar [REDACTED] MW** COD: 12/31/2022** 15** or 20 year term	<ul style="list-style-type: none"> <li>Extensive solar energy development experience including [REDACTED] having developed, currently owning and operating [REDACTED] solar project in Washington State.</li> <li>Site control has been achieved</li> <li>ODOE certificate secured</li> </ul>	<ul style="list-style-type: none"> <li>Complex delivery to PSE requires multiple transmission legs at additional cost</li> </ul>	<p><b>Not selected</b> – The RFP evaluation team does not recommend [REDACTED] proposal for phase 2 consideration in the 2018 All Resource RFP due to its low quantitative score.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18115</b>  PPA Developmental Solar MW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control is secured for a wind project, and can likely be altered to allow for Solar development</li> </ul>	<ul style="list-style-type: none"> <li>Solar energy in Montana does not appear to provide the same cost efficiency, net capacity factor, or contribution to peak capacity when compared to the larger wind projects in the region</li> <li>Energy delivery has been left to PSE and will be infeasible or expensive</li> <li>Minimal details regarding a permitting plan of action</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 All-Resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18116</b>  PPA Development Solar MW COD: 12/1/2022 20** or 25 year term	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>
<b>18117</b>  15-yr/20-yr PPA, Development Wind Up to MW COD: 1/1/2021 Term:	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18118</b>  PPA Developmental Solar IMW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control has been secured via land leases</li> <li>Permitting has been largely secured via Oregon EFSC in February 2018</li> </ul>	<ul style="list-style-type: none"> <li>Long-point to point transmission is unlikely to be feasible</li> <li>Lack of cohesive community relations plan coupled with EFSC permit presents some reputational risk to the project and to PSE</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18119</b>  PPA Developmental Solar IMW Solar with Optional Hr Energy Storage System COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control for the project is achieved</li> <li>While energy delivery was largely left to PSE, on initial review, it appears to be feasible</li> </ul>	<ul style="list-style-type: none"> <li>Generation-tie line still requires land-use rights</li> <li>Relatively insufficient permitting plan</li> <li>Potential issues with proximity to nearby airport</li> <li>Minimal details regarding a community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18120</b>  PPA Developmental Solar MW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control appears to be obtained imminently, however, minimal detail was included in the proposal</li> </ul>	<ul style="list-style-type: none"> <li>BPA transmission would require significant network upgrades which indicate cost and schedule risk</li> <li>Relatively insufficient permitting plan</li> <li>Minimal details regarding a community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18121</b> PPA Developmental Solar MW COD: 12/1/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Letters of intent have been signed with potential lessors, and there should be plenty of time to finalize lease agreements</li> <li>Community relations plan appears to be adequate</li> </ul>	<ul style="list-style-type: none"> <li>proposals into the 2018 RFP were withdrawn due to infeasibility in January 2018</li> <li>Transmission plan is undeveloped and reliant on PSE being a network customer of BPA, which is not and will not be the case</li> <li>Permitting plan is relatively insufficient and undeveloped</li> <li>Recent fires in this area, in close proximity to Interstate 90, presents a risk to the ongoing operation of the site</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18123</b> PPA Developmental Solar + Energy Storage System MW Solar & optional MW Storage MW, 2, 4**, 6 Ht Energy Storage System COD: 10/31/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Site control projected to be achieved by Q2 2019</li> </ul>	<ul style="list-style-type: none"> <li>Generation-tie line not included in proposed site control</li> <li>Interconnection queue position was described in the proposal, but could not be confirmed by RFP team</li> <li>Relatively insufficient information provided in the proposal</li> <li>County generally interested in renewables, including solar, but some nearby communities have opposed development</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18124</b> Operating Status & Offer PPA Development Solar MW or MW COD: 12/1/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18126</b> PPA Development Solar * MW of MW COD: 12/1/2022 20- or 25 year term		<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<ul style="list-style-type: none"> <li>This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</li> </ul>	<p><b>Not selected</b> – This proposal was removed from consideration by the developer on January 11<sup>th</sup> 2018.</p>
<b>18128</b> PPA**, Optional Energy Storage System Development solar Solar: MWac** Storage: MWh / MW / 2 HR COD: 06/01/2022 Term: 25 year		<ul style="list-style-type: none"> <li>Location in [redacted] relatively favorable location within the county.</li> <li>Real estate appears to be of an advanced stage and sufficient for proposed project size</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty solar experience exclusively small scale.</li> <li>While on PSE's system, complex delivery due to ATC constrains in area. Delivery is possible to Mid-C</li> <li>Developer withholds the rights to pursue state EFSEC permitting process, which would circumvent the county/local concerns, possibly engendering local hostility to the project</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18129</b> PPA** Development Solar MWac** COD: 01/01/2021 or 01/01/2023** Term: 15 or 20** year term		<ul style="list-style-type: none"> <li>Developer appears to have experience in the solar industry developing utility scale solar projects</li> <li>Relatively advanced stage of permitting with comprehensive permitting matrix provided by developer</li> <li>Real estate appears to be more than sufficient for the proposed project size</li> </ul>	<ul style="list-style-type: none"> <li>Proposed plan for energy delivery includes multiple transmission segments that would be costly</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION








Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18130</b> [REDACTED] PPA Development Solar + Energy Storage System [REDACTED] MW Solar & [REDACTED] MW 4 Hr Energy Storage System COD: 12/15/2022 15 or 20** year term	<ul style="list-style-type: none"> <li>[REDACTED] is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> </ul>	<ul style="list-style-type: none"> <li>Long-term site control is not yet obtained</li> <li>A BPA cluster study will likely be required to fixed point to point delivery to PSE's system, which brings cost and schedule variability</li> <li>Permitting progress has not yet begun as of the date of proposal submission</li> <li>Nameplate of [REDACTED] MW, a multiple of [REDACTED] MW, indicates developer consideration for PURPA eligibility</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as feasibility concerns regarding Transmission and Energy Delivery.</p>	
<b>18133</b> [REDACTED] PPA Development Solar + Energy Storage System [REDACTED] MW Solar & [REDACTED]** or 4 Hr, Energy Storage System COD: 12/15/2022 15 or 20** year term	<ul style="list-style-type: none"> <li>Experienced renewable developer, especially with wind assets</li> <li>Project expected to be financed on balance sheet</li> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>Proposed energy delivery plan is potentially not feasible, or overly expensive</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>	
<b>18134</b> [REDACTED] PPA Development Solar [REDACTED] MW COD: 1/1/2023 20 year term	<ul style="list-style-type: none"> <li>Financial support through [REDACTED] and other long-term debt partners</li> <li>Long-term site control is not yet achieved, but is reportedly close</li> </ul>	<ul style="list-style-type: none"> <li>[REDACTED] only has moderate renewable development, construction, and operational experience</li> <li>Energy delivery plan as proposed is likely infeasible, and transmission will need to be wheeled through BPA and Mid-C</li> <li>Community relations was not sufficient [REDACTED] in the proposal and solar development in [REDACTED] County is currently unpopular</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered [REDACTED]  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18136</b>  PPA Development Solar + Energy Storage System [redacted] MW Solar & [redacted] MW, 4 Hr Energy Storage System COD: 9/31/2022 20 year term		<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>[redacted] is a newer company with minimal construction and operational experience</li> <li>Transmission left to PSE (busbar delivery) and will likely route to Mid-C, removing any contribution to capacity</li> <li>Relatively immature permitting plan</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18137</b>  PPA Development Solar + Energy Storage System [redacted] MW Solar & [redacted] MW, 4 Hr Energy Storage System COD: 9/31/2022 20 year term		<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>[redacted] is a newer company with minimal construction and operational experience</li> <li>Transmission left to PSE (busbar delivery) and will likely route to Mid-C, removing any contribution to capacity</li> <li>Relatively immature permitting plan</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking as well as insufficient progress and level of detail provided when compared to other proposals in the RFP, especially regarding Transmission and Energy Delivery.</p>
<b>18138</b>  PPA Development Solar + Energy Storage System [redacted] MW Solar & [redacted] MW, 2 **, 4, or 6 Hr Energy Storage System COD: 3/31/2022 20 year term		<ul style="list-style-type: none"> <li>Long-term site control is achieved</li> <li>Significant efforts identifying and securing State and Federal permits</li> </ul>	<ul style="list-style-type: none"> <li>[redacted] is listed as a primary partner to [redacted] and [redacted] has had ongoing issues meeting construction schedule commitments with an in-construction wind farm [redacted]</li> <li>Solar energy in Montana does not appear to provide the same cost efficiency, net capacity factor, or contribution to peak capacity when compared to the larger wind projects in the region</li> <li>Minimal time has apparently been spent regarding local County permits</li> <li>Community relations was not covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>




\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18140</b>  PPA Development Solar + Energy Storage System MW Solar & MW 4 Hr Energy Storage System COD: 12/15/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>is an experienced renewable energy developer, specifically in the solar production</li> <li>Seller promises letter of credit and has experience obtaining financing with many major banks and financial institutions</li> <li>Long-term site control has been secured</li> <li>but relatively comprehensive, community relations plan</li> </ul>	<ul style="list-style-type: none"> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> <li>The permitting plan is not far along and there are potential schedule issues with the permitting as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18141</b>  PPA** Development Solar + Energy Storage System MW Solar** / MWh / 4 Hr Energy Storage System** COD: 9/30/2022** Term: 25 year**		<ul style="list-style-type: none"> <li>Located on location may ease development efforts</li> <li>Developer has experience in the region</li> <li>Purchase option (pricing undefined) offers some flexibility for asset purchase</li> </ul>	<ul style="list-style-type: none"> <li>Developer does not provide much financial information therefore financial credit worthiness is difficult to assess.</li> <li>Not apparent what value project brings with use of existing</li> <li>Little permitting work has been completed</li> <li>Use of transmission may be problematic and/or crowd out a future wind expansion at the site.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18142</b>  PPA Development Solar + Energy Storage System MW Solar & MW 4 Hr Energy Storage System COD: 9/30/2022 20 or 25** year term		<ul style="list-style-type: none"> <li>Large publically traded counterparty with strong financial performance and much experience in renewable development, construction, and operation</li> <li>Project would be financed on balance sheet</li> <li>Long-term site control is not yet achieved as of the proposal submission, but indications were that it would occur soon</li> </ul>	<ul style="list-style-type: none"> <li>There is apparently insufficient transmission capacity to secure firm point-to-point capacity</li> <li>Energy delivery plan as proposed requires PSE to be a network customer with BPA, which is not and will not be the case</li> <li>Permitting will require amendments, and not enough specifics on the plan was included in the proposal</li> <li>There was a relatively low amount of detail provided regarding the community relations plan</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18143</b>  BTS Development Energy Storage System MW, 2** or 4 Hr Lithium Ion or MW, 4 or 6 Hr Flow Energy Storage System COD: 12/31/2020		<ul style="list-style-type: none"> <li>Long-term site control secured</li> <li> is a Seattle-based company that should be able to engage the local community effectively</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li> New developer who recently lost a court battle regarding PURPA eligibility</li> <li> Site is in a location that has medium risk for gopher indicator soils, which has caused issues for PSE in the past</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18144</b>  CTA Development Energy Storage System MW, 4 Hr Lithium Ion Energy Storage System COD: 12/31/2021 10 or 20** year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li> Site is on land</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li> Transmission queue position with PSE has not yet been applied for</li> <li> Firm available transmission capacity is likely not obtainable</li> <li> Permitting process is relatively immature</li> <li> Community relations was not covered in proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18145</b>  CTA or BTS Development Energy Storage System MW, 2** or 4 Hr, Li-Ion Energy Storage System COD: 12/31/2021 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li> Long-term site control is not secured</li> <li> Site appears to be part of an active gravel pit</li> <li> Permitting process is early in development</li> <li> Community relations is not discussed in proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18146</b> [REDACTED] CTA or BTS Development Energy Storage System [REDACTED] MW, 4 Hr, Li-Ion Energy Storage System COD: 09/30/2022 20 year term	<ul style="list-style-type: none"> <li>Large multinational counterparty with experience in renewable and green power</li> <li>Strong financial performance and credit rating, and project would be financed on balance sheet</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Long-term site control is not yet secured</li> <li>Project is not yet in transmission queue, and would likely require significant network upgrades</li> <li>Community relations plan is lacking and is very necessary as the site is located in a commercial and industrial load center of PSE's service territory</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18147</b> [REDACTED] CTA Development Energy Storage System [REDACTED] MW, 4 Hr Li-Ion Energy Storage System COD: 09/30/2022 10 year term	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>[REDACTED] is a newer company with minimal construction and operational experience</li> <li>Site control has not yet been obtained</li> <li>Project is not yet in transmission queue</li> <li>Permitting for site is immature</li> <li>Community relations was not addressed in proposal and will be required as the site is in a major suburban load center in PSE's service territory</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	
<b>18148</b> [REDACTED] CTA or BTS** Development Energy Storage System [REDACTED] MW, [REDACTED] MWh / 2 hr Energy Storage System ** COD: 08/01/2022** Term: 20 year (CTA)**	<ul style="list-style-type: none"> <li>Extensive solar energy development experience including [REDACTED] having developed, currently owning and operating [REDACTED] solar project in Washington State.</li> <li>Strong management team, with storage experience</li> <li>Location on existing [REDACTED] may provide economy of scale in development and operation of project.</li> <li>Would be located on [REDACTED] property</li> </ul>	<ul style="list-style-type: none"> <li>May be siting concerns given proximity to wind turbines with required setbacks</li> <li>There may be permitting concerns at this location.</li> <li>Relatively low risk regarding community engagement [REDACTED] would fit well at location given the existing [REDACTED]</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>	

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered [REDACTED]  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18149</b>  CTA** or BTS Development Energy Storage System 100 MW / 4 Hr L-Ion Energy Storage System COD: 09/30/2022 20 or 25 year CTA term	<ul style="list-style-type: none"> <li>City of [REDACTED] would likely be excited about energy storage solutions</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Site is presumed to be located on PSE property, but the site may or may not be utilized by PSE system development in the future</li> <li>Counterparty has defaulted on an agreement in the past with PSE</li> <li>Interconnection and energy delivery plan is early on in process and contingent on PSE development</li> <li>Permitting plan is early in development</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Counterparty has defaulted on an agreement in the past with PSE</li> <li>Interconnection and energy delivery was left to PSE</li> <li>Community relations was not addressed in proposal, and the existing Energy Storage System installed in area had technical and communications challenges</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18150</b>  CTA** or BTS Development Energy Storage System 100 MW / 4 Hr L-Ion Energy Storage System COD: 09/30/2022 20 or 25 year CTA term	<ul style="list-style-type: none"> <li>Site is on developer-owned property</li> <li>City of [REDACTED] would likely allow battery storage outright</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Counterparty has defaulted on an agreement in the past with PSE</li> <li>Interconnection and energy delivery was left to PSE</li> <li>Community relations was not addressed in proposal, and the existing Energy Storage System installed in area had technical and communications challenges</li> </ul>	<ul style="list-style-type: none"> <li>It is unclear whether project is intended to be interconnected to PSE's [REDACTED] distribution substation (as stated) or BPA's [REDACTED] transmission substation (as depicted in the project documentation)</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18151</b>  CTA** Development Energy Storage System 100 MW / 4 hr 100 MW / 4 hr COD: 09/31/2022 Term: 20 year	<ul style="list-style-type: none"> <li>Developer presents minimal relative risk, having previously developed large utility scale Energy Storage System systems</li> <li>May be minor permitting risks</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18152</b> [REDACTED] CTA** or BTS Development Energy Storage System for [REDACTED] MW, 4 Hr Li-Ion Energy Storage System COD: 09/30/2022 20 or 25 year CTA term		<ul style="list-style-type: none"> <li>[REDACTED] is assessed to be a relatively strong parent company</li> <li>Project is proposed to be located on PSE-owned land</li> <li>Interconnection with [REDACTED] substation unlikely to cause major upgrades</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Permitting process is extremely immature, and it is unknown how the County will treat Energy Storage System projects</li> <li>Community relations was not sufficiently covered in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18154</b> [REDACTED] CTA** Development Energy Storage System Multiple options: [REDACTED] MW / 2 hr [REDACTED] MW / 4 hr** [REDACTED] MW / 4 hr COD: 01/01/2022 or 01/01/2023** Term: 16 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Site control should already be obtained</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any projects built or operational to date</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Possibly wetland concerns for the site</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18155</b> [REDACTED] CTA** Development Energy Storage System Multiple options: [REDACTED] MW / 2 hr [REDACTED] MW / 4 hr** [REDACTED] MW / 4 hr COD: 01/01/2022 or 01/01/2023** Term: 16 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Site control currently in negotiations with land owner</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any projects built or operational to date</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Permitting is in an early stage, however relatively further along than other Energy Storage System proposals</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18156</b>  CTA** Development Energy Storage System Multiple options: MW / MWh / 4 hr MW / MWh / 4 hr MW / MWh / 4 hr** COD: 09/30/2022** Term: 20 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on PSE property</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any Energy Storage System experience or projects built to date</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18157</b>  CTA** Development Energy Storage System Multiple options: MW / MWh / 4 hr MW / MWh / 4 hr MW / MWh / 4 hr** COD: 09/30/2022** Term: 20 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on private property adjacent to PSE substation</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any Energy Storage System experience or projects built to date</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18158</b>  CTA** Development Energy Storage System Multiple options: MW / MWh / 4 hr MW / MWh / 4 hr MW / MWh / 4 hr** COD: 09/30/2022** Term: 20 year**		<ul style="list-style-type: none"> <li>Management team has a deep background and experience developing renewable energy projects</li> <li>Located on PSE property</li> <li>Interconnected onto PSE's system</li> <li>Likely local support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Company is relatively new and does not have any Energy Storage System experience or projects built to date</li> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> <li>Cycle count limitations are exceptionally restrictive on potential operations</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>





\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18159</b>  CTA** or BTS Development Pumped Hydro  COD: 03/30/2023 20 CTA term		<ul style="list-style-type: none"> <li>Counterparty has worked with reputable engineering firm for project development</li> </ul>	<ul style="list-style-type: none"> <li>Capital costs are significant and financing will be difficult and complex</li> <li>Technology is very new to PSE and North America and requires significant investigation</li> <li>Significant issues involving permitting and ongoing operation of the facility</li> <li>Transmission left to PSE would likely be very complex due to large capacity and bidirectional requirements</li> <li>Site control status is unknown</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18160</b>  CTA** or BTS Development Pumped Hydro  COD: 03/30/2023 20 CTA term		<ul style="list-style-type: none"> <li>Major permitting hurdles, including FERC licensing, have been secured</li> <li>Long-term site control is achieved</li> </ul>	<ul style="list-style-type: none"> <li>Technology is very new to PSE and North America and requires significant investigation</li> <li>Transmission left to PSE would likely be very complex due to large capacity and bidirectional requirements</li> <li>Interconnecting resource into Colstrip Transmission System might drive limitations on renewable energy development in Montana serving PSE load</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over kilowatt year ranking.</p>
<b>18161</b> <b>BPA Peak Capacity</b> Bonneville Power Administration PPA** Operational portfolio of projects 1000 MW** COD: 01/01/2022** Term: 5 year**		<ul style="list-style-type: none"> <li>Counterparty is well known with existing ties to PSE and therefore no risk for this proposal</li> <li>There are no permitting, real estate or community relations concerns as the proposal is based on currently operational projects</li> </ul>	<ul style="list-style-type: none"> <li>Delivery to Mid-C presents a major concern as delivery to Mid-C negates any incremental capacity value, as energy would have to rely on current Mid-C BPAT/PSEI paths to get back to PSE system.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low leveled portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18162</b>  REC purchase Operational portfolio of projects RECS per year Start of term: 1/1/2022 10 year term		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience with existing contractual relationships with PSE</li> <li>Underlying projects are operational therefore no real estate, permitting, or community relations concerns</li> </ul>	<ul style="list-style-type: none"> <li>Other than low quantitative ranking, there are no major concerns with this proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18164</b>  REC purchase Underlying solar projects RECS per year Start of term: 1/1/2026 13 year term		<ul style="list-style-type: none"> <li>Full site control for underlying projects is assumed</li> <li>Interconnection is secured</li> <li>REC delivery through WREGIS</li> </ul>	<ul style="list-style-type: none"> <li>Low-risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18167</b>  PPA Development Wind (Offshore) MW COD: 12/31/2029 Term: 25 year		<ul style="list-style-type: none"> <li>Developer demonstrates a relative high level of acumen in offshore wind development on the west coast</li> <li>West coast offshore wind could prove to be a viable resource in the future</li> <li>Developer has conducted extensive community and tribal outreach for this project</li> </ul>	<ul style="list-style-type: none"> <li>Considerable counterparty risk, including questionable ability to finance the project without considerable commitment and risk by PSE</li> <li>Leases are through the federal BOEM with a long process for obtaining and uncertain outcome</li> <li>Permitting is through the federal BOEM with a long process for obtaining and uncertain outcome</li> <li>Interconnection and energy delivery would be complex and will require extensive vetting</li> <li>Start of offer is well outside of the time scope of PSE's 2018 All Resource RFP</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18168</b>  AAA Operating Wind  COD: 10/4/2020 5-year term		<ul style="list-style-type: none"> <li>Project is operating</li> </ul>	<ul style="list-style-type: none"> <li>Low-risk</li> <li>Start of term and duration do not match PSE's need as stated in the IRP and RFP</li> <li>Counterparty is potentially facing bankruptcy</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18171</b>  PPA Development Wind  COD: 12/31/2020** or 12/31/2021 Term: 20 year		<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate and permitting appear to be sufficient at this stage of development</li> </ul>	<ul style="list-style-type: none"> <li>Proposal has expired as per the original proposal documentation (expired on 1/1/2019)</li> <li>Complicated delivery to PSE likely required</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18172</b>  PPA Developmental Wind  COD: 1/1/2021 15 or 20** year term		<ul style="list-style-type: none"> <li> is a large publically traded company with a solid balance sheet and solid credit rating</li> <li>Long-term site control is secured</li> <li>Community relations was well addressed in the proposal and well-exceeds the EFSC requirements</li> </ul>	<ul style="list-style-type: none"> <li>Relative to most of their endeavors,  is relatively inexperienced with renewable energy</li> <li>Permitting schedule is aggressive and will be difficult to achieve as proposed</li> <li> has reportedly been a difficult interconnection counterparty to work with</li> <li>Transmission capacity to PSE's system will likely be contingent on a BPA cluster study, with the results presenting a cost and feasibility risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
 VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18174</b> PPA** or BTS Developmental Wind [REDACTED] for [REDACTED] MW COD: 1/1/2020** or 2021 30 year term		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>County will likely be supportive of wind development</li> </ul>	<ul style="list-style-type: none"> <li>[REDACTED] is owned by [REDACTED] a vertically integrated company in [REDACTED] that has experienced significant financial issues</li> <li>Colstrip Transmission System option was not quantified, and energy delivery and REC creation will be difficult as proposed</li> <li>Proposal does not adequately address permitting requirements</li> <li>It is unclear as to whether proposer has engaged local land owners</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18177</b> DAS or BTS Developmental Wind [REDACTED] MW COD: Q4 2020		<ul style="list-style-type: none"> <li>Long-term site control has been achieved</li> <li>Mid-C delivery seems viable</li> <li>Community relations was well-addressed in the proposal</li> <li>The permitting process seemed relatively mature</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to quantitatively assess the project</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed past Stage 1 of the RFP. There are several qualitative concerns evaluated in this proposal regarding the counterparty, financing, interconnection, and energy delivery. However, the primary fatal flaw is that capital and ongoing O&amp;M costs are assumed to be facilitated directly by PSE, but no capital cost estimates were issued with the proposal. Without this information, the RFP team is unable to sufficiently assess the proposal quantitatively.</p>
<b>18178</b> PPA Developmental Wind [REDACTED] MW COD: 12/31/2022 20 year term		<ul style="list-style-type: none"> <li>Balance sheet financing is great as long as parent company is willing to guarantee the project</li> <li>Long-term site control is secured</li> <li>Interconnection studies through BPA are complete</li> <li>Community relations plan seems sufficient, but requires more detail</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery left to PSE and appears to be overly expensive or otherwise infeasible</li> <li>Permitting plan requires significant development</li> <li>Company is relatively unknown to PSE and not much background information was provided</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18180</b>  PPA Developmental Wind IMW COD: 1/1/2021 or 2022 20 year term		<ul style="list-style-type: none"> <li>Long-term site control is apparently secured</li> <li>Interconnection studies through BPA are complete</li> <li>Project received Washington State EFSEC in 2012 after a contentious permitting process</li> </ul>	<ul style="list-style-type: none"> <li>This would be  first experience in the Pacific Northwest</li> <li>Insufficient detail regarding company financial health and project financing strategy was included in the proposal</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Significant reputational issues with proximity to local fisheries as well as blocking a view of the  River</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18181</b>  PPA** or BTS Developmental Wind IMW COD: 12/12/2020 20 year term		<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control is secured</li> <li>Interconnection process with BPA is well underway</li> <li>There are nearby wind farms, not many residential neighbors, and the RFP team believes the local community and government support solar development</li> <li>Permitting plan has minimal detail and represents a schedule and feasibility risk for the project</li> </ul>	<ul style="list-style-type: none"> <li>Long-term firm point-to-point transmission appears to not be feasible</li> <li>Community relations was not addressed in the proposal</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18182</b>  PPA**, DAS, or BTS Developmental Wind IMW COD: 12/01/2022 20 year term		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Permitting is early in process but presents little schedule or viability risk</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility risk</li> <li>Community and government relations is supposedly strong, but little detail was provided to support it</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18183</b> PPA** Developmental Wind MW COD: June 2020 10 or 15 year term		<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to quantitatively or qualitatively assess the project</li> </ul>	<p><b>Not selected</b> – Beyond a discussion of potential agreement terms, the proposal did not include enough detail to sufficiently assess on either a qualitative or quantitative basis. The RFP team does not recommend this proposal move beyond the first phase of the RFP process.</p>
<b>18184</b> PPA Developmental Solar + Energy Storage System MW & optional MW or MW** MW, 2 or 4** Hr. Energy Storage System COD: 10/31/2022 20** or 25 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Site control projected to be achieved by Q2 2019</li> </ul>	<ul style="list-style-type: none"> <li>RFP team could not confirm interconnection queue position asserted in the proposal</li> <li>Energy delivery would likely need to be periodically curtailed</li> <li>The permitting plan is largely undeveloped, and there are potential issues with wetlands and Mazama Pocket Gophers that threaten project viability and schedule</li> <li>There are potential glare issues with local roadway in the City of [REDACTED]</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18185</b> PPA Developmental Wind MW COD: 12/31/2020 20 year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Letter of intents have indicated likely site control in the near future</li> <li>Backup point of interconnection at [REDACTED] is likely a feasible energy delivery option</li> <li>Permitting is in the early stages, but since only construction permits will be required it represents a low risk</li> </ul>	<ul style="list-style-type: none"> <li>[REDACTED] intends to secure a long-term firm point-to-point transmission with [REDACTED] but have not yet taken steps to secure it</li> <li>Community and government relations was not adequately assessed in the proposal, but presents only a minor risk for the project as renewable energy is seen in a generally positive light</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18186</b>  15-yr/20-yr PPA Development Wind Up to [redacted] MW COD: 1/1/2021 Term: [redacted]		<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Interconnection studies with BPA are complete and an engineering and procurement agreement is soon to be secured</li> <li>Real-time delivery to PSE will not be necessary to secure RECs since the project is within BPA's regional territory</li> <li>Project appears to be fully permitted, with the exception of [redacted] approvals</li> </ul>	<ul style="list-style-type: none"> <li>Developer is relatively inexperienced at developing, permitting, construction, and operating generation sites</li> <li>Impact to local prime agricultural land might cause some local tension</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18187</b>  PPA Developmental Solar + Energy Storage System [redacted] MW Solar & optional [redacted]** or [redacted] MW, 2** or 4 Hr. Energy Storage System COD: 10/31/2022 15 or 20** year term		<ul style="list-style-type: none"> <li>Apparently strong counterparty with extensive experience in the development, construction, and operation of renewable generation</li> <li>Long-term site control is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE and appears to be complicated, and might pose a feasibility or cost risk</li> <li>Permitting process has not appreciably started, but represents a slight schedule and feasibility risk</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.</p>
<b>18188</b>  EPC Development Reciprocating Thermal [redacted] MW Dual Fuel or [redacted]** MW Single Fuel COD: 4/15/2021		<ul style="list-style-type: none"> <li>Expansion of existing [redacted] facility.</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate with other sites.</li> <li>Project could likely be facilitated with firm gas supply with existing facilities.</li> </ul>	<ul style="list-style-type: none"> <li>Air permit path is complex and possibly not feasible.</li> <li>The likely-to-be-required air permit modification could bring more operational constraints for the existing generation units.</li> <li>PSE will experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's thermal generation portfolio.</li> <li>Given the ongoing social controversy surrounding greenhouse gas ("GHG"), including the contribution to climate change from the local natural gas system and electric generation, the proposed schedule and general project feasibility seem to be in question.</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**



Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18189</b>  CTA** Development Energy Storage System 25 MW / 50 MWh / 2 hr 50 MW / 100 MWh / 2 hr COD: 08/01/2020 Term: 20 year		<ul style="list-style-type: none"> <li>Developer has experience in Energy Storage System projects, particularly with integration and control software</li> <li>Location at an existing site may offer development synergies, however permitting may be complicated with location at existing gas plant</li> </ul>	<ul style="list-style-type: none"> <li>Similar to every other stand-alone Energy Storage System proposal in the 2018 RFP, the transmission and distribution investment-deferral value is currently unknown for the point of interconnection as proposed</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18200</b>  Direct load control Smart thermostat, smart water heater 9-36 MW COD: 1/1/2019 Term: 5 years		<ul style="list-style-type: none"> <li>Detailed project implementation plan and schedule provided</li> <li>Minimum PSE engagement</li> <li>Seamless customer interruption</li> <li>Strong parent company financials</li> </ul>	<ul style="list-style-type: none"> <li>Lack of demonstrated winter peaking experience</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18202</b>  Direct load control Smart water heater 1-22 MW COD: 1/1/2019 Term: 10 years		<ul style="list-style-type: none"> <li>Vendor can also monitor and control load control switches; electric vehicles, solar photo voltaic, energy storage, building controls, heating, ventilation, air conditioning, and other demand side assets</li> </ul>	<ul style="list-style-type: none"> <li>Solution seems limited in its initial deployment</li> <li>Seems optimistic as to resource availability</li> <li>Lack of demonstrated program experience</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered  
 \*\*\*Indicates primary ranking criteria for particular proposal category.





**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>18203</b> Behavioral demand response 100% Residential 100 MW COD: 1/1/2019 Term: 5 years		<ul style="list-style-type: none"> <li>Existing working relationship with [REDACTED] on other energy efficiency projects</li> <li>Cumulative 1.5M utility customer</li> <li>Claim to be the [REDACTED] company.</li> </ul>	<ul style="list-style-type: none"> <li>Program is day-ahead and limits peak capacity contribution</li> <li>Lack of demonstrated winter peaking experience</li> <li>Aggressive program benefit assumption to roll out 375k customers to achieve [REDACTED] of savings</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18204</b> EMIS and traditional demand response programs 100 MW COD: 1/1/2019 Term: 5 years		<ul style="list-style-type: none"> <li>EMIS technology and program has longer term impact and savings averaging 3.5% across the board due to behavioral changes</li> <li>Experience with Winter DR programs</li> </ul>	<ul style="list-style-type: none"> <li>Heavy PSE involvement for marketing, Data, Customer Service</li> <li>Program is day-ahead and limits peak capacity contribution</li> <li>High counter-party risk as being a small private consulting company</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>
<b>18205</b> Commercial & industrial direct install 100 MW, mixed Day-ahead, hour-ahead, and 10-min ready MWs COD: 1/1/2019 Term: 5 Years		<ul style="list-style-type: none"> <li>Utilize existing relationship [REDACTED]</li> <li>Over 1000MW DR under management (self-claimed)</li> </ul>	<ul style="list-style-type: none"> <li>Mixed program contribution to peak capacity could limit program effectiveness</li> <li>Very expensive pricing</li> </ul>	<p><b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.</p>

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered [REDACTED]  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
**April 5, 2019**

Project	Quantitative Results** [See quantitative results, pages 8-12 herein.]	Qualitative Advantages (+)	Qualitative Risks (-)	Selection recommendation & Rationale
<b>UP001</b>  CTA or BTS** Design/construct Pumped Hydro MW, 6.4 Hr daily storage COD: 03/30/2023 20 CTA term		<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Insufficient data was provided regarding the counterparty background and financing plan</li> <li>Insufficient data was provided to qualitatively assess the project</li> <li>Insufficient data to quantitatively assess CTA</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over kilowatt year ranking.
<b>UP002</b>  REC purchase Underlying operating solar project RECS per year Start of term: 2020 9-year or 14-year term		<ul style="list-style-type: none"> <li>Not applicable<sup>1</sup></li> </ul> <p><sup>1</sup>Proposal was submitted late in Phase 1 (Feb. 7, 2018) when PSE was finalizing its Phase 1 results. PSE quantitatively screened the two offers, but neither offer was quantitatively competitive with PSE's other renewable resource alternatives. Had the proposal fared better in the quantitative analysis, an assessment of its qualitative merits and risks would have followed.</p>	<ul style="list-style-type: none"> <li>Price is higher and volume is smaller than other REC offers received in response this RFP.</li> </ul>	<b>Not selected</b> – The RFP team does not recommend this project proceed to the next phase of the 2018 all-resource RFP due to the relatively low levelized portfolio benefit over renewable energy credit ("REC") ranking.

\*This matrix summarizes key findings from PSE's Phase 1 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Some proposals contain multiple offers. The quantitative results shown in the table represent the best offer from each proposal in the no CO2 scenario. PSE also considered \*\*\*Indicates primary ranking criteria for particular proposal category.

**REDACTED  
 VERSION**

2018 All Resources RFP  
Phase 2 update



**EMC Informational**

June 20, 2019

**Cindy Song**

Business Initiatives Manager

**CONFIDENTIAL**

# Informational

---

**Intended recommendation:** at the July EMC meeting ask for approval with projects selected from the RFP and approval to proceed with negotiations.


## RFP timeline

	Date	Milestone
✓	March 29, 2018	Draft RFP filed with WUTC
✓	June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓	July 3, 2018	PSE released final RFPs
✓	August 17, 2018	Offers were due to PSE
✓	March 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
	July 2019	Complete Phase 2 evaluation, select final short list
	To follow	Notify respondents; contract negotiations


# Capacity resource need updated to 299MW in 2022 and REC need updated to 233,449 RECs in 2023

## Resource need forecasts updated in Phase 2 analysis to reflect draft 2019 IRP need assessments and F2019 load forecast\*

- 2018 RFP Capacity Need – Phase 2 update**
- PSE seeks 299 MW capacity by end of 2022
  - Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably
  - Need based on F2019 forecast net conservation, 2019 IRP resource adequacy

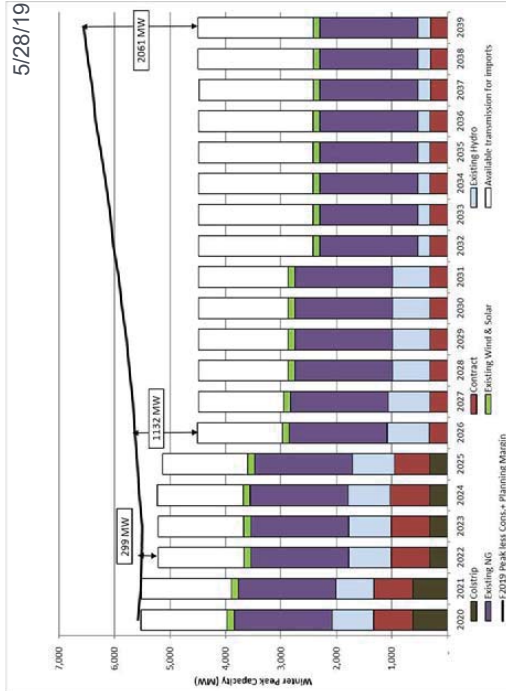

- 2018 RFP REC Need – Phase 2 update\*\***
- REC need is driven by the increase in the RPS from 9% to 15% in 2020
  - Projected need to meet the RPS is 233,449 RECs by 2023
  - PSE's inventory of banked RECs delays need until 2023

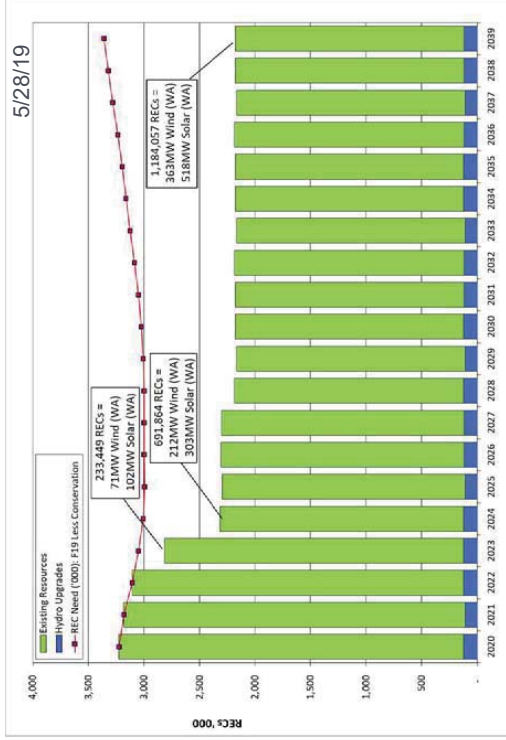

\*Original RFP issued to fill 272 MW capacity need in 2022 and 671,000 REC renewable need in 2023. See appendix A for memorandum on how the capacity need changed from 272 MW to 299 MW.  
 \*\*REC need reflects renewable need driven by RCW 19.285 (RPS). It does not reflect the impact of SB 5116 (Clean Energy Transformation Act).

# Total of 97 proposals received in 2018 RFPs; 25 proposals advanced to Phase 2 for further analysis

Proposals selected for Phase 2 evaluation reflect resource and technology diversity

Revised candidate list reflects the following changes:

Resource Type	Proposals Received *		Phase 2 Candidate List		Revised Phase 2 Candidate List **	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW
Solar - PV	16	2240	8	1050	7	890
Solar - PV + BESS	20	2848	1	100	1	100
Wind - Off Shore	1	400	0	0	0	0
Wind On Shore	16	3303	7	1642	7	1642
Wind + Winter Sys PPA	1	371	1	200	1	200
Wind + Solar and/or BESS	2	464	0	0	0	0
Storage - Battery ("BESS")	17	1265	0	0	0	0
Storage - Pumped Hydro	2	900	0	0	0	0
Biomass	2	72	1	17	1	17
Biomass + BESS	1	15	0	0	0	0
Natural Gas-fired Generation	4	1377	2	348	2	348
Geothermal	2	43	0	0	0	0
Hydro - Run of River	1	38	1	38	1	38
System PPA / Call Option	1	100	0	0	1	100
Unbundled RECs	5	n/a	3	n/a	4	n/a
Demand Response	6	154	1	8.7	2	33.7
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>25</b>	<b>3,404</b>	<b>27</b>	<b>3,369</b>

- 1 solar proposal withdrawn by the respondent (removed)
- 1 unsolicited REC and 1 demand response proposal reduced pricing (added)
- 1 system PPA/call option moved delivery point to BPAT.PSEI (added)

\* In addition to the 97 RFP proposals shown above, PSE also received two unsolicited proposals during Phase 1 (a pumped hydro and a REC-only proposal) and three unsolicited proposals during Phase 2 (all solar). None of these offers were competitive with the RFP proposals. However, the REC-only proposal price was reduced in Phase 2 and the proposal was added to the revised candidate list.  
 \*\* See appendix B for full list of proposals evaluated in Phase 2.

## 14 proposals selected for Phase 2 optimization analysis *Optimization list reflects a snapshot in time and is subject to change*

- Updated scenario analysis in Phase 2 reflects current IRP assumptions and new information provided by respondents\*
- Phase 2 proposals with a combination of the most favorable quantitative results across scenarios and no qualitative fatal flaws advanced for optimization analysis\*\*

As of 6/20/19

ID	Project Name	Resource Type	Nameplate	Counterparty	State
1	18100 SPI Industrial	Biomass	17 MW	SPI	WA
2	18169	MT Wind	MW		MT
3	18173	MT Wind	MW*		MT
4	18163	REC Only	REC		OR
5	18165	REC Only	REC		OR
6	UP002	REC Only	REC		ID
7	18111	Solar	MW		WA
8	18125	Solar	MW		WA
9	18127	Solar	MW		WA
10	18135	Solar	MW		WA
11	18161	Sys PPA/Call Opt.	MW		OR
12	18132	Wind	MW*		OR
13	18179	Wind	MW		WA
14	18170 Golden Hills Wind - Shaped / Unshaped	Wind	200 MW	Avangrid	OR

\* Updated Phase 2 assumptions include, but are not limited to, capacity and renewable need forecasts, power and gas price forecasts, and generic resource costs. See Appendix C for scenarios used in Phase 2 quantitative analysis and stand-alone proposal ranking results.

\*\* Three proposals were eliminated in Phase 2 for qualitative reasons: Garfield Peak MT Wind (#18176) (insufficient met data to support capacity factor; substantial development risks), and the two Phase 2 demand response proposals (#18201 and #18205) (incompatible with PSE's Distributed Energy Resource Management System implementation). See RFP executive summary and proposal memos for detailed qualitative assessment.

# At-a-glance qualitative assessment for projects selected for optimization analysis\* (results as of Jun. 20, 2019 subject to change)

Project Counterparty (Project ID)	REC contribution (RECs/yr)	MW Capacity contribution	Term start / length	Operating/Development status	Delivery point	Counterparty/Proposal risk	Site control	Permitting risk	Energy delivery risk	Operational/Reputational risk	Key	Other considerations*
1 SPI Biomass PPA Sierra Pacific Ind. (18100)	[REDACTED]	16	1/2021 17 yrs	Operating	BPAT. PSEI	●	●	●	●	●	Low Risk	Offers renewable resource diversity to portfolio
2	[REDACTED]	[REDACTED]	12/2021 25 yrs	Early Develop	BPAT. PSEI	●	●	●	●	●	Acceptable Risk	MT proposals are mutually exclusive
3	[REDACTED]	[REDACTED]	10/2022 20 yrs	Early Develop	BPAT. PSEI	●	●	●	●	●	Substantial Risk	MT proposals are mutually exclusive
4	[REDACTED]	[REDACTED]	1/2022 18 yrs	Mature Develop	n/a	●	●	●	●	●	Fatal Flaw	Screening model selects RECs for arbitrage benefit, not to meet RPS
5	[REDACTED]	[REDACTED]	1/2022 18 yrs	Mature Develop	n/a	●	●	●	●	●	Fatal Flaw	Screening model selects RECs for arbitrage benefit, not to meet RPS
6	[REDACTED]	[REDACTED]	1/2020 15 yrs	Operating	n/a	●	●	●	●	●	Fatal Flaw	Screening model selects RECs for arbitrage benefit, not to meet RPS
7	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	Mid-C*	●	●	●	●	●	Acceptable Risk	Mid-C delivery due to lack of transmission ATC
8	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	Mid-C	●	●	●	●	●	Acceptable Risk	
9	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	[REDACTED]	●	●	●	●	●	Acceptable Risk	Proposes independently operated solar co-located with [REDACTED]
10	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	[REDACTED]	●	●	●	●	●	Acceptable Risk	
11 BPA Peak Cap Sys PPA BPA (18161)	0	54	1/2022 5 yrs	Operating	BPAT. PSEI	●	●	●	●	●	Low Risk	
12	[REDACTED]	[REDACTED]	12/2022 20 yrs	Mature Develop*	Mid-C	●	●	●	●	●	Acceptable Risk	Operational project subject to repower
13	[REDACTED]	[REDACTED]	12/2021 20 yrs	Mature Develop	Mid-C*	●	●	●	●	●	Acceptable Risk	Mid-C delivery due to lack of transmission ATC
14 Golden Hills Wind (shaped / unshaped) Avangrid (18170)	[REDACTED]	79	12/2021 25 yrs	Early Develop	BPAT. PSEI	●	●	●	●	●	Low Risk	Full transmission may not be firm

\*Table summarizes certain key qualitative findings of most favorable Phase 2 resources. See RFP Executive Summary and proposal memos for detailed findings.

REDACTED VERSION

REDACTED VERSION



# Draft portfolio optimization results

(results as of Jun. 20, 2019, subject to change)

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)
List ID	Project ID	Resource	Project	Term Start	Term	Nameplate	Peak Capacity Credit	REC <sup>s</sup> <sup>1</sup>	As Proposed MT Wind - MW	Recommended Portfolio Preferred MT Wind - MW
1	18100	Biomass	SPI	1/1/2021	17	17 MW	16 MW		X	X
2	18161	Call Option	BPA Peak Capacity Product	1/1/2022	5	100 MW	54 MW		X	X
3a.	18169	MT Wind		12/31/2021	25	MW	150 MW		X	X
3b.	18169	MT Wind		12/31/2021	25	MW	135 MW		X	X
4a.	18173	MT Wind		10/31/2022	20	MW	136 MW		X	X
4b.	18173	MT Wind		10/31/2022	20	MW	100 MW		X	X
5a.	18170	Wind	Golden Hill Shaped	12/31/2021	20	200 MW	79 MW		X	X
5b.	18170	Wind		12/31/2021	20	MW	52 MW		X	X
6	18132	Wind		1/1/2023	20	MW	0 MW			
7	18179	Wind		12/1/2021	20	MW	0 MW			
8	18125	Solar		10/31/2022	20	MW	0 MW			
9	18111	Solar		12/31/2022	20	MW	0 MW			
10	18127	Solar		12/15/2022	20	MW	0 MW			
11	18135	Solar		12/31/2022	20	MW	0 MW			
12	18163	REC-only		1/1/2022	17	MW	0 MW			
13	18165	REC-only		1/1/2022	17	MW	0 MW			
14	UP002	REC-only		1/1/2020	10	MW	0 MW			
15		Total MWs							MW	MW
16		Peak Capacity Surplus / (Deficit) in 2022							MW	MW
17		Total RECs							1,986,862	2,189,656
18		Total Portfolio Benefits - \$ millions							\$375	\$369
19		Sensitivity Analysis with Social Cost of Carbon:								
20		Total Portfolio Benefits with Social Cost of Carbon as Planning Adder - \$ millions <sup>3</sup>							\$678	\$726
21		Total Portfolio Benefits with Social Cost of Carbon as Dispatch Adder - \$ millions							\$909	\$991
<b>Peak Capacity and REC Need 2022-2025</b>										
Peak Capacity Need										
REC Need										
2022 2023 2024 2025										
299 MW 233,449 691,864 700,482										
0										

1. The annual project RECs in column I does not include 0.2X apprenticeship multiplier.  
 2. The optimization model chose a portfolio with MW from MW submitted proposals for both MW and MW, but not MW. The MW size of the project is reduced from the proposed MW option based on available transmission capacity. The MW option will have to be negotiated with MW. Current indicative results reflect pricing based on the social cost of carbon at \$86/metric ton in 2010 dollars plus escalation is added to total portfolio costs as fixed cost.

REDACTED VERSION

REDACTED VERSION

# APPENDIX A

Resource need memo: evolution of need from  
2017 IRP to 2018 all resources RFP Phase 2





## Memorandum

TO: PSE EMC Committee Members

FROM: Elizabeth Hossner

SUBJECT: Updates to peak capacity need since the 2017 IRP and draft 2019 IRP

DATE: June 20, 2019

---

### Introduction

Physical need refers to the resources required to ensure reliable operation of the system. It is an operational requirement that includes three components: customer demand, planning margins and operating reserves. The word “load” – as in “PSE must meet load obligations” – specifically refers to customer demand plus planning margins plus operating reserve obligations. The planning margin and operating reserves are amounts over and above customer demand that ensure the system has enough flexibility to handle balancing needs and unexpected events such as variations in temperature, hydro and wind generation; equipment failure; or transmission interruption with minimal interruption of service.

When we compare physical need with the peak capacity value of existing resources, the resulting gap identifies resource need. PSE incorporates a planning margin in its description of resource need in order to achieve a 5 percent loss of load probability (LOLP). The 5 percent LOLP is an industry standard resource adequacy metric used to evaluate the ability of a utility to serve its load, and one that is used by the Pacific Northwest Resource Adequacy Forum.

### 2017 IRP

In the 2017 IRP, using the LOLP methodology, we determined that we needed 123 MW of resources by December 2020 before conservation which became a surplus 121 MW after all cost effective conservation, and a surplus 73 MW in December 2018. The 2017 IRP was filed on November 15, 2017 and used the F2016 demand forecast. Given that the demand forecast was updated and we found some errors in the calculation, the peak capacity need was updated to a deficit of 103 MW in December 2018.

## Updates to 2017 IRP

Given that the demand forecast was updated and we found some errors in the calculation, the peak capacity need was updated to a deficit of 103 MW in December 2018. The following table documents the changes and updates to December 2022 peak capacity calculation.

Table 1 - Changes to 2022 Peak Capacity Need to the 2017 IRP

(Deficit)/Surplus – Peak MW	Total December 2022 Peak Need w/o DSR	Total December 2022 Peak Need w/ DSR
2017 IRP	(621)	(192)
1. Updated to F2017 forecast and added 100 MW Mid-C transmission	(341)	(7)
2. Removed spinning reserves. The spinning reserves (50% of contingency reserves) were being removed from the hydro resources and that capacity was turned into available mid-C transmission. This increased the Mid-C transmission, but we were still counting the full amount of contingency reserves, so it was being double counted. This adjustment resulted in less available transmission to Mid-C	(610)	(272)* *Published number from 2018 RFP
3. Updated to F2018 Forecast	(704)	(294)* *Currently in Phase 1 of the RFP
4. Removed PSEI transmission from calculation. We previously assumed that Sch. 449 only used 300 MW, so that left 150 MW of free transmission. Wild Horse peak capacity is 30 MW, so that left 120 MW of available Mid-C transmission. As published on PSE OASIS, Sch. 449 has firm rights for all 450 MW.	(828)	(417)
5. Add 94 MW transmission from Garrison, removed BPA loss return, updated Wells percent share.	(808)	(397)

Given all the changes since the 2017 IRP, the peak need in 2022 went from a deficit of 192 MW to a deficit of 397 MW. The final peak deficit in December 2018 is 103 MW and was presented as part of the winter peak plan in the October 25 EMC.

The table below is the breakdown of peak need for December 2022.

Table 2 – Breakdown of 2022 Peak Need from Updates to 2017 IRP

	December 2022 w/o DSR	December 2022 w/ DSR
Peak Demand	5,228 MW	5,228 MW
Planning Margin	13.5%	13.5%
Normal Peak Load + PM	5,932 MW	5,932 MW
Operating Reserves	406 MW	394 MW
Total Capacity Need	6,337 MW	6,325 MW
Total Resources	(4,012) MW	(4,399) MW
Available Mid-C Transmissions	(1,541) MW	(1,541) MW
<b>Total</b>	<b>784 MW</b>	<b>386 MW</b>
Operating Reserves on new resources	24 MW	12 MW
<b>Total Resource (Deficit)/Surplus</b>	<b>(808) MW</b>	<b>(397) MW</b>

### Draft 2019 IRP

The updated peak need before conservation for the Draft 2019 IRP is a deficit of 685 MW in December 2022 which translates to a 16.5% planning margin, including operating reserves. This is up from the 13.5% in the 2017 IRP where operating reserves was calculated as a separate number. The change in peak need from the 2017 IRP of 123 MW in 2020 to 685 MW in 2022 the 2019 IRP has to do with the updates in the resource adequacy model. Below is a table documenting the updates and the changes to the peak need.

Table 3 – Changes to 2022 Peak Capacity Need in Draft 2019 IRP

Revisions	MW Needed for 5 % LOLP	Incremental Change	Total Change
2017 IRP, Study Period Oct 2020-Sep 2021			
Resource need	123		
2019 IRP, Study Period Oct 2022-Sep 2023			
2017 IRP resource need, Colstrip 1&2 retired	503	380	380
Model updates			
<ul style="list-style-type: none"> <li>Improved sampling of outage and renewable generation scenarios, temporarily disabled NWPP reserve sharing and wholesale market purchase risk</li> </ul>	490	(13)	367
<ul style="list-style-type: none"> <li>Full coverage of all hydro x temperature years for synchronization with GENESYS</li> </ul>	636	146	513
<ul style="list-style-type: none"> <li>Updated transmission access model</li> </ul>	972	336	849
<ul style="list-style-type: none"> <li>Updated operating reserve definition</li> </ul>	804	(168)	681
<ul style="list-style-type: none"> <li>Redeveloped logic for calling on contingency reserves, including the NWPP reserve sharing group</li> </ul>	717	(87)	594

F18 load forecast	539	(178)	416
Expansion of scenarios from 77 to 88 temperature years – from 6160 to 7040 simulations	531	(8)	408
Updated draws for PSE wind resources	497	(34)	374
Updated available transmission to Mid-C (additional transmission contract award)	389	(108)	266
Updated outage draws and resource capabilities (corrected outage rates on PSE resources)	535	146	412
Updated hydro year forecast, BPA 2016 Rate Case	535	0	412
Updated contract interchange	546	11	423
Updated third-party load reserve obligations	548	2	425
Updated loss return calculation	558	10	435
Updated balancing reserves	601	43	478
Included Green Direct 2 resource, 150 MW solar	576	(25)	453
Updated available transmission to Mid-C (corrected portion of access rights)	706	130	583
Updated wholesale market purchase risk model (GENESYS base for PSE: 3400 MW SW import maximum, updated PSE resource capabilities, embed Green Direct 2 resources into GENESYS)	750	44	627
Corrected outage rates on PSE resources	688	(62)	565
Corrected modeling for Canadian entitlement and loss returns at Mid-C	779	91	656
Corrected available transmission to Mid-C (increased total transmission amount)	680	(99)	557
Corrected PSE share of Mid-C hydro projects	679	(1)	556
Corrected transmission contract on Goldendale	688	9	565
Corrected existing Columbia River gorge wind data	753	65	630
Corrected Northwest Power Pool logic	744	(9)	621
Corrected logic for release of operating reserves	738	(6)	615
Corrected transmission access for Wild Horse	759	21	636
Analysis of random seed impact: 500 simulations, mean of resource need results Closest seeds to mean results chosen	748	(11)	625
Corrected minor error in hydro data	748	0	625
Updated wind data to ensure correlations are captured for Columbia River gorge wind, Skookumchuck, and hypothetical new resources	755	7	632
Adaptation to perfect capacity, instead of peaker-equivalent capacity	703	(52)	580
Implemented hydro peaking model for Columbia River hydro generation	682	(21)	559
Updated all data for existing and future contracted renewable generation using new data from DNV GL analysis Average of 5 runs ( <b>Resource Need</b> )	<b>685</b>	3	562

The table below is the breakdown of peak need for December 2022 before conservation comparing the 2017 IRP, the 2018 RFP phase I, winter peak plan, and the 2019 IRP.

Table 4 – Comparison of how 2022 Peak Need Changes over Time

	2017 IRP	2018 RFP Phase I	Winter Peak Plan	Draft 2019 IRP
Peak Demand	5,301 MW	5,228 MW	5,228 MW	5,064 MW
Planning Margin	13.5%	13.5%	13.5%	16.5%
Normal Peak Load + PM	6,001 MW	5,922 MW	5,932 MW	5,897 MW
Operating Reserves	410 MW	407 MW	406 MW	
Total Capacity Need	6,415 MW	6,330 MW	6,337 MW	5,897 MW
Total Resources	(4,072) MW	(4,072) MW	(4,012) MW	(3,671) MW
Available Mid-C Transmissions	(1,741) MW	(1,574) MW	(1,541) MW	(1,541) MW
<b>Total</b>	<b>602 MW</b>	<b>684 MW</b>	<b>784 MW</b>	<b>685 MW</b>
Operating Reserves on new resources	18 MW	21 MW	24 MW	
<b>Total Resource (Deficit)/Surplus</b>	<b>(620) MW</b>	<b>(704) MW</b>	<b>(808) MW</b>	<b>(685) MW</b>

The total capacity contribution from resources has been updated based on the 2019 IRP ELCC. The 2019 IRP updated the approach to look at “perfect” capacity as the comparison instead of a NG plant. With this approach, all resources now have an ELCC. The table below is the update to the peak capacity contribution of resources.

Table 5 – Update to Peak Capacity Contribution of Resources

	Winter Peak Plan	Draft 2019 IRP
Colstrip 3&4	360	314
Encogen	173	167
Ferndale w/ DF	285	240
Frederickson 1&2	168	146
Freddy 1	124	124
Fredonia 1&2	234	194
Fredonia 3&4	126	102
Goldendale w/ DF	315	254
Mint Farm w/ DF	320	257
Sumas	148	130
Whitehorn 2&3	168	146

Lund Hill Solar (Green Direct)	-	4
Hopkins Ridge	17	15
Klondike III	6	5
LSR	38	33
Skookumchuck wind (Green Direct)	52	47
Wild Horse	30	26
Priest Rapids	5	5
Rock Island	137	137
Rocky Reach	311	311
Wanapum	5	5
Wells	95	95
Lower Baker	64	88
Upper Baker	94	89
Snoqualmie Falls	39	39
Contracts	698	696
<b>Total Resources</b>	<b>4,012 MW</b>	<b>3,671 MW</b>

## 6/5/2019 Updated Peak Need for RFP Phase II

An update on the peak need was made on June 5, 2019 for the RFP phase II, to reflect the demand forecast update to the F2019. The Draft 2019 IRP uses a version of the F2018 demand forecast where the conservation targets are applied through 2019, but no new conservation starting Jan. 1, 2020. The Draft 2019 IRP evaluates for new conservation starting in 2020. The Draft 2019 IRP has a peak demand of 5,064 in 2022 and the updated F2019 gross conservation has a peak demand of 5,107 MW, a difference of (47) MW. With the updated demand forecast, the total peak need deficit in 2022 is 630 MW before conservation, or 299 MW after conservation.

Table 6 – Breakdown of 2022 Peak Need from Updated Peak Need for RFP Phase II

	December 2022 w/o DSR	December 2022 w/ DSR
Peak Demand	5,017 MW	5,017 MW
Planning Margin	16.5%	16.5%
Normal Peak Load + PM	5,842 MW	5,842 MW
Total Resources	(3,671) MW	(4,002) MW
Available Mid-C Transmissions	(1,541) MW	(1,541) MW
<b>Total Resource (Deficit)/Surplus</b>	<b>(630) MW</b>	<b>(299) MW</b>



# APPENDIX B

## Phase 2 Candidate List



# Phase 2 candidate list<sup>1</sup>

As of 6/20/19

ID	Project Name	Resource Type	Nameplate	Counterparty	State
1	18100 SPI Industrial	Biomass	17 MW	SPI	WA
2	18201	Demand Response	MW		WA
3	18205	Demand Response	MW		MA
4	18169	MT Wind	MW		MT
5	18173	MT Wind	MW*		MT
6	18176	MT Wind	MW*		MT
7	18163	REC Only	REC		OR
8	18165	REC Only	REC		OR
9	18190	REC Only	REC		WA
10	UP002	REC Only	REC		ID
11	18107	Run-of-River	MW		ID
12	18135	Solar	MW		WA
13	18111	Solar	MW		WA
14	18122	Solar	MW		WA
15	18131	Solar	MW		WA
16	18127	Solar	MW		WA
17	18114	Solar	MW		WA
18	18125	Solar	MW		WA
19	18139	Solar + BESS	MW/BESS		WA
20	18105	Thermal	MW		OR
21	18103	Thermal	MW		WA
22	18161 BPA Peak Capacity Product	Sys PPA/Call Opt.	100 MW	BPA	OR
23	XXXXX	Transmission			OR
24	18175	Wind	MW		NA
25	18132	Wind	MW*		WA
26	18179	Wind	MW		OR
27	18170 Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	WA
28	18166	Wind	MW		OR

\* Numbers shown are rounded to the nearest 5 MW.

\*\* Assumes a redirect of 100MW of BPA transmission from ██████████ to Mid-C to PSEI, available January, 2022 for a 50-year term, and using Mid-C forecast for energy pricing. Redirect originally under consideration was removed during Phase 2, as the available ATC associated with the assumption has already been included as an existing resource in the current capacity need assessment (shown on slide 5) and does not represent an incremental solution.

\*\*\* ██████████ (#18111)

<sup>1</sup>The candidate list reflects the best offer from each proposal. The list was revised early in Phase 2 to remove the ██████████ proposal (#18112) (withdrawn developer), and to add the BPA Peak Capacity Product (#18161) (adjusted original delivery point from Mid-C to BPAT PSEI), the ██████████ proposal (#18205) (repriced after Phase 1 elimination) and the unsolicited proposal (#UP002) (repriced after Phase 1 elimination).

# APPENDIX C

## 2018 All Resources RFP Phase 2 quantitative analysis scenarios and stand-alone proposal ranking results



# RFP Phase 2 price scenarios

Scenarios	WECC /PSE			Generic Resource Costs
	Phase	Demand	Gas Price	
1. No carbon tax	1 + 2	Base	Base	Base
2. CO2 (low societal \$16/ton)	1 + 2	Base	Base	Base
3. CO2 (mid-societal \$42/ton)	1 + 2	Base	Base	Base
4. CO2 (high societal \$62/ton)	2	Base	Base	Base
5. No CO2 low load	2	Low	Low	Base
6. No CO2 updated w/CA SB100	2	Base	Update	Base

# 2018 RFP Phase II Preliminary Quantitative Results Summary- CAPACITY PROPOSALS

Preliminary Figures Only- Subject to Change  
As of June 12, 2019

Primary Energy Output  
Secondary Output  
Capital Costs

ID	Capacity Proposal	Technology	Term Start	Book Contract Term	Nameplate Capacity (MW)	Peak Capacity Credit	Levelized PE (Peak Capacity kW - Yr)			Banking Limited PE / Yr			Net Capacity			Dispatch Capacity		
							NO COE	NO COE Upstream w/3000	NO COE Low cost w/3000	NO COE	NO COE	NO COE Upstream w/3000	NO COE	NO COE	NO COE Upstream w/3000	NO COE	NO COE	NO COE Upstream w/3000
1	88170 Golden Hills Shaded	Wind	Dec-20	25	200 MW	78.8	1	1	1	1	1	1	1	1	1	1	1	1
2	88185	WT Wind	Dec-21	25	200 MW	78.8	1	1	1	1	1	1	1	1	1	1	1	1
3	88100	Industrial Biomass	Jan-21	17	3.7 MW	85.4	6	2	1	2	1	2	1	2	1	2	1	2
4	88178	WT Wind	Oct-22	20	200 MW	78.8	5	3	3	4	3	3	4	3	3	4	3	3
5	88173	WT Wind	Oct-22	20	200 MW	78.8	4	4	4	3	4	4	4	3	4	4	3	4
6	88105	Thermal	Jan-22	20	200 MW	78.8	3	5	5	5	5	5	5	5	5	5	5	5
7	88103	Thermal	Jun-22	10	200 MW	78.8	7	7	6	7	6	7	6	7	6	7	6	7
8	88161	BPA Peak Capacity / Forecast (C9)	Jan-22	5	300 MW	52.0	9	8	7	9	9	9	9	9	9	9	9	9
10	88203	DR	Jan-25	6	200 MW	52.0	10	1	10	10	10	10	10	10	10	10	10	10
11	88205	DR	Jan-21	5	200 MW	52.0	10	1	10	10	10	10	10	10	10	10	10	10
12	88190	WT Wind	Dec-22	20	200 MW	78.8	10	1	10	10	10	10	10	10	10	10	10	10

- Notes:
- The metric shown- Levelized PE (Peak Capacity kW - Yr)- is the portfolio benefit attributable to peak capacity service divided by the average peak capacity.
  - Generation Resources with a peak capacity contribution (as described by ELCC or Effective Load Carrying Contribution) of 30% or higher were considered "Capacity Resources".
  - Generation Resources with Mid-C delivery are not considered Capacity Resources regardless of ELCC.
  - Capacity-specific contracts and products such as Demand Response, Transmission Redirect, and BPA Capacity are considered alongside generation resources.
  - None of the demand response projects in Phase II were selected, as there was no identifiable deferred RSD value that would have made it a cost-effective solution. In addition, the providers' lack of experience in integrating with ASES/DERM (Distributed Energy Resource Management) system was deemed to be a critical hindrance to implementation.
  - Transmission Redirect has been eliminated as a viable option to meet capacity need.
  - Wind Response projects were eliminated as viable options to meet capacity need.
  - At the time of the RFP, there were no available options for determining production capacity figures.
  - BPA's Peak Capacity product, highlighted in green, is included in the optimization modeling even though it ranks low when compared to other long-term projects (generally 20+ years) in the RFP. The product has a unique profile in that it is a short term product (5 years), with a high ELCC of 54% and qualitatively appropriate for implementation.

REDACTED  
VERSION

REDACTED  
VERSION



# 2018 All Resources RFP:

Phase 2 results and recommended shortlist



***EMC Decisional***

July 23, 2019

***Cindy Song***

*Business Initiatives Manager*

# Decisional

---

**Recommendation:** Approve projects selected from the RFP (slide #5) and authorize RFP team to proceed with contract negotiations.

## RFP timeline and next steps

Date	Milestone
✓ March 29, 2018	Draft RFP filed with WUTC
✓ June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓ July 3, 2018	PSE released final RFPs
✓ August 17, 2018	Offers were due to PSE
✓ March 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
✓ July 2019	Complete Phase 2 evaluation, select final short list
July/August 2019	Notify respondents; begin contract negotiations
To follow	Seek EMC/board approval prior to executing negotiated contracts



July 23, 2019 EMC Decisional: 2018 All Resources RFP |




# Capacity resource need updated to 299 MW in 2022 and REC need updated to 233,449 RECs in 2023

Resource need forecasts updated in Phase 2 analysis to reflect draft 2019 IRP need assessments and F2019 load forecast (net conservation)\*


### 2018 RFP Capacity Need – Phase 2 update

- PSE seeks 299 MW capacity by end of 2022; near-term gap in 2020-2021 to be filled by short-term RFP
- Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably

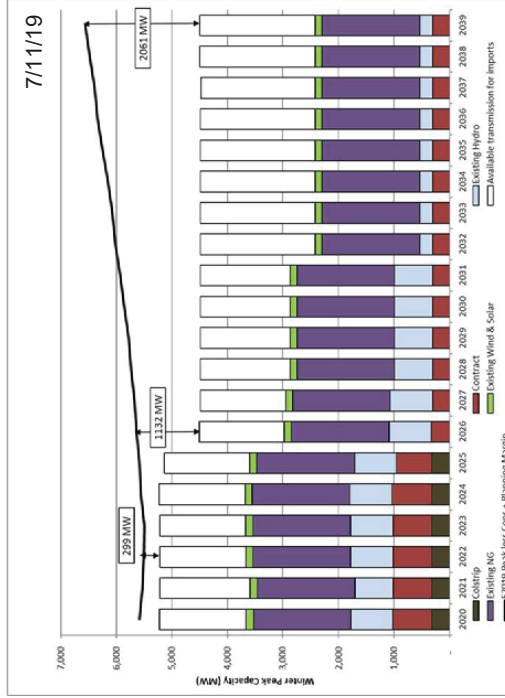

### 2018 RFP REC Need – Phase 2 update\*\*

- REC need is driven by the increase in the RPS from 9% to 15% in 2020
- Projected need to meet the RPS is 233,449 RECs by 2023
- PSE's inventory of banked RECs delays need until 2023

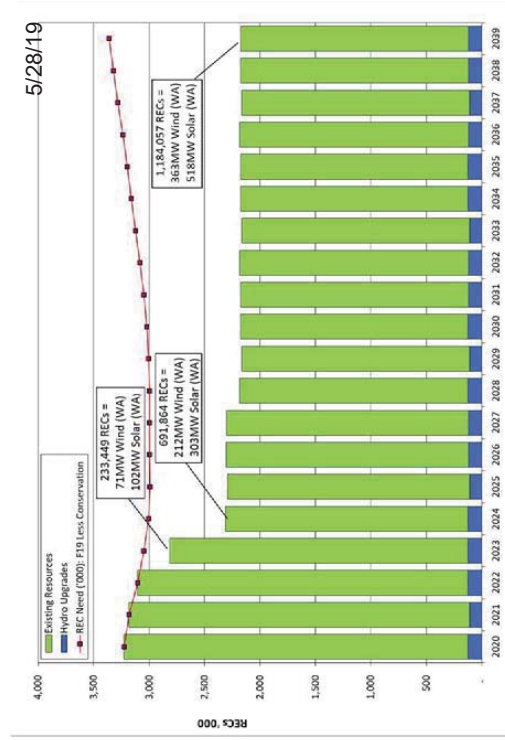

\*Original RFP issued to fill 272 MW capacity need in 2022 and 671,000 REC renewable need in 2023.  
\*\*REC need reflects renewable need driven by RCW 19.285 (RPS). It does not reflect the impact of SB 5116 (Clean Energy Transformation Act).



# Portfolio optimization results\*

(results as of July 23, 2019)

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)
Project List ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Preferred Optimized Portfolio	As Proposed Optimized Portfolio	
1	Biomass	SPI	17 MW	16 MW		X	X	
2	Call Option	BPA Peak Capacity Product	100 MW	53 MW		X	X	
3	MT Wind		350 MW			X		
4	MT Wind		300 MW				X	
5	Wind	Golden Hill Shaped	200 MW	77 MW		X	X	
6	Total Peak Capacity Credits - MWs							MW
7	Peak Capacity Surplus / (Deficit) in 2022 <sup>4</sup>							MW
8	Total Annual RECs							2,189,656
9	Portfolio Benefits - \$M							\$408
10								
11	With Consideration of Social Cost of Carbon:							
12	Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>5</sup>							\$1,038
13	Portfolio Benefits w/ Carbon Costs in Dispatch Costs - \$M							\$959
<b>Peak Capacity and REC Need 2022-2025</b>								
Peak Capacity Need					2022	2023	2024	2025
REC Need					299 MW	281 MW	328 MW	457 MW
					0	233,449	691,864	700,482

CONFIDENTIAL

1. The annual project RECs in column I does not include 0.2X apprenticeship multiplier.  
 2. The optimization model chose a portfolio with [REDACTED] MW from [REDACTED] submitted proposals for both [REDACTED] MW and [REDACTED] MW, but not [REDACTED] MW. The size of the project is reduced from the proposed [REDACTED] MW option based on available transmission capacity. The [REDACTED] MW option will have to be negotiated with [REDACTED]. Current indicative results reflect pricing based on the [REDACTED] MW offer.  
 3. The current project COD for [REDACTED] is Dec 2021. There has been perceived timing risks for PSE to secure long-term transmission rights to bring the energy home. If the COD is delayed to Dec 2022 to mitigate this risk, NPV of PPA cost will increase by up to \$35M. Without [REDACTED] the next lowest cost portfolio is \$123M more expensive than the recommended portfolio. However it would have the same timing risks on transmission because the new lowest cost portfolio includes the [REDACTED] project, which uses the same Colstrip transmission path.  
 4. Final Portfolio ELCC reduces the sum of individual project peak capacity contribution by 8 MW. It could potentially be mitigated by 1) short-term capacity purchase for \$720k per year; 2) a 20MW battery for \$41M.  
 5. Social cost of carbon at \$86/metric ton in 2010 dollars plus escalation is added to total portfolio costs as fixed cost.

\*Detailed optimization results for Phase 2 proposals are presented in Appendix E. Detailed scenario analysis and standalone proposal ranking results are presented in Appendix C.

July 23, 2019 EMC Decisional: 2018 All Resources RFP |



REDACTED VERSION

REDACTED VERSION

## RFP short list – selected four projects to go out and start negotiations

---

1. SPI Biomass (Sierra Pacific Industries) 17-year PPA
2. [REDACTED] Montana wind ([REDACTED]) 25-year PPA
3. Golden Hills Oregon wind (Avangrid) 20-year PPA
4. BPA peak capacity product (BPA) 5-year call option

REDACTED  
VERSION



# Selected proposal: SPI Biomass PPA

## Proposed terms are subject to change

### Seller:

- Sierra Pacific Industries (SPI)

### Product:

- Delivery of 17 MW of firm capacity (24/7)
- Delivery of up to 20 MW worth of energy (3 MW is variable)
- Minimum availability: [REDACTED] (92% historic)
- Contribution to Peak Capacity: 16 MW



\* The SPI Burlington lumber mill began operating in 2001. The biomass cogeneration facility was added in 2007. Facility is subject to an existing contract with a broker to sell the output through 2020.

\*\* Levelized cost of energy is \$ [REDACTED]

### Term:

- Start: Jan. 1, 2021\*
- 17 years

### Point of Delivery:

- SPI.CABO.GEN at Fredonia Substation (also Point of Interconnection)

### Price\*\*:

Calendar Year	Contract Year	Energy Price (\$/MWh)	Expected Energy Output (MWh/year)
2021	1	[REDACTED]	[REDACTED]
2022	2	[REDACTED]	[REDACTED]
2023	3	[REDACTED]	[REDACTED]
2024	4	[REDACTED]	[REDACTED]
2025	5	[REDACTED]	[REDACTED]
2026	6	[REDACTED]	[REDACTED]
2027	7	[REDACTED]	[REDACTED]
2028	8	[REDACTED]	[REDACTED]
2029	9	[REDACTED]	[REDACTED]
2030	10	[REDACTED]	[REDACTED]
2031	11	[REDACTED]	[REDACTED]
2032	12	[REDACTED]	[REDACTED]
2033	13	[REDACTED]	[REDACTED]
2034	14	[REDACTED]	[REDACTED]
2035	15	[REDACTED]	[REDACTED]
2036	16	[REDACTED]	[REDACTED]
2037	17	[REDACTED]	[REDACTED]

July 23, 2019 EMC Decisional: 2018 All Resources RFP |

REDACTED VERSION



# SPI Biomass PPA: Key risks and benefits

## Risks and mitigations:

Risk	Responsibility	Impact without mitigation	Proposed PSE mitigation
Availability or production risk	PSE	PSE peak capacity need would be unmet in the short term	Liquidated Damages assessed on counterparty; Trade floor purchases short-term market capacity

## Benefits:

- Operational status, solid operating history, reliable fuel supply and interconnection to PSE's system
- High-yield capacity contribution from a renewable resource
- No known community or reputational risks
- Consistent with Washington State's clean energy goals
- Strong counterparty with no project subsidiary
- Counterparty appears motivated to work with PSE to negotiate mutually acceptable PPA terms
- Quantitative analysis demonstrates that SPI Biomass performs well compared to alternatives on a standalone basis and is selected in all optimization portfolios, including the lowest reasonable cost solution



# Selected proposal: [REDACTED] Wind PPA

*Proposed terms are subject to change*

**Seller:**

- [REDACTED]
- Term: 25 years

**Product:**

- Nameplate Capacity: Proposed [REDACTED]
- NCF: [REDACTED] %
- Expected Output: [REDACTED] MWh/year

**Term:**

- COD: Proposed 12/31/2021\*\*

**Point of Delivery:**

- [REDACTED] Substation 500 kV

(also Point of Interconnection)

\*Preferred size [REDACTED] MW (no offer yet)

\*\*To be determined based on timing of transmission availability



**Price (based on 300 MW PPA)\*\*\*:**

Calendar Year	Contract Year	PPA	
		Fiat Energy Price	Expected Energy Output (MWh/year)
2022	1	[REDACTED]	[REDACTED]
2023	2	[REDACTED]	[REDACTED]
2024	3	[REDACTED]	[REDACTED]
2025	4	[REDACTED]	[REDACTED]
2026	5	[REDACTED]	[REDACTED]
2027	6	[REDACTED]	[REDACTED]
2028	7	[REDACTED]	[REDACTED]
2029	8	[REDACTED]	[REDACTED]
2030	9	[REDACTED]	[REDACTED]
2031	10	[REDACTED]	[REDACTED]
2032	11	[REDACTED]	[REDACTED]
2033	12	[REDACTED]	[REDACTED]
2034	13	[REDACTED]	[REDACTED]
2035	14	[REDACTED]	[REDACTED]
2036	15	[REDACTED]	[REDACTED]
2037	16	[REDACTED]	[REDACTED]
2038	17	[REDACTED]	[REDACTED]
2039	18	[REDACTED]	[REDACTED]
2040	19	[REDACTED]	[REDACTED]
2041	20	[REDACTED]	[REDACTED]
2042	21	[REDACTED]	[REDACTED]
2043	22	[REDACTED]	[REDACTED]
2044	23	[REDACTED]	[REDACTED]
2045	24	[REDACTED]	[REDACTED]
2046	25	[REDACTED]	[REDACTED]

\*\*\*Price does not include delivery to PSE's system. Levelized cost of energy is [REDACTED].



REDACTED VERSION

REDACTED VERSION

## Wind PPA: Key risks and benefits

### Risks and mitigations:

Risk	Responsibility	Impact without mitigation	Proposed PSE mitigation
Commercial operation delayed - site control - permitting - construction	[REDACTED]	Short-term capacity deficit	Liquidated Damages assessed on counterparty; Trade floor purchases short-term market capacity
[REDACTED] network upgrades complete later than expected	PSE	Insufficient long-term available transmission capacity (ATC)	PSE purchases available short-term transmission capacity; remaining output curtailed

### Benefits:

- Relatively inexpensive large-scale wind project
- Expected capacity factor and wind shape indicate a high-yield capacity contribution from a renewable resource
- Consistent with Washington State's clean energy goals
- Strong counterparty with a parent guarantee
- Quantitative analysis demonstrates [REDACTED] performs well compared to alternatives on a standalone basis and was the linchpin to meet the RPS and peak capacity needs during portfolio optimization



# Selected proposal: Golden Hills Wind (Shaped) Proposed terms are subject to change

**Seller:**

- Avangrid Renewables, Inc.

**Product:**

- Nameplate Capacity: 200 MW
- NCF: [REDACTED]
- Expected Output: [REDACTED] MWh/year
- Shaped Capacity: up to [REDACTED] MW
- Shaped Schedule: Nov - Feb
- Shaped Hours: HE 9-11, 18-21

**Term:**

- COD: 12/31/2021
- Term: 20 years


**Point of Delivery:**

- BPAT.PSEI

**Price\*:**

\*Levelized cost of energy is \$ [REDACTED] /MWh.

Calendar Year	Contract Year	PPA		Winter-Peaking Capacity	
		Fiat Energy Price (\$/MWh)	Expected Energy Output (MWh/year)	Capacity Price (\$/kW-mo)	Capacity (MW)
2022	1	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2023	2	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2024	3	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2025	4	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2026	5	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2027	6	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2028	7	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2029	8	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2030	9	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2031	10	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2032	11	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2033	12	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2034	13	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2035	14	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2036	15	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2037	16	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2038	17	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2039	18	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2040	19	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2041	20	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]

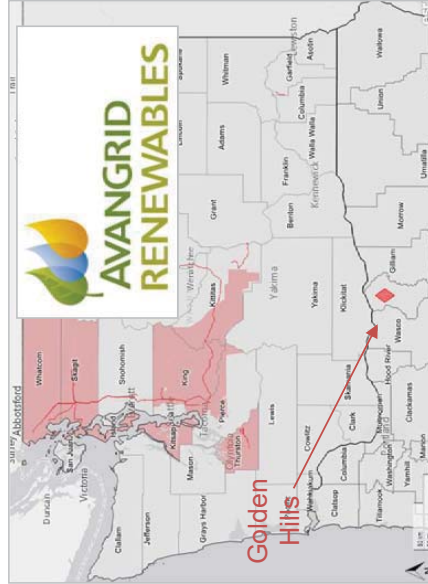


July 23, 2019 EMC Decisional: 2018 All Resources RFP |

REDACTED VERSION



## The uniquely shaped output during winter months yields higher peak capacity contribution

- “As generated” Golden Hills Wind has an ELCC of 26%, therefore a peak capacity contribution of 52MW.
- Avangrid Renewables has offered a synthetic peak capacity output profile for winter months (Nov-Feb) that reshapes the wind output in those months to optimize the coincidence to PSE’s load profile.
- This reshaped wind product offers an ELCC of 39%, therefore a peak capacity contribution of 79MW.
- PSE has an opportunity to optimize the shaped product, and analysis is ongoing.



REDACTED  
VERSION

# Golden Hills PPA: Key risks and benefits

## Risks and mitigations:

Risk	Responsibility	Impact without mitigation	Proposed PSE mitigation
Commercial operation delayed - construction	Avangrid	Short-term capacity deficit	Liquidated Damages assessed on counterparty; Trade floor purchases short-term market capacity
Available long-term firm transmission capacity (200 MW) is less than project nameplate capacity (200 MW)	Avangrid	Possible impact to energy delivery in excess of 200 MW	Confirm use of short-term firm redirects
Shaped product resource pool may not be 100% renewable	PSE	May misalign with CETA requirements	May require some offset purchases starting in 2030

## Benefits:

- Incremental wind asset with shaped capacity product provides contribution to both RPS and capacity needs identified in RFP
- Consistent with Washington State's clean energy goals
- Strong counterparty with a parent guarantee
- Shaped hours are negotiable, allowing optimization to need.
- Quantitative analysis demonstrates that Golden Hills PPA (shaped) performs well compared to alternatives on a standalone basis and is selected in all optimization portfolios, including the lowest reasonable cost solution




July 23, 2019 EMC Decisional: 2018 All Resources RFP |

## Selected proposal: BPA Capacity Tolling Agreement (CTA) Proposed terms are subject to change

- Seller:**
- Bonneville Power Administration (BPA)
- Product:**
- Capacity: 100 MW
  - Firm Capacity which may be scheduled in [REDACTED] MW on a [REDACTED] basis
  - Western Systems Power Pool (WSPP) Schedule C, Heavy Load Hour, Low Carbon Firm Energy

- Term:**
- Start: 01/01/2022
  - Term: 5 years

- Point of Delivery:**
- BPAT.PSEI
  - PSE Covington 230 kV Substation

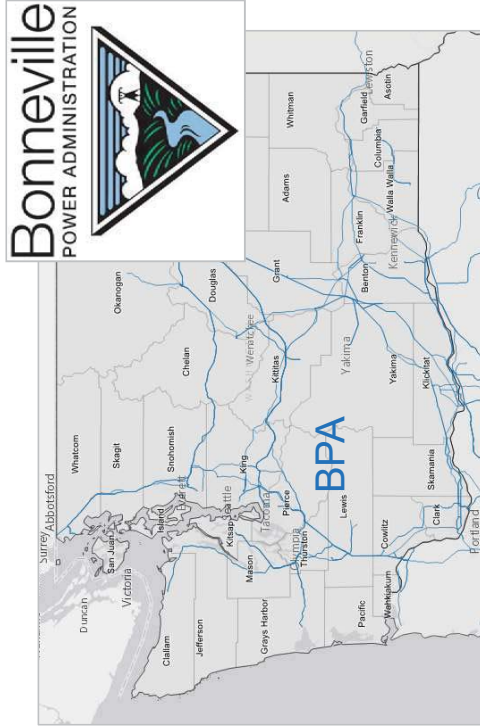

**Price\*:**

Calendar Year	Contract Year	Energy Price (\$/MWh)	Possible Energy Output (MWh/year)	Capacity Price (\$/kW-mo)	Capacity (MW)
2022	1	[REDACTED]	[REDACTED]	[REDACTED]	100
2023	2	[REDACTED]	[REDACTED]	[REDACTED]	100
2024	3	[REDACTED]	[REDACTED]	[REDACTED]	100
2025	4	[REDACTED]	[REDACTED]	[REDACTED]	100
2026	5	[REDACTED]	[REDACTED]	[REDACTED]	100

\* Powerdex hourly Mid-Columbia index for each hour MWh are delivered



July 23, 2019 EMC Decisional: 2018 All Resources RFP |

REDACTED  
VERSION

# BPA Capacity CTA: Key risks and benefits

## Risks and mitigations:

Risk	Responsibility	Impact without mitigation	Proposed mitigation
Increased market exposure	PSE	Potentially higher energy costs	Trade floor implements hedging strategy

## Benefits:

- Very strong counterparty with minimal risk of default
- No development risk
- Consistent with Washington State's clean energy goals
- Energy delivered from BPA's system will be certified as an Asset Controlling Supplier (ACS) product, typically 95% carbon free\*
- Quantitative analysis demonstrates that BPA Capacity CTA performs well compared to alternatives on a standalone basis and is selected in all optimization portfolios, including the lowest reasonable cost solution

\* As reported to the California Air Resources Board (CARB)



# Appendix A

---

## RFP modeling assumptions



## PSE updated key Phase 2 modeling assumptions to reflect current draft 2019 IRP assumptions\*


	RFP Phase 2	RFP Phase 1	2017 IRP
Mid-C power prices (Levelized)	\$28.75 / MWh	\$33.92 / MWh	\$40.48 / MWh
Gas prices (Levelized)	\$3.50 / mmbtu	\$3.74 / mmbtu	\$4.02 / mmbtu
Load growth	0.4%	0.5%	0.7%
Effective load carrying capability (ELCC)	See appendix.		

\* This is not intended to be a complete list of all model updates. Certain additional Phase 2 modeling assumptions are described in the appendix.




# Phase 1: Load forecast comparison

---

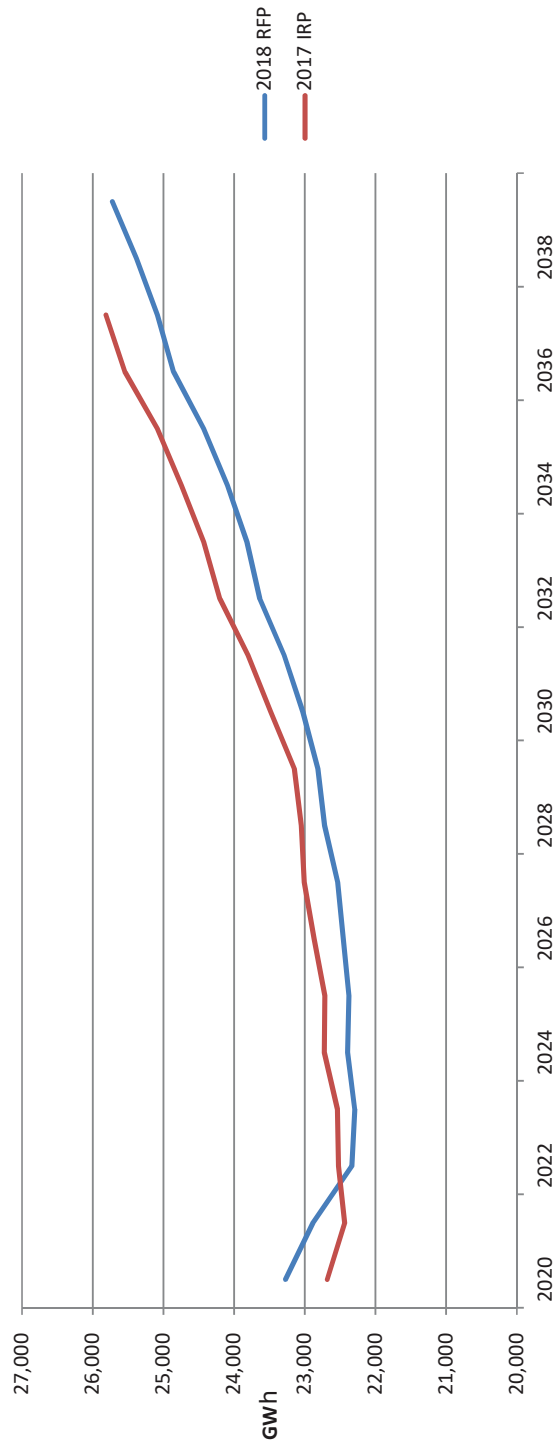


# Phase 2: Load forecast comparison

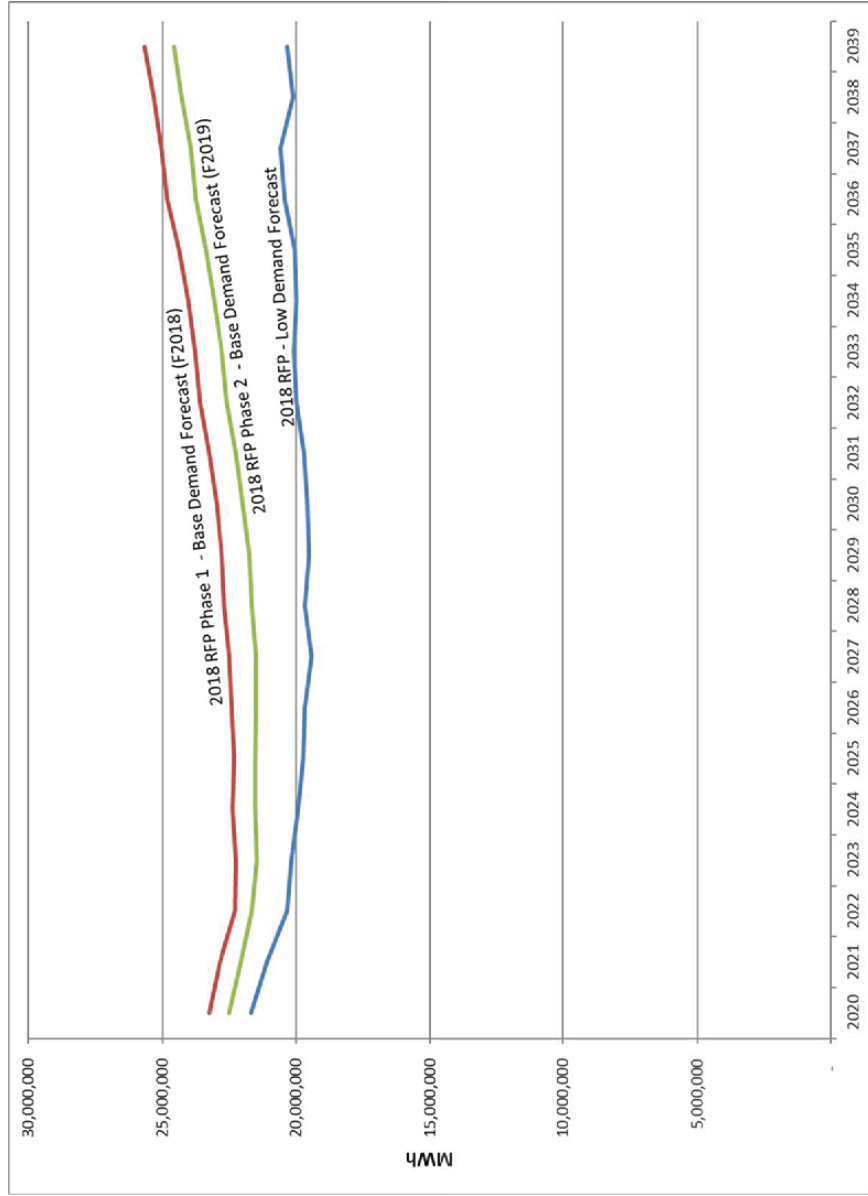




# Phase 1: Power price forecast

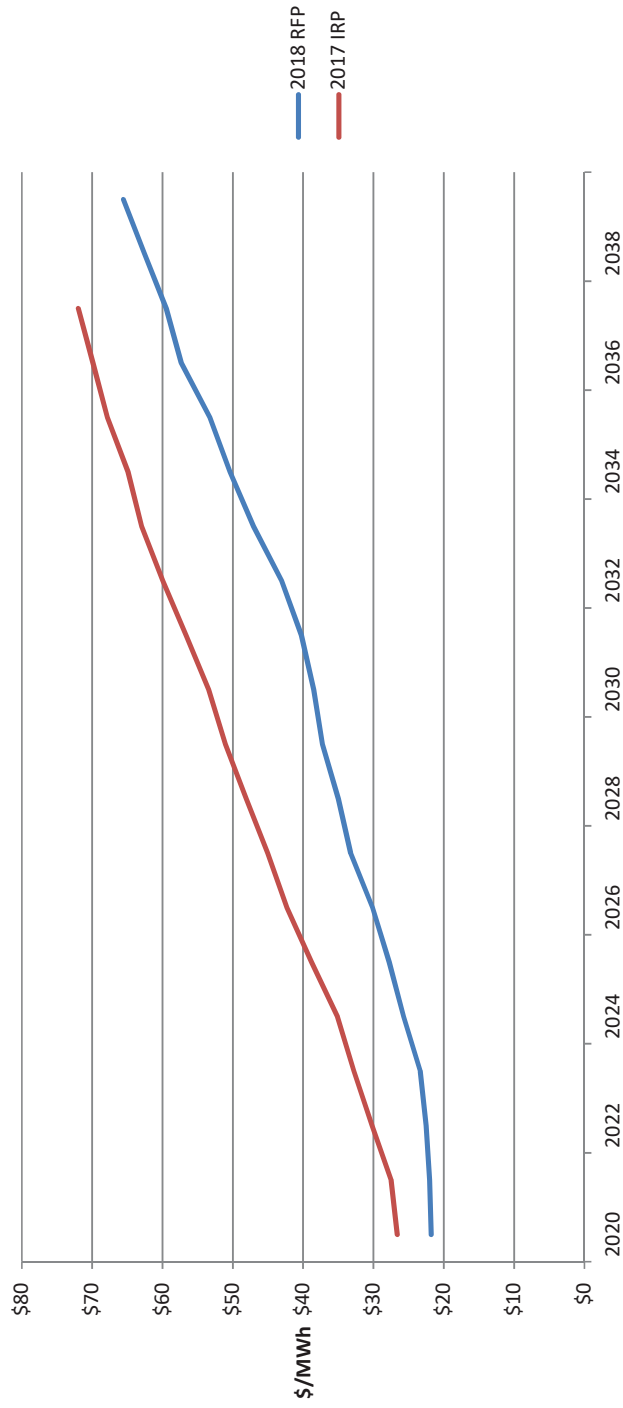

# Phase 2: Power price forecast

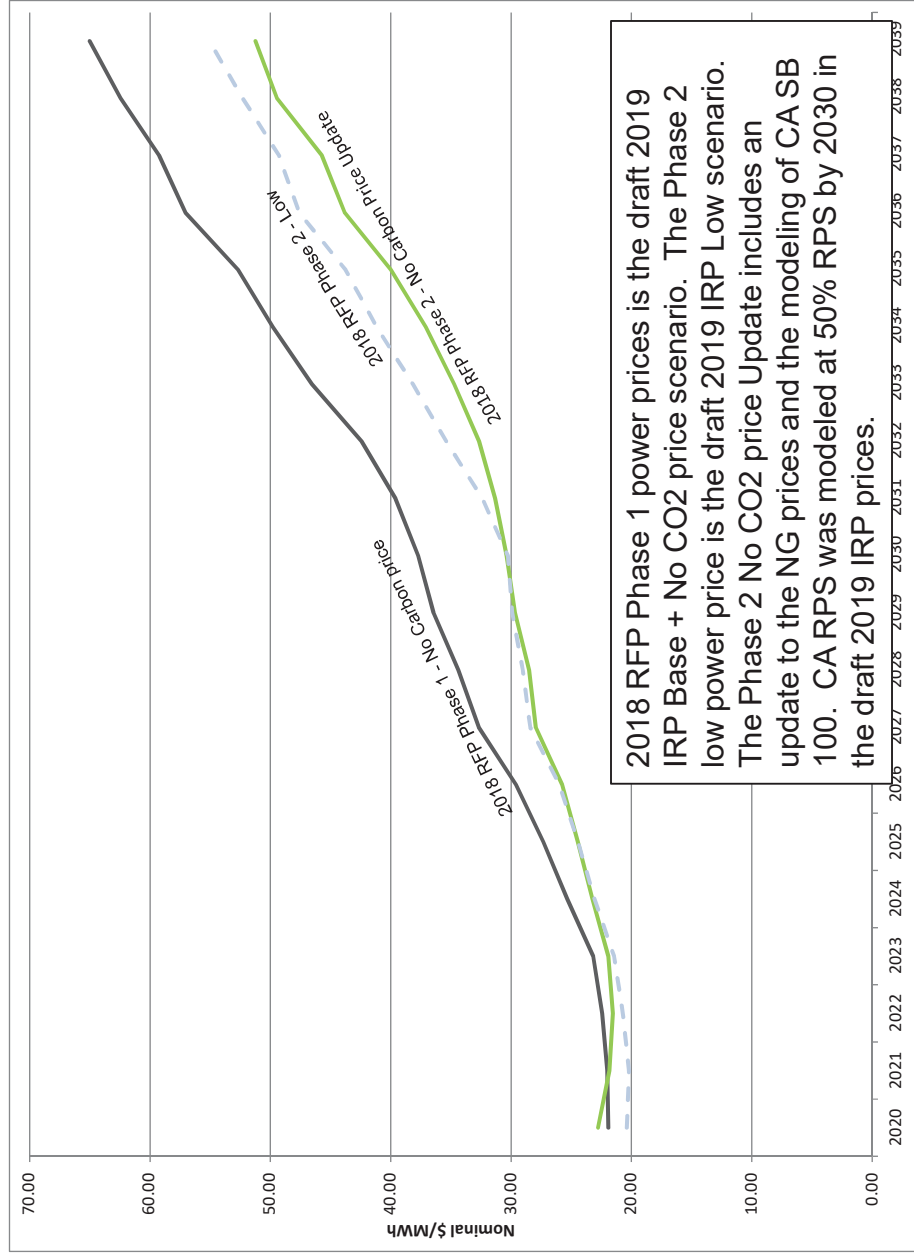


2018 RFP Phase 1 power prices is the draft 2019 IRP Base + No CO2 price scenario. The Phase 2 low power price is the draft 2019 IRP Low scenario. The Phase 2 No CO2 price Update includes an update to the NG prices and the modeling of CA SB 100. CA RPS was modeled at 50% RPS by 2030 in the draft 2019 IRP prices.




July 23, 2019 EMC Decisional: 2018 All Resources RFP

# Phase 2: Natural gas price forecasts

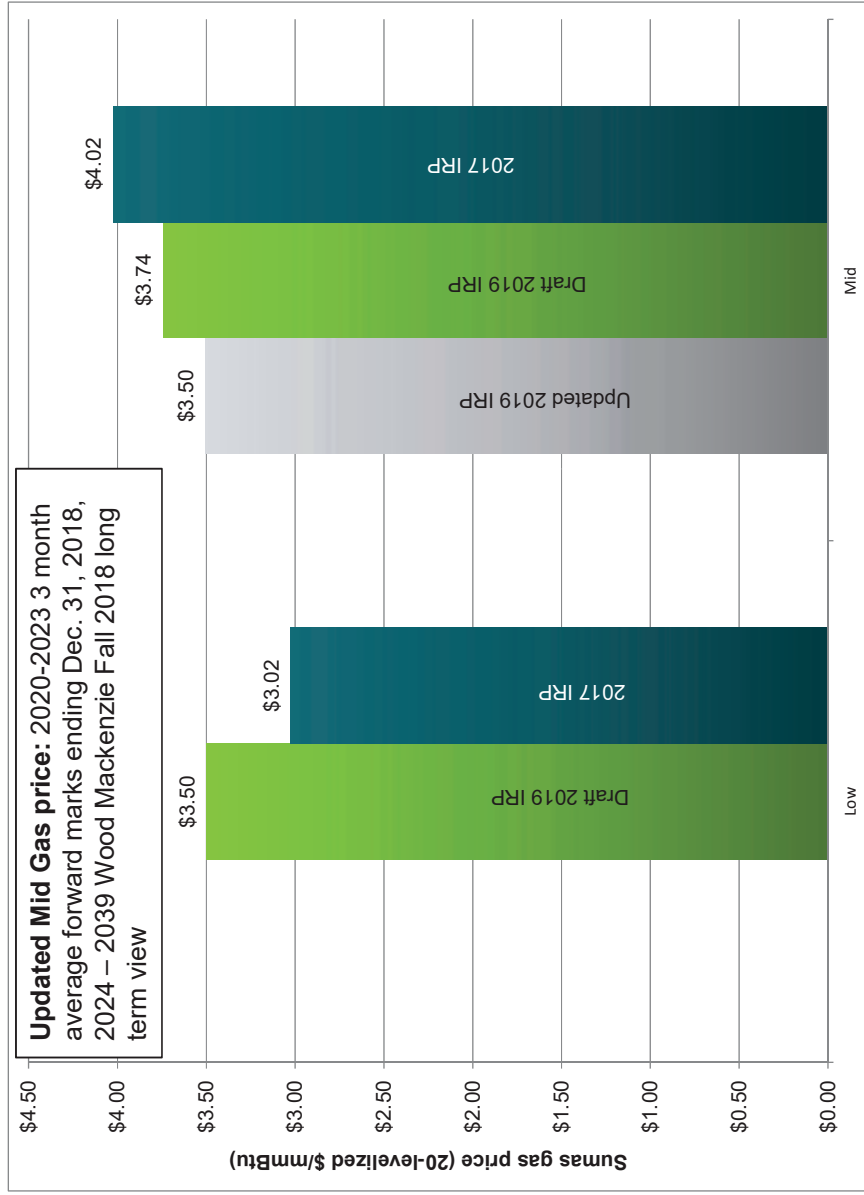

July 23, 2019 EMC Decisional: 2018 All Resources RFP |

# Carbon Prices

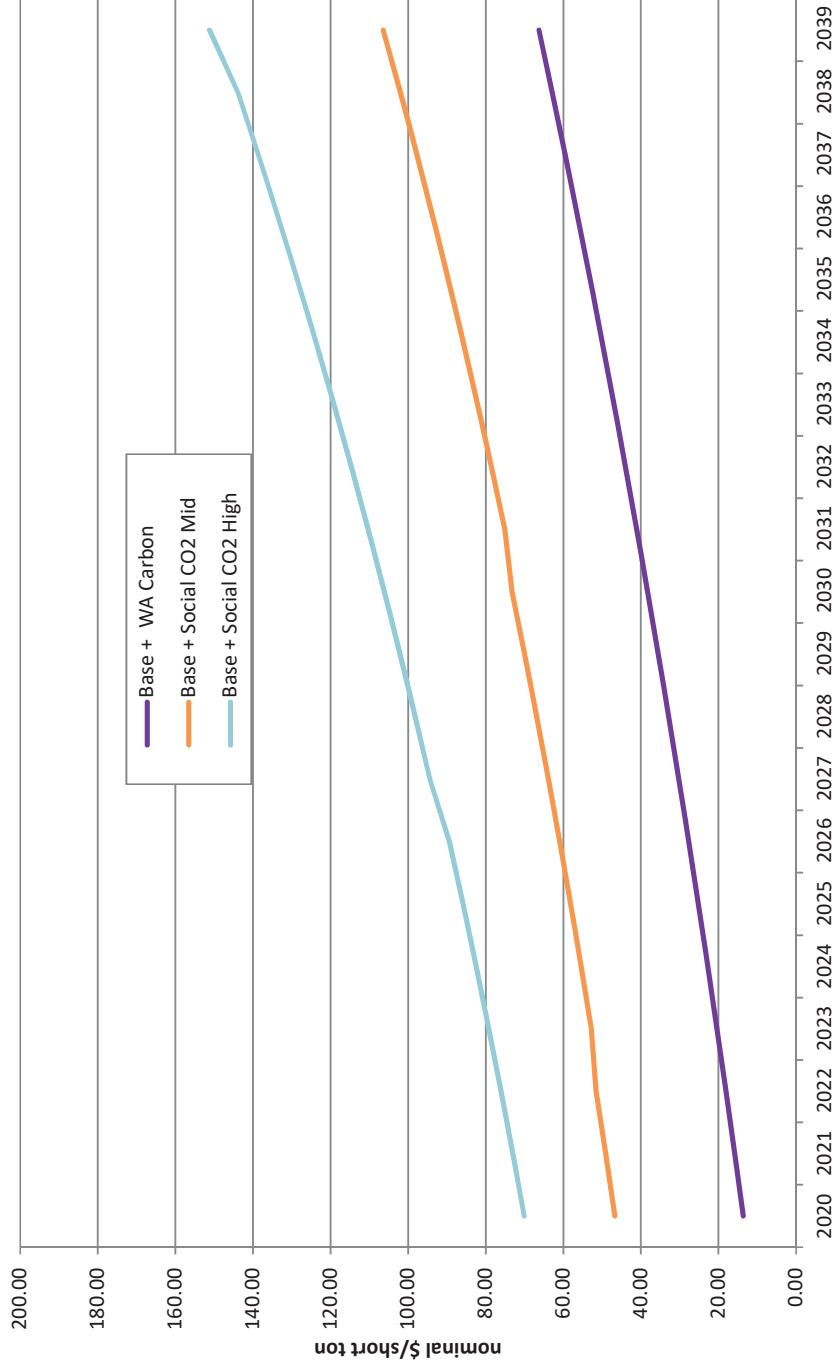

July 23, 2019 EMC Decisional: 2018 All Resources RFP |

# Phase 1: Comparison of generic resource costs

2018 \$/kW	2017 IRP			2019 IRP			Change in costs from 2019 IRP to 2017 IRP		
	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	All in Costs
CCCT	\$1,020	\$358	\$1,378	\$898	\$269	\$1,167	(\$122)	(\$89)	(\$211)
Frame Peaker (Fuel Fuel)	\$526	\$172	\$698	\$554	\$271	\$825	\$28	\$99	\$127
Recip Engine (NG only)	\$1,030	\$312	\$1,341	\$842	\$350	\$1,192	(\$188)	\$38	(\$149)
WA Wind	\$1,548	\$656	\$2,204	\$1,656	\$386	\$2,042	\$108	(\$270)	(\$162)
MT Wind	\$1,471	\$1,312	\$2,783	\$1,633	\$1,111	\$2,744	\$162	(\$201)	(\$39)
Solar	\$1,497	\$874	\$2,371	\$1,352	\$570	\$1,922	(\$145)	(\$304)	(\$449)
Biomass	\$4,084	\$207	\$4,291	\$7,036	\$2,659	\$9,695	\$2,952	\$2,452	\$5,404
Offshore Wind	\$5,717	\$1,795	\$7,512	\$5,000	\$1,547	\$6,547	(\$717)	(\$248)	(\$965)
Li-Ion Battery 2-hr	\$1,313	\$342	\$1,655	\$1,331	\$599	\$1,930	\$18	\$257	\$275
Li-Ion Battery 4-hr	\$2,116	\$552	\$2,668	\$2,346	\$708	\$3,054	\$230	\$156	\$386
Flow Battery 4-hr	\$1,870	\$674	\$2,544	\$1,493	\$618	\$2,111	(\$377)	(\$56)	(\$433)
Flow Battery 6-hr	\$2,447	\$882	\$3,329	\$2,050	\$708	\$2,758	(\$397)	(\$174)	(\$571)
Pumped Storage	\$2,503	\$127	\$2,630	\$1,800	\$879	\$2,679	(\$703)	\$752	\$49



# Phase 2: Generic resource costs

---

Generic resource capital costs updated from HDR final report as part of the 2019 IRP.

## Cost updates include:

### ➤ **Solar capital cost**

- *Draft:* \$1,922/kw
- *Update:* \$1,614/kw

### ➤ **MT wind capital cost**

- *Draft:* \$2,744/kw
- *Update:* \$1,617/kw

### ➤ **WA wind capital cost**

- *Draft:* \$2,042/kw
- *Update:* \$1,633/kw

### ➤ **Frame Peaker FOM cost**

- *Draft:* \$3.93/kw-yr
- *Update:* \$11.40/kw-yr  
\$11.40/kw-yr includes  
\$3.93/kw-yr FOM +  
\$7.47/kw-yr for 48  
hours of oil.



# PSE also updated ELCC modeling assumptions to reflect current draft 2019 IRP assumptions

Resource	Nameplate (MW)	IRP 2017 Peak Capacity Solve to 5% LOLP Relative to <u>New Peaker</u>	IRP 2019 Peak Capacity Solve to 5% LOLP Relative to <u>Perfect Capacity</u>
Existing Wind	823	11%	9.7%
Skookumchuck	131	40%	36.0%
Generic Montana Wind	100	49%	51.4%
Generic Washington Wind	100	16%	6.4%
Generic Offshore WA Wind	100	51%	47.6%
Generic Washington Solar	100	0%	1.0%
Lund Hill Solar	150	N/A	2.4%
Storage Resources	Nameplate (MW)	IRP 2017 Peak Capacity EUE at 5% LOLP	IRP 2019 Peak Capacity EUE at 5% LOLP
Lithium-Ion 2 hr, 82% RT efficiency	25	60%	19.2%
Lithium-Ion 4 hr, 87% RT efficiency	25	88%	38.4%
Flow 4 hr, 73% RT efficiency	25	76%	36.0%
Flow 6 hr, 73% RT efficiency	25	N/A	46.4%
Demand Response 3 hr duration, 6 hr delay 10 calls per year	100	77%	38.2%



July 23, 2019 EMC Decisional: 2018 All Resources RFP |

# Appendix B

---

## 2018 All Resources RFP Phase 2 Executive Summary



July 23, 2019 EMC Decisional: 2018 All Resources RFP |





## 2018 RFP – Executive Summary\*

Quantitative results are the product of analysis performed in PSM III version 25.13.

### Phase 2 Candidate Short List: Proposals selected for contracting phase of RFP

Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18100</b> <b>SPI Burlington Biomass</b> Sierra Pacific Industries PPA Operational biomass 17 MW nameplate COD: 01/01/2021 Term: 17 years capacity	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$14.132 M Levelized PB/REC: \$ [REDACTED] *** Peak capacity PB / kW-Yr: [REDACTED] Net cost PV: \$33.613 M Peak capacity contribution (MW): 16.4 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Existing/operating facility so no development risk</li> <li>Biomass project is REC producing</li> <li>High effective load-carrying capability (ELCC), i.e. contribution to peak capacity need</li> <li>Interconnected onto PSE's system</li> </ul>	<ul style="list-style-type: none"> <li>Sierra Pacific Industries is a privately held company, so less financial information is available than if it were public</li> <li>A disruption of mill operations would likely impact long-term operation of the facility</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18161</b> <b>BPA Peak Capacity</b> Bonneville Power Administration PPA** Operational portfolio of projects 100 MW** COD: 01/01/2022** Term: 5 years**	Levelized cost: N/A Portfolio benefit: (\$8,028 M) Peak capacity PB / kW-Yr: [REDACTED]*** Net cost PV: \$25,426 M Peak capacity contribution (MW): 100 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Counterparty is well known with existing ties to PSE and, therefore, no risk for this proposal</li> <li>There are no permitting, real estate or community relations concerns as the proposal is based on currently operational projects</li> <li>As a response to data requests, Bonneville Power Administration (BPA) moved their delivery location from Mid-C to BPAT, PSEI</li> </ul>		<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.
<b>18169</b> [REDACTED] PPA** or 50% ownership+PPA Development wind 100 MW** COD: 12/31/2021** Term: 20 or 25** years	Levelized cost: \$[REDACTED]/MWh Portfolio benefit: \$417,294 M Levelized PB/REC: [REDACTED] Peak capacity PB / kW-Yr: [REDACTED] Net cost PV: \$24,422 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Relatively cost efficient way to contribute towards both the REC and contribution to peak capacity need</li> <li>Large and experienced counterparty</li> <li>Site control is reportedly achieved, but supporting documentation was not included in proposal</li> <li>Public has been notified of the project as at [REDACTED] MW facility</li> <li>Shape of wind based on 6 operating meteorological towers appears to fit well with PSE's needs</li> </ul>	<ul style="list-style-type: none"> <li>Lengthy gen-tie line for which site-control has not yet been fully obtained</li> <li>Transmission from [REDACTED] to PSE is both schedule and cost risk to PSE as the energy offtaker</li> <li>There is a potential permitting issue with sage grouse habitat</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to limitations between [REDACTED] the projects are considered mutually exclusive.
<b>18170</b> <b>Golden Hills Wind</b> Avangrid Renewables PPA-shaped Development wind 200 MW** COD: 12/31/2020** Term: 20 years**	Levelized cost: \$[REDACTED]/MWh Portfolio benefit: \$106,924 M Levelized PB/REC: [REDACTED] Net cost PV: \$74,948 M Peak capacity contribution (MW): 51.6 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Shaped product offers capacity contribution during peak winter months</li> <li>Site control is achieved</li> <li>Permitting well advanced with Oregon Energy Facility Siting Council (EFSC) permit application already amended</li> </ul>	<ul style="list-style-type: none"> <li>Complex energy delivery will require additional vetting</li> <li>Complexity of shaped product will require additional vetting</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<p>18173</p> <p>PPA** Development wind 1MW or 1 MW COD: 10/31/2022** Term: 20 years**</p>	<p>Levelized cost: \$ / MWh</p> <p>Portfolio benefit: \$280.504 M</p> <p>Levelized PB/REC: \$</p> <p>Peak capacity PB / kW-Yr: (\$ )</p> <p>Net cost PV: \$116.358 M</p> <p>Peak capacity contribution (MW) ( )</p> <p>Annual REC contribution: ( )</p>	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Project may be sited on a single landowner's property, which would likely minimize real estate complexity</li> <li>Favorable state support; however, local level of support unknown</li> </ul>	<ul style="list-style-type: none"> <li>Project site may include Montana Department of Natural Resources and Conservation (DNRC) land, which could complicate site control and permitting</li> <li>Permitting is in a relatively early stage of development; risk of potential delay to scheduled COD</li> <li>Assumed use of under ongoing review and may be problematic</li> </ul>	<p><b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to available transmission capacity limitations between [REDACTED] and [REDACTED], [REDACTED] considered mutually exclusive.</p>

REDACTED VERSION

REDACTED VERSION

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Phase 2 proposals not selected for contracting phase of RFP

Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18103</b> [REDACTED] CTA** or asset transfer Operational repurchased cycle [REDACTED] MW Start: 06/01/2022 Term: 10 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: (\$29.120 M) Peak capacity PB / kW-Yr: (\$ [REDACTED]) Net cost PV: \$163.748 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Existing/operating facility (rather than new build) therefore no development risk</li> <li>Existing presence in the community with local opposition unlikely</li> </ul>	<ul style="list-style-type: none"> <li>High social cost of carbon adversely impacts project economics in certain quantitative scenarios</li> <li>In light of recently passed Clean Energy Transition Act (SB5116), advancement of this and other fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Lack of firm delivery of natural gas is a risk to the effective load-carrying capability (ELCC) of the project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18105</b> [REDACTED] CTA** or BTS Frederickson thermal expansion [REDACTED] MW COD: 01/01/2022 Term: 5, 15, or 20** years	Levelized cost: \$ [REDACTED] / MW Portfolio benefit: (\$16.898 M) Peak capacity PB / kW-Yr: (\$ [REDACTED]) Net cost PV: \$85.973 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Proposed expansion of [REDACTED] may bring O&amp;M cost savings on a per-kW basis (versus an entirely new thermal facility)</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate at other sites</li> <li>[REDACTED] MW proposal would likely be facilitated with firm gas supply from existing facilities</li> </ul>	<ul style="list-style-type: none"> <li>In light of recently passed Clean Energy Transition Act (Washington State Bill 5116), advancement of new fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Proposed project would require extensive integration with existing PSE facility, the viability of which is unknown at this time</li> <li>Would require review and likely modification of air permit for co-located generation facility. Process expected to be exceedingly difficult and the outcome uncertain, with possible impacts to existing facility operational permits</li> <li>PSE will likely experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's CO<sub>2</sub> emitting portfolio</li> <li>Strong likelihood of considerable delays to COD due to expected public protest, litigation and permit process</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION

REDACTED  
VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18107</b> [REDACTED] PPA** Operational hydro MW: [REDACTED] Start: 1/1/2021 (assumed) Term: 20 years (assumed)	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: (\$36.163 M) Levelized PB/REC: \$ [REDACTED] ** Net Cost PV: \$38.677 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>No development risk, project is an existing operational facility</li> <li>Clean energy (although not RPS compliant)</li> <li>Run-of-river hydro can be less environmentally impactful than standard hydro</li> <li>Little to no permitting or real estate risk due to current operational status</li> </ul>	<ul style="list-style-type: none"> <li>Run-of-river asset provides little capacity value.</li> <li>Not RPS compliant (although clean energy)</li> <li>Energy delivery strategy has been left to PSE, and appears to be complex</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and did not show potential during standalone quantitative analysis.
<b>18111</b> [REDACTED] PPA** Development solar Solar: [REDACTED] MWac COD: 12/31/2022 Term: 20 years	Levelized cost: \$36.79 / MWh Portfolio benefit: \$107.686 M Levelized PB/REC: \$ [REDACTED] ** Net cost PV: \$51.359 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Relatively high quantitative score for solar project</li> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Site control has been achieved</li> <li>Permitting status is sufficient at this stage</li> <li>Located on PSE's system in [REDACTED] County</li> <li>avoids community concerns in [REDACTED]</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to available transmission capacity (ATC) constraints in area. Delivery is possible to Mid-C; however, may be difficult given project's proximity to [REDACTED] (substation)</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18112</b> [REDACTED] PPA** Development solar Solar: n/a COD: n/a Term: n/a	Levelized cost: [REDACTED] Portfolio benefit: N/A Levelized PB/REC: [REDACTED] Net cost PV: N/A Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<b>Not Selected</b> – Project withdrawn by applicant.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18114</b> PPA Solar generation (IMW) COD: 12/1/2021 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$45.772 M Levelized PB/REC: \$ ** Net Cost PV: \$36.011 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li> is assessed to be a relatively strong parent company</li> </ul>	<ul style="list-style-type: none"> <li>Environmental permitting not yet begun.</li> <li>Permitting will require the transfer of a Washington Energy Facility Site Evaluation Council (EFSEC) permit, which introduces a viability and reputational risk to the project and PSE</li> <li>Transmission and energy delivery may be overly expensive or otherwise infeasible</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Current site leases were executed for wind projects; it is not yet known whether or not land owners would be amenable to solar leases</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18122</b> PPA**, optional BESS Development/Wind (IMW) COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$32.877 M Levelized PB/REC: \$ ** Net Cost PV: \$35.687 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control for project site is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Solar development is viewed with skepticism in this area; history of active local opposition</li> <li>Site may block the view of a local real estate development</li> <li>Contribution to the peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18125</b> PPA Development/Solar (IMW) COD: 1/1/2023 Term: 15 or 20** years	Levelized cost: \$ / MWh Portfolio benefit: \$55.283 M Levelized PB/REC: \$ Net Cost PV: \$32.311 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> </ul>	<ul style="list-style-type: none"> <li>While interconnected to PSE's system, complex delivery due to available transmission capacity (ATC) constraints in the area</li> <li>Site permitting is in a relatively early stage of development</li> <li>Minimal information provided regarding community relations and or support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18127</b> PPA Development/solar IMW** or IMW COD: 12/31/2022 Term: 15** or 20 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$119,579 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$60,272 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Extensive solar energy development experience; developed currently in Washington State</li> <li>Location on existing project site may provide economies of scale in developing and operating project</li> <li>County has expressed support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Potential siting risks given proximity to wind turbines with required setbacks</li> <li>Assumes use of PSE site control</li> <li>Interconnection and energy delivery assume use of PSE existing infrastructure and analysis assumes no coincidental curtailment due to overproduction between existing wind and proposed solar</li> <li>Conditional Use Permit (CUP) required to permit project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18131</b> PPA** or BTS Development/wind IMW** or IMW COD: 12/31/2022 Term: 25 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$11,525 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$20,124 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Proposes to provide credit support in the form of a parent guarantee, letter of credit, or cash</li> <li>Long-term site control for most of the site is secured</li> <li>Community relations plan is strong compared to other proposals</li> </ul>	<ul style="list-style-type: none"> <li>Less experienced than other counterparties</li> <li>IMW offer configuration would likely exceed available transmission capacity</li> <li>tribe request compensation from project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18132</b> PPA** Development/wind IMW COD: 01/01/2023 Term: 20 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$61,479 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$20,702 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Repower of existing wind project; site control and community relations risks are unlikely</li> <li>Oregon Energy Facility Siting Council (EFSC) amendment secured during Phase 2 of the RFP</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED  
VERSION

REDACTED  
VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18135</b> PPA** or BTS Development solar ( ) MW or ( ) MW solar Optional: 25 MW, 4-hr BESS COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$123.395 M Levelized PB/REC: \$ Net Cost PV: \$5,724 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Large counterparty with experience all over the world</li> <li>Letter of intent with an option to lease has been signed for project lands</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Permitting plan is underdeveloped</li> <li>There is no site control for current generation-tie line alignment</li> <li>Project is on irrigated farmland--mitigation strategy not included in proposal, but developer has retained a ( ) PR ( ) support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18139</b> PPA Development solar ( ) MW with optional ( ) MW or ( ) MW, 1-hr BESS COD: 1/1/2023 Term: 10 years	Levelized cost: \$ / MWh Portfolio benefit: \$26.120 M Levelized PB/REC: \$ Net Cost PV: \$15,659 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Large multi-national counterparty with greater-than-average renewable development experience</li> </ul>	<ul style="list-style-type: none"> <li>Site control not yet secured and copy of anticipated letter of intent has not been provided</li> <li>Energy delivery has been left to PSE, appears to be complicated, and may pose a feasibility risk</li> <li>Respondent provided little to no evidence of a successful permitting strategy</li> <li>Community relations matters were not covered sufficiently, and tribal support may be required</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18163</b> REC purchase Underlying solar projects ( ) MW per year Start of term: 1/1/2022 Term: 18 years	Levelized cost: \$ / MWh Portfolio benefit: \$19,635 M Levelized PB/REC: \$ Net Cost PV: \$2,412 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Minimal risk regarding underlying projects</li> <li>Interconnection at distribution voltage dictates that each as-generated MWh produces two Washington State RECs</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facilities</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED VERSION

REDACTED VERSION





Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18165</b> [REDACTED] REC purchase Underlying solar project [REDACTED] year Start of term: 1/1/2022** or 2024 Term: 16 or 18** years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$13.181 M Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$1.755 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Minimal risk regarding underlying project</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facility</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18166</b> [REDACTED] Development asset sale, BTS or PPA** Development wind IMW COD: 12/1/2020, 2021*, or 2022 Term: 25 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$114.836 M Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$121.737 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Long-term site control established</li> </ul>	<ul style="list-style-type: none"> <li>Significant concerns regarding the counterparty's ability to develop, finance, and construct the facility</li> <li>Relatively small counterparty with inconclusive rights to the project's developmental assets</li> <li>Timing of project is contingent on Bonneville Power Administration (BPA) infrastructure upgrades to enable transmission capacity</li> <li>Project owner, [REDACTED] interested in furthering project development via first-hand experience at [REDACTED] pub [REDACTED]</li> <li>Timeline as-proposed is likely infeasible and pricing is likely contingent on timing due to production tax credit (PTC) safe harbor</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18175</b> [REDACTED] PPA, BTS**, or WSPSP shaped Development wind IMW COD: 1/1/2021 Term: 25 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$176.514 M Levelized PB/REC: \$ [REDACTED] Peak capacity PB / kW-Yr: \$ [REDACTED] Net Cost PV: \$177.135 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Western Systems Power Pool (WSPP) schedule C delivery is a unique value</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty and financing details will require data requests</li> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Mid-C delivery will likely be necessary, which would negate a contribution to PSE's peak capacity</li> <li>Permitting plan seems either underdeveloped or underrepresented in the proposal</li> <li>Outreach plan is underdeveloped</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18176</b> PPA** Development wind IMW** of [REDACTED] COD: 12/31/2022 Term: 20	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$135,600 M Levelized PB/REC: \$ [REDACTED] Peak capacity PB / kW-Yr: \$ [REDACTED] Net Cost PV: \$2,425,24 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Indications of strong local, state and environmental support</li> <li>Potential to partner with a local Native American tribe</li> <li>Located near [REDACTED] and [REDACTED] Time County</li> <li>Counterparty has indicated a plan to partner and/or otherwise engage an experienced renewable energy developer on the project</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty does not have experience designing, financing, building, owning or operating a large scale renewable or other energy project</li> <li>Assumed use of [REDACTED] may be problematic for full proposed output</li> <li>Additional detail needed regarding the real estate and permitting considerations necessary for the site</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18179</b> PPA** or DBS Development wind IMW** COD: 12/31/2021 Term: 20 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$70,371 M Levelized PB/REC: \$ [REDACTED]** Net Cost PV: \$28,121 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate appears adequate and relatively low risk</li> <li>Project size has been altered to address some local viewshed concerns</li> </ul>	<ul style="list-style-type: none"> <li>History of considerable local and county-level opposition to the project</li> <li>Counterparty bypassed the County permitting process by pursuing permit approval through the state's Washington Energy Facility Site Evaluation Council (EFSEC) process</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18190</b> REC purchase 5 underlying proposed solar facilities REC COD: 01/01/2022 Term: 12, 15, or 20** years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$46,975 M Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$5,948 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Site control is secured</li> <li>Washington Energy Facility Site Evaluation Council (EFSEC) projects have been approved by Governor Inslee</li> </ul>	<ul style="list-style-type: none"> <li>Realizing full REC output of underlying projects is unlikely due to interconnection issues</li> <li>[REDACTED] is in litigation with PSE over interconnection issues with the underlying projects</li> <li>[REDACTED] Court [REDACTED] uses the EFSEC decision and has applied for judicial review</li> <li>Major feasibility concerns with some and schedule concerns for all of the underlying projects</li> <li>Projects sited on commercial agricultural land and many stakeholders in the county oppose development of these lands</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<p><b>18201</b></p> <p>Direct load control Bring your own thermostat, smart water heater COD: 1/1/2023 Term: 6 years</p>	<p>Not applicable, please see selection recommendation &amp; rational section to the right</p>	<ul style="list-style-type: none"> <li>Described as an industry leader by a recent study</li> <li>Manage program implementation</li> <li>Excellent financial strength, Washington based</li> <li>The 1 MW opti makes it a small scale project well suited for conceptual testing</li> </ul>	<ul style="list-style-type: none"> <li>Proposal schedule includes significant ramp up of customer participation in first program year (2023); unclear if this is feasible</li> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> </ul>	<p><b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.</p>
<p><b>18205</b></p> <p>Commercial &amp; industrial curtailment IMW COD: 1/1/2021 Term: 5 years</p>	<p>Not applicable, please see selection recommendation &amp; rational section to the right</p>	<ul style="list-style-type: none"> <li>Winter peak experience</li> <li>Commercial and Industrial segment provides a diversification benefit</li> </ul>	<ul style="list-style-type: none"> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> <li>Counterparty has only been established since 2016, and has not been financially profitable.</li> </ul>	<p><b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.</p>
<p><b>UP002</b></p> <p>REC purchase REC COD: 1/1/2020 Term: 15 years</p>	<p>Levelized cost: / MWh Portfolio benefit: \$4,502 M Levelized PB/REC: \$ Net Cost PV: \$1,153 M Peak capacity contribution (MW): Annual REC contribution: )</p>	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Price is higher and volume is smaller than other REC offers received in response this RFP.</li> </ul>	<p><b>Not Selected</b> – Project not selected during portfolio optimization process.</p>

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.

\*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.

\*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION

REDACTED  
VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
July 23, 2019

Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>XXXXX</b> <b>Colstrip Transmission System Redirection</b> Puget Sound Energy N/A Transmission redirect 11MW***, 11 MW COD: 01/01/2022 Term: 56-year book life	Levelized cost: █ Portfolio benefit: \$57.274 M Peak Capacity PB / kW-Yr: █ Net Cost PV: \$27,905 M Peak capacity contribution (MW): █ Annual REC contribution: █	<ul style="list-style-type: none"> <li>If feasible, redirect to Mid-C would provide a strong capacity resource</li> </ul>	<ul style="list-style-type: none"> <li>Increased exposure to market prices (for redirect to Mid-C)</li> <li>Redirects require Available Transmission Capacity (ATC) between the new points of receipt and delivery. With no ATC between Mid-C and BPAT, PSEI, a redirect to Mid-C is unfeasible.</li> <li>Redirecting elsewhere on BPA's system would require appropriate ATC, as well as an energy source at the redirect point, which may nullify contribution to peak capacity.</li> </ul>	<b>Not Selected</b> – Proposal withdrawn from consideration due to lack of Available Transmission Capacity (ATC).

REDACTED VERSION

REDACTED VERSION

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

# Appendix C

---

## 2018 All Resources RFP Phase 2 quantitative analysis scenarios and stand-alone proposal ranking results







# Appendix D

---

## 2018 All Resources RFP Phase 2 qualitative assessment dashboard



July 23, 2019 EMC Decisional: 2018 All Resources RFP |



# At-a-glance qualitative assessment of Phase 2 proposals (as of July 23, 2019)

Project Counterparty (Project ID)	REC contribution (RECs/yr)	MW Capacity contribution	Term start / length	Operating/Development status	Delivery point	Counterparty/Proposal risk	Site control	Permitting risk	Energy delivery risk	Operational/Reputational risk	Other considerations*
1 SPI Biomass PPA Sierra Pacific Ind. (181100)	16	16	1/2021 17 yrs	Operating	BPAT, PSEI	●	●	●	●	●	Offers renewable resource diversity to portfolio
2			12/2021 25 yrs	Early Develop		●	●	●	●	●	MT proposals are mutually exclusive
3			10/2022 0 yrs	Early Develop		●	●	●	●	●	MT proposals are mutually exclusive
4			1/2022 18 yrs	Mature Develop	n/a	●	●	●	●	●	Screening model selects RECs for arbitrage benefit, not to meet RPS
5			1/2022 18 yrs	Mature Develop	n/a	●	●	●	●	●	Screening model selects RECs for arbitrage benefit, not to meet RPS
6			1/2020 15 yrs	Operating	n/a	●	●	●	●	●	Screening model selects RECs for arbitrage benefit, not to meet RPS
7			12/2022 20 yrs	Early Develop	Mid-C*	●	●	●	●	●	Mid-C delivery due to lack of transmission ATC
8			12/2022 20 yrs	Early Develop	Mid-C	●	●	●	●	●	
9			12/2022 20 yrs	Early Develop		●	●	●	●	●	Proposes independently operated solar co-located
10			12/2022 20 yrs	Early Develop	Sub	●	●	●	●	●	
11 BPA Peak Cap Sys PPA BPA (18161)	0	54	1/2022 5 yrs	Operating	BPAT, PSEI	●	●	●	●	●	Operational project subject to repower
12			12/2022 20 yrs	Mature Develop*	Mid-C	●	●	●	●	●	
13			12/2021 20 yrs	Mature Develop	Mid-C	●	●	●	●	●	Mid-C delivery due to lack of transmission ATC
14 Golden Hills Wind (shaped / unshaped) Avangrid (18170)		79	12/2021 25 yrs	Mature Develop	BPAT, PSEI	●	●	●	●	●	

\*Table summarizes certain key qualitative findings of Phase 2 resources. See RFP Executive Summary (Appendix B) and proposal memos for detailed findings.

REDACTED VERSION

REDACTED VERSION

# At-a-glance qualitative assessment of Phase 2 proposals (as of July 23, 2019)

Project Counterparty (Project ID)	REC contribution (RECs/yr)	MW Capacity contribution	Term start / length	Operating/Development status	Delivery point	Counterparty/Proposal risk	Site control	Permitting risk	Energy delivery risk	Operational/Reputational risk	Other considerations*
[REDACTED]	[REDACTED]	[REDACTED]	1/2022 20 yrs	Early Develop	[REDACTED]	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	6/2022 10 yrs	Operating	BPAT.PSEI (or Busbar)	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	10/2022 0 yrs	Early Develop	n/a	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	12/2022 10 yrs	Early Develop	Busbar	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	Mid-C	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	1/2022 20 yrs	Early Develop	Busbar	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	Mid-C	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	12/2021 25 yrs	Early Develop	[REDACTED] Sub	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	12/2022 25 yrs	Early Develop	BPAT.PSEI (or Busbar)	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	1/2019 20 yrs	Operating	[REDACTED] Sub	●	●	●	●	●	MT proposals are mutually exclusive
[REDACTED]	[REDACTED]	[REDACTED]	12/2022 20 yrs	Early Develop	[REDACTED]	●	●	●	●	●	
[REDACTED]	[REDACTED]	[REDACTED]	2023 6 yrs	n/a	n/a	●	●	●	●	●	Not cost effective compared to alternatives without identifiable deferred T&D values; concern about ability to integrate with in-development DERMS. **
[REDACTED]	[REDACTED]	[REDACTED]	2019 5 yrs	n/a	n/a	●	●	●	●	●	Not cost effective compared to alternatives without identifiable deferred T&D values; concern about ability to integrate with in-development DERMS. **

\*Table summarizes certain key qualitative findings of Phase 2 resources. See RFP Executive Summary (Appendix B) and proposal memos for detailed findings.

\*\* Distributed energy resource management system (DERMS)

REDACTED VERSION

# Appendix E

---

## 2018 All Resources RFP Phase 2 detailed optimization results



July 23, 2019 EMC Decisional: 2018 All Resources RFP |



# 2018 All Resources RFP Status Update



***EMC Informational***

November 21, 2019

***Weimin Dang***  
*Business Initiatives*

**CONFIDENTIAL**

# Informational

---

**Intended recommendation:** At next month's EMC meeting, ask for approval to execute contracts for the following projects:


- SPI Biomass (counterparty: Sierra Pacific Industries) 17 MW, 17-year PPA
- BPA peak capacity product (counterparty: BPA) 100 MW, 5-year call option
- Morgan Stanley System PPA (counterparty: Morgan Stanley): 100 MW, 5-year PPA (unsolicited proposal received on October 23, 2019)



# Changes since October EMC


---

REDACTED  
VERSION

1. Updated peak capacity need from draft 2019 IRP
2. New unsolicited proposal from Morgan Stanley
3. Updated portfolio optimization results
4. Negotiation status update for all shortlisted RFP projects:
  - SPI
  - BPA
  - Golden Hills
  - 



Draft 2019 IRP projected peak capacity need after  
current shortlisted RFP resources



PSE

4

November 21, 2019 EMC Informational: 2018 All Resources RFP

REDACTED  
VERSION



# Unsolicited proposal: Morgan Stanley System PPA

*Proposed terms are indicative, subject to change*

- Product:**
- 100 MW of firm heavy load hour (HLH) energy (16/6)
  - Zero emission, no RECs
  - Fixed or indexed pricing
- Term:**
- 5 years starting 1/1/2022
  - With or without Q2
- Point of Delivery:**
- BPAT.PSEI or other PSE designated point
- LCOE: 5-year, no Q2, 100 MW**
- Fixed: \$ MWh
  - Indexed + Hedging: \$ MWh
  - 81 MW peak capacity contribution

### Pricing structure alternatives

Term	Volume	Details	Start	End	Fixed Price	MIDC + Adder	Hedge + Adder
3 Year	100 MW	HLH Delivery	Jan-22	Dec-24	\$		
3 Year	100 MW	HLH Delivery	Jan-22	Dec-24	\$		
5 Year	100 MW	HLH Delivery	Jan-22	Dec-26	\$		
5 Year	100 MW	HLH Delivery	Jan-22	Dec-26	\$		
3 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-24	\$		
3 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-24	\$		
5 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-26	\$		
5 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-26	\$		

\*Main pricing difference between hedging cost and offered fixed price is due to different pricing dates.



## Adding 100 MW Morgan Stanley System PPA will help mitigate [REDACTED] COD risk and Colstrip risk

Recommendation:  
5 years 100 MW HLH delivery  
no Q2 with fixed price


Benefits:

- Existing counterparty with good reputation
- Zero emission energy from a large renewable pool
- Relatively low capacity pricing

- Fixed pricing reduces exposure to market price volatility ([REDACTED] MWh/year)

Risk & Consideration:

- No renewable attributes (RECs)



REDACTED  
VERSION

REDACTED  
VERSION



REDACTED  
VERSION

REDACTED  
VERSION

# Updated portfolio optimization

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)
Project List	ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Recommended Portfolio
1	18100	Biomass	SPI	17 MW	16 MW		X
2	18161	Call Option	BPA Peak Capacity Product	100 MW	53 MW		X
3	18169	MT Wind		MW			X
4	18169	MT Wind		MW			X
5	18170	Wind	Golden Hills Shaped	200 MW	77 MW		X
6	xxxxx	System PPA	Morgan Stanley Sys PPA	100 MW	81 MW		X
7		Total Peak Capacity Credits - MWs					MW
8		Total Annual RECs					2,189,656
9		Portfolio Benefits - \$M					\$679
10		Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>2,3</sup>					\$1,179

Peak Capacity and REC Need 2022-2025		2022	2023	2024	2025
Peak Capacity Need		MW	MW	MW	MW
Peak Need / (Surplus) after Resources		MW	MW	MW	MW
REC Need		0	233,449	691,864	700,482
REC Need / (Surplus) after Resources		-2,189,656	-1,956,207	-1,497,791	-1,489,174

- The annual project RECs in column G do not include 0.2X apprenticeship multiplier.
- The social cost of carbon at \$62/metric ton in 2007 dollars plus escalation is added to the total portfolio costs as a fixed cost. Source: UTC docket U-190730, Sept 12, 2019.
- Emission rate of 0.437 metric tons of CO2/MWh for market purchases is included in social cost of carbon calculation.

**CONFIDENTIAL** November 21, 2019 EMC Informational: 2018 All Resources RFP Status Update | 7

# Negotiation status update for all shortlisted RFP projects

---

1. SPI biomass: near agreement on final terms and price. Intend to ask for approval to execute the contract in next month's EMC.
2. BPA peak capacity product: near agreement on final terms. Intend to ask for approval to execute the contract in next month's EMC.
3. Golden Hills Oregon wind: negotiating with counterparty.
4. [REDACTED] Montana wind: negotiating with counterparty.

REDACTED  
VERSION



# Informational

---

**Intended recommendation:** At next month's EMC meeting, ask for approval to execute contracts for the following projects:

- SPI Biomass (counterparty: Sierra Pacific Industries) 17 MW, 17-year PPA
- BPA peak capacity product (counterparty: BPA) 100 MW, 5-year call option
- Morgan Stanley System PPA (counterparty: Morgan Stanley): 100 MW, 5-year PPA (unsolicited proposal received on October 23, 2019)



# APPENDIX A

Draft terms for projects we intend to recommend  
for approval in next month's EMC



# Selected proposal: SPI Biomass PPA

## Seller:

- Sierra Pacific Industries (SPI)

## Product:

- Delivery of 17 MW of firm capacity (24/7)
- Delivery of up to 20 MW worth of energy (3 MW is variable)
- Minimum availability: █ % Nov-Feb, █ % Annual (92% historic)
- Contribution to Peak Capacity: 16 MW



\* The SPI Burlington lumber mill began operating in 2001. The biomass cogeneration facility was added in 2007. Facility is subject to an existing contract with a broker to sell the output through 2020.

\*\* Levelized cost of energy is \$ █ .

## Term:

- Start: Jan. 1, 2021\*
- 17 years

## Point of Delivery:

- SPI.CABO.GEN at Fredonia Substation  
(also point of interconnection)


**Pricing: Currently negotiating price. Intend to return to the EMC in December with final price.**

Calendar Year	Contract Year	Energy Price (\$/MWh)	Expected Energy Output (MWh/year)
2021	1		
2022	2		
2023	3		
2024	4		
2025	5		
2026	6		
2027	7		
2028	8		
2029	9		
2030	10		
2031	11		
2032	12		
2033	13		
2034	14		
2035	15		
2036	16		
2037	17		



# Selected RFP proposal: BPA Capacity Tolling Agreement (CTA)

*Proposed terms are subject to change*

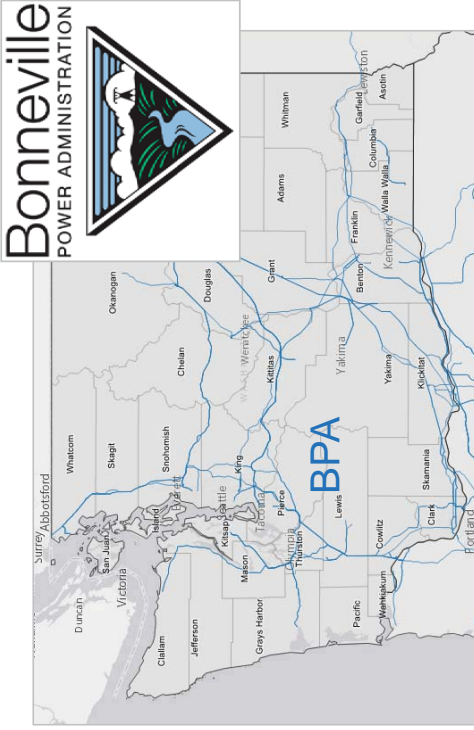

- Seller:**
- Bonneville Power Administration (BPA)
- Product:**
- Capacity: 100 MW
  - Firm Capacity that may be scheduled in increments from [REDACTED] MW on a [REDACTED] basis for up to [REDACTED]
  - Western Systems Power Pool (WSPP) Schedule C, heavy load hour (HLH), low carbon firm energy

- Term:**
- Start: 01/01/2022
  - Term: 5 years
- Point of Delivery:**
- BPAT.PSEI
  - PSE Covington 230 kV Substation

**Price\*:**

Calendar Year	Contract Year	Energy Price (\$/MWh)	Possible Energy Output (MWh/Year)	Capacity Price (\$/kW-mo)	Capacity (MW)
2022	1	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2023	2	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2024	3	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2025	4	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2026	5	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]

- Mid-C price will be based on Powertex hourly price for each MWh delivered.
- Capacity Price [REDACTED] that will be indexed to BPA PTP and Ancillary Service Schedules 1 & 2. Rate will be updated on the first day of each new rate period.



November 21, 2019 EMC Informational: 2018 All Resources RFP | 12

REDACTED VERSION



# APPENDIX B

## Detailed optimization summary



# Portfolio Optimization Summary: as of 11.21.2019

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	
List ID	Project ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Recommended Portfolio: Renewables	Backup Portfolio: Renewables	Contingency Portfolio: No MT Wind	Optimized Least Cost Portfolio with NO Carbon Costs Consideration	Optimized Least Cost Portfolio with Carbon Costs Consideration	
1	18100	Biomass	SPI	17 MW	18 MW		X	X			X	
2	18161	Call Option	BPA Peak Capacity Product	100 MW	53 MW		X				X	
3a.	18169	MT Wind					X				X	
3b.	18169	MT Wind								X		
4a.	18173	MT Wind					X					
4b.	18173	MT Wind										
5a.	18170	Wind	Golden Hills Shaped	200 MW	77 MW		X				X	
5b.	18170	Wind										
6	xxxx	System PPA	Morgan Stanley Sys PPA	100 MW	81 MW		X	X			X	
7	18132	Wind						X				
8	18179	Wind										
9	18106	Wind										
10	18175	Wind										
11	18125	Solar										
12	18111	Solar										
13	18127	Solar										
14	18135	Solar										
15	18139	Solar										
16	18131	Solar							X		X	
17	18114	Solar										
18	18122	Solar										
19	18163	REC-only										
20	18165	REC-only										
21	UP-002	REC-only										
22	18103	Thermal							X		X	
23	XXXXX	Thermal	Generic Peaker	237 MW	224 MW							
24	XXXXX	Generic	Generic Peaker	175 MW	66 MW							
25	XXXXX	Generic	Generic Battery	224 MW	66 MW							
26	<b>Total Peak Capacity Credits - MWs</b>							2,189,656	1,773,109	1,297,005	1,419,658	2,406,449
27	<b>Portfolio Benefits - \$M</b>							\$679	\$619	\$739	\$926	\$658
28	<b>Portfolio Benefits w/ Carbon Costs as an Adder - \$M<sup>2</sup></b>							\$1,179	\$945	\$827	\$1,046	\$1,206

Peak Capacity and REC Need 2022-2025	2022	2023	2024	2025
Peak Capacity Need	299 MW	292 MW	358 MW	477 MW
REC Need	0	233,449	691,864	700,482

1. The annual project RECs in column G do not include 0.2X apprenticeship multiplier.  
 2. The social cost of carbon at \$62/metric ton in 2007 dollars plus escalation is added to the total portfolio costs as a fixed cost. Source: UTC docket U-190730, Sept 12, 2019.  
 3. Emission rate of 0.437 metric tons of CO2/MWh for market purchases is included in social cost of carbon calculation.



REDACTED VERSION

REDACTED VERSION

*2018 RFP Evaluation Process Document*

## F.2 Presentations to WUTC Staff

# 2018 All Resources and Demand Response RFPs



## *Update to WUTC: Proposals Received and Evaluation Process*

September 12, 2018

# Agenda

---

- RFP schedule and resource need
- Proposals received
- All Resources RFP evaluation process
- Demand Response RFP evaluation process
- Next steps



1

# RFP schedule and resource need

Presenter: Cindy Song


# 2018 RFP schedule

Date	Milestone
✓ March 29, 2018	Draft RFP filed with WUTC
✓ June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓ July 3, 2018	PSE released final RFPs
✓ August 17, 2018	Offers were due to PSE
Feb/Mar 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
Q2 2019	Complete Phase 2 evaluation, select final short list



# PSE seeks 272 MW of capacity by end of 2022

- Target online date by 2022\*
- Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably
- Market PPAs must be delivered to BPAT.PSEI\*\*

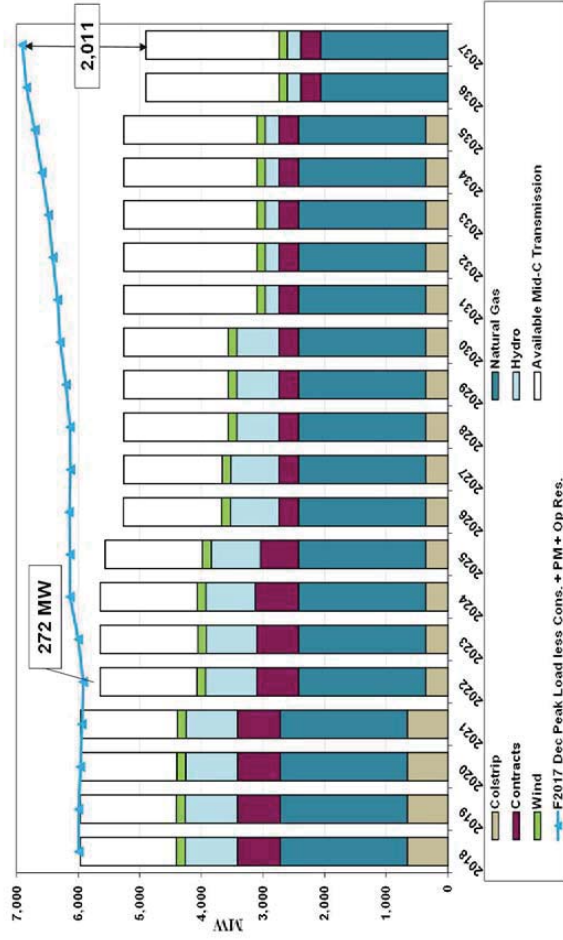


Target online date is based on earliest need, but will not disqualify long-lead resources.

\*\*Market / Non-unit contingent PPAs delivered to Mid-C or anywhere outside PSE's system are not eligible for this RFP.



# Projected need to meet the RPS is 671,000 RECs 2023

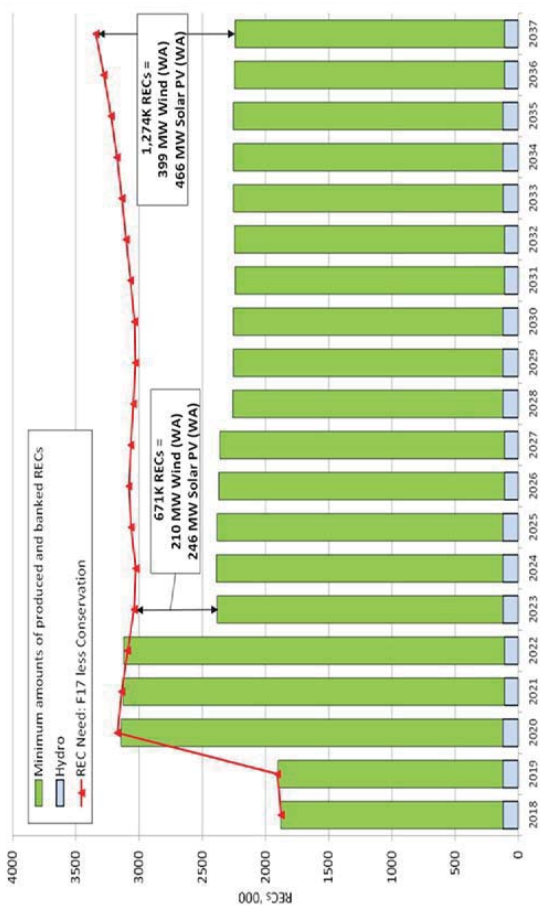

- REC need is driven by the increase in the RPS from 9% to 15% in 2020
- PSE’s inventory of banked RECs delays need until 2023
- PSE will consider early delivery dates to take advantage of tax incentives prior to phase out
  - PSE will evaluate the tradeoff between capturing the benefit of a higher tax incentive and the carrying cost of acquiring early production
- A renewable resource may count toward peak capacity need based on coincident winter peak production
  - PSE will engage reputable consultant for resource due diligence and to develop synthetic distributions for peak capacity calculation
- Proposals which demonstrate that they qualify for Washington state apprenticeship labor credit will add 1.2x multiplier to REC output



\* If proposing a qualifying renewable resource located outside the Pacific Northwest as defined for the Bonneville Power Administration in Section 3 of the Pacific Northwest Electric Power Planning and Conservation Act (94 Stat. 2698; 16 U.S.C. Sec. 839a), electricity from the facility must be delivered into Washington state on a real-time basis without shaping, storage, or integration services.

2

## Proposals received

Presenter: Sheri Maynard

# Nearly 100 proposals received

## Largest response to an All Source RFP to date

Resource Type	2018 All Resource and Demand Response RFPs		2017 Renewables Only RFP (Green Direct 2.0) <sup>1</sup>		2011 All Source RFP		2010 All Source RFP		2008 All Source RFP		2005 All Source RFP	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW <sup>1</sup>	# Proposals	Max Cap MW
Biomass	2	72			3	61	9	590				
Biomass + BESS	1	15							1	100	6	4950
Coal - Traditional + IGCC					1	500						
Cold Fusion					1	1880						
Demand Response	6	154					1	80			1	34
Distributed Generation											1	5
Geothermal	2	43									1	48
Hydro - Run of River	1	38		4	1	77	2	105	3	165	3	139
Natural Gas-fired Generation <sup>2</sup>	4	1377			10	2624	18	5342	10	2588	17	4307
Solar - PV	16	2240		574	2	24	1	10				
Solar - PV + BESS	20	2848										
Storage - Battery ("BESS")	17	1265			2	251						
Storage - Pumped Hydro	2	900										
System PPA / Call Option	1	100			4	400	10	n/a	9	1675	7	400
Unbundled RECs <sup>3</sup>	4						2	n/a				
Waste-to-Energy / Landfill Gas					1	23					1	5
Wind - Off Shore	1	400										
Wind On Shore	16	3303		2601	4	369	21	3776	8	862	10	1165
Wind + Winter Sys PPA	1	371										
Wind + Solar and/or BESS	2	464		339								
<b>TOTAL</b>	<b>96</b>	<b>13,590</b>	<b>43</b>	<b>3,518</b>	<b>29</b>	<b>6,209</b>	<b>64</b>	<b>9,903</b>	<b>31</b>	<b>5,390</b>	<b>47</b>	<b>11,053</b>

[1] The 2017 RFP sought large and small (<5 MW) renewable resources to serve multiple voluntary green power programs.

[2] Natural gas-fired generation may include CCCTs, SCCTs, reciprocating engines, combined heat and power facilities and gas turbine equipment sales.



## 92% of proposals offered a PPA option, 29% of proposals offered an ownership option


Resource Type	# Proposals	Max Cap MW <sup>1</sup>	Offer Structure(s)	
			Own	PPA/Toll/ Other Agmt Both
Biomass	2	72		2
Biomass + BESS	1	15		1
Geothermal	2	43		2
Hydro - Run of River	1	38		1
Natural Gas CCCT	2	1020		1
Natural Gas SCCT	1	245		1
Natural Gas Recip	1	112	1	
Solar - PV	16	2240	1	14
Solar - PV + BESS	20	2848		18
Storage - Battery ("BESS")	17	1265	1	8
Storage - Pumped Hydro	2	900		2
Peak Capacity Call Option	1	100		1
Unbundled RECs <sup>2</sup>	4	n/a		4
Wind - Off Shore	1	400		1
Wind On Shore	16	3303	3	11
Wind + Winter Sys PPA	1	371		1
Wind + Solar + BESS	2	464	1	1
DR Direct Load Control	4	109		4
DR C&I Curtailment <sup>3</sup>	2	44		2
<b>TOTAL</b>	<b>96</b>	<b>13,589</b>	<b>7</b>	<b>69</b>

- 90% of proposed projects are in development stage
- Many proposals included multiple offer options, such as:
  - Multiple structure options:
    - development rights
    - asset purchase
    - PPA, Toll or other agreement
  - Fixed/escalating PPA pricing
  - Various term lengths and/or start dates
  - Hybrid options to include storage, or to pair solar with wind
  - Transmission delivery points



[1] MW column reflects total combined potential capacity  
 [2] Unbundled RECs: 1 offer is for a 10-year agreement for up to 100,000 RECs; the other three offers are due to arrive this week from the same entity (REC volume TBD)

# 70% of projects proposed are located in Washington



- Battery energy storage system (BESS)
- Biomass
- Biomass + BESS
- Geothermal
- Hydro – run of river
- Natural gas-fired generation
- Pumped hydro storage
- Solar - PV
- Solar + BESS
- Wind
- Wind + Solar + BESS options

# 3


## All Resources RFP evaluation process

Presenters: Ryan Sherlock, Bob Williams

# Evaluation process is cross-functional and thorough




# Evaluation criteria help identify proposals with lowest reasonable cost and risk\*

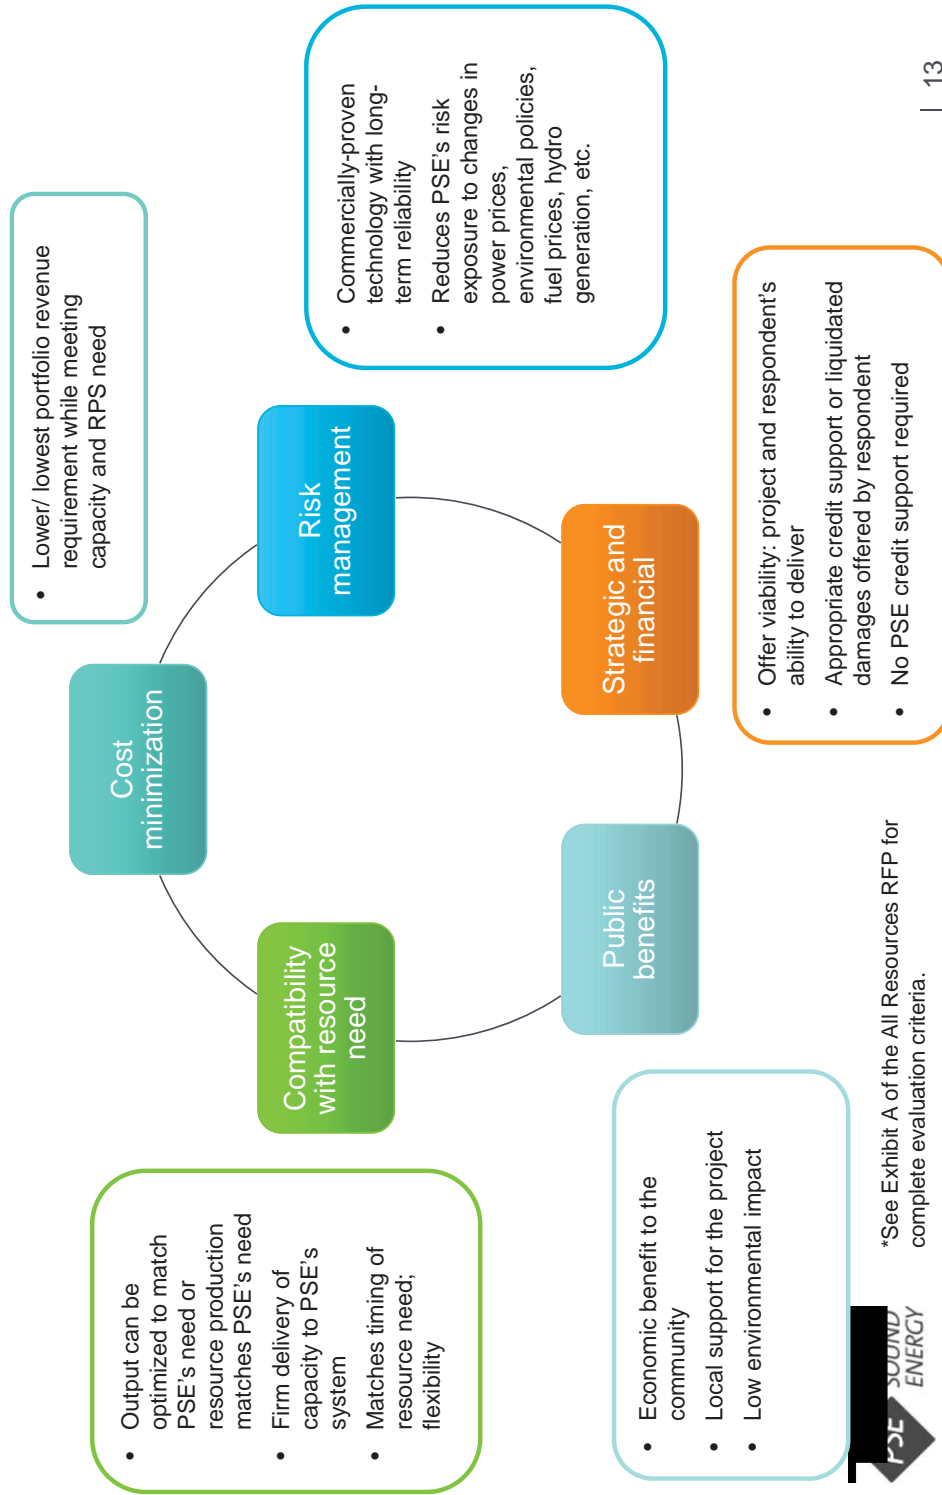





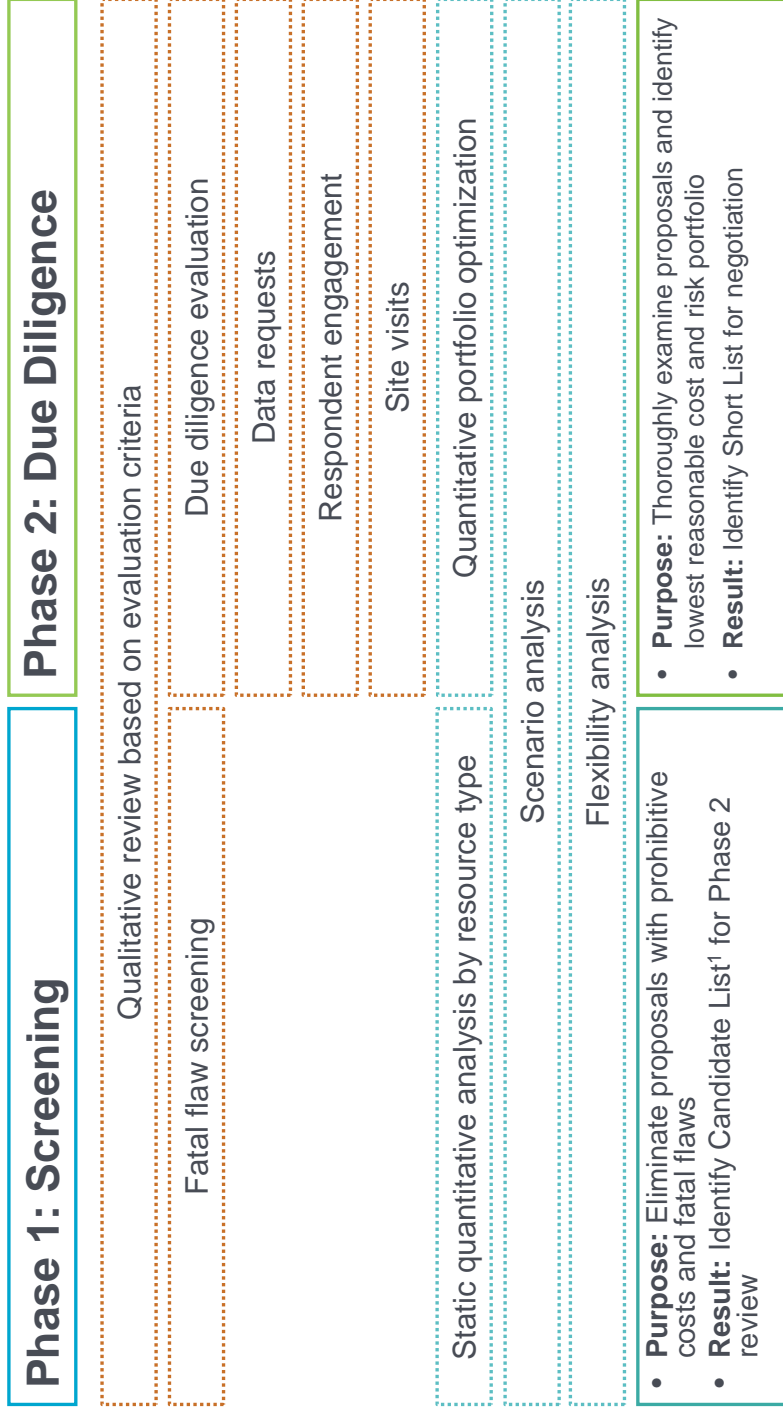





# Phases allow PSE to focus on most favorable proposals for robust analysis



<sup>1</sup> The Candidate List represents the lowest cost resources with no fatal flaws, and a representative sampling of renewable, hybrid, storage, demand response and capacity resources.



# Qualitative evaluation asks key questions designed to identify proposal benefits and risks\*

    <ul style="list-style-type: none"> <li>✓ Are the offer terms acceptable?</li> <li>✓ Is project operating or likely to meet proposed commercial operation date?</li> <li>✓ What is the nameplate capacity of the project? Sized appropriately to help meet need?</li> <li>✓ Where is the project located? Benefits/risks?</li> <li>✓ Does project have site control?</li> <li>✓ What is the permitting status?</li> <li>✓ Status of transmission and interconnection?</li> <li>✓ What is the selected technology? History of reliable operation?</li> <li>✓ What is the useful life of the project?</li> <li>✓ Does the project have community support?</li> <li>✓ What is the status of all relevant agreements? Examples: key component supply contracts (e.g. wind turbines), service and maintenance, EPC contract, BOP, interconnection, transmission, permits, site control, etc.</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Project output?</li> <li>✓ Net capacity factor (NCF)?</li> <li>✓ Degradation?</li> <li>✓ Eligible for tax incentives?</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Capacity (MW) and duration (MWh)?</li> <li>✓ Roundtrip efficiency?</li> <li>✓ Degradation / augmentation?</li> <li>✓ Flexibility and T&amp;D benefits?</li> </ul>
 <ul style="list-style-type: none"> <li>✓ Fuel supply and transportation secured? If not, status?</li> <li>✓ Operational characteristics?</li> <li>✓ Emissions? Permitting risks? If operating, compliance history?</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Project output?</li> <li>✓ Net capacity factor (NCF)?</li> <li>✓ Eligible for tax incentives?</li> </ul>	

\*This list is illustrative only. It does not reflect all eligible resource types or a complete list of criteria considered in the All Resources RFP evaluation. For more detail, see RFP Exhibit A (Evaluation Criteria) and Exhibit B (Proposal Requirements).




# Examples of fatal flaws

---

- Significantly higher cost than alternatives
- Proposal fails to provide sufficient information to substantiate a viable project
- No transmission secured and no available transmission between the project and PSE's system
- Insufficient fuel supply or fuel transportation to generation project
- Commercially unproven technology
- Unable to obtain necessary permits to execute the project
- Excessive counterparty risk likely to cause counterparty to be unable to complete the project or meet contractual obligations to PSE
- Regulatory or legal risks associated with non-compliance or other obligations that could adversely impact PSE




# Projects are evaluated on a cost and risk basis delivered to PSE's load

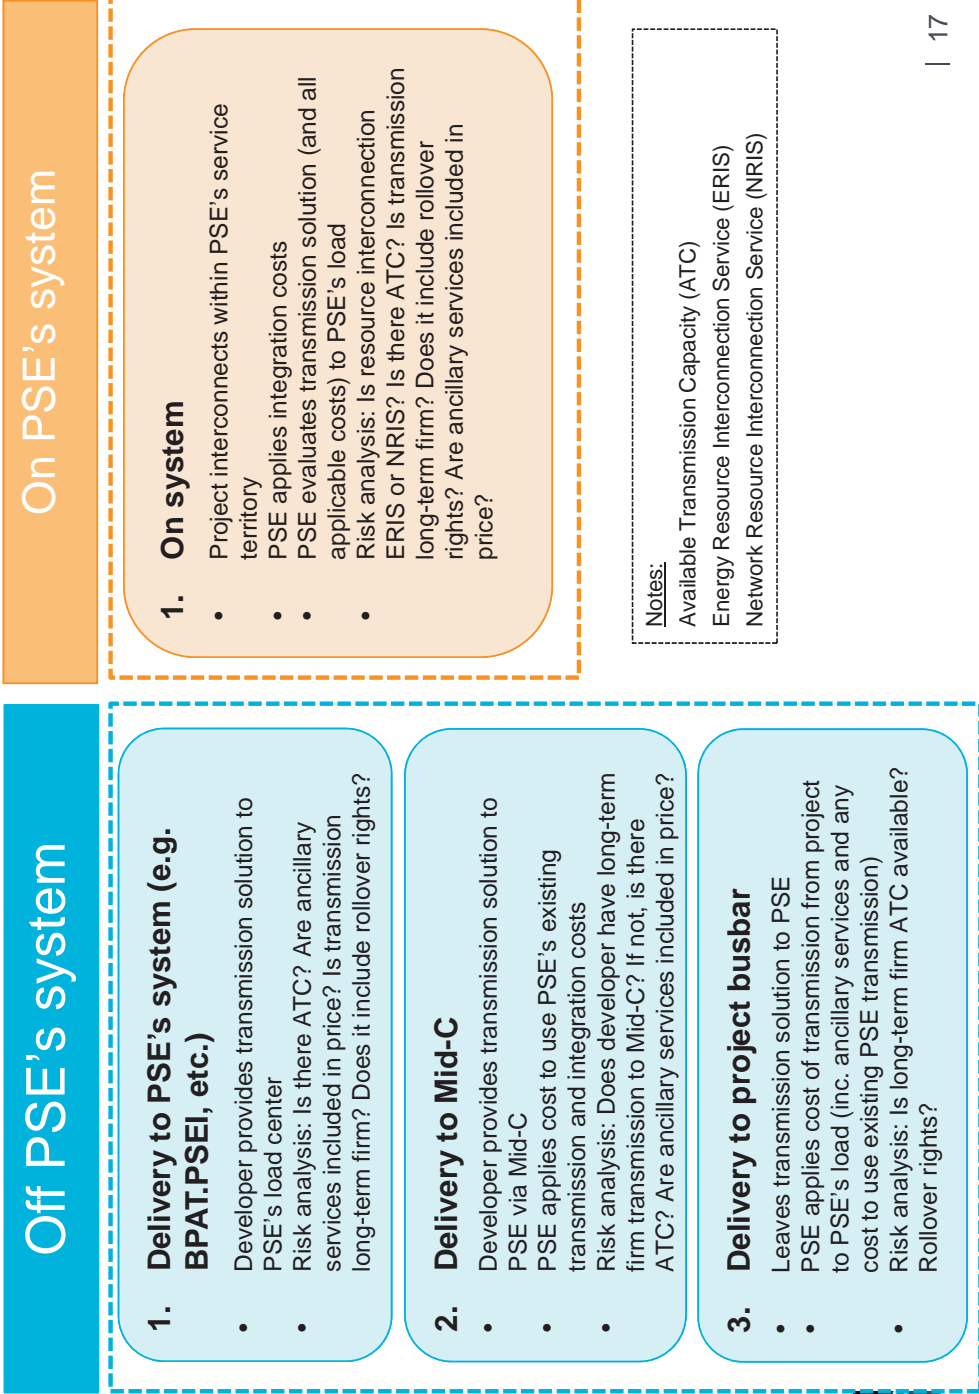

# Resource costs


PSE uses three models to analyze resource costs and characteristics

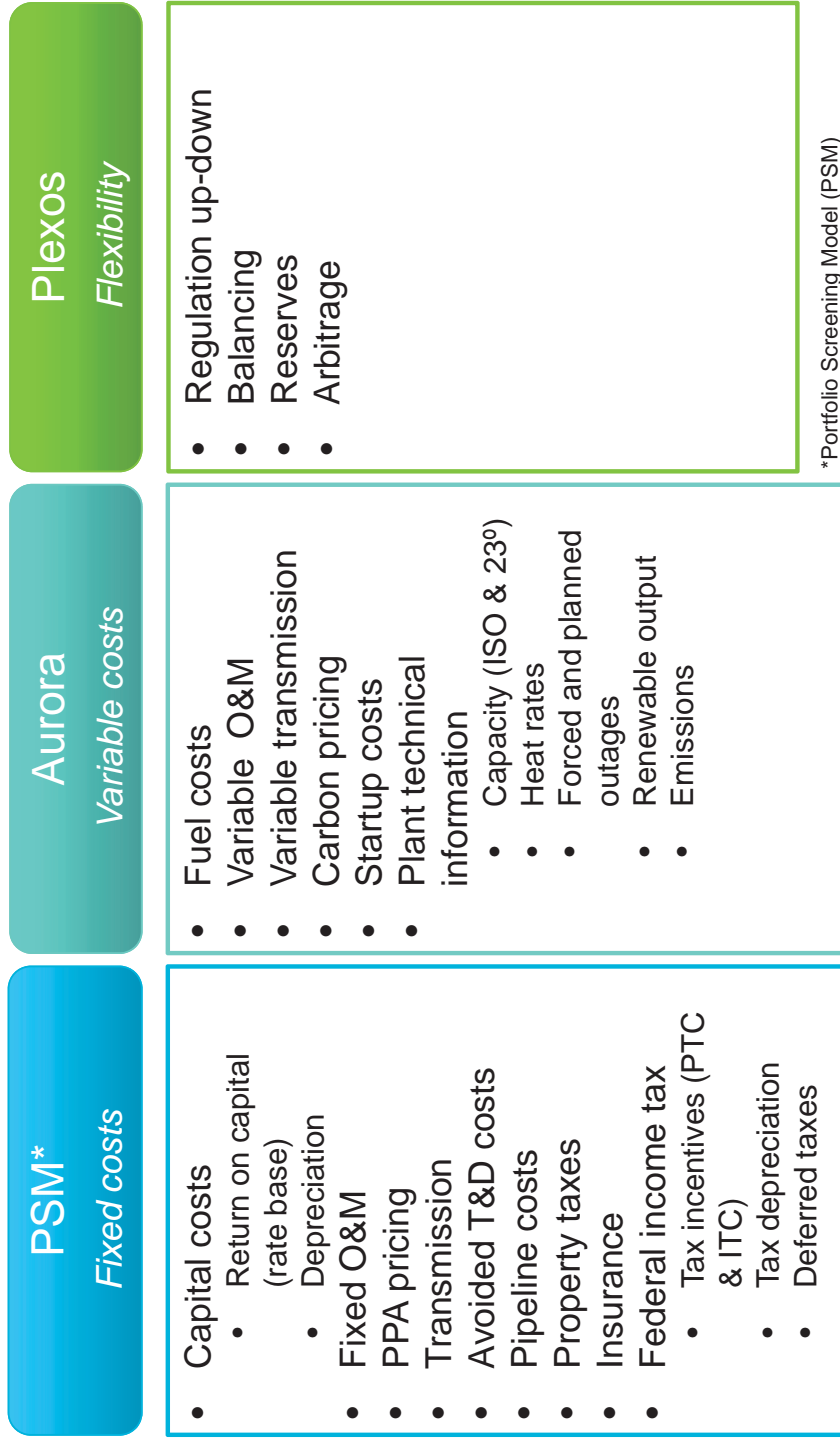


\*Portfolio Screening Model (PSM)



# PSM optimization process

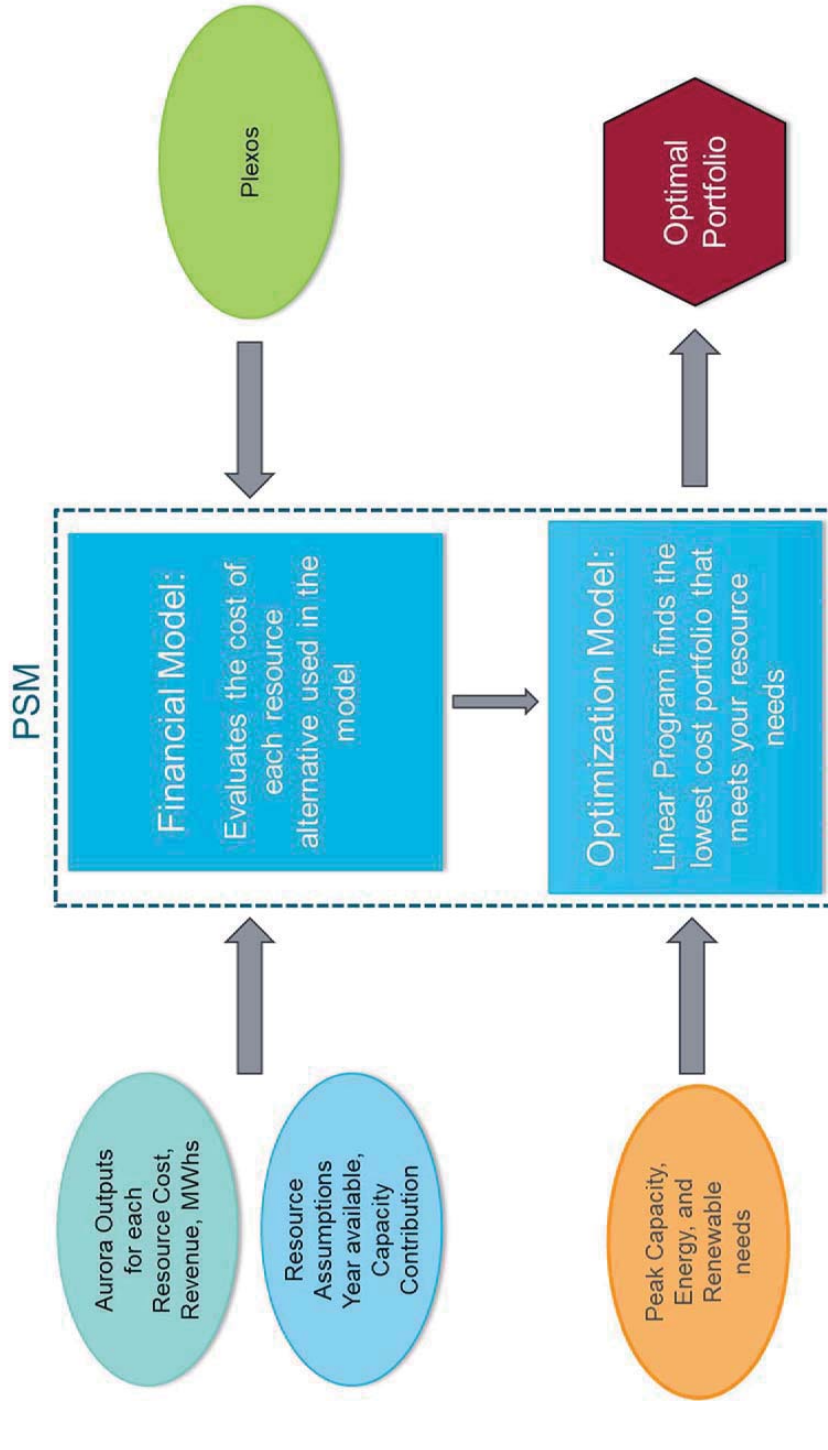

## Quantitative screening metrics allow PSE to compare and rank resources with different characteristics and capacities

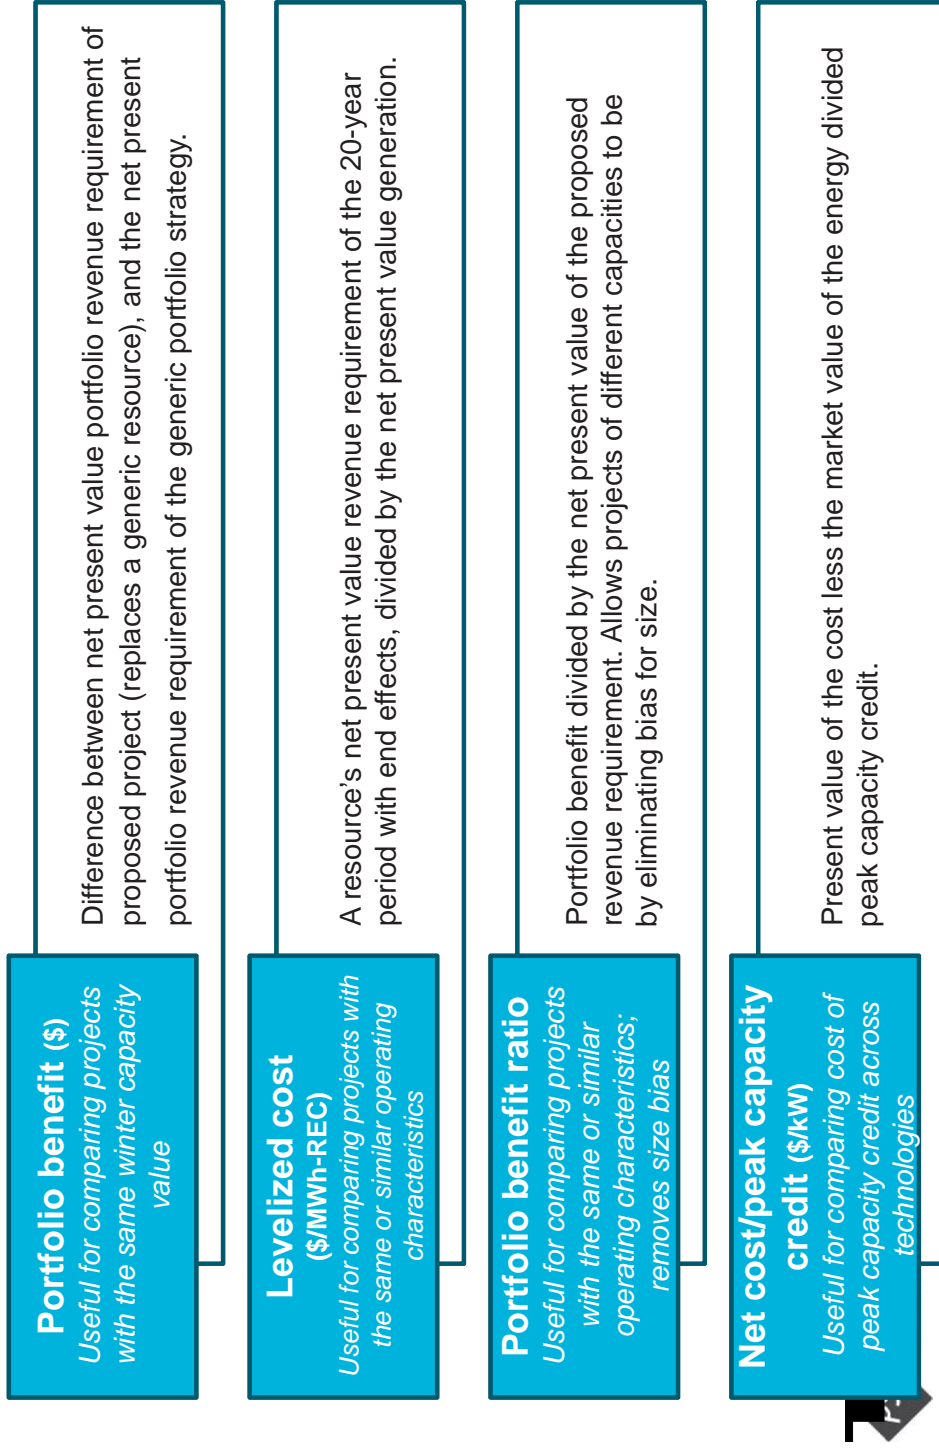

## PSE has updated its RFP modeling assumptions to reflect 2019 IRP assumptions

---

	2018 RFP	2017 IRP
Mid-C power prices Levelized	\$34.28/MWh	\$40.48/MWh
Gas prices Levelized	\$3.86/mmbtu	4.02/mmbtu
Load growth	0.5%	0.7%





# RFP price scenarios (subject to change)

	Phase	WECC /PSE Demand	Gas Price	Generic Resource Costs
No carbon tax	1 + 2	Base	Base	Base
CO2 (Initiative 1631)	1 + 2	Base	Base	Base
CO2 (societal)	1 + 2	Base	Base	Base
CO2 (high societal tax)	2	Base	Base	Base
High growth (high societal)	2	High	High	Base
Low growth (no carbon tax)	2	Low	Low	Base

If Initiative 1631 does not pass, the RFP would use assumptions consistent with the 2019 IRP.



4


# Demand Response RFP evaluation process

Presenter: Wei Dang

# DR proposals at a glance

Type	Term	Max MW
Direct Load Control	2019-23	35.5
Direct Load Control	2023-28	24.0
Direct Load Control	2019-28	21.5
Behavioral Demand Response + Direct Load Control	2019-23	28.1
C&I Curtailment*	2019-23	24
C&I Curtailment*	2019-23	40

\*Commercial & Industrial (C&I)



# DR resource objectives

---

## **Primary Objectives:**


- Ensure DR resource is cost effective and is available:
  - November 1 – February 28/29
  - Weekdays, 7 a.m. – 10 a.m. and 5 p.m. – 9 p.m.
- Provide load response with one of the following options:
  - Hour ahead notification,
  - Day ahead notification, or
  - A combination of hour ahead and day ahead notification
- Total event time  $\leq$  40 hrs per individual product per season

## **Secondary Objectives:**

- Develop flexible DR capability
  - Provide fast response with notification time of  $\leq$ 10 mins

# DR proposals evaluation process

---

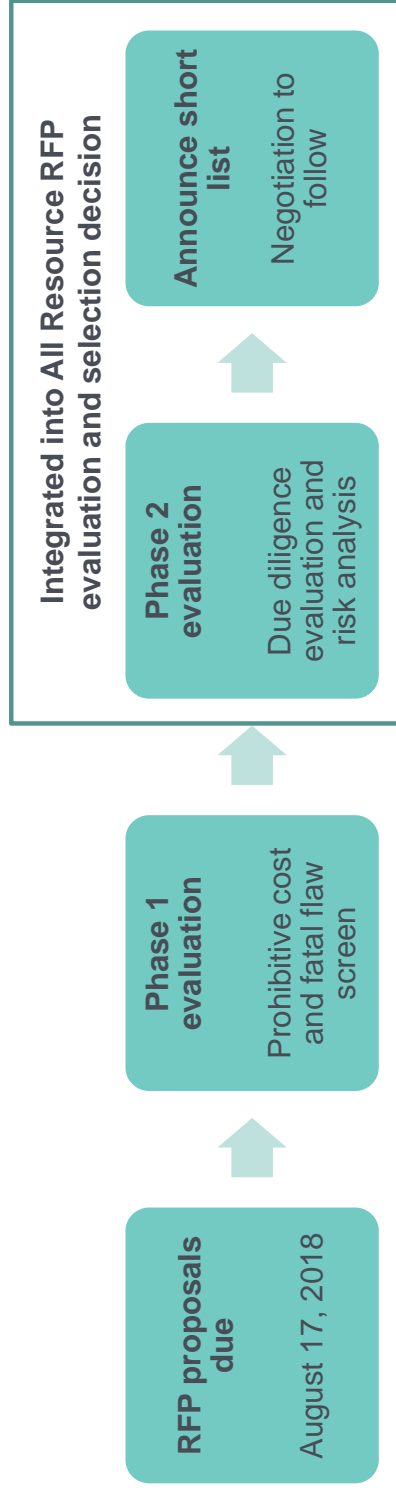

Proposals will be evaluated on a variety of criteria including, but not limited to:

- Demonstrated competence and experience
- Management structure and assigned personnel
- Quality of proposed equipment and services
- Pricing
- Performance guarantees



## Aligned with IRP methodology, using Portfolio Screening Model (PSM)


Costs	Benefits
<ul style="list-style-type: none"> <li>• Technology and Implementation               <ul style="list-style-type: none"> <li>• Customer tech. and installation</li> <li>• PSE Integration</li> </ul> </li> <li>• Program Administration</li> </ul>	<ul style="list-style-type: none"> <li>• Peak Capacity</li> <li>• System-Wide T&amp;D Deferral</li> </ul>

### Other Tests / Considerations:

- Program administrator cost (PAC) / Total resource cost (TRC)
- Effective load carrying capability (ELCC)



# Demand response evaluation team

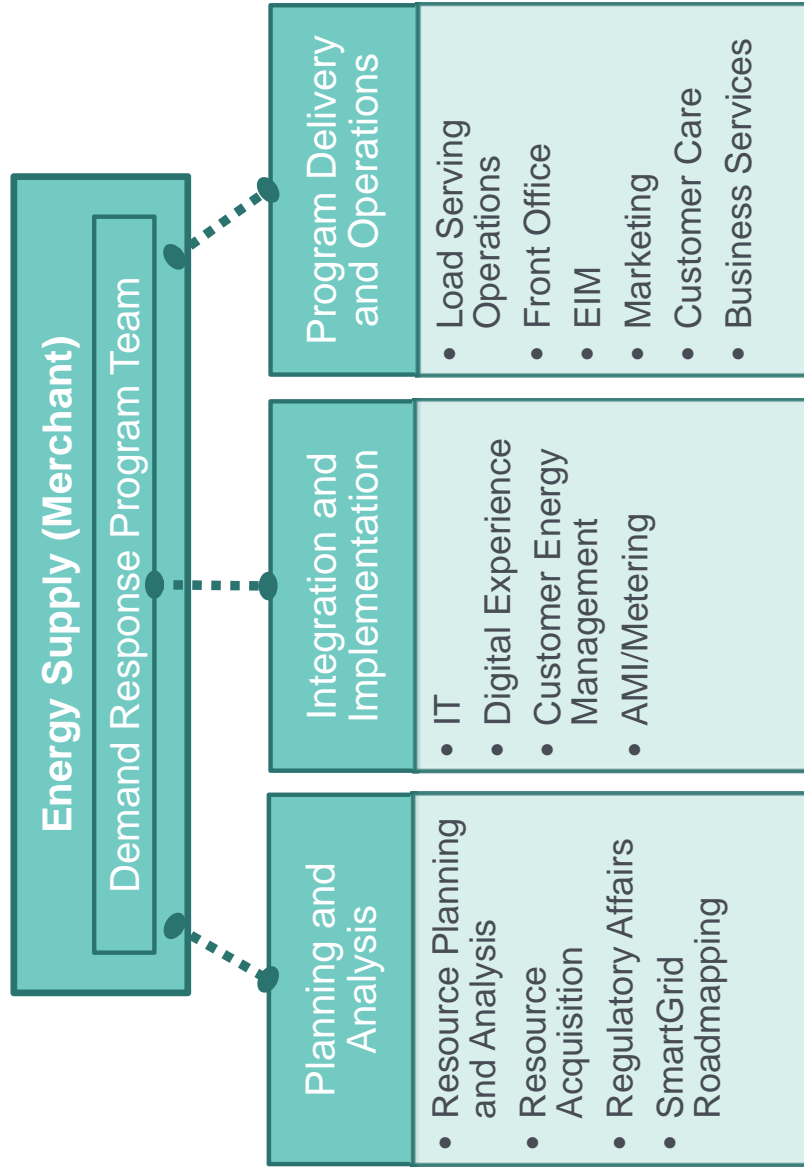

5

## Next steps

Presenter: Sheri Maynard



# What's next?

---

- Next WUTC update: late Q1/early Q2
  - Phase 1 results
  - Candidate short list
  - Phase 2 update/schedule



# 2018 RFP schedule

Date	Milestone
✓ March 29, 2018	Draft RFP filed with WUTC
✓ June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓ July 3, 2018	PSE released final RFPs
✓ August 17, 2018	Offers were due to PSE
Feb/Mar 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
Q2 2019	Complete Phase 2 evaluation, select final short list



# Appendix

# Appendix

---

- Proposals received by status and location
- Montana transmission path
- RFP modeling assumptions:
  - Load forecast
  - Power price forecast
  - Carbon price
- Additional screening metrics
- Comparison of generic resource costs
- Program administrator costs (PAC) and total resource costs (TRC) tests
- Effective load carrying capability (ELCC) table

# 90% of projects proposed are development stage

Resource Type	# Proposals	Max Cap MW <sup>1</sup>	Status		
			Development	Construction	Operating
Biomass	2	72			2
Biomass + BESS	1	15	1		
Geothermal	2	43	1	1	
Hydro - Run of River	1	38			1
Natural Gas CCCT	2	1020			2
Natural Gas SCCT	1	245	1		
Natural Gas Recip	1	112	1		
Solar - PV	16	2240	16		
Solar - PV + BESS	20	2848	20		
Storage - Battery ("BESS")	17	1265	17		
Storage - Pumped Hydro	2	900	2		
Peak Capacity Call Option	1	100			
Unbundled RECs <sup>2</sup>	4	n/a	3		1
Wind - Off Shore	1	400	1		
Wind On Shore	16	3303	14	1	1
Wind + Winter Sys PPA	1	371	1		
Wind + Solar + BESS	2	464	2		
DR Direct Load Control	4	109			
DR C&I Curtailment <sup>3</sup>	2	44			
<b>TOTAL</b>	<b>96</b>	<b>13,589</b>	<b>80</b>	<b>2</b>	<b>7</b>

[1] MW column reflects total combined potential capacity

[2] Unbundled RECs; 1 offer is for a 10-year agreement for up to 100,000 RECs; the other three offers are due to arrive this week from the same entity (REC volume TBD)



# 70% of projects proposed are located in Washington


Resource Type	# Proposals	Max Cap MW <sup>1</sup>	Location			
			WA	OR	MT	NV
Biomass	2	72	2			
Biomass + BESS	1	15				
Geothermal	2	43				1
Hydro - Run of River	1	38				1
Natural Gas CCCT	2	1020	1	1		
Natural Gas SCCT	1	245	1			
Natural Gas Recip	1	112	1			
Solar - PV	16	2240	14	2	1	
Solar - PV + BESS	20	2848	15	4	1	
Storage - Battery ("BESS")	17	1265	17			
Storage - Pumped Hydro	2	900	1		1	
Peak Capacity Call Option	1	100		1		
Unbundled RECs <sup>2</sup>	4	n/a		3		
Wind - Off Shore	1	400	1			
Wind On Shore	16	3303	7	3	6	
Wind + Winter Sys PPA	1	371		1		
Wind + Solar + BESS	2	464	1	1		
DR Direct Load Control	4	109	4			
DR C&I Curtailment <sup>3</sup>	2	44	4			
<b>TOTAL</b>	<b>96</b>	<b>13,589</b>	<b>69</b>	<b>16</b>	<b>9</b>	<b>1</b>

[1] MW column reflects total combined potential capacity

[2] Unbundled RECs: 1 offer is for a 10-year agreement for up to 100,000 RECs; the other three offers are due to arrive this week from the same entity (REC volume TBD)



# Montana transmission path

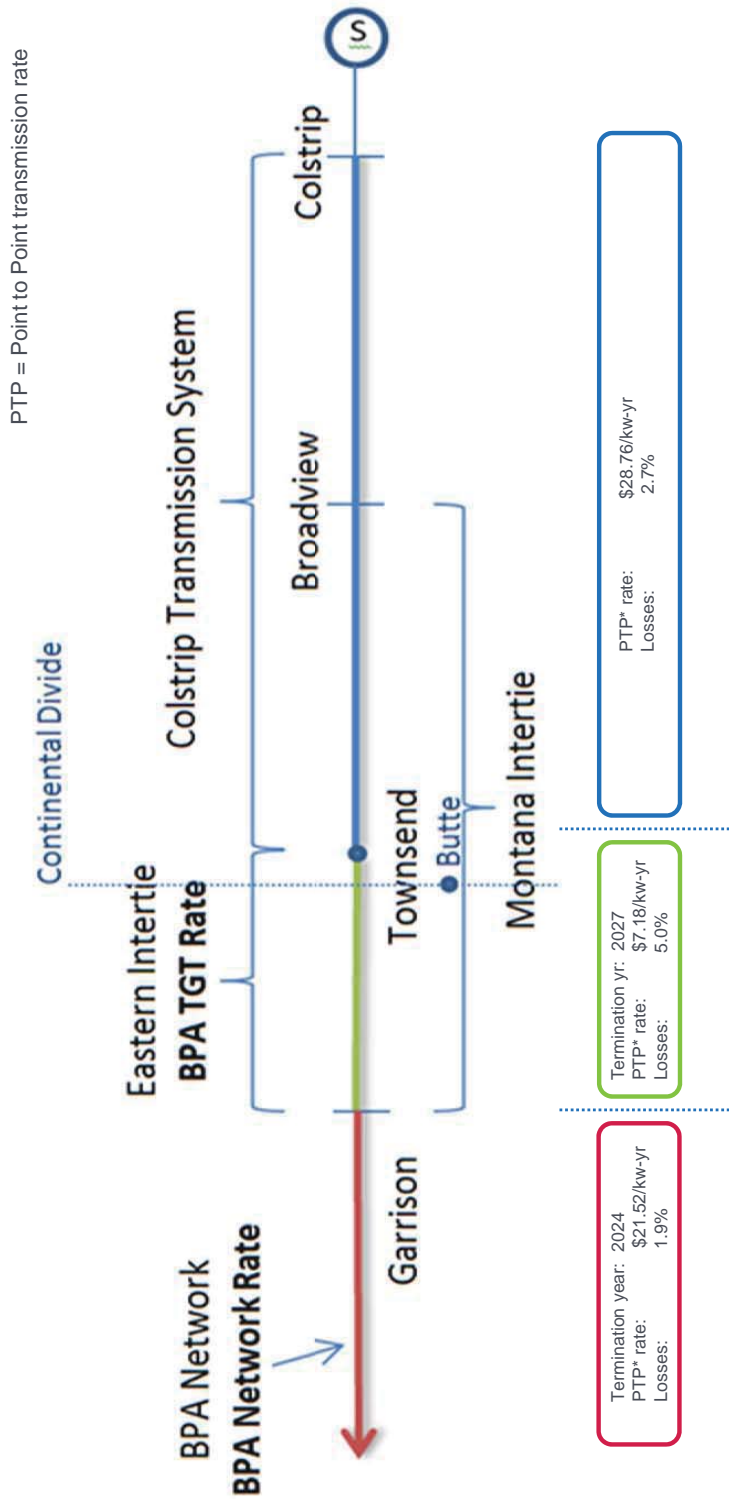


Other costs to consider:

- Additional losses from the project to the delivery point
- Renewable integration costs



# Load forecast comparison

---

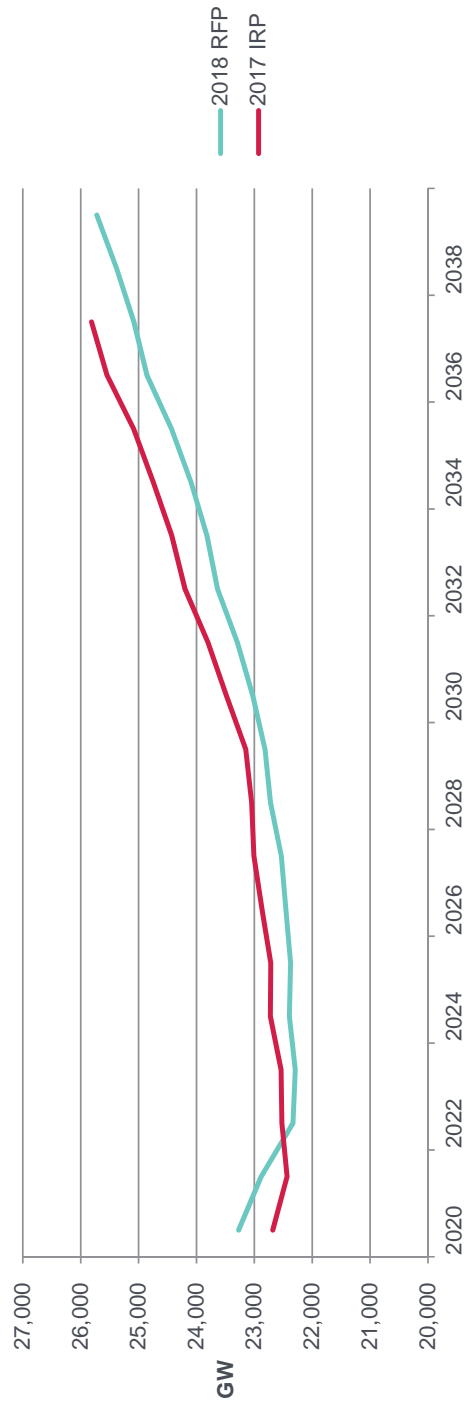




# Power price forecast


---



# Carbon price

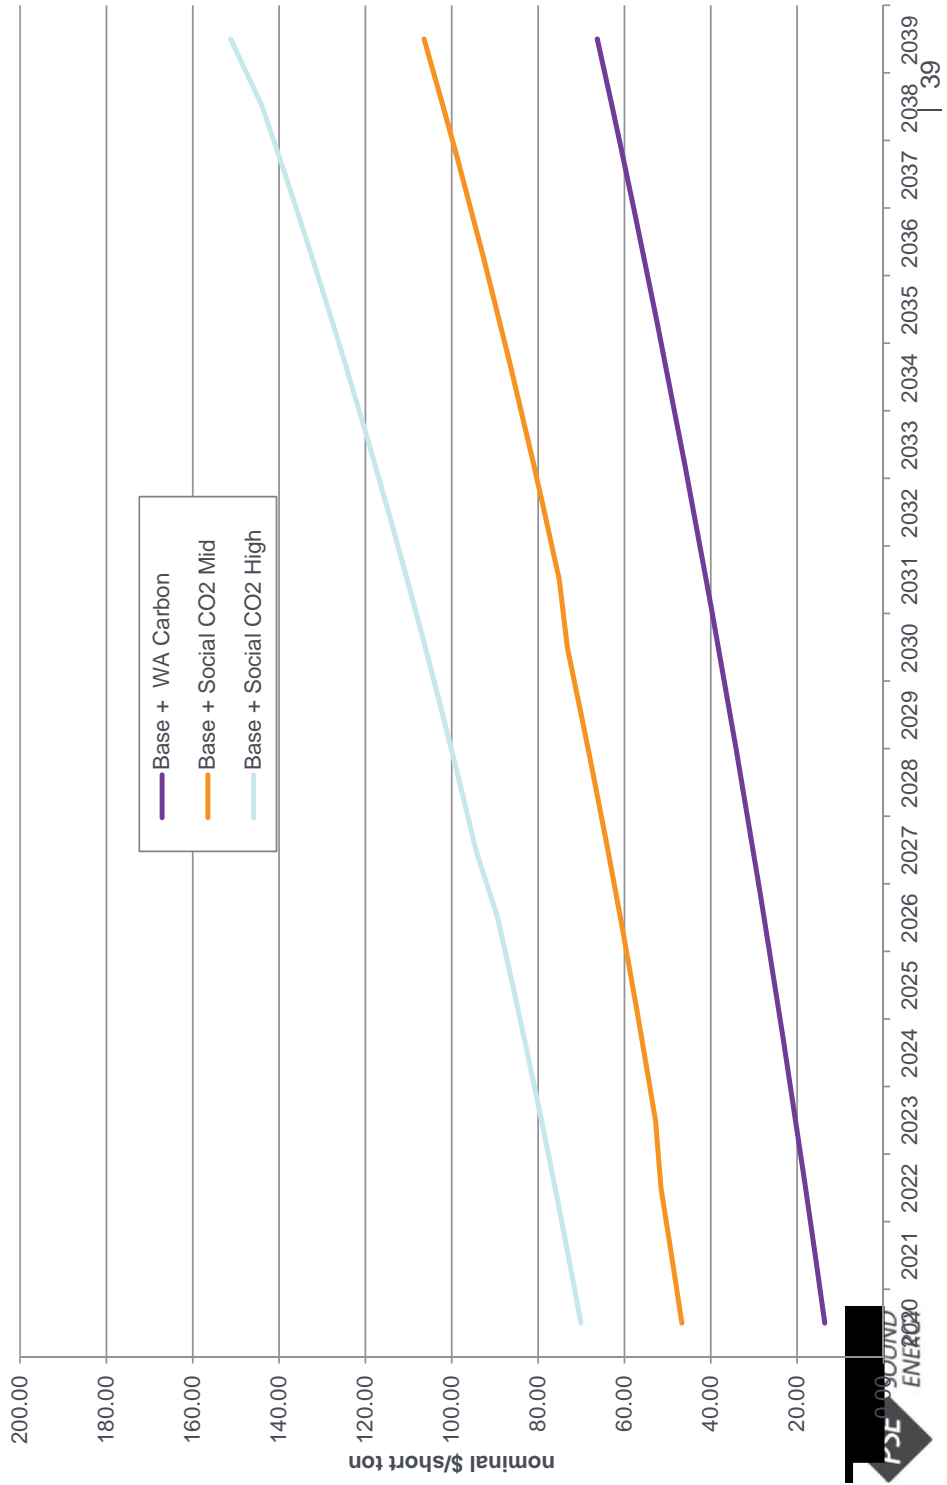

## Additional screening metrics

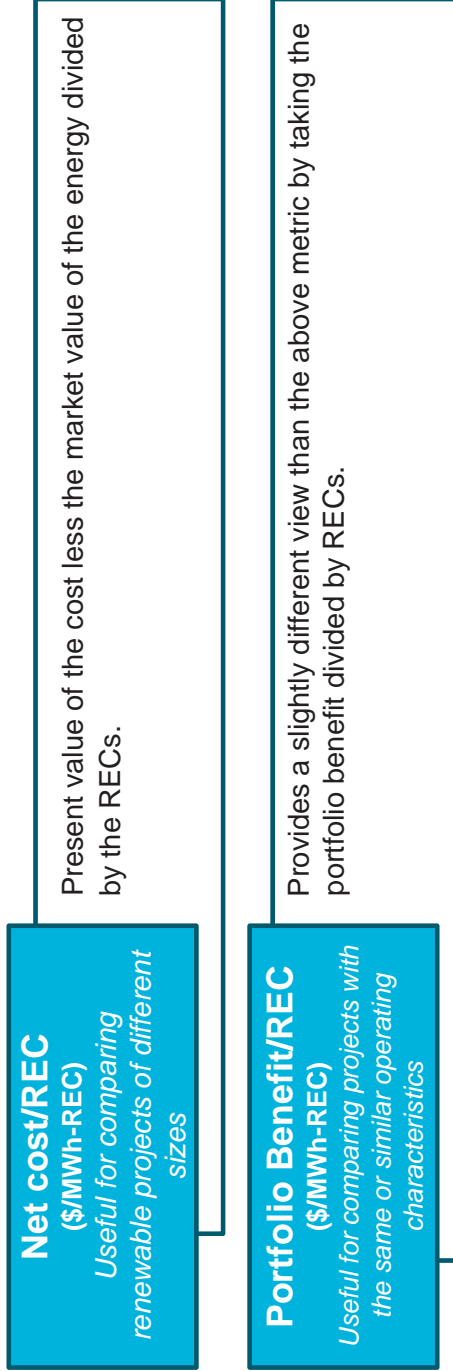

# Comparison of generic resource costs

2018 \$/kW	2017 IRP			2019 IRP			Change in costs from 2019 IRP to 2017 IRP		
	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	All in Costs
CCCT	\$1,020	\$358	\$1,378	\$698	\$269	\$1,167	(\$122)	(\$69)	(\$211)
Frame Peaker (Fuel Fuel)	\$526	\$172	\$698	\$554	\$271	\$825	\$28	\$99	\$127
Recip Engine (NG only)	\$1,030	\$312	\$1,341	\$842	\$350	\$1,192	(\$188)	\$38	(\$149)
WA Wind	\$1,548	\$656	\$2,204	\$1,656	\$386	\$2,042	\$108	(\$270)	(\$162)
MT Wind	\$1,471	\$1,312	\$2,783	\$1,633	\$1,111	\$2,744	\$162	(\$201)	(\$39)
Solar	\$1,497	\$874	\$2,371	\$1,352	\$570	\$1,922	(\$145)	(\$304)	(\$449)
Biomass	\$4,084	\$207	\$4,291	\$7,036	\$2,659	\$9,695	\$2,952	\$2,452	\$5,404
Offshore Wind	\$5,717	\$1,795	\$7,512	\$5,000	\$1,547	\$6,547	(\$717)	(\$248)	(\$965)
Li-Ion Battery 2-hr	\$1,313	\$342	\$1,655	\$1,331	\$599	\$1,930	\$18	\$257	\$275
Li-Ion Battery 4-hr	\$2,116	\$552	\$2,668	\$2,346	\$708	\$3,054	\$230	\$156	\$386
Flow Battery 4-hr	\$1,870	\$674	\$2,544	\$1,493	\$618	\$2,111	(\$377)	(\$56)	(\$433)
Flow Battery 6-hr	\$2,447	\$882	\$3,329	\$2,050	\$708	\$2,758	(\$397)	(\$174)	(\$571)
Pumped Storage	\$2,503	\$127	\$2,630	\$1,800	\$879	\$2,679	(\$703)	\$752	\$49



# PAC and TRC tests

PSE will evaluate the cost-effectiveness of proposals in two ways: using the Program Administrator Cost Test (PAC) and Total Resource Cost (TRC) Test

Benefits	PAC	TRC
Avoided Capacity Costs	✓	✓
Avoided Energy Costs	✓	✓
Avoided Transmission & Distribution Costs	✓	✓
Avoided Environmental Compliance Costs	✓	✓
Costs	PAC	TRC
Program Administrator Expenses	✓	✓
Program Administrator Capital Costs	✓	✓
Financial Incentive to Participant	✓	x
DR Measure Cost: Program Administrator	✓	✓
DR Measure Cost: Participant Contribution	x	✓
Participant Transaction Costs	x	✓
Participant Value of Lost Service	x	✓
Increased Energy Consumption	✓	✓
Environmental Compliance Costs	✓	✓

Source: Demand Response RFP, Exhibit D: Cost-effectiveness Evaluation Criteria, Tables 1 and 2



# ELCC Table

Effective Load Carrying Capability (ELCC) Estimates for Various DR Event Parameters						
Event Duration (Hours)	Call Frequency					
	Elapsed Hours After Last Events				Elapsed Hours Since Start of Last Event	
	4	6	8	12	24	24
2	63%	61%	57%	49%		
3	80%	77%	77%	59%		
4	90%	85%	80%	65%	53%	58%
5	94%	89%	84%	68%	55%	

Source: Demand Response RFP, Exhibit D: Cost-effectiveness Evaluation Criteria, Table 3



# 2018 All Resources and Demand Response RFPs



*Update to WUTC: RFP Process and Phase 1 Results*

April 2, 2019

**CONFIDENTIAL**

# Agenda

---

- RFP schedule and resource need
- Proposals received
- Phase 1 evaluation process
- Phase 1 results
- Phase 2 evaluation process
- Next steps





1

# RFP schedule and resource need

Presenter: Cindy Song


# 2018 RFP schedule

Date	Milestone
✓ March 29, 2018	Draft RFP filed with WUTC
✓ June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓ July 3, 2018	PSE released final RFPs
✓ August 17, 2018	Offers were due to PSE
✓ Feb/Mar 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
Q2 2019	Complete Phase 2 evaluation, select final short list



# RFP solicits 272 MW of capacity by end of 2022\*

- Target online date by 2022\*\*
- Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably

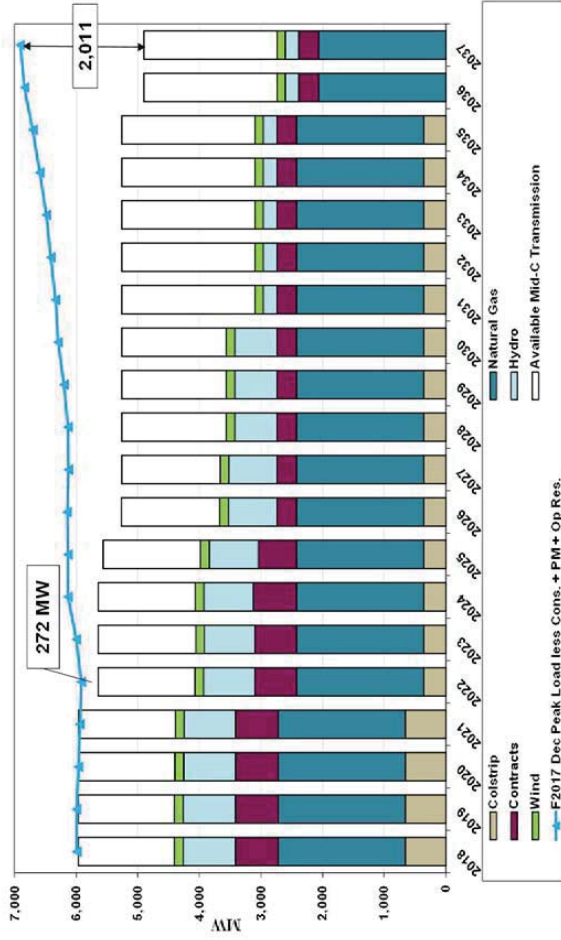


\* The All Resources RFP filed with the WUTC in June 2018 reflected then-current resource need projections based on the F2017 load forecast. In August 2018, PSE adjusted its resource need forecast for Phase 1 to reflect the F2018 load forecast. The resource need projection is based on current law and is not predictive of any future or pending legislative action.

\*\* Target online date is based on earliest need, but will not disqualify long-head resources.

# Projected need to meet the RPS is 671,000 RECs 2023\*

- REC need is driven by the increase in the RPS from 9% to 15% in 2020\*\*
- PSE's inventory of banked RECs delays need until 2023
- PSE will consider early delivery dates to take advantage of tax incentives prior to phase out
  - PSE will evaluate the tradeoff between capturing the benefit of a higher tax incentive and the carrying cost of acquiring early

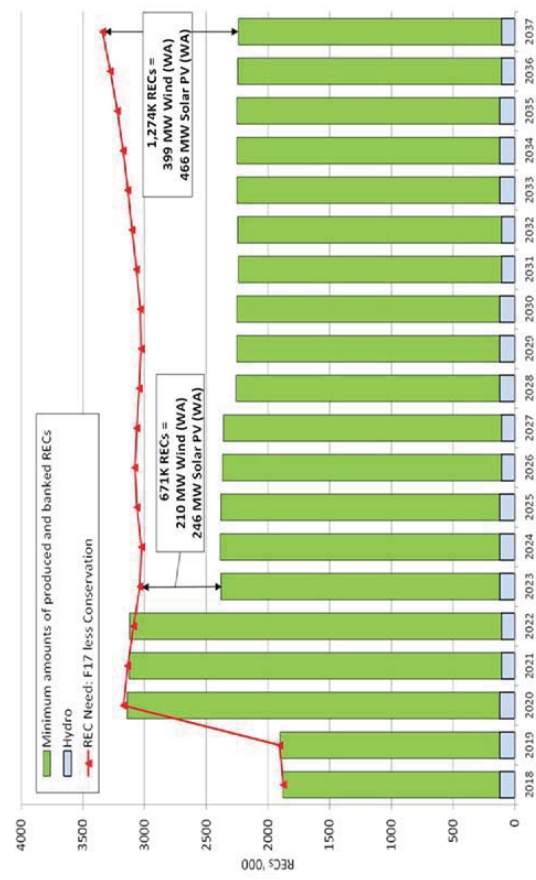

- A renewable resource may count toward peak capacity need based on coincident winter peak production
  - PSE will engage reputable consultant for resource due diligence and to develop synthetic distributions for peak capacity calculation
- Proposals which demonstrate that they qualify for Washington state apprenticeship labor credit will add 1.2x multiplier to REC output



\* The All Resources RFP filed with the WUTC in June 2018 reflected then-current resource need projections based on the F2017 load forecast. In August 2018, PSE adjusted its resource need forecast for Phase 1 to reflect the F2018 load forecast.

\*\* If proposing a qualifying renewable resource located outside the Pacific Northwest as defined for the Bonneville Power Administration in Section 3 of the Pacific Northwest Electric Power Planning and Conservation Act (94 Stat. 2698; 16 U.S.C. Sec. 839a), electricity from the facility must be delivered into Washington state on a real-time basis without shaping, storage, or integration services.

2

## Proposals received

Presenter: Sheri Maynard

# Nearly 100 proposals received

## Largest response to an All Source RFP to date

Resource Type	2018 All Resource and Demand Response RFPs		2017 Renewables Only RFP (Green Direct 2.0) <sup>1</sup>		2011 All Source RFP		2010 All Source RFP		2008 All Source RFP		2005 All Source RFP	
	# Proposals <sup>2</sup>	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW <sup>1</sup>	# Proposals	Max Cap MW
Solar - PV	16	2240	17	574	2	24	1	10				
Solar - PV + BESS	20	2848										
Wind - Off Shore	1	400										
Wind On Shore	16	3303	20	2601	4	369	21	3776	8	862	10	1165
Wind + Winter Sys PPA	1	371										
Wind + Solar and/or BESS	2	464	4	339								
Storage - Battery ("BESS")	17	1265			2	251						
Storage - Pumped Hydro	2	900										
Biomass	2	72			3	61	9	590				
Biomass + BESS	1	15										
Natural Gas-fired Generation	4	1377			10	2624	18	5342	10	2588	17	4307
Geothermal	2	43									1	48
Hydro - Run of River	1	38	2	4	1	77	2	105	3	165	3	139
System PPA / Call Option	1	100			4	400	10	n/a	9	1675	7	400
Unbundled RECs	5						2	n/a				
Demand Response	6	154					1	80			1	34
Coal - Traditional + IGCC					1	500			1	100	6	4950
Cold Fusion					1	1880						
Distributed Generation												
Waste-to-Energy / Landfill Gas					1	23					1	5
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>43</b>	<b>3,518</b>	<b>29</b>	<b>6,209</b>	<b>64</b>	<b>9,903</b>	<b>31</b>	<b>5,390</b>	<b>47</b>	<b>11,053</b>

[1] The 2017 RFP sought large and small (<5 MW) renewable resources to serve multiple voluntary green power programs.

[2] PSE also received two unsolicited proposals during Phase 1, a REC-only and a pumped storage hydro storage, which are not included in the table.



## 93% of proposals offered a PPA option, 28% of proposals offered an ownership option


Resource Type	# Proposals	Max Cap MW <sup>1</sup>	Offer Structure(s)		
			Own	PPA/Toll/ Other Agmt	Both
Solar - PV	16	2,240	1	14	1
Solar - PV + BESS	20	2,848		18	2
Wind - Off Shore	1	400			1
Wind On Shore	16	3,303	3	11	2
Wind + Winter Sys PPA	1	371		1	
Wind + Solar + BESS	2	464	1	1	
Storage - Battery ("BESS")	17	1,265	1	8	8
Storage - Pumped Hydro	2	900			2
Biomass	2	72		2	
Biomass + BESS	1	15		1	
Natural Gas CCCT	2	1,020		1	1
Natural Gas SCCT	1	245			1
Natural Gas Recip	1	112	1		
Geothermal	2	43			2
Hydro - Run of River	1	38		1	
System PPA / Call Option	1	100		1	
Unbundled RECs	5	n/a		5	
DR Direct Load Control	4	109		4	
DR C&I Curtailment <sup>2</sup>	2	44		2	
<b>TOTAL</b>	<b>97</b>	<b>13,589</b>	<b>7</b>	<b>70</b>	<b>20</b>

- 90% of proposed projects are in early development stage
- Many proposals included multiple offer options, such as:
  - Multiple structure options:
    - development rights
    - asset purchase
    - PPA, Toll or other agreement
  - Fixed/escalating PPA pricing
  - Various term lengths and/or start dates
  - Hybrid options to include storage, or to pair solar with wind
  - Transmission delivery points



[1] MW column reflects total combined potential capacity  
 [2] Commercial & Industrial Curtailment (C&I Curtailment)

# 70% of projects proposed are located in Washington



REDACTED  
VERSION




# 3

## Phase 1 evaluation process

Presenters: Will Foster, Wei Dang, Bob Williams

# Two-phased evaluation process allows PSE to focus on most favorable proposals for robust analysis

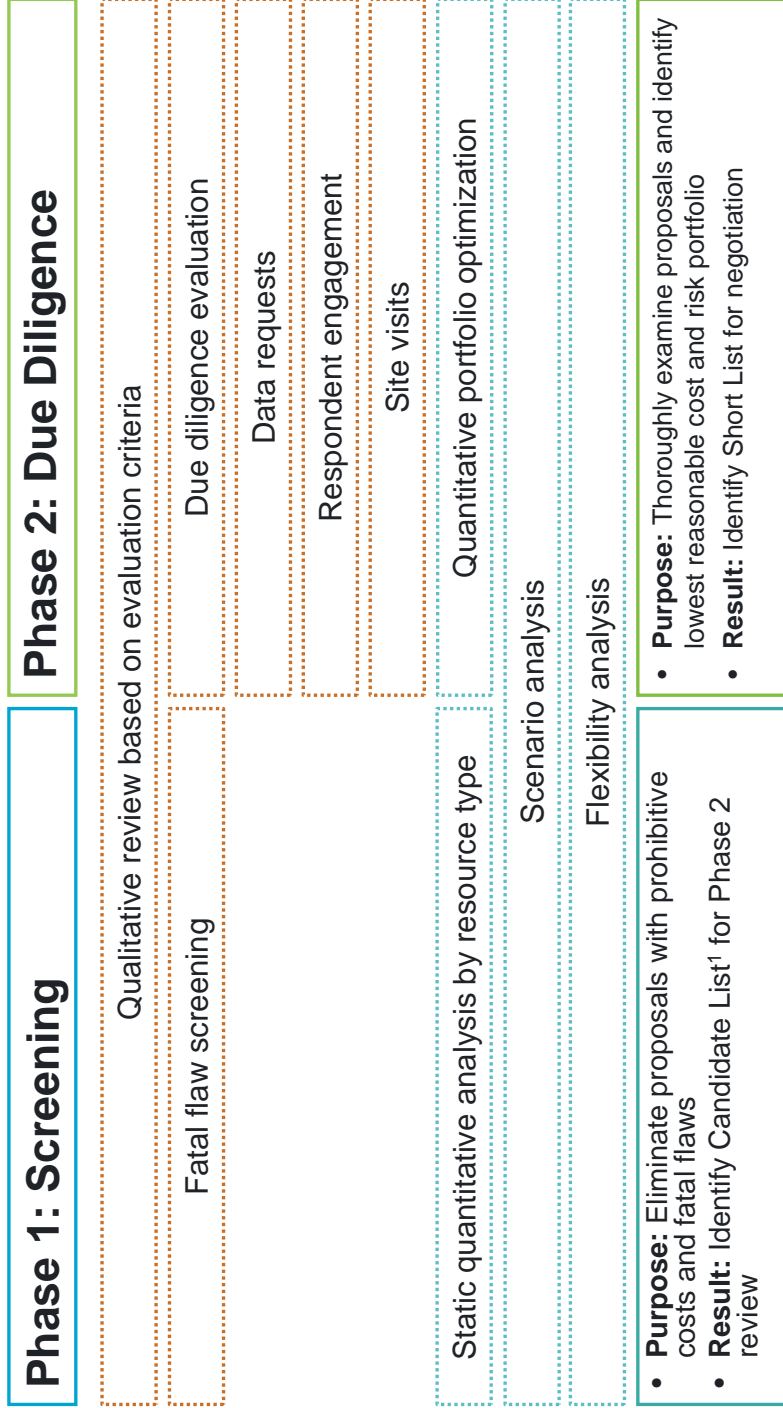

<sup>1</sup> The Candidate List represents the lowest cost resources with no fatal flaws, and a representative sampling of renewable, hybrid, storage, demand response and capacity resources.




# Phase 1 screening eliminates proposals with higher costs and fatal flaws



*Additional subject matter experts engaged in Phase 2 for both the All Resources and Demand Response proposals to help thoroughly evaluate the risks and merits of all offers (slide 28).*





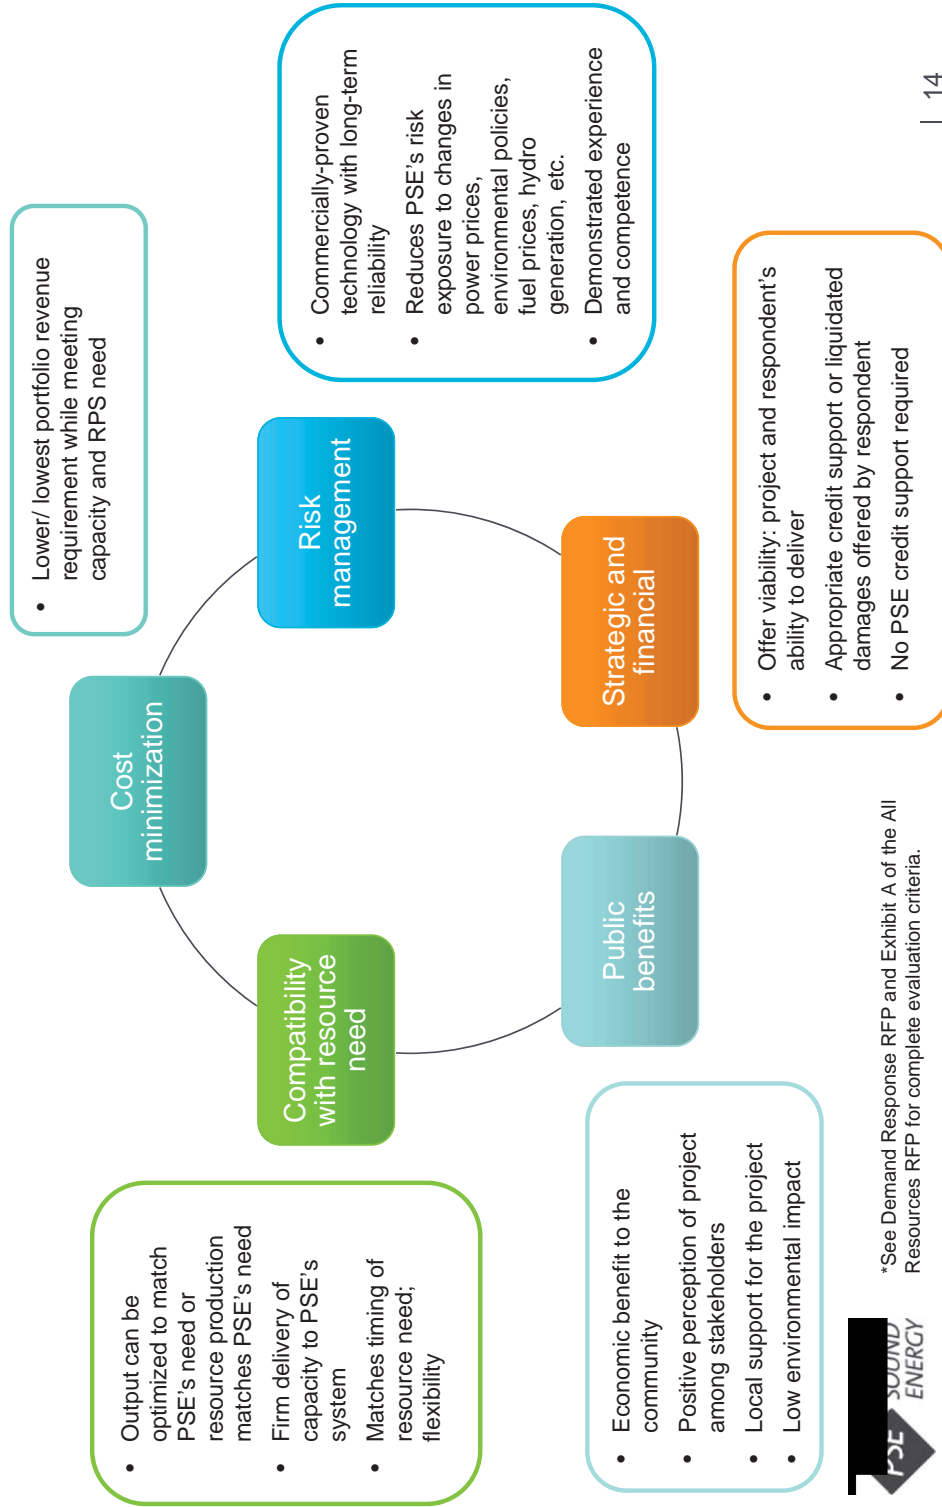





# Evaluation criteria help identify proposals with lowest reasonable cost and risk\*



\*See Demand Response RFP and Exhibit A of the All Resources RFP for complete evaluation criteria.



# Qualitative evaluation asks key questions designed to identify proposal benefits and risks\*

    <ul style="list-style-type: none"> <li>✓ Are the offer terms acceptable?</li> <li>✓ Is project operating or likely to meet proposed commercial operation date?</li> <li>✓ What is the nameplate capacity of the project? Sized appropriately to help meet need?</li> <li>✓ Where is the project located? Benefits/risks?</li> <li>✓ Does project have site control?</li> <li>✓ What is the permitting status?</li> <li>✓ Status of transmission and interconnection?</li> <li>✓ What is the selected technology? History of reliable operation?</li> <li>✓ What is the useful life of the project?</li> <li>✓ Does the project have community support?</li> <li>✓ What is the status of all relevant agreements? Examples: key component supply contracts (e.g. wind turbines), service and maintenance, EPC contract, BOP, interconnection, transmission, permits, site control, etc.</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Project output?</li> <li>✓ Net capacity factor (NCF)?</li> <li>✓ Degradation?</li> <li>✓ Eligible for tax incentives?</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Capacity (MW) and duration (MWh)?</li> <li>✓ Roundtrip efficiency?</li> <li>✓ Degradation / augmentation?</li> <li>✓ Flexibility and T&amp;D benefits?</li> </ul>
 <ul style="list-style-type: none"> <li>✓ Fuel supply and transportation secured? If not, status?</li> <li>✓ Operational characteristics?</li> <li>✓ Emissions? Permitting risks? If operating, compliance history?</li> </ul>	 <ul style="list-style-type: none"> <li>✓ Project output?</li> <li>✓ Net capacity factor (NCF)?</li> <li>✓ Eligible for tax incentives?</li> </ul>	

\*This list is illustrative only. It does not reflect all eligible resource types or a complete list of criteria considered. For more detail, see RFP Exhibit A (Evaluation Criteria) and Exhibit B (Proposal Requirements).



# Sample qualitative questions for demand response proposals\*



- ✓ Are the offer terms acceptable?
- ✓ Is the program operating or likely to meet proposed commercial operation date?
- ✓ Has the respondent entity demonstrated its competence and experience?
- ✓ Does the proposal include a management structure and the relevant experience of assigned personnel?
- ✓ What is the quality of the proposed equipment and services?
- ✓ How does the proposed pricing compare to other alternatives?
- ✓ Does the offer include acceptable performance guarantees?

\*This list is illustrative only. It does not reflect a complete list of criteria considered. For more detail, see the Demand Response RFP.



## Examples of fatal flaws


---

- Significantly higher cost than alternatives
- Proposal fails to provide sufficient information to substantiate a viable project
- No transmission secured and no available transmission between the project and PSE's system
- Insufficient fuel supply or fuel transportation to generation project
- Commercially unproven technology
- Unable to obtain necessary permits to execute the project
- Excessive counterparty risk likely to cause counterparty to be unable to complete the project or meet contractual obligations to PSE
- Regulatory or legal risks associated with non-compliance or other obligations that could adversely impact PSE



# Resource costs

PSE uses three models to analyze resource costs and characteristics

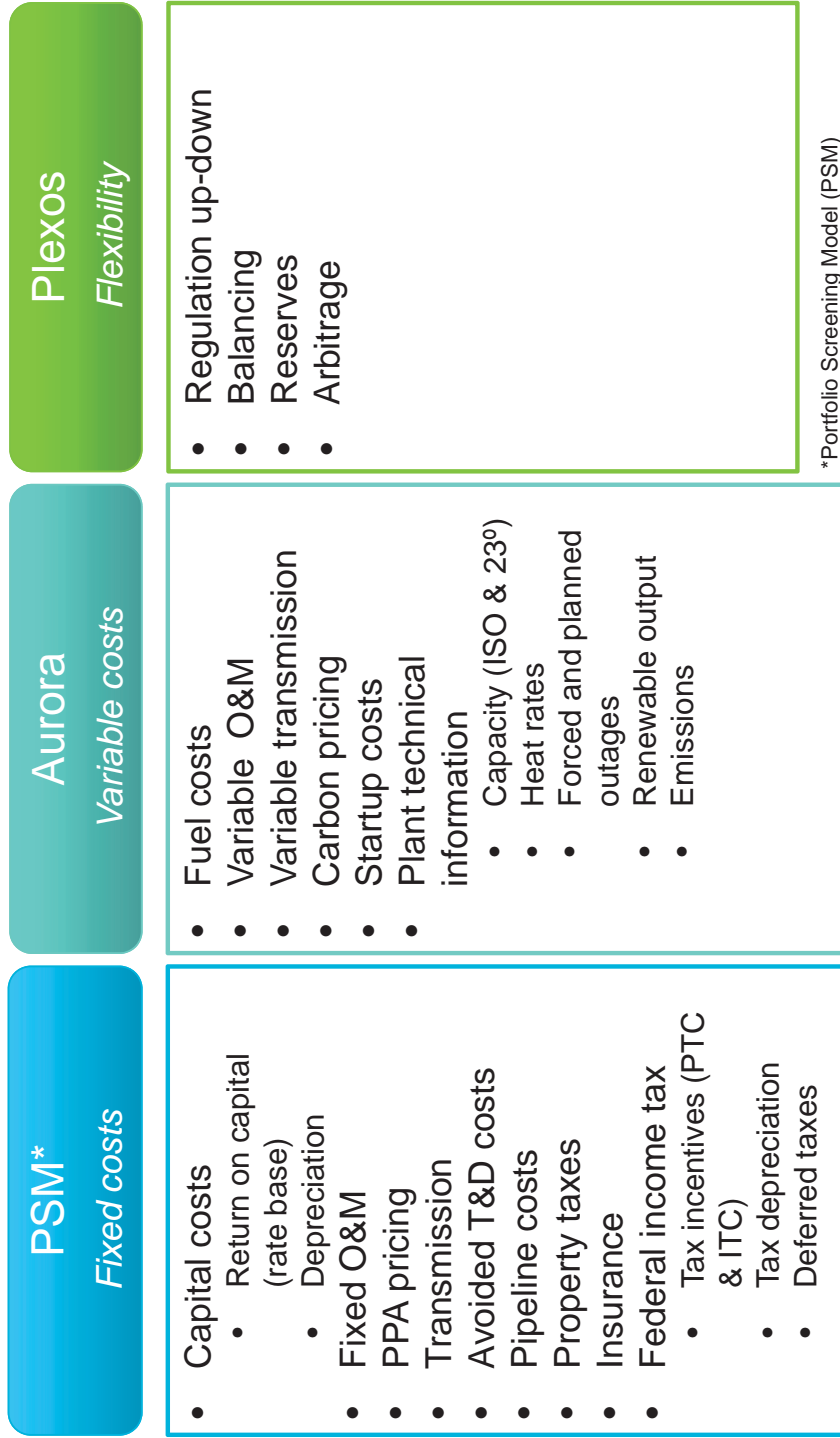


\*Portfolio Screening Model (PSM)






# PSM optimization process

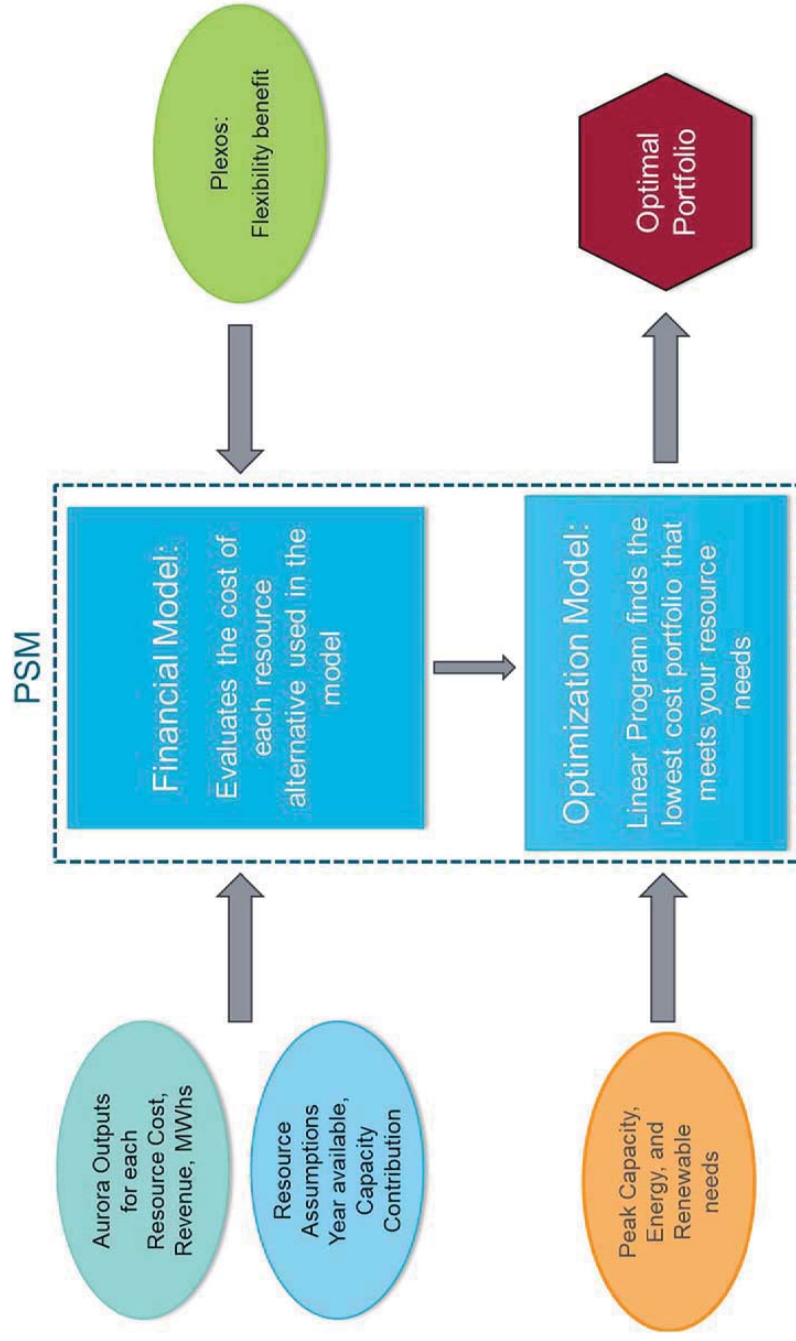

## Quantitative screening metrics allow PSE to compare and rank resources with different characteristics and capacities

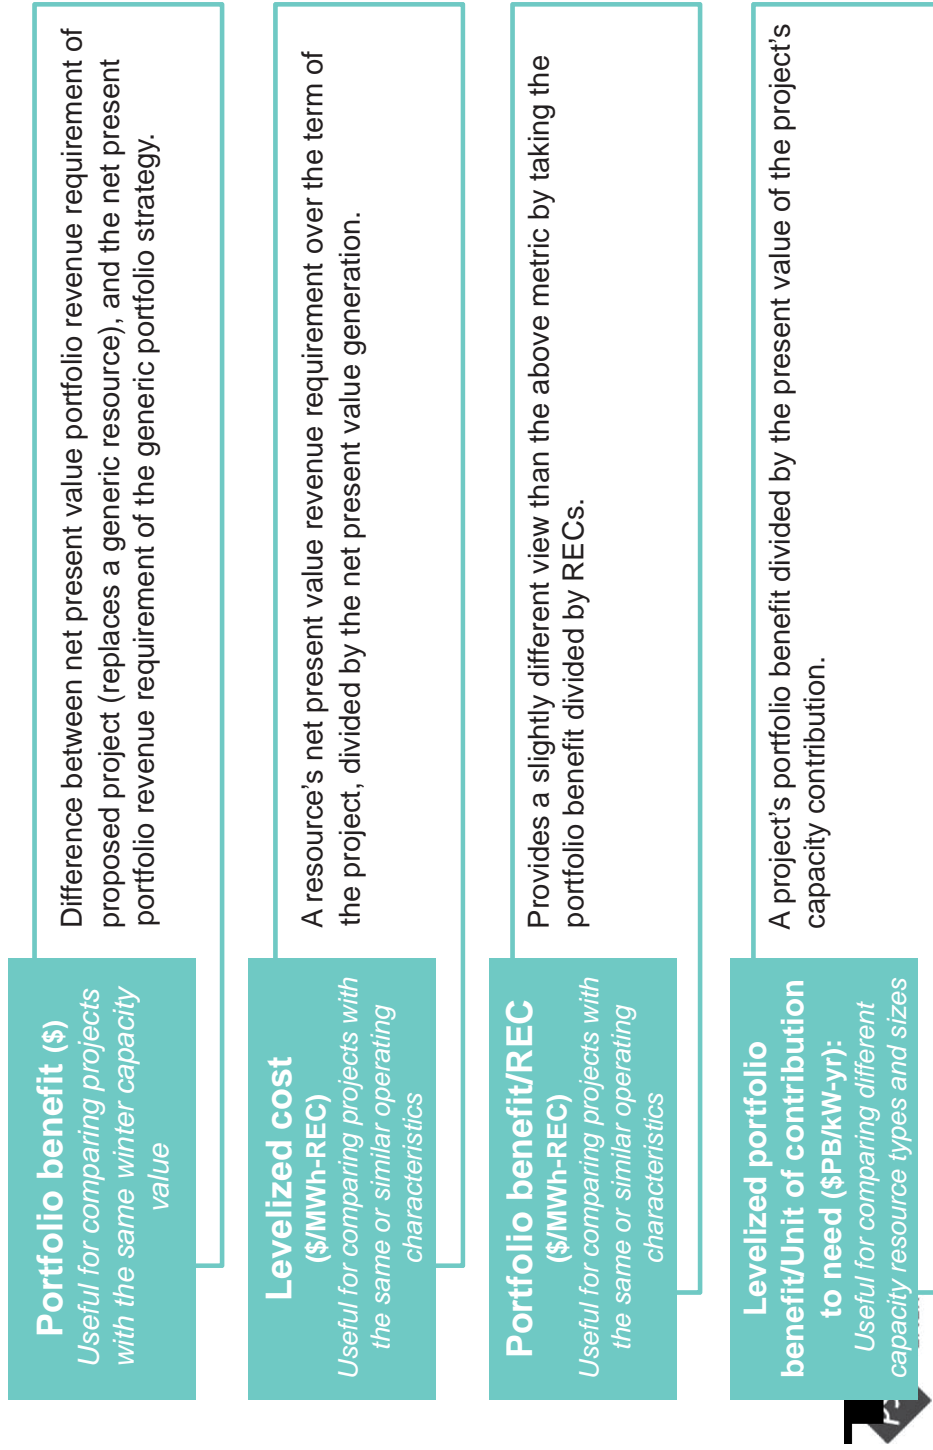

# Additional screening metrics

## Net cost/REC (\$/MWh-REC)

*Useful for comparing  
renewable projects of different  
sizes*

Present value of the cost less the market value of the energy divided by the RECs.

## Portfolio benefit ratio

*Useful for comparing projects  
with the same or similar  
operating characteristics;  
removes size bias*

Portfolio benefit divided by the net present value of the proposed revenue requirement. Allows projects of different capacities to be compared by eliminating bias for size.

## Net cost/peak capacity credit (\$/kw)

*Useful for comparing cost of  
peak capacity credit across  
technologies*

Present value of the cost less the market value of the energy divided by peak capacity credit.



# Phase 1 price scenarios

---

1. **No carbon tax** – Base case from the 2017 IRP with no carbon tax
2. **CO2 (Initiative 1631)** – Scenario 1 + \$16/ton carbon price
3. **CO2 (WECC-wide social cost)** – Scenario 1 + \$42/ton carbon price



4

## Phase 1 results

Presenter: Cindy Song

# Observations from Phase 1

- Solar prices have dramatically declined compared to other resource types
- Battery storage prices have also considerably declined and show potential, but are not yet competitive with alternatives available to PSE in this RFP
- Of 97 total proposals, 40 included battery storage configurations, while only 4 offered gas-fired generation
- Phase 1 analysis suggests many renewables are beating our current projections for Mid-C transmission redirects

Proposals selected for Phase 2 evaluation reflect resource and technology diversity

As of 3/18/19	Proposals Received <sup>1</sup>		Phase 2 Candidate List	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW
Resource Type				
Solar - PV	16	2240	8	1050
Solar - PV + BESS	20	2848	1	100
Wind - Off Shore	1	400	0	0
Wind On Shore	16	3303	7	1642
Wind + Winter Sys PPA	1	371	1	200
Wind + Solar and/or BESS	2	464	0	0
Storage - Battery ("BESS")	17	1265	0	0
Storage - Pumped Hydro	2	900	0	0
Biomass	2	72	1	17
Biomass + BESS	1	15	0	0
Natural Gas-fired Generation	4	1377	2	348
Geothermal	2	43	0	0
Hydro - Run of River	1	38	1	38
System PPA / Call Option	1	100	0	0
Unbundled RECs	5	n/a	3	n/a
Demand Response	6	154	1	8.7
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>25</b>	<b>3,404</b>

<sup>1</sup>PSE also received two unsolicited proposals during Phase 1, one REC-only and one pumped hydro storage. While the proposals are not included in the table count above, they were evaluated as part of the Phase 1 analysis.



# Candidate list for Phase 2

(results are a snap shot in time, subject to change)

ID	Project Name	Resource Type	Nameplate	Counterparty	State
18100	SPI Industrial	Biomass	17 MW	SPI	WA
18201		Demand Response			WA
18169		MT Wind	MW		MT
18173		MT Wind	MW*		MT
18176		MT Wind	MW*		MT
18163		REC Only	0 REC		OR
18165		REC Only	0 REC		OR
18190		REC Only	0 REC		WA
18107		Run-of-River	MW		ID
18135		Solar	MW		WA
18111		Solar	MW		WA
18122		Solar	MW		WA
18131		Solar	MW		WA
18127		Solar	MW		WA
18114		Solar	MW		WA
18112		Solar	MW		WA
18125		Solar	MW		WA
18139		Solar + BESS	MW BESS		OR
18105		Thermal	MW		WA
18103		Thermal	MW		OR
XXXXX		Transmission	MW		N/A
18175		Wind	MW		WA
18132		Wind	MW*		OR
18179		Wind	MW		WA
18170	Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
18166		Wind	MW		OR

\* Numbers shown are rounded to the nearest 5MW.

\*\* Reflects a redirect of MW of BPA transmission from ██████████ to PSEI, available January, 2022 for a 50-year term, and using Mid-C forecast for energy pricing. ██████████ MW may be available for redirect on BPA's system, however it is likely only ██████████ MW is possible for redirect to Mid-C. Redirects are assessed given the most current data and are a snap shot of the present system. The results are subject to change and may vary in the future based on updated ATC calculations and flow gate constraints within BPA's network. While redirect of the remaining ██████████ MW is feasible, the location, source and cost of this redirect remains under review, therefore not included in this analysis.

Proposals shown here are best offers from each proposal.




**CONFIDENTIAL | For RFP evaluation team use only. Do not forward.**

REDACTED VERSION

# Detailed Phase 1 results

---

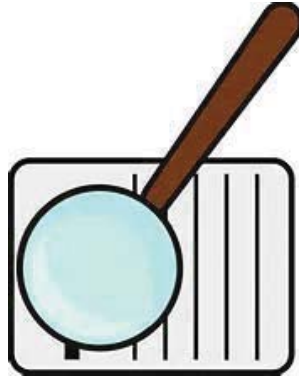




5

## Phase 2

Presenter: Will Foster, Wei Dang and Bob Williams

# Phase 2 due diligence is designed to identify proposals that are lowest reasonable cost

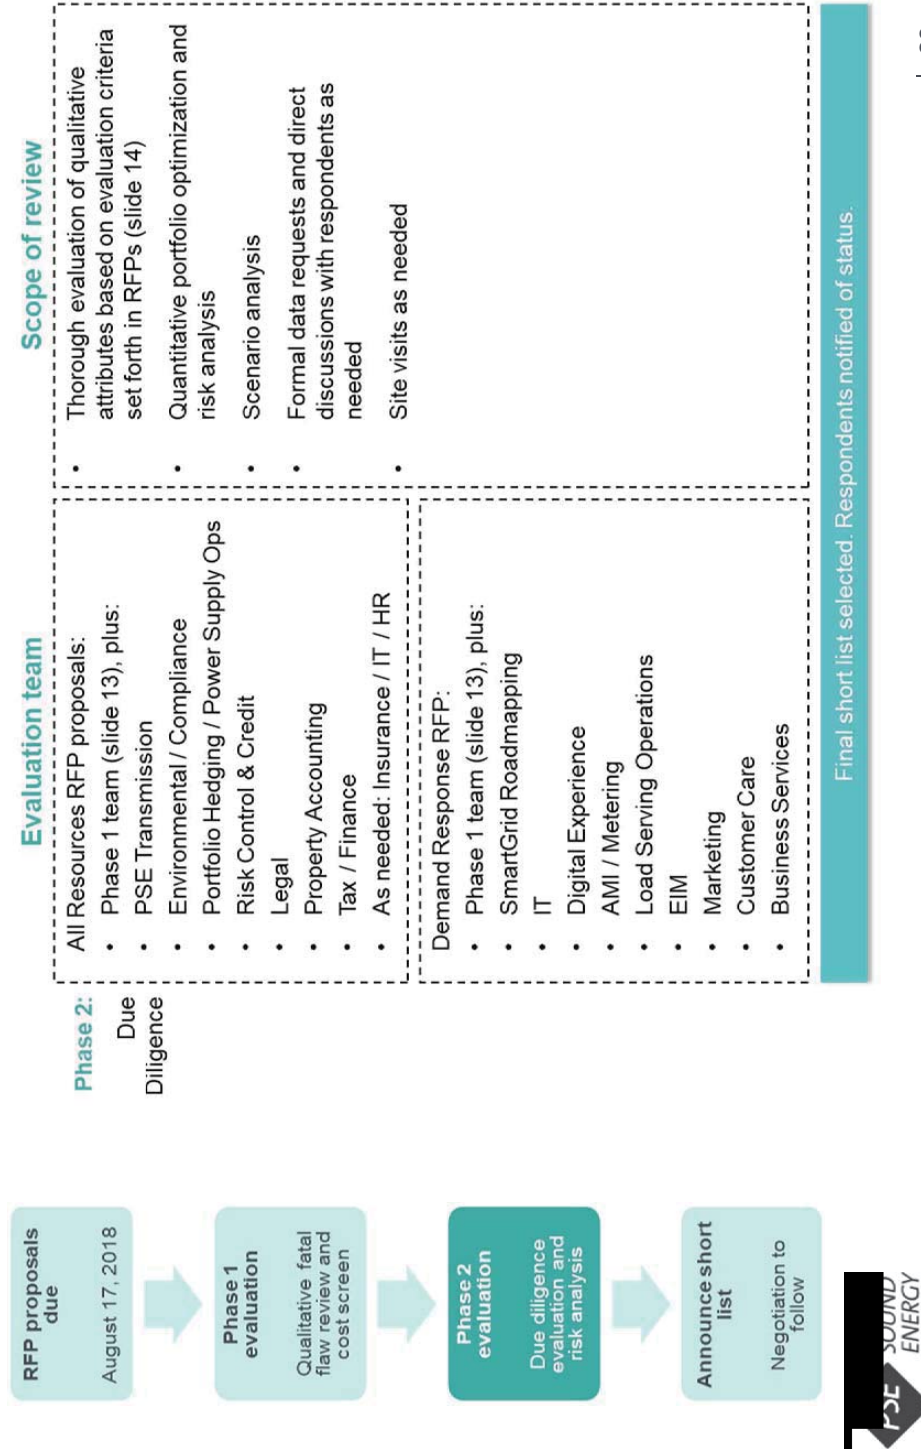

# How is Phase 2 different from Phase 1?

---

*Detailed, cross-functional due diligence to evaluate the costs, risks and merits of each proposal based on the evaluation criteria used in Phase 1 screening*

- In Phase 1, we gave proposals the benefit of the doubt; in Phase 2, we verify
- Phase 1 analysis relies on the proposals and public information sources; Phase 2 involves more interaction with respondents and a deeper dive into the details of each proposal
  - Phase 2 will include data requests, direct discussion with respondents as needed, and may include site visits
  - Phase 2 quantitative analysis will include:
    - Additional scenario testing in portfolio screening model (see slide 30)
    - Update quantitative assumptions as available
- RFP team will consider impacts of the Clean Energy Bill (anticipated April 2019) on potential resource selections



## Phase 2 price scenarios (subject to change)

	Phase	WECC /PSE Demand	Gas Price*	Generic Resource Costs	CA SB 100
No carbon tax	1 + 2	Base	Base	Base	No
CO2 (Initiative 1631)	1 + 2	Base	Base	Base	No
CO2 (WECC-wide social cost)	1 + 2	Base	Base	Base	No
CO2 (high WECC-wide social cost)	2	Base	Base	Base	No
Low growth (no carbon tax)	2	Low	Low	Base	No
No carbon tax (updated gas price)	2	Base	2018 Price	Base	Yes

Source: Draft 2019 IRP assumptions



\* The Base and Low gas prices are based on the Wood Mackenzie 2018 spring price. The 2018 Price is based on the 2018 fall price.

## PSE will update key Phase 2 modeling assumptions to reflect current draft 2019 IRP assumptions\*

	RFP Phase 2	RFP Phase 1	2017 IRP
Mid-C power prices levelized	\$28.75/MWh	\$33.92/MWh	\$40.48/MWh
Gas prices levelized	\$3.50/mmbtu	\$3.74/mmbtu	4.02/mmbtu
Load growth	0.5%	0.5%	0.7%
Effective load carrying capability (ELCC)	See appendix.		



\* This is not intended to be a complete list of all model updates. Certain additional Phase 2 modeling assumptions are described in the appendix.

5

## Next steps

Presenter: Sheri Maynard

# What's next?

---

- Phase 2 evaluation of RFP proposals
- Select short list / present results to PSE management end of Q2
- Next WUTC update: July 2019
  - Phase 2 results
  - Final short list



# 2018 RFP schedule

	Date	Milestone
✓	March 29, 2018	Draft RFP filed with WUTC
✓	June 28, 2018	WUTC approved Demand Response and All Resource RFPs
✓	July 3, 2018	PSE released final RFPs
✓	August 17, 2018	Offers were due to PSE
✓	Feb/Mar 2019	Complete Phase 1 evaluation, select Phase 2 candidate list
	Late Q2 2019	Complete Phase 2 evaluation, select final short list





# Appendix

# Appendix


---

- RFP modeling assumptions:
  - Resource need
  - Load
  - Power prices
  - Gas prices
  - Carbon prices
  - ELCC contribution
  - Generic resource costs
  - Transmission
- Additional proposal summary slides
- Additional demand response slides




## Appendix 1: RFP modeling assumptions

# Phase 1: Peak updated to F2018 demand forecast

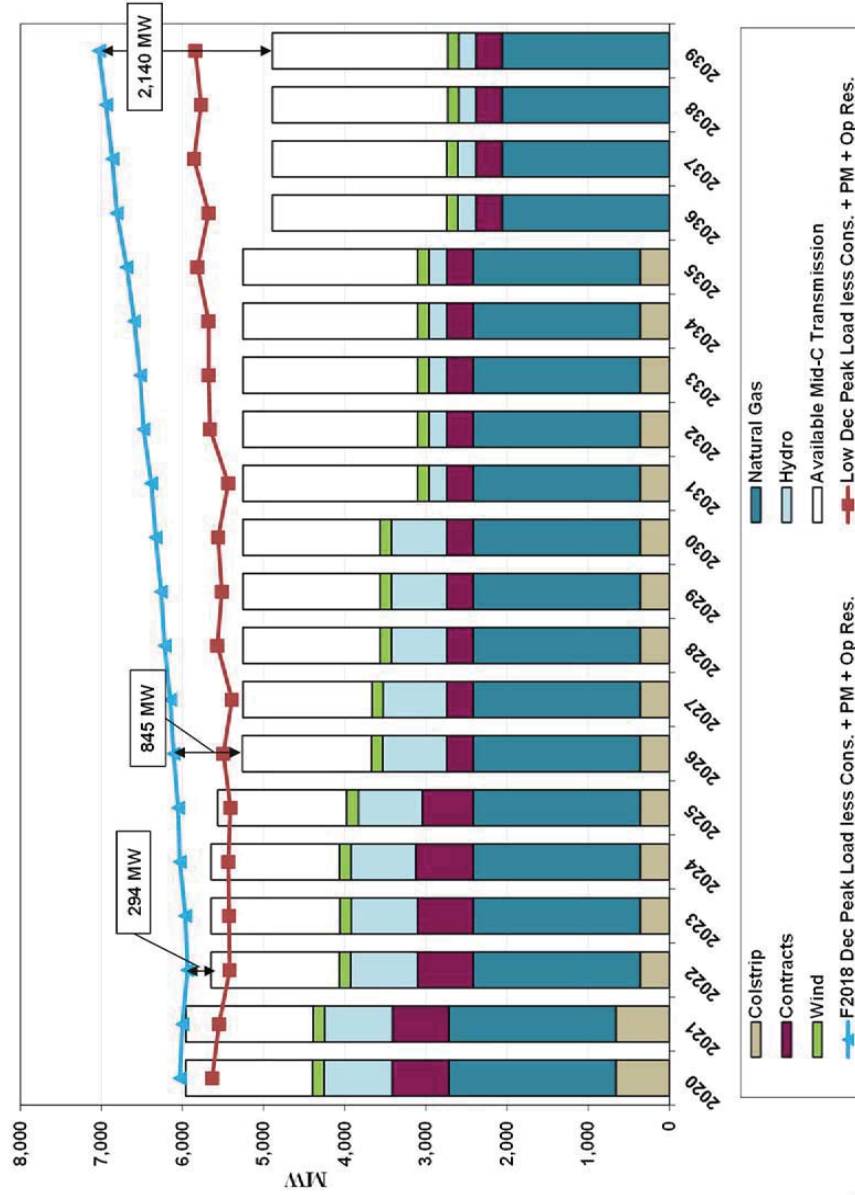

# Phase 1: Renewable need updated to F2018 demand forecast

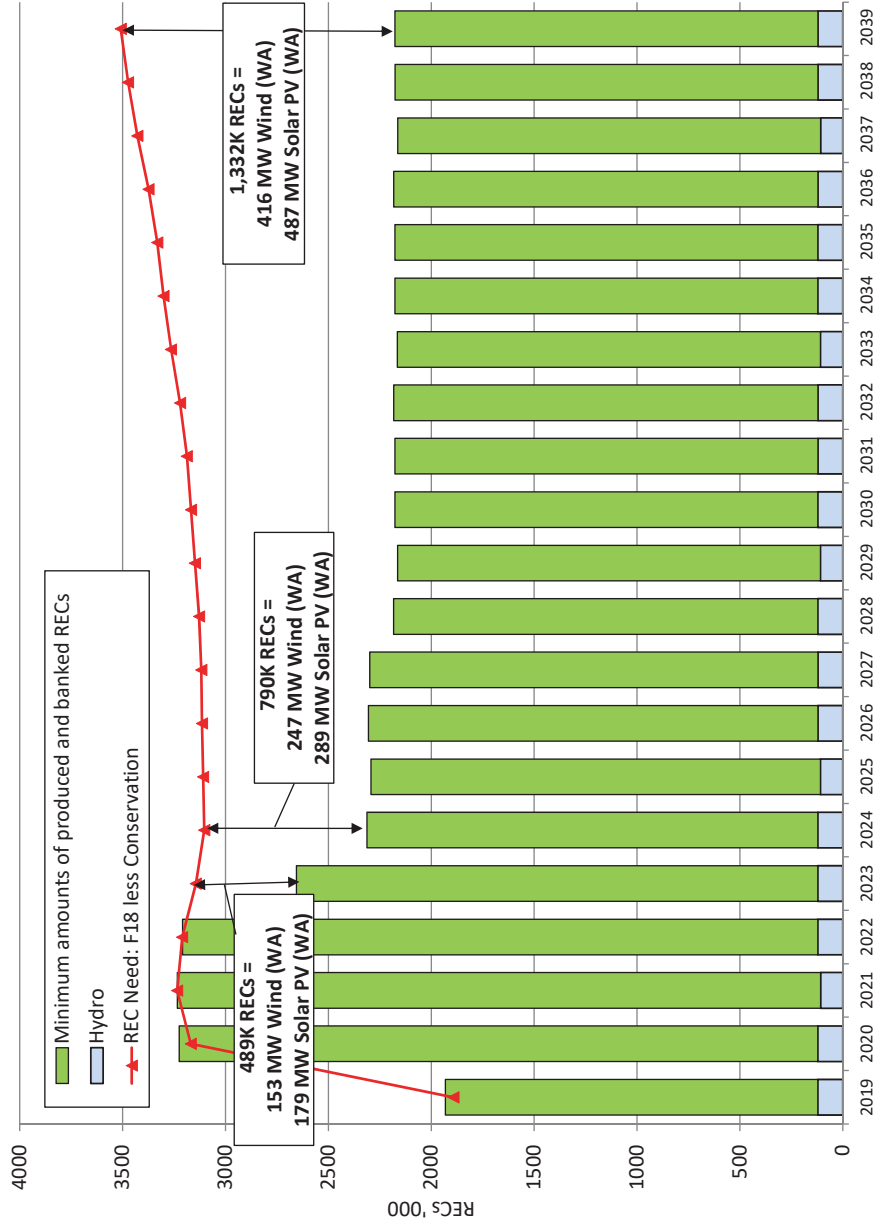

# PSE updated key Phase 1 modeling assumptions to reflect then current draft 2019 IRP assumptions\*


	RFP Phase 1	2017 IRP
Mid-C power prices Levelized	\$33.92/MWh	\$40.48/MWh
Gas prices Levelized	\$3.74/mmbtu	4.02/mmbtu
Load growth	0.5%	0.7%




\* This is not intended to be a complete list of all model updates. Certain additional modeling assumptions are described in the Phase 2 portion of this presentation (including updated ELCC assumptions consistent with the draft 2019 IRP). Other key assumptions are described in the appendix.

# Phase 1: Load forecast comparison

---

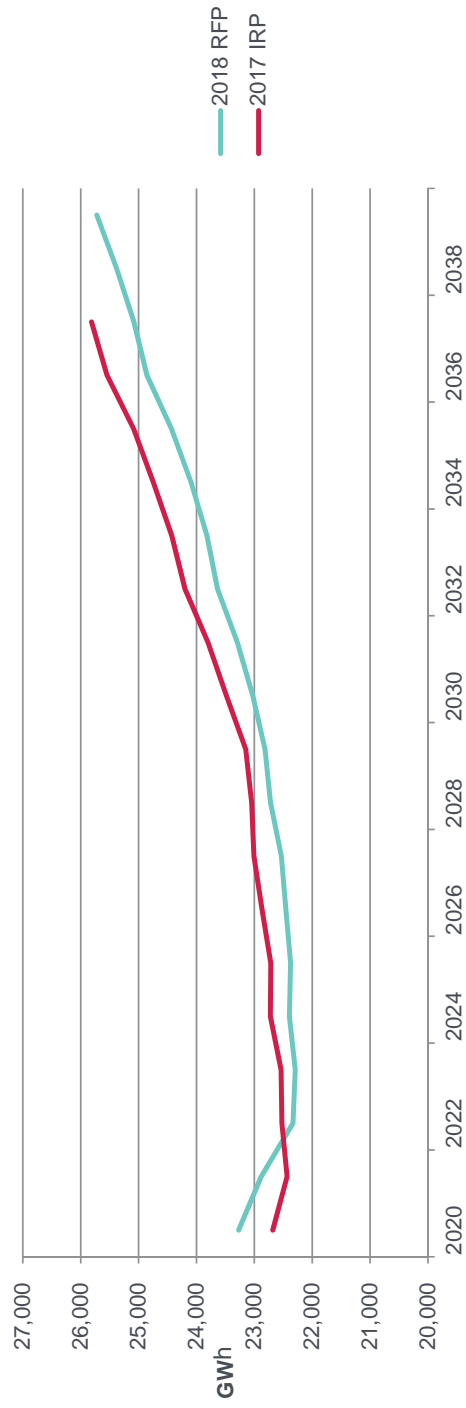

# Phase 2: Load forecast comparison

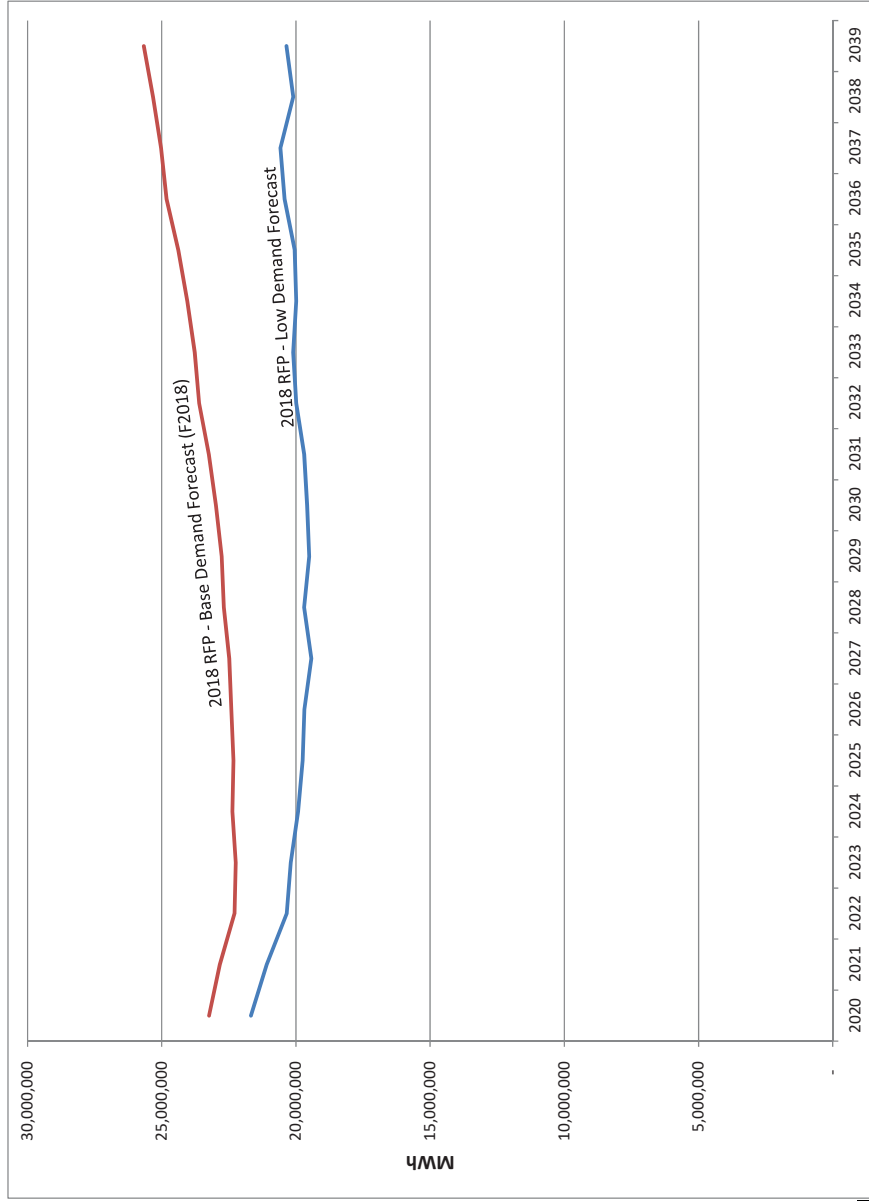




# Phase 1: Power price forecast


---




# Phase 2: Power price forecast

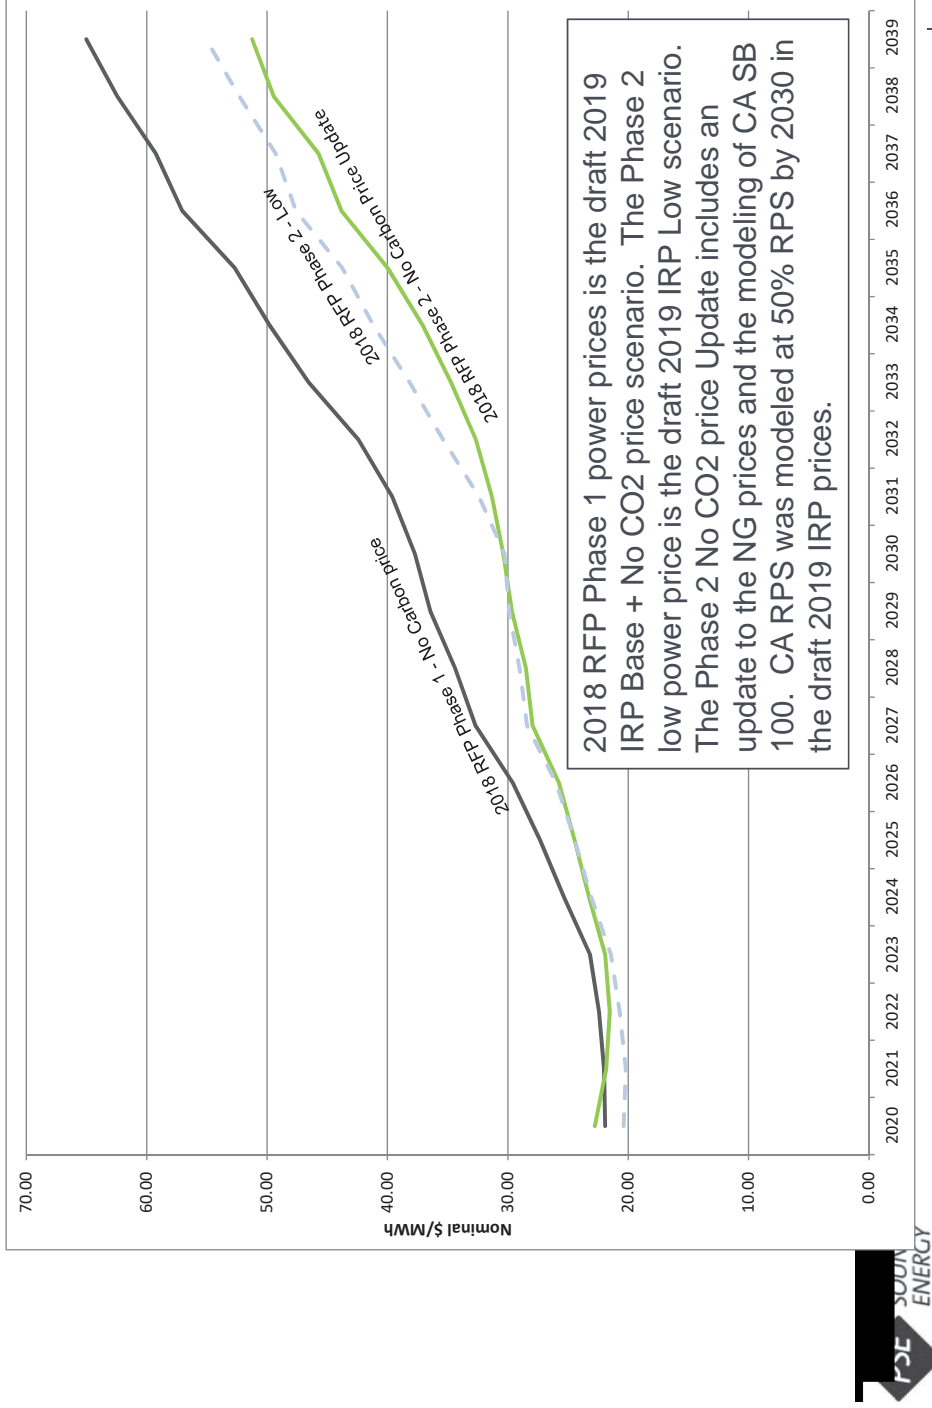

# Phase 2: Natural gas price forecasts

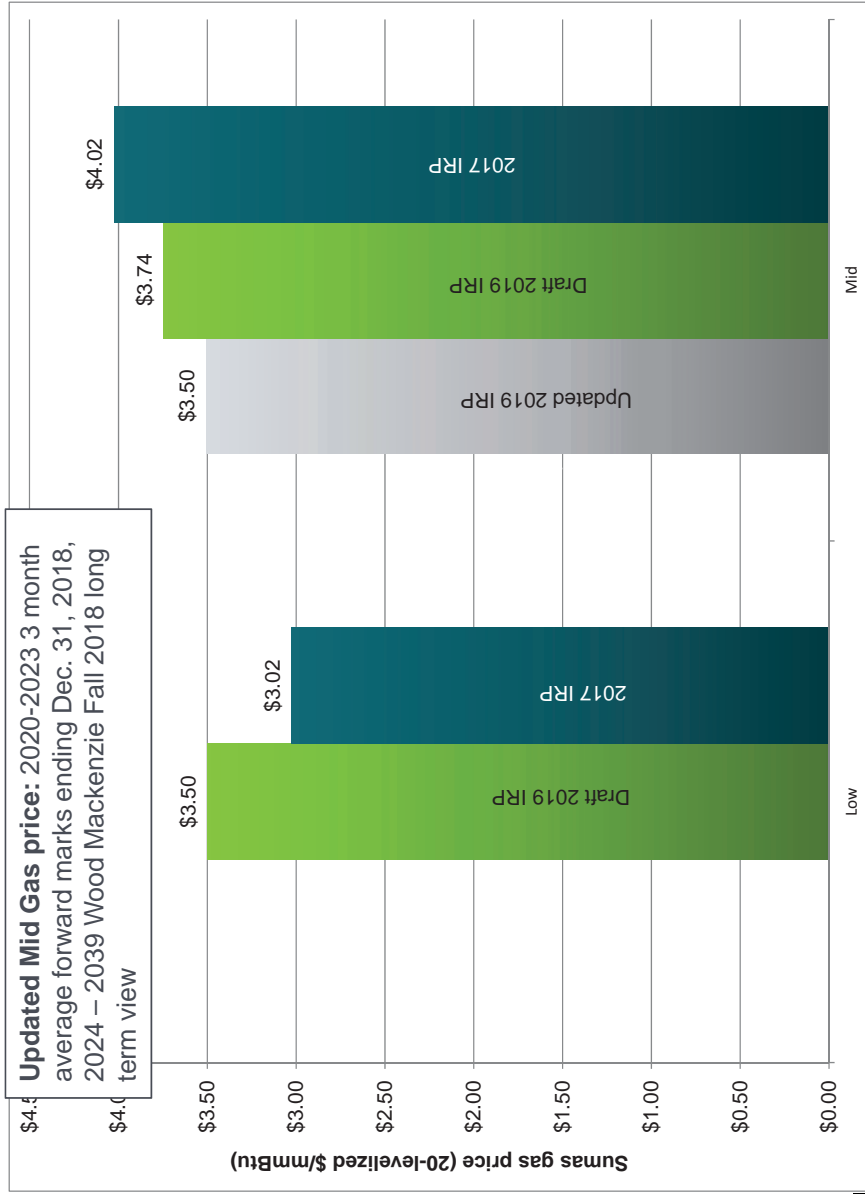

# Carbon prices

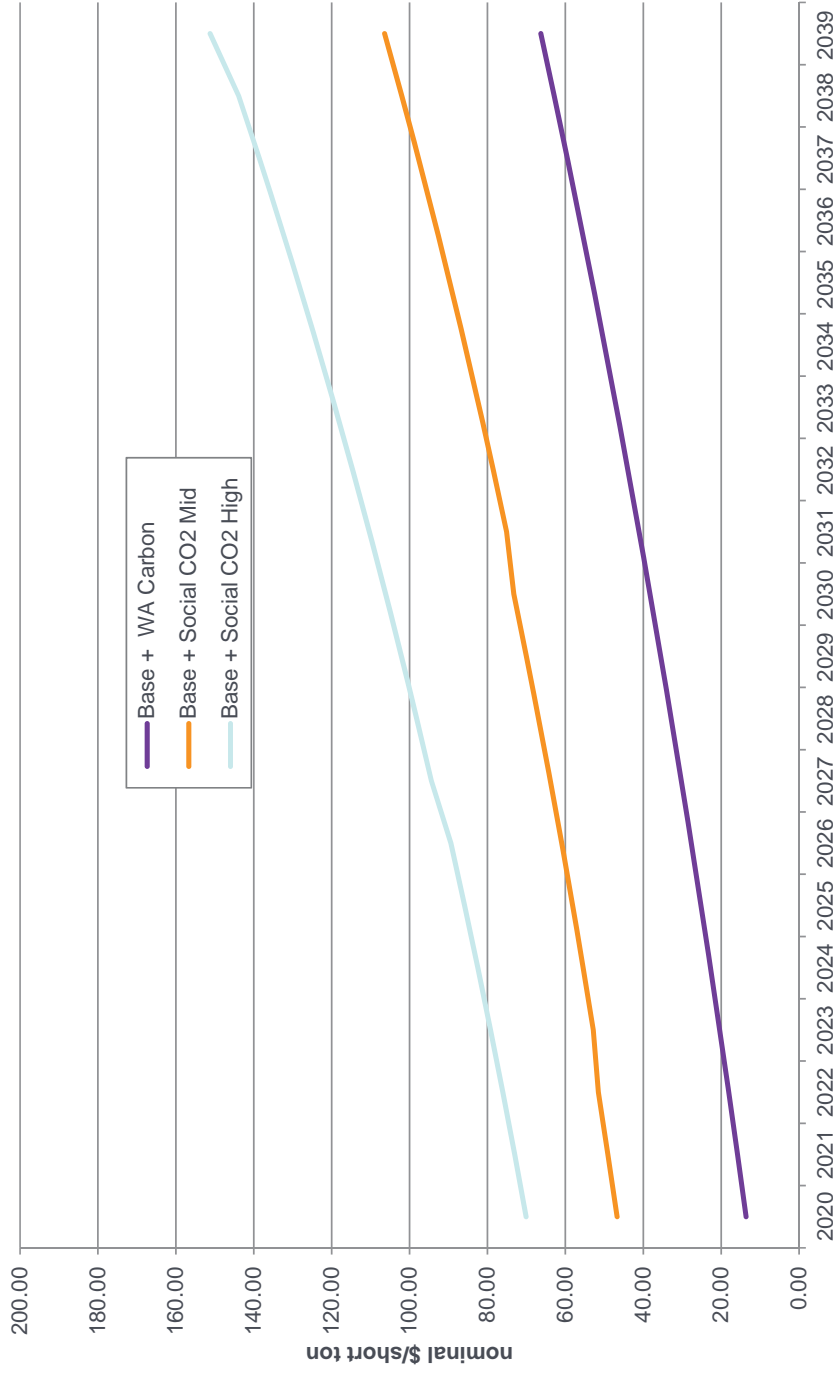

# Phase 1: Comparison of generic resource costs

2018 \$/kW	2017 IRP			2019 IRP			Change in costs from 2019 IRP to 2017 IRP		
	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	All in Costs
CCCT	\$1,020	\$358	\$1,378	\$698	\$269	\$1,167	(\$122)	(\$69)	(\$211)
Frame Peaker (Fuel Fuel)	\$526	\$172	\$698	\$554	\$271	\$825	\$28	\$99	\$127
Recip Engine (NG only)	\$1,030	\$312	\$1,341	\$842	\$350	\$1,192	(\$188)	\$38	(\$149)
WA Wind	\$1,548	\$656	\$2,204	\$1,656	\$386	\$2,042	\$108	(\$270)	(\$162)
MT Wind	\$1,471	\$1,312	\$2,783	\$1,633	\$1,111	\$2,744	\$162	(\$201)	(\$39)
Solar	\$1,497	\$874	\$2,371	\$1,352	\$570	\$1,922	(\$145)	(\$304)	(\$449)
Biomass	\$4,084	\$207	\$4,291	\$7,036	\$2,659	\$9,695	\$2,952	\$2,452	\$5,404
Offshore Wind	\$5,717	\$1,795	\$7,512	\$5,000	\$1,547	\$6,547	(\$717)	(\$248)	(\$965)
Li-Ion Battery 2-hr	\$1,313	\$342	\$1,655	\$1,331	\$599	\$1,930	\$18	\$257	\$275
Li-Ion Battery 4-hr	\$2,116	\$552	\$2,668	\$2,346	\$708	\$3,054	\$230	\$156	\$386
Flow Battery 4-hr	\$1,870	\$674	\$2,544	\$1,493	\$618	\$2,111	(\$377)	(\$56)	(\$433)
Flow Battery 6-hr	\$2,447	\$882	\$3,329	\$2,050	\$708	\$2,758	(\$397)	(\$174)	(\$571)
Pumped Storage	\$2,503	\$127	\$2,630	\$1,800	\$879	\$2,679	(\$703)	\$752	\$49



## Phase 2: Generic resource costs

---

Generic resource capital costs updated from HDR final report as part of the 2019 IRP.

### Cost updates include:

- Frame peaker FOM cost
  - Draft: \$3.93/kw-yr
  - Update: \$11.40/kw-yr
- \$11.40/kw-yr includes \$3.93/kw-yr FOM + \$7.47/kw-yr for 48 hours of oil.
- MT wind capital cost
  - Draft: \$2,744/kw
  - Update: \$1,617/kw
- WA wind capital cost
  - Draft: \$2,042/kw
  - Update: \$1,633/kw
- Solar capital cost
  - Draft: \$1,922/kw
  - Update: \$1,614/kw




# PSE will also update ELCC modeling assumptions to reflect current draft 2019 IRP assumptions

Resource	Nameplate (MW)	IRP 2017 Peak Capacity Solve to 5% LOLP Relative to <u>New</u> Peaker	IRP 2019 Peak Capacity Solve to 5% LOLP Relative to <u>Perfect</u> Capacity
Existing Wind	823	11%	8%
Skookumchuck	131	40%	37%
Green Direct 2 Solar	150	N/A	18%
Generic Montana Wind	100	49%	53%
Generic Washington Wind	100	16%	4%
Generic Offshore WA Wind	100	51%	42%
Generic Washington Solar	100	0%	10%
Energy Limited Resources	Nameplate (MW)	IRP 2017 Peak Capacity EUE at 5% LOLP	IRP 2019 Peak Capacity EUE at 5% LOLP
Lithium-Ion Battery 2 hr, 82% RT efficiency	25	60%	21%
Lithium-Ion Battery 4 hr, 87% RT efficiency	25	88%	42%
Flow Battery 4 hr, 73% RT efficiency	25	76%	39%
Flow Battery 6 hr, 73% RT efficiency	25	N/A	50%
Demand Response 3 hr duration, 6 hr delay	100	77%	40%

Source: 2019 IRTAG Meeting #5 presentation




# Projects are evaluated on a cost and risk basis delivered to PSE's load

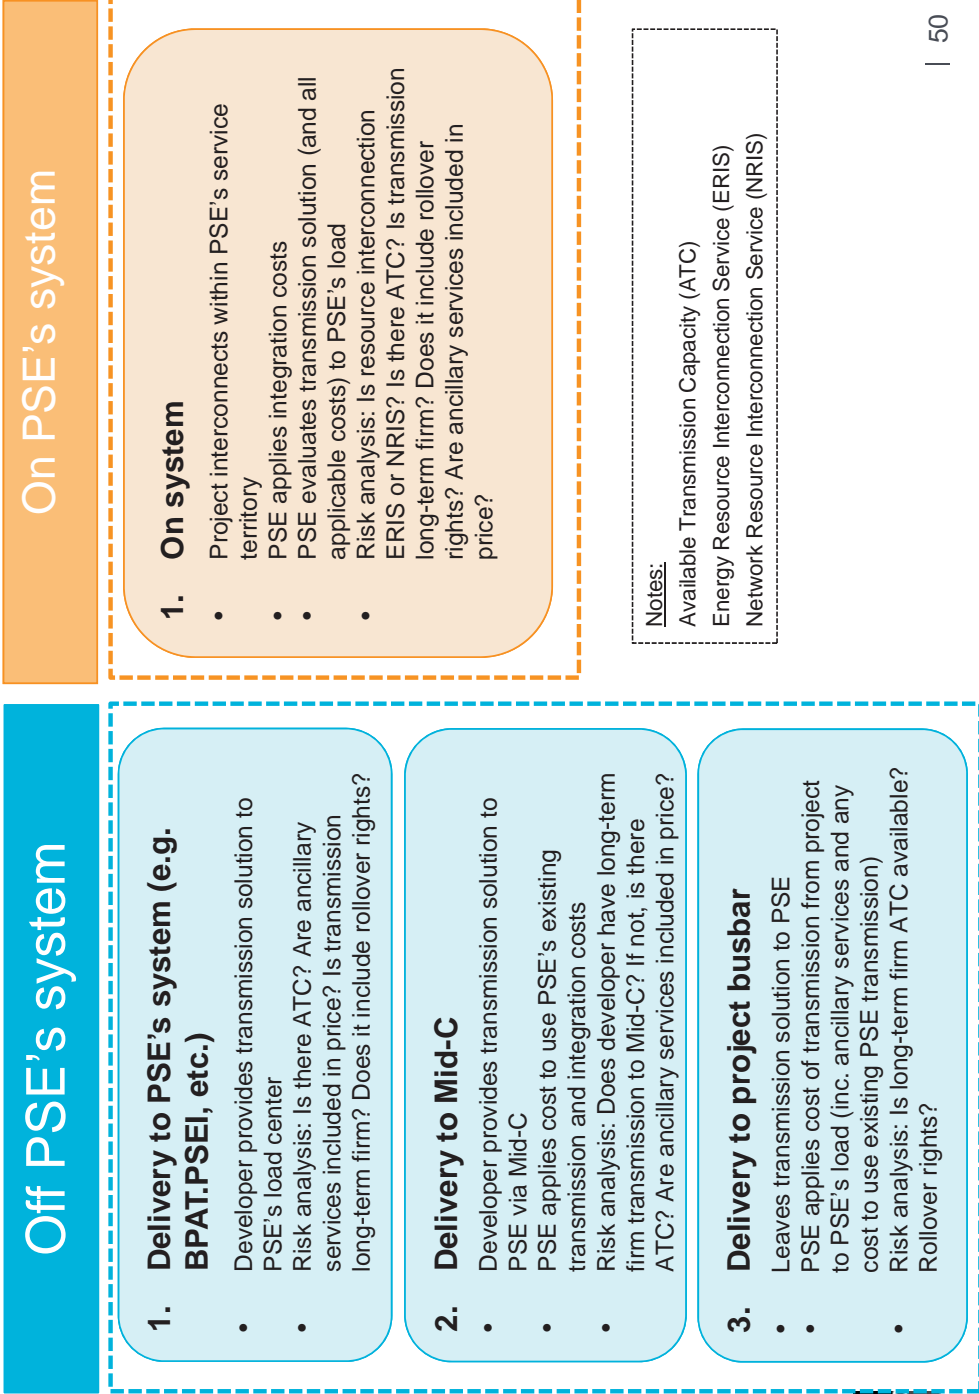



# Montana transmission path

PTP = Point to Point transmission rate

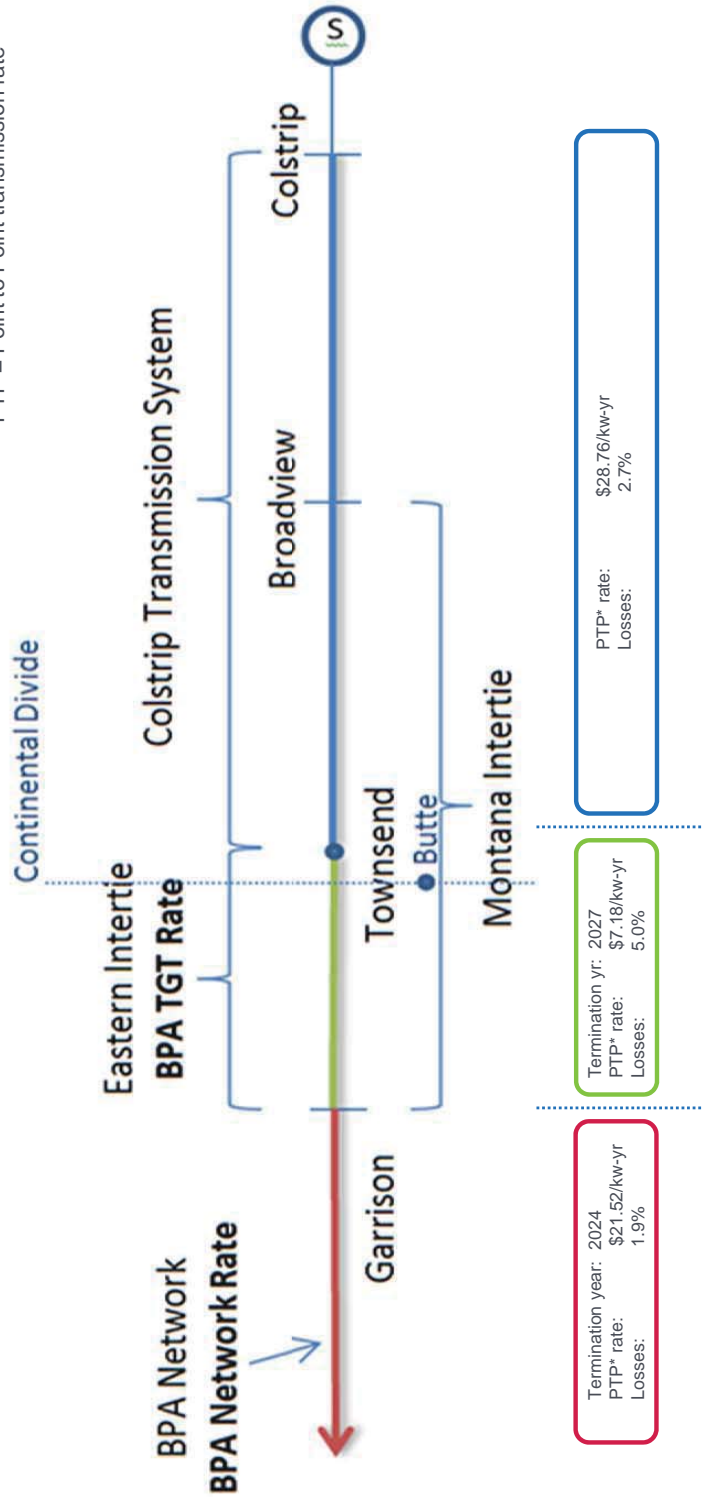

Other costs to consider:

- Additional losses from the project to the delivery point
- Renewable integration costs



## Appendix 2: Additional proposal summary slides







# Proposals received

Resource type	# Proposals	Size range (MW / RECs, roughly)
Solar	36	35 – 290 MW
Wind	20	45 – 500 MW
Storage – battery	17	10 – 200 MW / 30 – 800 MWh
Storage – pumped hydro	2	330 – 500 MW
Biomass	3	10 – 55 MW
Natural Gas-fired Gen.	4	50 – 620 MW
Geothermal	2	15-25 MW
Hydro - run of river	1	40 MW
System PPA / Call Option	1	100 MW
Unbundled RECs	5	35,000 - 130,000 RECs
Demand Response	6	20-40 MW
<b>Total</b>	<b>97</b>	



# Candidate list for Phase 2



	Biomass
	Hydro – run of river
	Natural gas-fired generation
	Solar - PV
	Solar + BESS
	Wind

Map does not include REC-only (3) or demand response (1) offers.

REDACTED  
VERSION



## Appendix 3: Additional demand response slides

# DR resource objectives

---

## **Primary Objectives:**

- Ensure DR resource is cost effective and is available:
  - November 1 – February 28/29
  - Weekdays, 7 a.m. – 10 a.m. and 5 p.m. – 9 p.m.
- Provide load response with one of the following options:
  - Hour ahead notification,
  - Day ahead notification, or
  - A combination of hour ahead and day ahead notification
- Total event time  $\leq$  40 hours per individual product per season

## **Secondary Objectives:**

- Develop flexible DR capability
  - Provide fast response with notification time of  $\leq$ 10 minutes



# PAC and TRC tests

PSE will evaluate the cost-effectiveness of proposals in two ways: using the Program Administrator Cost Test (PAC) and Total Resource Cost (TRC) Test

Benefits	PAC	TRC
Avoided Capacity Costs	✓	✓
Avoided Energy Costs	✓	✓
Avoided Transmission & Distribution Costs	✓	✓
Avoided Environmental Compliance Costs	✓	✓
Costs	PAC	TRC
Program Administrator Expenses	✓	✓
Program Administrator Capital Costs	✓	✓
Financial Incentive to Participant	✓	x
DR Measure Cost: Program Administrator	✓	✓
DR Measure Cost: Participant Contribution	x	✓
Participant Transaction Costs	x	✓
Participant Value of Lost Service	x	✓
Increased Energy Consumption	✓	✓
Environmental Compliance Costs	✓	✓

Source: Demand Response RFP, Exhibit D: Cost-effectiveness Evaluation Criteria, Tables 1 and 2



# DR proposals phase I results summary

ID	Project Name	Resource Type	Nameplate	Term	State	Phase I Results
18200	[REDACTED]	DLC	MW	2019-23	[REDACTED]	Not Selected
18201	[REDACTED]	DLC	MW	2023-28	[REDACTED]	Selected
18201	[REDACTED]	DLC	MW	2023-28	[REDACTED]	Not Selected
18201	[REDACTED]	DLC	MW	2023-28	[REDACTED]	Not Selected
18202	[REDACTED]	DLC	MW	2019-28	[REDACTED]	Not Selected
18203	[REDACTED]	BDR + DLC	MW	2019-23	[REDACTED]	Not Selected
18204	[REDACTED]	C&I	MW	2019-23	[REDACTED]	Not Selected
18205	[REDACTED]	C&I	MW	2019-23	[REDACTED]	Not Selected

- PSE received 4 Direct Load Control (DLC) and 2 Commercial & Industrial Curtailment (C&I) proposals. Max proposed MWs between 21.5-40 MWs.
- [REDACTED] – Option 1 is the only project selected for phase II evaluation primarily based on cost-benefit analysis.

REDACTED VERSION





2018 RFP Phase I Quantitative Results Summary - Renewable Resource

Project ID	Project	Nameplate	Levelized Cost			Portfolio Benefit / REC			Portfolio Benefit Ratio			Net Cost / REC		
			All Scenarios \$/MWh	NO CO2 \$/MWh	CO2 Fee \$/MWh	Societal \$/MWh	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 \$/REC	CO2 Fee \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank
18109	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18110	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18111	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18112	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18113	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18114	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18115	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18116	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18117	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18118	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18119	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18120	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18121	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18122	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18123	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18124	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18125	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18126	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18127	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18128	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18129	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18130	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18131	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18132	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18133	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18134	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18135	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18136	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18137	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18138	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18139	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18140	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18141	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18142	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18143	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18144	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18145	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18146	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18147	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18148	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18149	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18150	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18151	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18152	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18153	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18154	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18155	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18156	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18157	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18158	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18159	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18160	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18161	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18162	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18163	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18164	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18165	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18166	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18167	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18168	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18169	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18170	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18171	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18172	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18173	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18174	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18175	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18176	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18177	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18178	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18179	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18180	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18181	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18182	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18183	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18184	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18185	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18186	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18187	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18188	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18189	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18190	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18191	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18192	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18193	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18194	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18195	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18196	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18197	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18198	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18199	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	
18200	MW		5	1	6	79	-2.7	-1.6	39	105	7	6	135	

REDACTED VERSION

REDACTED VERSION



Project ID	Project	Nameplate	Levelized Cost			Portfolio Benefit / REC			Portfolio Benefit Ratio			Net Cost/REC				
			All Scenarios \$/MWh	NO CO2 \$/REC	Rank	NO CO2 \$/REC	Societal \$/REC	NO CO2 Rank	CO2 Fee Rank	Societal Rank	NO CO2 Rank	CO2 Fee Rank	Societal Rank	NO CO2 Rank	CO2 Fee Rank	Societal Rank
181106		MW	N/A													
181107		MW	N/A													
181111		MW	N/A													
181116		MW	N/A													
181118		MW	N/A													
181119		MW	N/A													
181120		MW	N/A													
181121		MW	N/A													
181122		MW	N/A													
181123		MW	N/A													
181124		MW	N/A													
181125		MW	N/A													
181126		MW	N/A													
181127		MW	N/A													
181128		MW	N/A													
181129		MW	N/A													
181130		MW	N/A													
181131		MW	N/A													
181132		MW	N/A													
181133		MW	N/A													
181134		MW	N/A													
181135		MW	N/A													
181136		MW	N/A													
181137		MW	N/A													
181138		MW	N/A													
181139		MW	N/A													
181140		MW	N/A													
181141		MW	N/A													
181142		MW	N/A													
181143		MW	N/A													
181144		MW	N/A													
181145		MW	N/A													
181146		MW	N/A													
181147		MW	N/A													
181148		MW	N/A													
181149		MW	N/A													
181150		MW	N/A													
181151		MW	N/A													
181152		MW	N/A													
181153		MW	N/A													
181154		MW	N/A													
181155		MW	N/A													
181156		MW	N/A													
181157		MW	N/A													
181158		MW	N/A													
181159		MW	N/A													
181160		MW	N/A													
181161		MW	N/A													
181162		MW	N/A													
181163		MW	N/A													
181164		MW	N/A													
181165		MW	N/A													
181166		MW	N/A													
181167		MW	N/A													
181168		MW	N/A													
181169		MW	N/A													
181170		MW	N/A													
181171		MW	N/A													
181172		MW	N/A													
181173		MW	N/A													
181174		MW	N/A													
181175		MW	N/A													
181176		MW	N/A													
181177		MW	N/A													
181178		MW	N/A													
181179		MW	N/A													
181180		MW	N/A													
181181		MW	N/A													
181182		MW	N/A													
181183		MW	N/A													
181184		MW	N/A													
181185		MW	N/A													
181186		MW	N/A													
181187		MW	N/A													
181188		MW	N/A													
181189		MW	N/A													
181190		MW	N/A													
181191		MW	N/A													
181192		MW	N/A													
181193		MW	N/A													
181194		MW	N/A													
181195		MW	N/A													
181196		MW	N/A													
181197		MW	N/A													
181198		MW	N/A													
181199		MW	N/A													
181200		MW	N/A													

REDACTED  
VERSION

# 2018 RFP Phase I Quantitative Results Summary - Capacity Resource

Project ID	Project	NAME/PLATE	Levelized Cost		Portfolio Benefit / kW-yr			Net Cost / kW-yr		
			All Scenarios \$/MWh	Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-yr	Societal Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-yr	Societal Rank
18169		MW	\$	16	1	2	2	1	2	2
18169		MW	\$	27	2	3	3	10	3	3
18173		MW	\$	50	3	1	1	6	1	1
18176		MW	\$	32	4	4	5	3	4	6
18173		MW	\$	47	5	5	4	4	5	4
18100	SPI Industrial Biomass	17 MW	\$	98	6	6	6	46	28	7
18105		MW	\$	150	7	10	10	2	8	11
18105		MW	\$	162	8	9	15	5	12	18
XXXXX		MW	\$	160	9	8	9	7	9	9
18105		MW	\$	160	10	14	11	9	15	12
18105		MW	\$	152	11	11	12	12	11	15
18170	Golden Hill Shaped	200 MW	\$	42	12	7	8	8	7	10
18105		MW	\$	161	13	13	16	13	16	19
18201		MW	\$	25	14	12	17	11	10	14
18103		MW	\$	25	15	17	20	15	6	24
18201		MW	\$	117	16	16	18	14	17	16
18104		MW	\$	117	17	21	25	17	25	13
18202		MW	\$	114	18	18	19	18	19	21
18104		MW	\$	114	19	24	26	16	22	29
18201		MW	\$	151	20	20	21	19	20	23
18105		MW	\$	151	21	23	23	20	24	25
18105		MW	\$	154	23	27	22	21	30	26
18105		MW	\$	155	24	26	24	23	27	27
18104		MW	\$	155	25	28	28	24	33	34
18104		MW	\$	92	26	31	29	22	32	32
18145		MW	\$	38	27	57	53	26	38	28
18104		MW	\$	156	29	37	27	25	40	33
18159		MW	\$	156	30	36	30	27	41	37
UP001		MW	\$		31	51	37	30	48	5
18203		MW	\$		32	46	34	28	47	40
18156/18158		MW	\$		33	45	59	29	46	42
18157		MW	\$		34	44	61	32	52	43
18145		MW	\$		35	80	74	31	29	22
18156/18158		MW	\$		36	42	62	33	42	46
18188		MW	\$		37	52	36	35	56	49
18157		MW	\$	158	38	41	63	34	54	47
18156/18158		MW	\$		39	48	80	36	51	48
18157		MW	\$		40	68	81	37	55	50
18156/18158		MW	\$		41	35	82	39	51	51
18145		MW	\$		42	95	71	48	31	20
18157		MW	\$		43	62	83	41	59	52
18156/18158		MW	\$		44	34	56	40	37	30
18188		MW	\$		45	56	45	43	60	64
18157		MW	\$	159	46	38	58	42	39	31
18107		MW	\$		47	29	7	38	26	8
18144		MW	\$	114	48	53	42	44	49	53
18147		MW	\$		49	49	32	45	53	39
18156/18158		MW	\$		50	43	77	47	43	35
18157		MW	\$		51	61	79	49	44	38
18156/18158		MW	\$		52	54	87	52	66	76
18156/18158		MW	\$		53	25	104	63	18	87
18156/18158		MW	\$		54	88	70	53	99	77
18200		MW	\$		55	59	33	51	64	61
18152		MW	\$		56	81	50	50	84	44
18147		MW	\$		57	58	38	54	62	54
18156/18158		MW	\$		58	30	97	55	36	66

REDACTED VERSION

REDACTED VERSION

Project ID	Project	NAMEPLATE	Levelized Cost All Scenarios \$/MWh	Portfolio Benefit / kW-yr			Net Cost / kW-yr		
				NO CO2 \$/kW-yr	CO2 Fee \$/kW-Societal \$/kW-yr	Rank	NO CO2 \$/kW-yr	CO2 Fee \$/kW-Societal \$/kW-yr	Rank
18157		MW		59	103	86	65	63	65
18157		MW		60	99	98	57	71	68
18156 / 18158		MW		61	22	99	58	23	70
18147		MW		62	60	39	60	65	55
18157		MW		63	93	72	70	77	67
18157		MW		64	97	100	61	73	72
18152		MW		65	87	35	56	58	44
18155		MW		66	64	40	62	68	57
18205		MW		67	72	49	59	72	71
18155		MW		68	65	41	64	69	60
18156 / 18158		MW		69	19	95	66	21	56
18157		MW		70	96	96	69	61	58
18146		MW		71	63	67	68	14	62
18145		MW		72	40	68	67	92	17
18155		MW		73	71	44	71	74	63
18143		MW		74	76	47	73	80	75
18151		MW		75	83	65	72	85	84
18154		MW		76	75	46	74	79	69
18157		MW		77	106	102	80	82	82
18154		MW		78	77	48	76	81	74
18152		MW		79	90	57	75	94	86
18148		MW		80	70	76	78	79	79
18146		MW		81	79	69	77	34	73
18154		MW		82	82	51	78	87	78
18155		MW		83	86	52	81	93	81
18143		MW		84	89	54	83	95	85
18152		MW		85	66	43	82	67	59
18155		MW		86	84	55	84	91	83
18154		MW		87	92	60	86	98	88
18154		MW		88	91	64	88	97	89
18204		MW		89	94	73	89	100	91
18149		MW		90	67	101	91	75	94
18155		MW		91	98	66	90	101	92
18149 / 18153		MW		92	73	105	97	86	99
18154		MW		93	100	75	92	102	93
18143		MW		94	101	78	94	103	96
18149		MW		95	55	90	93	57	95
18149		MW		96	47	88	95	45	97
18160		MW		97	104	93	96	106	109
18189		MW		98	33	89	98	35	103
18149 / 18153		MW		99	69	103	99	70	100
18150		MW		100	78	85	100	83	101
18149 / 18153		MW		101	105	106	101	89	102
18160		MW		102	102	84	102	104	98
18150		MW		103	74	91	103	76	80
18150		MW		104	85	92	105	88	104
18189		MW		105	90	94	104	50	108
18159		MW		106	107	107	107	107	107
18161	BPA Peak Capacity Product	100MW							
18143		MW							

REDACTED VERSION

REDACTED VERSION

# 2018 All Resources and Demand Response RFPs



***Update to WUTC: RFP Results and Short List (Draft)***

December 20, 2019

# Agenda

---

- Introduction and level set to Phase 2
  - RFP timeline
  - Updated resource need
  - Updated Phase 2 candidate list
- Phase 2 evaluation process
  - Process overview
  - Updated assumptions and scenarios
- Phase 2 results and short list (April – July 2019)
- Post-RFP re-evaluation of alternatives (August – December 2019)
  - Updated assumptions, RFP pricing and two new proposals
  - Updated optimization results
  - Revised short list
  - Overview of selected offers



# 1


## Introduction

Presenter: Cindy Song



# RFP timeline and UTC staff updates

PSE last met with UTC staff in April to present Phase 1 results

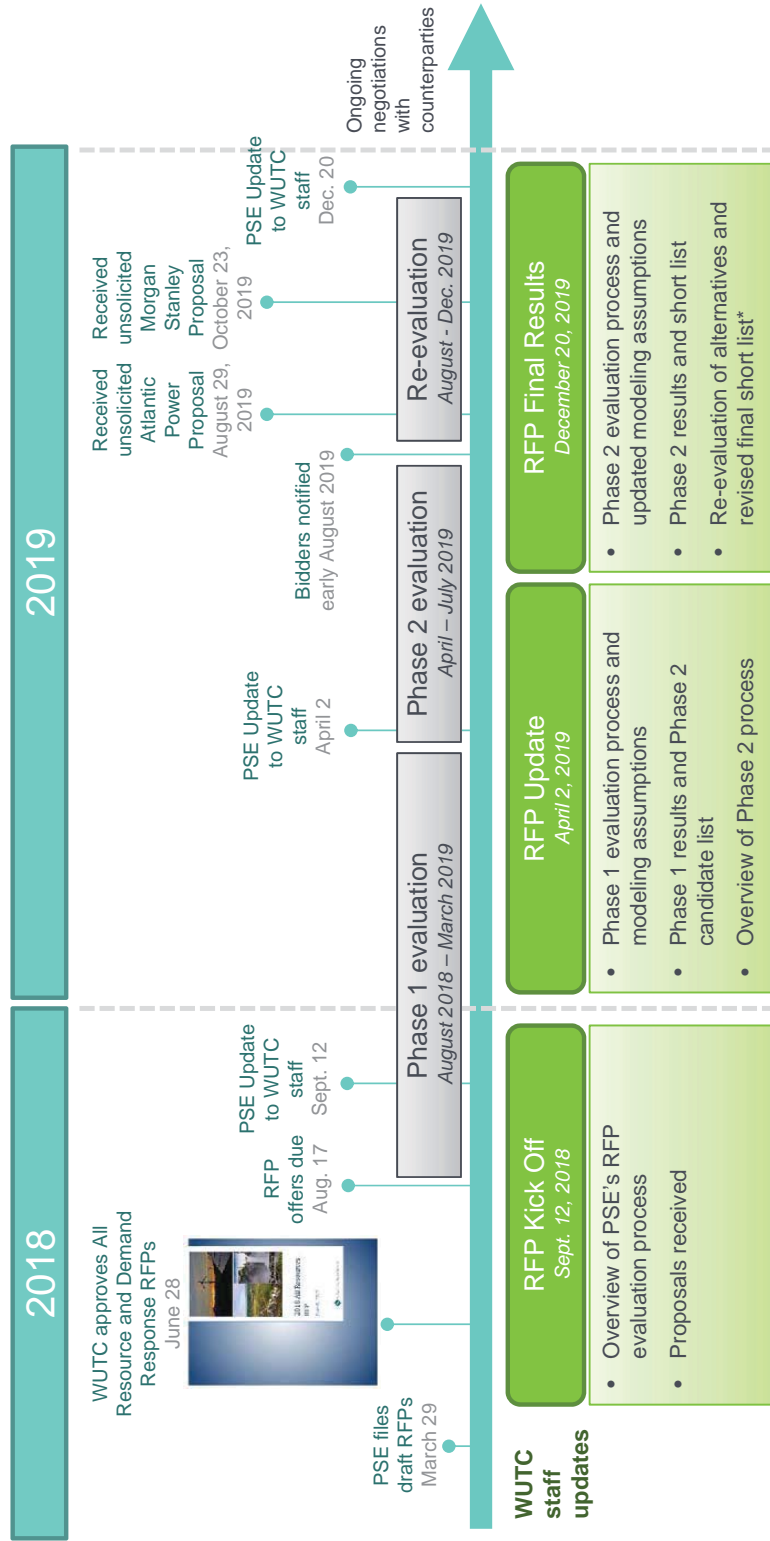


\*After selecting a short list at the end of the Phase 2 analysis and notifying respondents of their status, PSE received new proposals from Atlantic Power and Morgan Stanley. PSE performed a re-evaluation of its alternatives and subsequently revised its short list.




# Capacity resource need updated to 299MW in 2022 and REC need updated to 233,449 RECs in 2023\*

Resource need forecasts updated in Phase 2 analysis to reflect draft 2019 IRP need assessments and F2019 load forecast (net conservation)

- 2018 RFP Capacity Need – Phase 2 update**
- PSE seeks 299 MW capacity by end of 2022; near-term gap in 2020-2021 to be filled by short-term RFP
  - Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably
  - Need based on F2019 forecast net conservation (from 2017 IRP), 2019 IRP planning margin

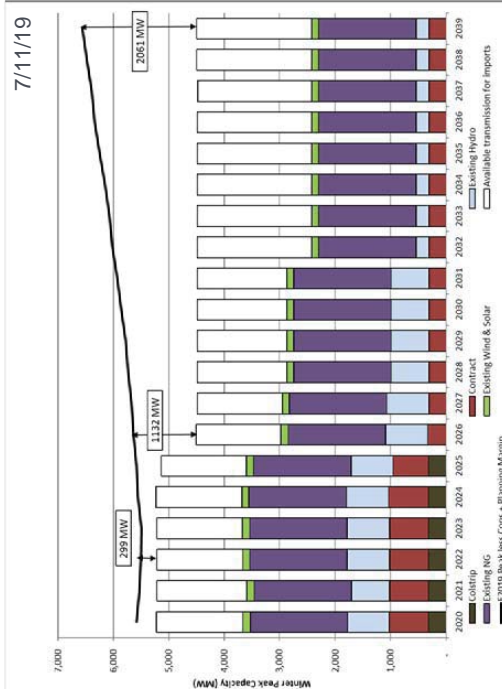

- 2018 RFP REC Need – Phase 2 update\*\***
- REC need is driven by the increase in the RPS from 9% to 15% in 2020
  - Projected need to meet the RPS is 233,449 RECs by 2023
  - PSE's inventory of banked RECs delays need until 2023

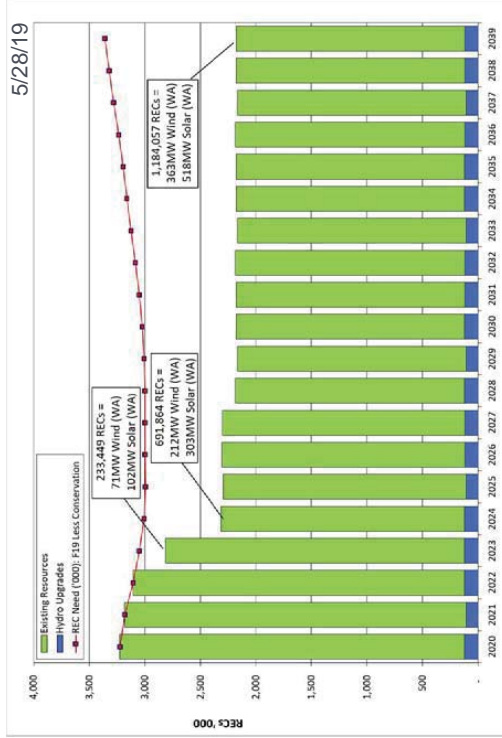

\*\*Original RFP issued to fill 272 MW capacity need in 2022 and renewable need in 2023.

\*\*REC need reflects renewable need driven by RCW 19.285 (RPS). It does not reflect the impact of SB 5116 (Clean Energy Transformation Act).

# PSE received 97 proposals in response to the 2018 RFPs 27 proposals advanced to Phase 2 for further analysis

Proposals selected for Phase 2 evaluation reflect resource and technology diversity

Phase 2 candidate list revised after April 2019 WUTC staff update due to the following changes:

- 1 solar proposal withdrawn by respondent (removed)
- 1 unsolicited REC and 1 demand response proposal reduced pricing (added)
- 1 system PPA/call option moved delivery point from Mid-C to BPAT.PSEI (added)

Updated 6/20/19	Proposals Received *		Phase 2 Candidate List		Revised Phase 2 Candidate List **	
	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW
Solar - PV	16	2240	8	1050	7	890
Solar - PV + BESS	20	2848	1	100	1	100
Wind - Off Shore	1	400	0	0	0	0
Wind On Shore	16	3303	7	1642	7	1642
Wind + Winter Sys PPA	1	371	1	200	1	200
Wind + Solar and/or BESS	2	464	0	0	0	0
Storage - Battery ("BESS")	17	1265	0	0	0	0
Storage - Pumped Hydro	2	900	0	0	0	0
Biomass	2	72	1	17	1	17
Biomass + BESS	1	15	0	0	0	0
Natural Gas-fired Generation	4	1377	2	348	2	348
Geothermal	2	43	0	0	0	0
Hydro - Run of River	1	38	1	38	1	38
System PPA / Call Option	1	100	0	0	1	100
Unbundled RECs	5	n/a	3	n/a	4	n/a
Demand Response	6	154	1	8.7	2	33.7
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>25</b>	<b>3,404</b>	<b>27</b>	<b>3,369</b>

\* In addition to the 97 RFP proposals shown above, PSE also received two unsolicited proposals during Phase 1 (a pumped hydro and a REC-only proposal) and three unsolicited proposals during Phase 2 (all solar). None of these offers were competitive with the RFP proposals. However, the REC-only proposal price was reduced in Phase 2 and the proposal was added to the revised candidate list.  
 \*\* See Slide 7 for a list of proposals evaluated in Phase 2.



# Phase 2 candidate list<sup>1,2</sup>

ID	Project Name	Resource Type	Nameplate	Counterparty	State
1	18100 SPI Industrial	Biomass	17 MW	SPI	WA
2	18201	Demand Response	MW		WA
3	18205	Demand Response	MW		MA
4	18169	MT Wind	MW		MT
5	18173	MT Wind	MW*		MT
6	18176	MT Wind	MW*		MT
7	18163	REC Only	REC		OR
8	18165	REC Only	REC		OR
9	18190	REC Only	REC		WA
10	UP002	REC Only	REC		ID
11	18107	Run-of-River	MW		ID
12	18135	Solar	MW		WA
13	18111	Solar	MW		WA
14	18122	Solar	MW		WA
15	18131	Solar	MW		WA
16	18127	Solar	MW		WA
17	18114	Solar	MW		WA
18	18125	Solar	MW		WA
19	18139	Solar + BESS	MW BESS		OR
20	18105	Thermal	MW		OR
21	18103	Thermal	MW		OR
22	18161	Sys PPA/Call Opt.	MW		OR
23	XXXXX	Transmission	MW		OR
24	18175	Wind	MW		WA
25	18132	Wind	MW*		OR
26	18179	Wind	MW		WA
27	18170 Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
28	18166	Wind	MW		OR

\* Numbers shown are rounded to the nearest 5 MW.

\*\* Reflects a redirect of MW of BPA transmission from [REDACTED] to PSEI, available January, 2022 for a 50-year term, and using Mid-C forecast for energy pricing. MW may be available for redirect on BPA's system, however it is likely only MW is possible for redirect to Mid-C. Redirects are assessed given the most current data and are a snap shot of the present system. The results are subject to change and may vary in the future based on updated ATC calculations and flow gate constraints within BPA's network. While redirect of the remaining MW is feasible, the location, source and cost of this redirect remains under review, therefore not included in this analysis.

\*\*\* [REDACTED] (formerly [REDACTED] Solar) (#18111)

<sup>1</sup>The candidate list reflects the best offer from each proposal.

<sup>2</sup>The list was revised early in Phase 2 to remove the [REDACTED] proposal (#18112) (withdrawn developer), and to add the BPA Peak Capacity Product (#16161) (adjusted original delivery point from Mid-C to BPAT,PSEI), the [REDACTED] proposal (#18205) (replaced after Phase 1 elimination) and the unsolicited [REDACTED] proposal (#UP002) (replaced after Phase 1 elimination).

REDACTED  
VERSION


2

## Phase 2 evaluation process

Presenter: Bob Williams

# How is Phase 2 different than Phase 1?

In Phase 1, we give proposals a reasonable benefit of the doubt; in Phase 2, we verify

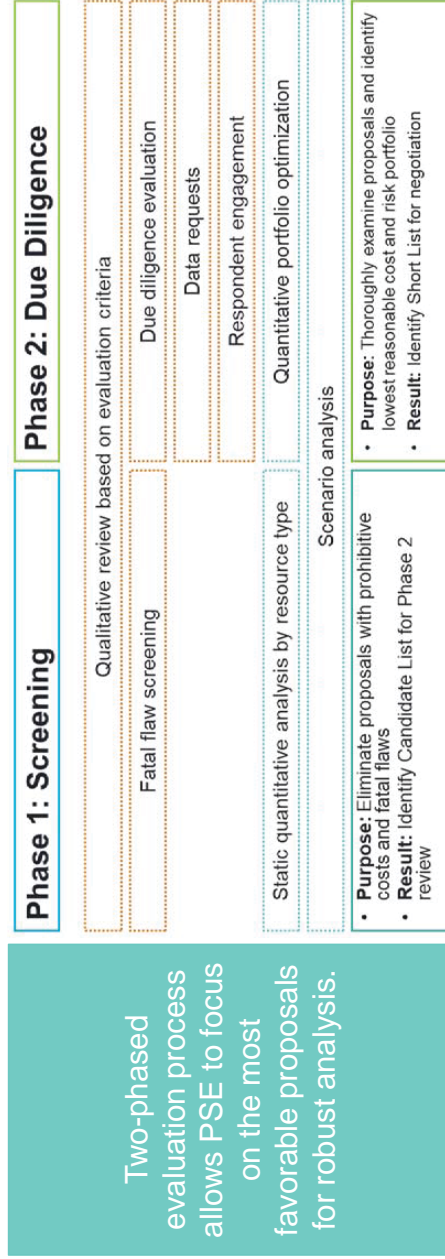


- Phase 1 analysis relied on the proposals and public information sources; Phase 2 involved more interaction with respondents and a deeper dive into the details of each proposal
- Phase 2 quantitative analysis included:
  - Updated quantitative assumptions
  - Optimization analysis and updated standalone portfolio screening analysis in the Portfolio Screening Model (PSM)



# Phase 2 uses the same evaluation criteria and models as Phase 1

Process includes detailed, cross-functional due diligence to evaluate the costs, risks and merits of each proposal

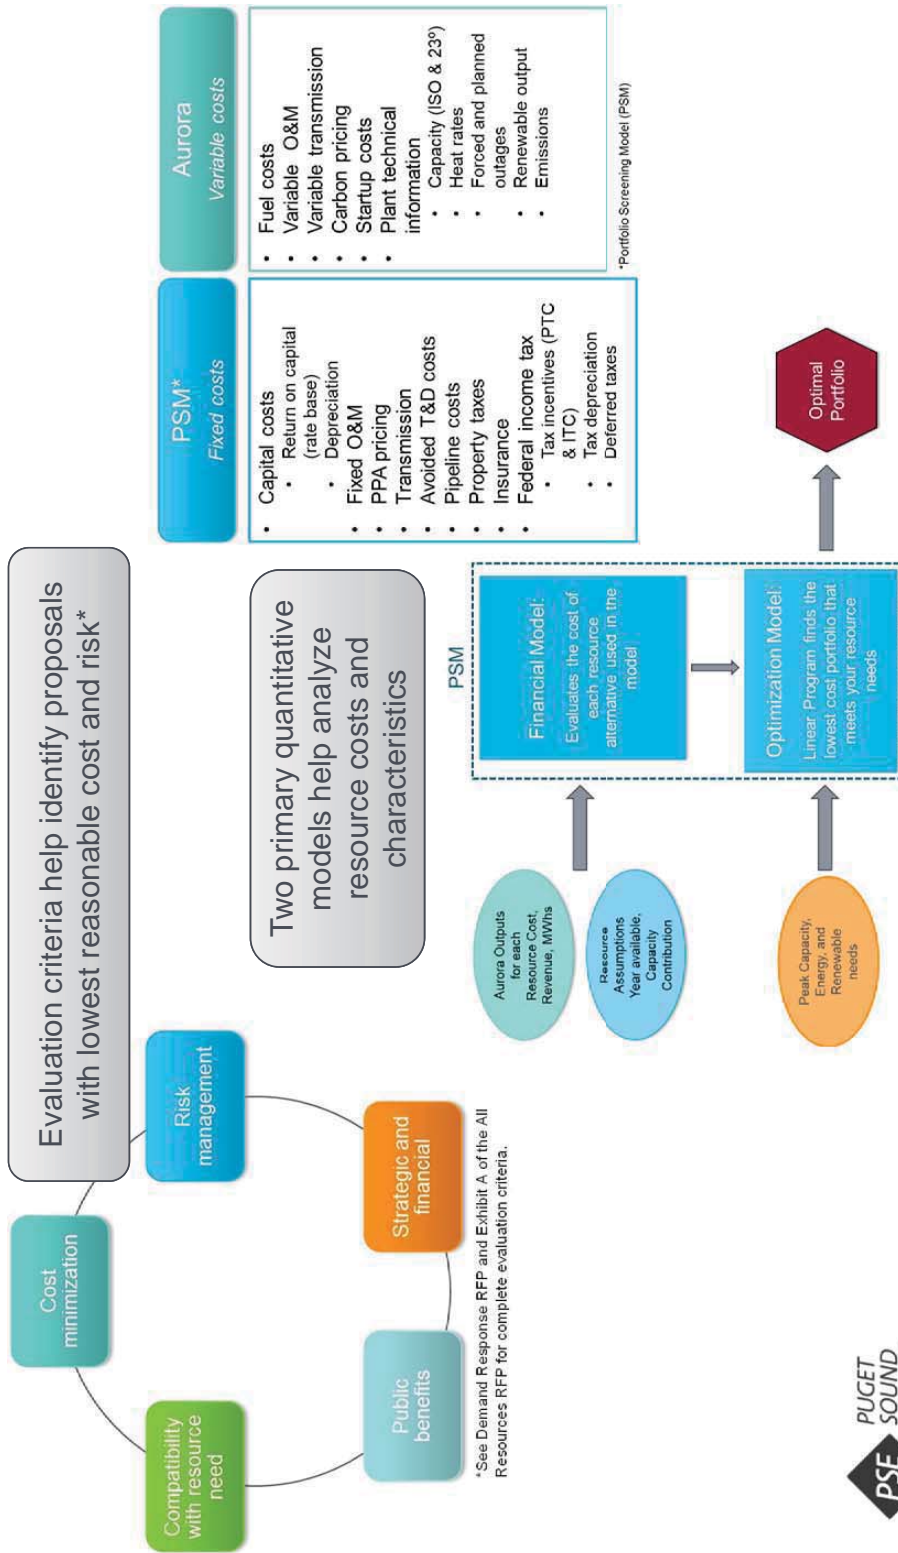

December 20, 2019: 2018 All Resources RFP | 10



# Phase 2 uses the same quantitative screening metrics as Phase 1

Key metrics allow PSE to compare and rank resources with different characteristics and capacities\*

<p><b>Portfolio benefit (\$)</b></p> <p><i>Useful for comparing projects with similar contribution to PSE's winter capacity or renewable needs</i></p> <ul style="list-style-type: none"> <li>Difference between the net present value portfolio revenue requirement with the proposed project and the net present value portfolio revenue requirement without the proposed project (the all generic portfolio)</li> </ul>	Higher is better
<p><b>Levelized cost (\$/MWh)</b></p> <p><i>Useful for comparing projects with the same or similar operating characteristics</i></p> <ul style="list-style-type: none"> <li>The net present value of the proposed project's revenue requirement divided by the net present value of the proposed project's generation</li> </ul>	Lower is better
<p><b>Levelized portfolio benefit per REC (\$PB/REC)</b></p> <p><i>Useful for comparing different project sizes and different technologies</i></p> <ul style="list-style-type: none"> <li>A proposed project's portfolio benefit divided by the renewable energy credits (REC) it would contribute to help meet PSE's renewable need</li> </ul>	Higher is better
<p><b>Levelized portfolio benefit per unit of levelized peak capacity (\$PB/kW-yr)</b></p> <p><i>Useful for comparing different project sizes and different technologies</i></p> <ul style="list-style-type: none"> <li>A project's portfolio benefit divided by the capacity it would contribute to help meet PSE's winter capacity need</li> </ul>	Higher is better



\*Primary quantitative screening metrics shown here. Additional metrics shown in appendix.



# Modeling assumptions were updated as new information became available\*

Modeling Assumption	2017 IRP (filed Nov. 2017)	RFP Phase 1 (Aug. 2018 – Mar. 2019)	RFP Phase 2 (Apr. 2019 – Jul. 2019)	RFP Phase 2 Update (Aug. 2019 – Nov. 2019)
Mid-C power prices levelized	\$40.48/MWh	\$33.92/MWh	\$28.75/MWh**	\$23.66/MWh***
Gas prices levelized	\$4.02/mmbtu	\$3.74/mmbtu	\$3.56/mmbtu	No change
Annual average load growth	0.7%	0.5%	0.5%	No change

\*Other updates include testing a wider range of carbon costs (Slides 13 and 41), updating Effective Load Carrying Capability (“ELCC”) values for generic resources to reflect 2019 IRP assumptions (Slide 43), and updating proposed RFP resource ELCC values to reflect resource-specific attributes (Slide 44).

\*\*RFP Phase 2 Mid-C power price reflects the expected impact of California Senate Bill 100.

\*\*\*PSE used the RFP Phase 2 Update Mid-C power prices (consistent with September 19, 2019 IRTAG #8 publication) in its post-Phase 2 re-evaluation of resources (Aug.-Nov. 2019). The Update reflects the expected impact of the Clean Energy Transformation Act (“CETA”).



# RFP price scenarios

Scenarios	WECC /PSE		Gas Price*	Generic Resource Costs
	Phase	Demand		
1. No carbon tax	1 + 2	Base	Base	Base
2. CO2 (low societal \$16/ton)	1 + 2	Base	Base	Base
3. CO2 (mid-societal \$42/ton)	1 + 2	Base	Base	Base
4. CO2 (high societal \$62/ton)	2	Base	Base	Base
5. No CO2 low load	2	Low	Low	Base
6. No CO2 updated pricing	2	Base	Update	Base

- Added 3 new pricing scenarios in Phase 2 to test:
  - a broader range of future carbon costs (from \$0/ton to \$62/ton)\*\*
  - the impact of lower load growth (Scenario 5)
  - updated pricing as a result of California’s Senate Bill 100, which mandates 100% renewable power generation in the state by 2045 (Scenario 6)

\*The Base and Low gas prices are based on the Wood Mackenzie 2018 spring price. The Update price is based on the 2018 fall price.  
 \*\*Carbon price forecast assumptions shown on Slide 41.



4

## Phase 2 results

Presenter: Weimin Dang

# At-a-glance qualitative assessment\*

PSE's cross-functional team evaluated proposals based on a wide range of criteria, consistent with criteria described in Appendix A to the 2018 All Resources RFP and Chapter 480-107-035 WAC

- Table illustrates certain key qualitative findings of Phase 2 resources
- Detailed qualitative findings are presented in the 2018 RFP Evaluation Process Document, the Phase 2 Executive Summary and the individual proposal memos.

Project Counterparty (Project ID)	Operating/Development status	Delivery point	Counterparty/Proposal risk	Site control	Permitting risk	Energy delivery risk	Opposition/reputational risk
SPI Biomass PPA Sierra Pacific Ind. (18100)	Operating	BPAT, PSEI					
	Early Develop						
	Early Develop						
	Mature Develop	n/a					
	Mature Develop	n/a					
	Operating	n/a					
	Early Develop	Mid-C*					
	Early Develop	Mid-C					
	Early Develop						
	Operating	BPAT, PSEI					
	Mature Develop*	Mid-C					
	Mature Develop	Mid-C					
Golden Hills Wind (shaped / unshaped) / Avergrid (18170)	Mature Develop	BPAT, PSEI					

Project Counterparty (Project ID)	Operating/Development status	Delivery point	Counterparty/Proposal risk	Site control	Permitting risk	Energy delivery risk	Opposition/reputational risk
	Early Develop						
	Operating						
	Early Develop	n/a					
	Early Develop	Busbar					
	Early Develop	Mid-C					
	Early Develop	Busbar					
	Early Develop	Mid-C					
	Early Develop						
	Early Develop	BPAT, PSEI (or Busbar)					
	Operating						
	Early Develop						
	n/a	n/a					
	n/a	n/a					

Low Risk	Acceptable Risk	Substantial Material Risk	Fatal Flaw
Key			

REDACTED VERSION

REDACTED VERSION

## Six proposals were eliminated from Phase 2 prior to optimization based on qualitative and/or quantitative criteria

ID	Project Name	Resource Type	Nameplate	Counterparty	State	Reason(s) for elimination*
1	18201	Demand Response	MW		WA	Risks associated with integrating with new DERM, feasibility risks, less cost-effective than originally anticipated
2	18205	Demand Response	MW		WA	Risks associated with integrating with new DERM, counterparty risks (experience and financial performance), less cost-effective than originally anticipated
3	18176	MT Wind	MW		MT	Third-party review of net capacity factors provided by seller determined they were unrealistic; no met towers on site to verify expected output; significant development risks
4	18190	REC only	MW		WA	Risks include interconnection uncertainties that could impact REC output, substantial feasibility risks for underlying projects, potential legal issues associated with EFSC permitting decision [REDACTED] County applied for judicial review), counterparty risks and concerns about local opposition related to siting projects on commercial agricultural land
5	18107	Run-of-river hydro	MW		ID	Run-of-river plant offers little capacity value and is not RPS compliant; complex and potentially risky energy delivery strategy left to PSE
6	18105	Thermal	MW		WA	Expansion project development risks related to permitting, PR and energy delivery. Additional development at site also creates substantial permitting and PR risk for existing facility.

\*The 2018 RFP Evaluation Process Document (Section 7) and the Executive Summary of Phase 2 Results (Appendix D-1), which describe the reasons for elimination in more detail. Additional findings are summarized in the RFP proposal evaluation memos.



REDACTED  
VERSION

## 21 proposals selected for Phase 2 optimization analysis

- Phase 2 proposals with a combination of the most favorable quantitative results across scenarios and no obvious qualitative fatal flaws advanced for optimization analysis\*
- Updated scenario analysis in Phase 2 reflects current IRP assumptions and new information provided by respondents

ID	Project Name	Resource Type	Nameplate	Counterparty	State
1	SPI Industrial	Biomass	17 MW	SPI	WA
2		MT Wind			MT
3		MT Wind			MT
4		REC Only			OR
5		REC Only			OR
6		REC Only			ID
7		Solar			WA
8		Solar			WA
9		Solar			WA
10		Solar			WA
11		Solar			WA
12		Solar			WA
13		Solar			WA
14		Solar + BESS			OR
15		Thermal			OR
16	BPA Peak Capacity Product	SysPPA/Call Opt.	100 MW	BPA	OR
17		Wind			WA
18		Wind			OR
19		Wind			WA
20	Golden Hills Wind – Shaped	Wind	200 MW	Avangrid	OR
21		Wind			OR



\*Qualitative evaluation continued during the optimization analysis. Qualitative results were not final until the end of Phase 2. At-a-glance summary (Slide 15) is consistent with final results.

# Portfolio optimization results\*

(results as of July 23, 2019)

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)
Project List ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Preferred Optimized Portfolio	As Proposed Optimized Portfolio	
1	18100 Biomass	SPI	17 MW	16 MW		X	X	
2	18161 Call Option	BPA Peak Capacity Product	100 MW	53 MW		X	X	
3	18169 MT Wind					X		
4	18169 MT Wind						X	
5	18170 Wind	Golden Hill Shaped	200 MW	77 MW		X	X	
6	<b>Total Peak Capacity Credits - MWs</b>							<b>MW</b>
7	<b>Peak Capacity Surplus / (Deficit) in 2022<sup>4</sup></b>							<b>MW</b>
8	<b>Total Annual RECs</b>							<b>1,986,862</b>
9	<b>Portfolio Benefits - \$M</b>							<b>\$408</b>
10	<b>With Consideration of Social Cost of Carbon:</b>							
12	<b>Portfolio Benefits w/ Carbon Costs as an Adder - \$M<sup>5</sup></b>							<b>\$1,038</b>
13	<b>Portfolio Benefits w/ Carbon Costs in Dispatch Costs - \$M</b>							<b>\$959</b>

Peak Capacity and REC Need 2022-2025	2022	2023	2024	2025
Peak Capacity Need	299 MW	281 MW	328 MW	457 MW
REC Need	0	233,449	691,864	700,482

1. The annual project RECs in column I does not include 0.2X apprenticeship multiplier.  
 2. The optimization model chose a portfolio with [REDACTED] MW from [REDACTED] submitted proposals for both [REDACTED] MW and [REDACTED] MW, but not [REDACTED] MW. The size of the project is reduced from the proposed [REDACTED] MW option based on available transmission capacity. The [REDACTED] MW option will have to be negotiated with [REDACTED]. Current indicative results reflect pricing based on the [REDACTED] MW offer.  
 3. The current project COD for [REDACTED] is Dec 2021. There has [REDACTED] for PSE to secure long-term transmission rights to bring the energy home. If the COD is delayed to Dec 2022 to mitigate this risk, NPV of PPA cost will increase by up to \$35M. Without [REDACTED] the next lowest cost portfolio is \$123M more expensive than the recommended portfolio. However it would have the same timing risks on transmission because the new lowest cost portfolio includes the [REDACTED] project, which uses the same Colstrip transmission path.  
 4. Final P portfolio ELCC reduces the sum of individual project peak capacity contribution by 8 MW. It could potentially be mitigated by 1) short-term capacity purchase for \$720k per year; 2) a 20MW battery for \$41M.  
 5. Social cost of carbon at \$86/metric ton in 2010 dollars plus escalation is added to total portfolio costs as fixed cost.

\*Detailed Phase 2 quantitative analysis results (standalone analysis and optimization analysis) are presented in Appendix C.

CONFIDENTIAL

REDACTED VERSION

REDACTED VERSION



## 2018 RFP short list (as of July 23, 2019)

---

*PSE notified RFP respondents of their selection status in early August 2019*

1. SPI Biomass (Sierra Pacific Industries) 17-year PPA
2. [REDACTED] Montana wind ([REDACTED]) 25-year PPA
3. Golden Hills Oregon wind (Avangrid) 20-year PPA
4. BPA peak capacity product (BPA) 5-year call option

REDACTED  
VERSION





5

## Post-RFP re-evaluation of alternatives

Presenter: Weimin Dang

# Re-evaluation of resource alternatives

PSE re-ran its optimization analysis between Aug. 2019 and Dec. 2019 to include the following updates:


1. Updated peak capacity need based on draft 2019 IRP
2. Updated Mid-C price forecast consistent with September 19, 2019 IRTAG #8 publication (a 20% price reduction from previous forecast)
3. Added new proposal (received 8/29/19) from [REDACTED] to purchase or offtake power from their interest in [REDACTED]
4. Added new proposal (received on 10/23/19) from Morgan Stanley for a 3-5-year (no Q2), 100 MW system PPA\*\*
5. Added updated pricing from [REDACTED] (lower price), BPA (higher price), SPI (lower price) and Morgan Stanley (new structure)
6. Updated social cost of carbon per UTC docket U-190730, dated 9-12-2019 (2.5% discount rate scenario, 0.437ton/MWh market purchase carbon intensity)
7. Retired Colstrip Units 1&2 by 2020
8. Other ad hoc model updates as they became available



[REDACTED]  
\*\*MSCG is offering a zero emissions system PPA (no RECs).

# Updated Mid-C power price forecast (red line)

Phase 2 Update price forecast dropped 20% compared to the Phase 2 price forecast\*

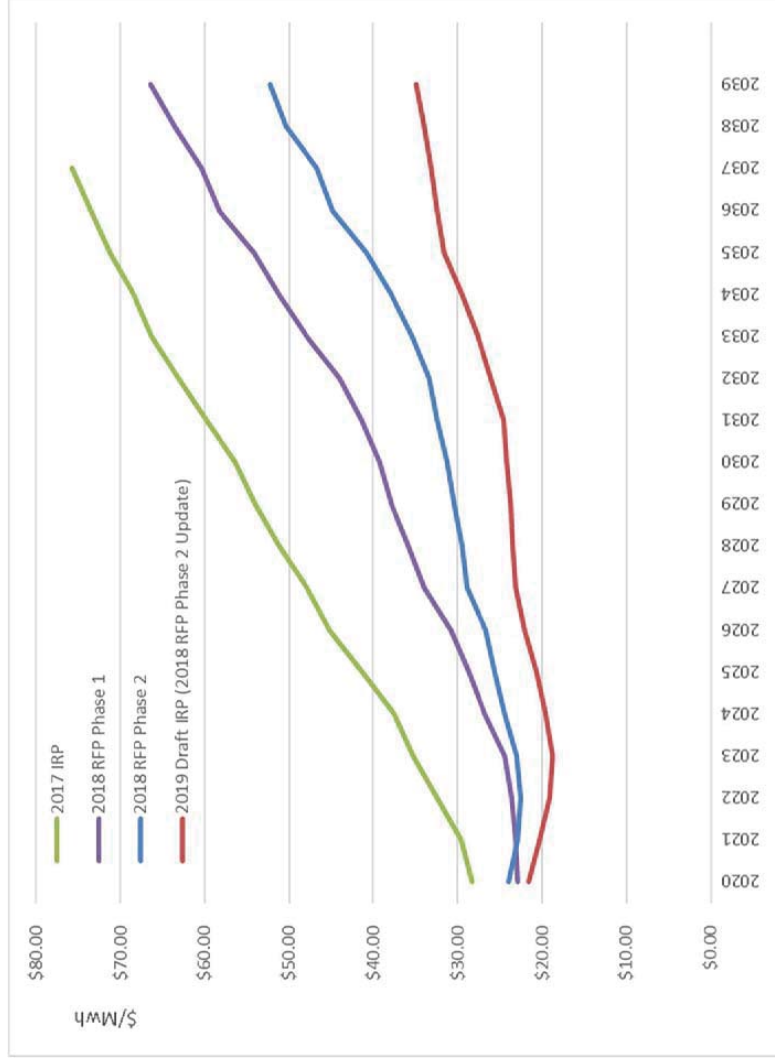

\*PSE used the RFP Phase 2 Update Mid-C power prices (consistent with Sep. 19, 2019 IRTAG #8 publication) in its post-Phase 2 re-evaluation of resources (Aug.-Dec. 2019).

\*\*Range of Phase 2 power prices tested is shown in Appendix A.



# Updated portfolio optimization confirms selection of shortlisted resources and adds Morgan Stanley PPA (results as of November 21, 2019)

Confidential

Updated optimization analysis included all 21 proposals from the RFP Phase 2 optimization analysis (Slide 18), the two new proposals from [REDACTED] and Morgan Stanley, and price updates from SPI, BPA and Morgan Stanley.

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)
Project List ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Recommended Portfolio	
1	Biomass	SPI	17 MW	16 MW		X	
2	Call Option	BPA Peak Capacity Product	100 MW	53 MW		X	
3	MT Wind	[REDACTED]				X	
4	MT Wind	[REDACTED]				X	
5	Wind	Golden Hills Shaped	200 MW	77 MW		X	
6	System PPA	Morgan Stanley Sys PPA	100 MW	81 MW		X	
7	Total Peak Capacity Credits - MWs						2,189,656
8	Total Annual RECs						\$679
9	Portfolio Benefits - \$M						\$1,179
10	Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>2,3</sup>						\$1,179

Peak Capacity and REC Need 2022-2025 <sup>4, 5</sup>	2022	2023	2024	2025
Peak Capacity Need	299 MW	292 MW	358 MW	477 MW
Peak Need / (Surplus) after Resources	0	233,449	691,864	700,482
REC Need	-2,189,656	-1,956,207	-1,497,791	-1,489,174
REC Need / (Surplus) after Resources				

- The annual project RECs in column G do not include 0.2X apprenticeship multiplier.
- The social cost of carbon at \$62/metric ton in 2007dollars plus escalation is added to the total portfolio costs as a fixed cost. Source: UTC docket U-190730, Sept. 12, 2019.
- Emission rate of 0.437 metric tons of CO2/MWh for market purchases is included in social cost of carbon allocation.
- REC and capacity need assessments updated to reflect CETA impact to market power prices.
- Capacity resource need does not reflect the sale of Colstrip Unit 4 to North Western Energy announced on Dec. 10, 2019.



REDACTED VERSION

REDACTED VERSION

# Selected proposal: [REDACTED] Wind PPA

Highly Confidential

*Proposed terms are subject to change based on negotiations*

## Seller:

- [REDACTED]

## Term:

- COD: Proposed 12/31/2021\*
- Term: 25 years


## Product:

- Nameplate Capacity: Proposed [REDACTED] MW
- NCF: [REDACTED] %
- Expected Output: [REDACTED] MWh/year

## Point of Delivery:

- [REDACTED]  
(also Point of Interconnection)

\*To be determined based on timing of transmission availability



## Price\*\*:

Calendar Year	Contract Year	PPA	
		Flat Energy Price	Expected Energy Output (MWh/year)
2022	1	[REDACTED]	[REDACTED]
2023	2	[REDACTED]	[REDACTED]
2024	3	[REDACTED]	[REDACTED]
2025	4	[REDACTED]	[REDACTED]
2026	5	[REDACTED]	[REDACTED]
2027	6	[REDACTED]	[REDACTED]
2028	7	[REDACTED]	[REDACTED]
2029	8	[REDACTED]	[REDACTED]
2030	9	[REDACTED]	[REDACTED]
2031	10	[REDACTED]	[REDACTED]
2032	11	[REDACTED]	[REDACTED]
2033	12	[REDACTED]	[REDACTED]
2034	13	[REDACTED]	[REDACTED]
2035	14	[REDACTED]	[REDACTED]
2036	15	[REDACTED]	[REDACTED]
2037	16	[REDACTED]	[REDACTED]
2038	17	[REDACTED]	[REDACTED]
2039	18	[REDACTED]	[REDACTED]
2040	19	[REDACTED]	[REDACTED]
2041	20	[REDACTED]	[REDACTED]
2042	21	[REDACTED]	[REDACTED]
2043	22	[REDACTED]	[REDACTED]
2044	23	[REDACTED]	[REDACTED]
2045	24	[REDACTED]	[REDACTED]
2046	25	[REDACTED]	[REDACTED]

\*\*Price does not include delivery to PSE's system. [REDACTED]



# Selected proposal: Golden Hills Wind (Shaped)

Proposed terms are subject to change based on negotiations

Highly Confidential

**Seller:**

- Avangrid Renewables, Inc.

**Product:**

- Nameplate Capacity: 200 MW
- NCF: [REDACTED]
- Expected Output: [REDACTED] MWh/year
- Shaped Capacity: up to [REDACTED] MW
- Shaped Schedule: Nov - Feb
- Shaped Hours: [REDACTED]

**Term:**

- COD: 12/31/2021
- Term: 20 years


**Point of Delivery:**

- BPAT.PSEI

**Price\*:**

\*Levelized cost of energy is \$ [REDACTED] /MWh.

Calendar Year	Contract Year	PPA		Winter-Peaking Capacity	
		Fiat Energy Price (\$/MWh)	Expected Energy Output (MWh/year)	Capacity Price (\$/kW-mo)	Capacity (MW)
2022	1	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2023	2	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2024	3	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2025	4	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2026	5	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2027	6	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2028	7	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2029	8	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2030	9	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2031	10	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2032	11	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2033	12	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2034	13	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2035	14	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2036	15	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2037	16	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2038	17	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2039	18	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2040	19	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
2041	20	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]

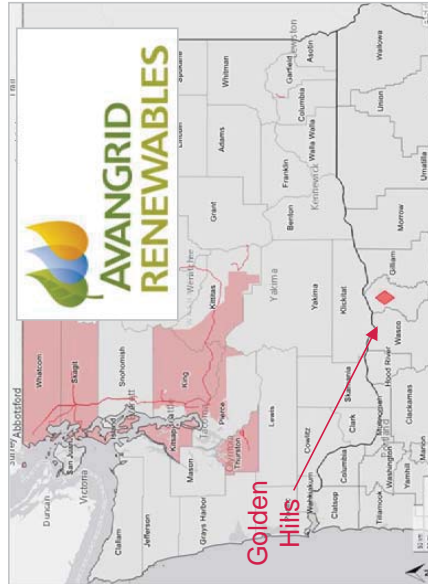


REDACTED VERSION

## The uniquely shaped output during winter months yields higher peak capacity contribution

Highly Confidential

- “As generated” Golden Hills Wind has an ELCC of 26%, therefore a peak capacity contribution of 52MW.
- Avangrid Renewables has offered a synthetic peak capacity output profile for winter months (Nov-Feb) that reshapes the wind output in those months to optimize the coincidence to PSE’s load profile.
- This reshaped wind product offers an ELCC of 39%, therefore a peak capacity contribution of 79MW.
- PSE has an opportunity to optimize the shaped product, and analysis is ongoing.



REDACTED  
VERSION



# Selected proposal: SPI Biomass PPA

*Proposed terms are subject to change based on negotiations*

**Seller:**

- Sierra Pacific Industries (SPI)

**Product:**

- Delivery of 17 MW of firm capacity (24/7)
- Delivery of up to 20 MW worth of energy (3 MW is variable)
- Minimum availability: Nov-Feb, Annual (92% historic)
- Contribution to Peak Capacity: 16 MW



\* The SPI Burlington lumber mill began operating in 2001. The biomass cogeneration facility was added in 2007. Facility is subject to an existing contract with a broker to sell the output through 2020.



**Term:**

- Start: Jan. 1, 2021\*
- 17 years

**Point of Delivery:**

- SPI.CABO.GEN at Fredonia Substation (also point of interconnection)

**Updated pricing:**

Calendar Year	Contract Year	Energy Price (\$/MWH)	Expected Energy Output (MWh/year)
2021	1		
2022	2		
2023	3		
2024	4		
2025	5		
2026	6		
2027	7		
2028	8		
2029	9		
2030	10		
2031	11		
2032	12		
2033	13		
2034	14		
2035	15		
2036	16		
2037	17		


\*\* Levelized cost of energy is \$ [REDACTED]



**Highly Confidential**

# Selected proposal: BPA Capacity Tolling Agreement

*Proposed terms are subject to change based on negotiations*

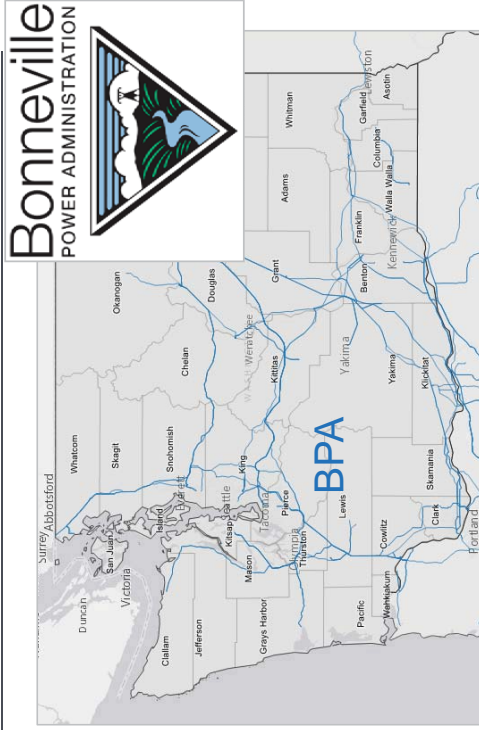

- Seller:**
- Bonneville Power Administration (BPA)
- Product:**
- Capacity: 100 MW
  - Firm Capacity that may be scheduled in increments from [REDACTED] MW on a [REDACTED] basis for up to [REDACTED]
  - Western Systems Power Pool (WSPP) Schedule C, heavy load hour (HLH), low carbon firm energy

- Term:**
- Start: 01/01/2022
  - Term: 5 years
- Point of Delivery:**
- BPAT.PSEI
  - PSE Covington 230 kV Substation

**Updated pricing\*:**

Calendar Year	Contract Year	Energy Price (\$/MWh)	Possible Energy Output (MWH/Year)	Capacity Price (\$/kW-mo)	Capacity (MW)
2022	1	[REDACTED]	[REDACTED]	[REDACTED]	100
2023	2	[REDACTED]	[REDACTED]	[REDACTED]	100
2024	3	[REDACTED]	[REDACTED]	[REDACTED]	100
2025	4	[REDACTED]	[REDACTED]	[REDACTED]	100
2026	5	[REDACTED]	[REDACTED]	[REDACTED]	100

\*Mid-C price will be based on Powerdex hourly price for each MWh delivered.  
 \*\*Capacity Price [REDACTED] includes \$ [REDACTED] that will be indexed to BPA PTP and Ancillary Service Schedules 1 & 2. Rate will be updated on the first day of each new rate period.



# Selected proposal: Morgan Stanley System PPA

*Proposed terms are indicative, subject to change*

**Product:**

- 100 MW of firm heavy load hour (HLH) energy (16/6)
  - Zero emission, no RECs
  - Fixed pricing
  - Q1 and Q4 deliveries only
- Point of Delivery:**
- BPAT.PSEI or other PSE designated point
- LCOE: 5-year, Q1&Q4, 100 MW**
- Fixed: \$ ████████ MWh
  - 70 MW peak capacity contribution

**Term:**

- 5 years starting 1/1/2022

**Pricing structure alternatives**

Term	Volume	Details	Start	End	Fixed Price	MIDC	Adder	Hedge	Adder
3 Year	50 MW	HLH Delivery	Jan-22	Dec-24	\$				
3 Year	100 MW	HLH Delivery	Jan-22	Dec-24	\$				
5 Year	50 MW	HLH Delivery	Jan-22	Dec-26	\$				
5 Year	100 MW	HLH Delivery	Jan-22	Dec-26	\$				
3 Year	50 MW	HLH Delivery No Q2	Jan-22	Dec-24	\$				
3 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-24	\$				
5 Year	50 MW	HLH Delivery No Q2	Jan-22	Dec-26	\$				
5 Year	100 MW	HLH Delivery No Q2	Jan-22	Dec-26	\$				
5 Year	100 MW	HLH Delivery Q1&Q4	Jan-22	Dec-26	\$				

\*Main pricing difference between hedging cost and offered fixed price is due to different pricing dates.



# What's next?

---

- Ongoing negotiations with counterparties
- Request approval from PSE management and (as needed) PSE Board to execute contracts with counterparties
- Execute contracts



# Appendix

# Appendix

---

## A. Additional RFP modeling assumptions and metrics

- Resource need (as filed)
- Generic resource costs
- Carbon cost assumptions
- ELCC values
- Transmission assumptions
- Additional metrics produced by the Portfolio Screening Model

## B. Additional proposal summary slides

- Comparison of 2018 RFP to prior RFPs
- Original Phase 2 candidate list (presented to UTC staff in April 2019)

## C. Detailed RFP Phase 2 results


- Executive summary of Phase 2 results
- Phase 2 standalone portfolio analysis results



# Appendix A: Additional modeling assumptions and metrics

# RFP solicits 272 MW of capacity by end of 2022\* Resource need as filed in June 2018

- Target online date by 2022\*\*
- Products that fill winter need while minimizing surpluses in other parts of the year will evaluate more favorably

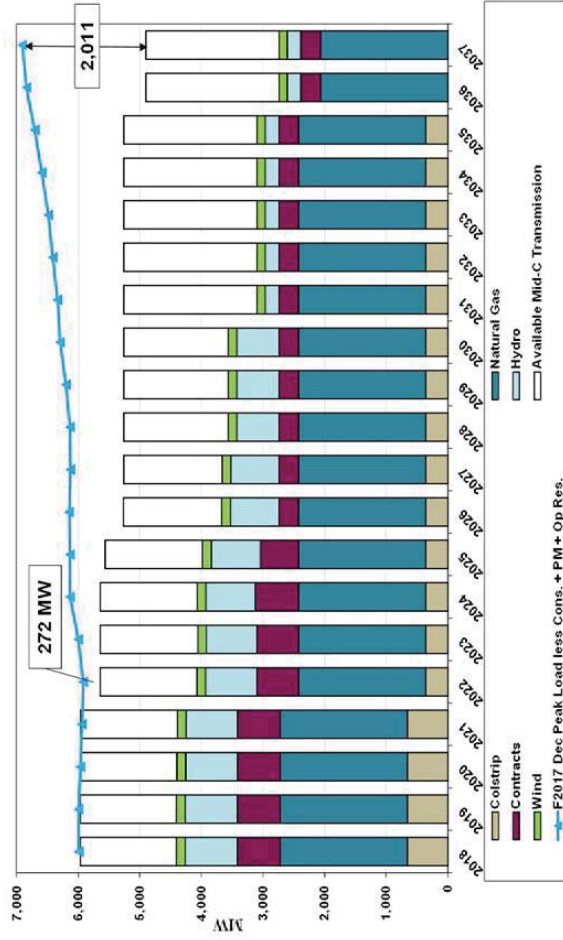


\* The All Resources RFP filed with the WUTC in June 2018 reflected then-current resource need projections based on the F2017 load forecast. In August 2018, PSE adjusted its resource need forecast for Phase 1 to reflect the F2018 load forecast. The resource need projection is based on current law and is not predictive of any future or pending legislative action.

\*\* Target online date is based on earliest need, but will not disqualify long-lead resources.



# Projected need to meet the RPS is 671,000 RECs 2023\* Resource need as filed in June 2018

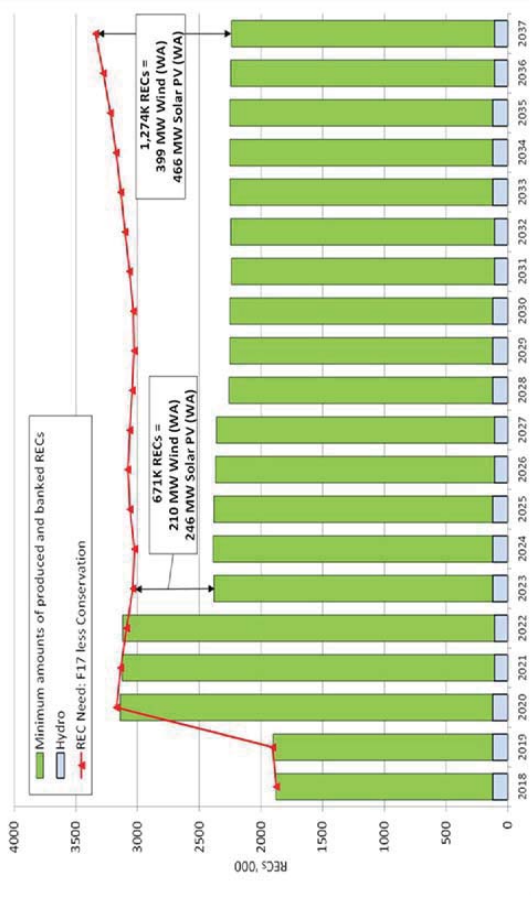

- REC need is driven by the increase in the RPS from 9% to 15% in 2020\*\*
- PSE’s inventory of banked RECs delays need until 2023
- PSE will consider early delivery dates to take advantage of tax incentives prior to phase out
  - PSE will evaluate the tradeoff between capturing the benefit of a higher tax incentive and the carrying cost of acquiring early production
- A renewable resource may count toward peak capacity need based on coincident winter peak production
  - PSE will engage reputable consultant for resource due diligence and to develop synthetic distributions for peak capacity calculation
- Proposals which demonstrate that they qualify for Washington state apprenticeship labor credit will add 1.2x multiplier to REC output




\* The All Resources RFP filed with the WUTC in June 2018 reflected then-current resource need projections based on the F2017 load forecast. In August 2018, PSE adjusted its resource need forecast for Phase 1 to reflect the F2018 load forecast.

\*\* If proposing a qualifying renewable resource located outside the Pacific Northwest as defined for the Bonneville Power Administration in Section 3 of the Pacific Northwest Electric Power Planning and Conservation Act (94 Stat. 2698; 16 U.S.C. Sec. 839a), electricity from the facility must be delivered into Washington state on a real-time basis without shaping, storage, or integration services.




# Load forecast assumptions

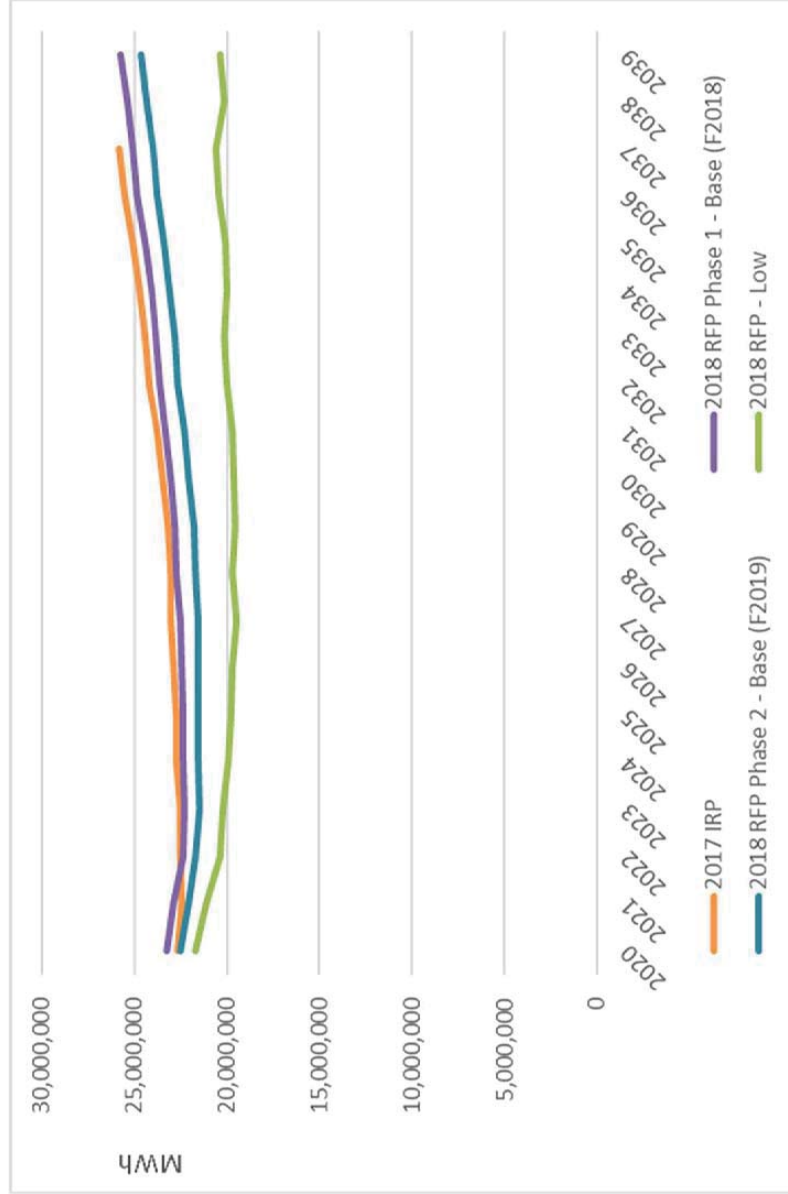


# Range of power prices tested in Phase 2


---

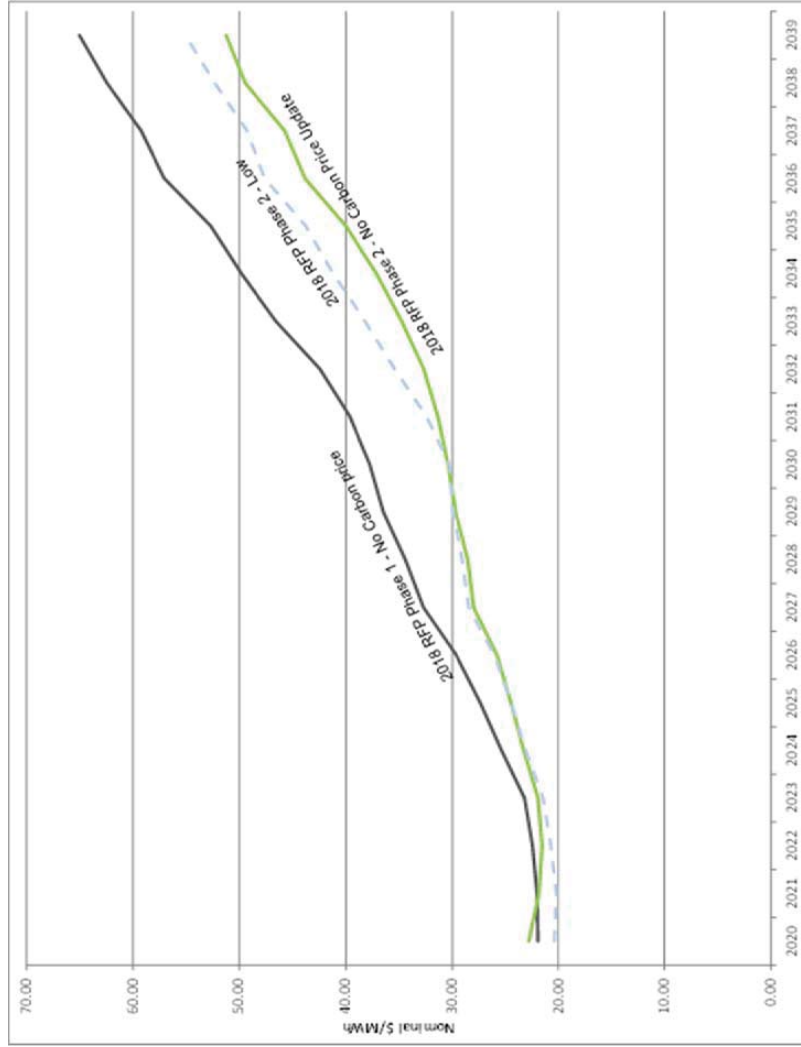

# Natural gas price forecasts

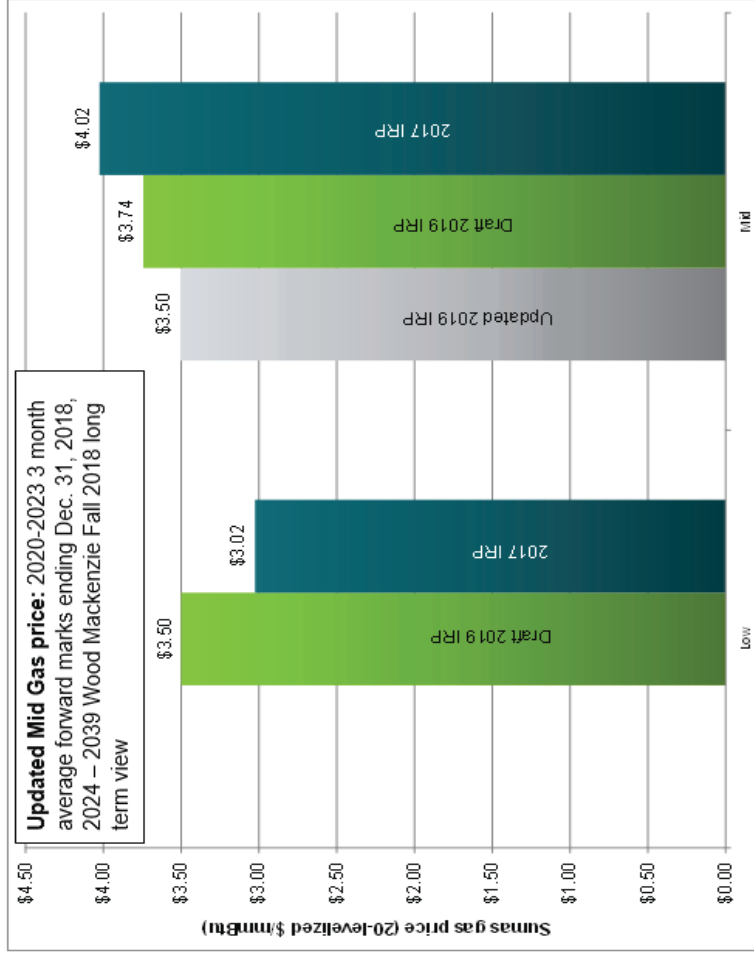

- PSE used the draft 2019 IRP prices for RFP Phase 1
- PSE used the Updated 2019 IRP price for RFP Phase 2



# Generic resource cost assumptions 2017 IRP vs. Draft 2019 IRP (used for RFP Phase 1)

2018 \$/kW	2017 IRP			Draft 2019 IRP			Cost change from 2017 IRP to Draft 2019 IRP		
	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	Total Costs	EPC Cost	Owner's Costs + Interconnection	All in Costs
COCC	\$1,020	\$358	\$1,378	\$898	\$269	\$1,167	(\$122)	(\$89)	(\$211)
Frame Peaker (Fuel Fuel)	\$526	\$172	\$698	\$554	\$271	\$825	\$28	\$99	\$127
Recip Engine (NG only)	\$1,030	\$312	\$1,341	\$842	\$350	\$1,192	(\$188)	\$38	(\$149)
WA Wind	\$1,548	\$656	\$2,204	\$1,656	\$386	\$2,042	\$108	(\$270)	(\$162)
MT Wind	\$1,471	\$1,312	\$2,783	\$1,633	\$1,111	\$2,744	\$162	(\$201)	(\$39)
Solar	\$1,497	\$874	\$2,371	\$1,352	\$570	\$1,922	(\$145)	(\$304)	(\$449)
Biomass	\$4,084	\$207	\$4,291	\$7,036	\$2,659	\$9,695	\$2,952	\$2,452	\$5,404
Offshore Wind	\$5,717	\$1,795	\$7,512	\$5,000	\$1,547	\$6,547	(\$717)	(\$248)	(\$965)
LH-on Battery 2-hr	\$1,313	\$342	\$1,655	\$1,331	\$599	\$1,930	\$18	\$257	\$275
LH-on Battery 4-hr	\$2,116	\$552	\$2,668	\$2,346	\$708	\$3,054	\$230	\$156	\$386
Flow Battery 4-hr	\$1,870	\$674	\$2,544	\$1,493	\$618	\$2,111	(\$377)	(\$56)	(\$433)
Flow Battery 6-hr	\$2,447	\$882	\$3,329	\$2,050	\$708	\$2,758	(\$397)	(\$174)	(\$571)
Pumped Storage	\$2,503	\$127	\$2,630	\$1,800	\$879	\$2,679	(\$703)	\$752	\$49

\*Generic resource costs used in RFP Phase 1 were based on a draft report produced by HDR for the 2019 IRP. This report was later updated; the final report costs were used in RFP Phase 2 (as shown on Slide 40).



# Generic resource cost assumptions\*

Overnight capital cost assumptions generally came down, with the exception of capital costs for frame peakers

	Solar capital cost (\$/kW)	MT wind capital cost (\$/kW)	WA wind capital cost (\$/kW)	Frame Peaker FOM <sup>1</sup> (\$/kW-yr)
<b>RFP Phase 1</b> (draft HDR report)	\$1,922	\$2,744	\$2,042	\$3.93
<b>RFP Phase 2</b> (final HDR report)	\$1,614	\$1,617	\$1,633	\$11.40 <sup>2</sup>

1. Fixed O&M costs ("FOM")


2. HDR's updated frame peaker FOM assumption (\$11.40/kw-yr) includes \$3.93/kw-yr FOM + \$7.47/kw-yr for 48 hours of oil stored on site.

\*Phase 1 cost assumptions were based on a draft report produced by HDR for the 2019 IRP. Phase 2 assumptions are based on the final HDR report.



# Carbon price forecasts

Assumptions used in RFP phases 1 & 2\*

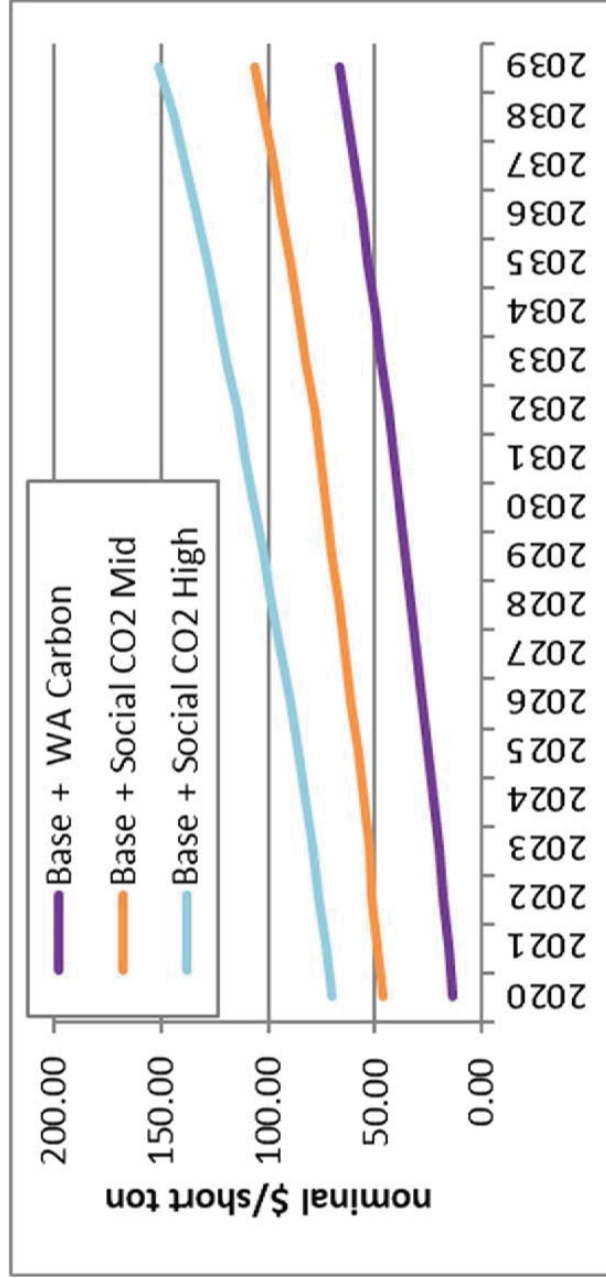

\*Reflects carbon price assumptions used through July 2019. Does not reflect updates to social cost of carbon assumptions used in the Aug-Dec 2019 re-evaluation of alternatives (Slide 42).



# Social cost of carbon assumptions

## Revised per UTC docket U-190730

Highlighted column reflects assumptions used in the post-RFP re-evaluation analysis conducted between Aug. and Dec. 2019

**Table ES-1: Social Cost of CO<sub>2</sub>, 2010 – 2050 (in 2007 dollars per metric ton of CO<sub>2</sub>)**

Year	5% Average	3% Average	2.5% Average	High Impact (95 <sup>th</sup> Pct at 3%)
2010	10	31	50	86
2015	11	36	56	105
2020	12	42	62	123
2025	14	46	68	138
2030	16	50	73	152
2035	18	55	78	168
2040	21	60	84	183
2045	23	64	89	197
2050	26	69	95	212

Source: U.S. Government 2016 Technical Support Document: Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis Under Executive Order 12866



# Generic resource electric load carrying capability (ELCC) values\*

Resource	Nameplate (MW)	IRP 2017 Peak Capacity Solve to 5% LOLP Relative to New Peaker	IRP 2019 Peak Capacity Solve to 5% LOLP Relative to Perfect Capacity
Existing Wind	823	11%	9.7%
Skookumchuck	131	40%	36.0%
Generic Montana Wind	100	49%	51.4%
Generic Washington Wind	100	16%	6.4%
Generic Offshore WA Wind	100	51%	47.6%
Generic Washington Solar	100	0%	1.0%
Lund Hill Solar	150	N/A	2.4%

Storage Resources	Nameplate (MW)	IRP 2017 Peak Capacity EUE at 5% LOLP	IRP 2019 Peak Capacity EUE at 5% LOLP
Lithium-Ion 2 hr, 82% RT efficiency	25	60%	19.2%
Lithium-Ion 4 hr, 87% RT efficiency	25	88%	38.4%
Flow 4 hr, 73% RT efficiency	25	76%	36.0%
Flow 6 hr, 73% RT efficiency	25	N/A	46.4%
Demand Response 3 hr duration, 6 hr delay, 10 calls per year	100	77%	38.2%

\*Generic proxy values for RFP Phase 1 generally reflected 2017 IRP ELCC values (as published in the 2018 All Resources RFP, Appendix G). ELCC values were later updated to reflect ELCC values updated for the 2019 IRP.





# Phase 2 ELCCs\* for intermittent generation resources

Resource	Peak Capacity [MW]	Nameplate [MW]	ELCC
			45.00%
			5.40%
			44.90%
			1.71%
			31.92%
			1.82%
			0.69%
			1.49%
			46.07%
			2.00%
			0.75%
			1.56%
			19.90%
			16.00%
			1.00%
			1.13%


In Phase 2, PSE performed a study to determine the ELCC value of for each individual project, based on its unique characteristics and attributes, its nameplate capacity and its specific location.\*\*

\* In Phase 1, PSE applied a generic Electric Load Carrying Capability ("ELCC") proxy value to the proposals based on each project's resource type, nameplate capacity and general location (slide 43).  
 \*\* ELCC values shown in the table do not take into account project delivery points.




REDACTED VERSION

# Projects are evaluated on a cost and risk basis delivered to PSE's load

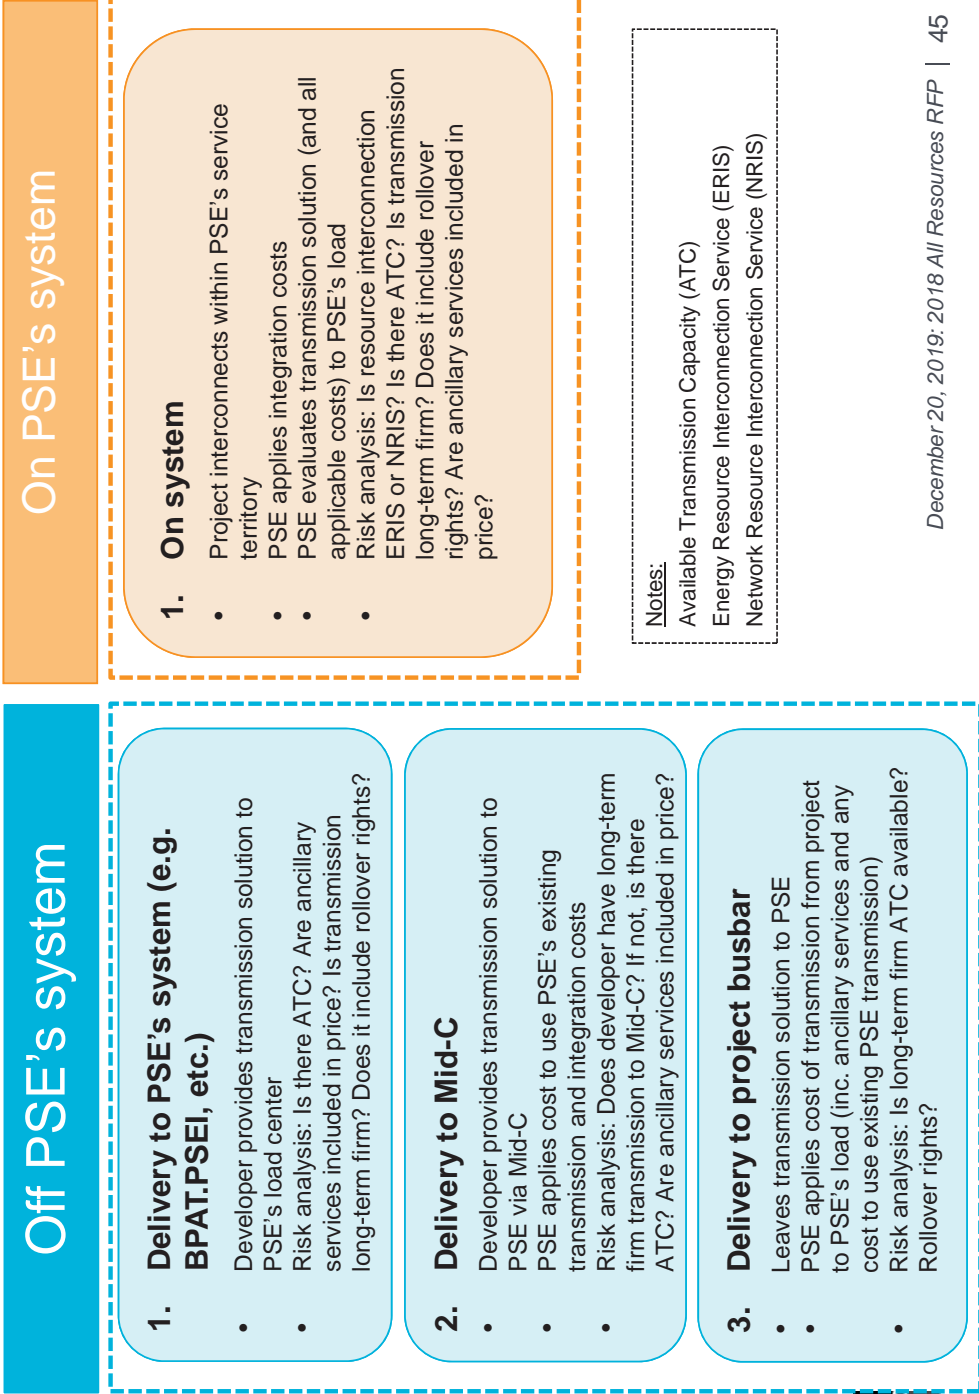

# Montana transmission path

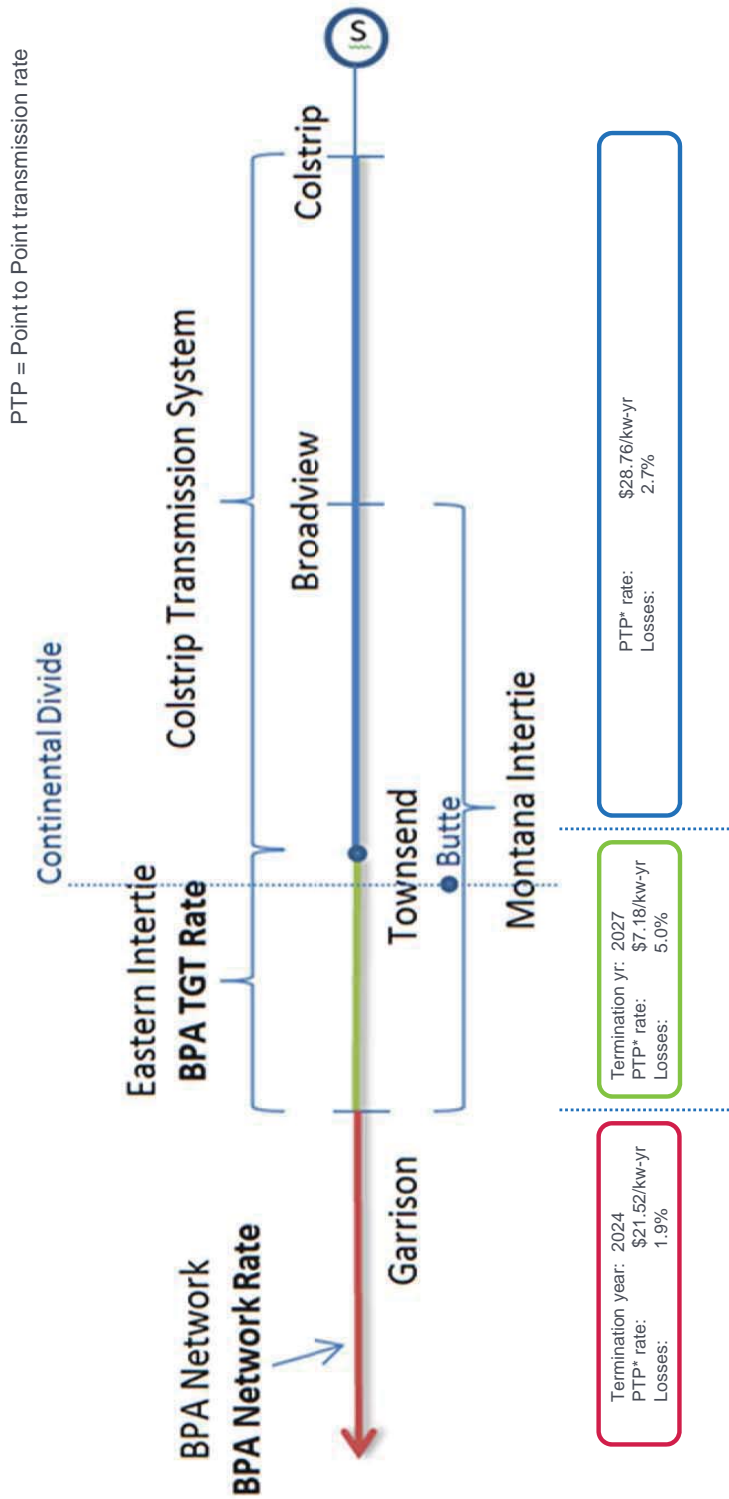

Other costs to consider:

- Additional losses from the project to the delivery point
- Renewable integration costs



## Additional quantitative screening metrics

### Levelized net cost per REC (\$/MWh-REC)

*Useful for comparing renewable projects of different sizes*

Lower is better

- Difference between the net present value project revenue requirement, and the net present value market revenue of the project's generation divided by the net present value of the project's capacity contribution

### Levelized net cost per unit of peak capacity (\$/kW)

*Useful for comparing peak capacity projects of different sizes*

Lower is better

- Difference between the net present value of the cost, and the market value of the energy divided by the peak capacity credit

### Portfolio benefit ratio

*Useful for comparing projects with similar operating characteristics; removes size bias*

Higher is better

- Portfolio benefit divided by the net present value of the proposed project's revenue requirement. Allows projects with different capacities to be compared without a bias for size.

\*Key quantitative screening metrics shown in presentation (on slide 11).



## Appendix B: Additional proposal summary slides

# Nearly 100 proposals received

## Largest response to an All Source RFP to date

Resource Type	2018 All Resource and Demand Response RFPs		2017 Renewables Only RFP (Green Direct 2.0) <sup>1</sup>		2011 All Source RFP		2010 All Source RFP		2008 All Source RFP		2005 All Source RFP	
	# Proposals <sup>2</sup>	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW	# Proposals	Max Cap MW <sup>1</sup>	# Proposals	Max Cap MW
Solar - PV	16	2240	17	574	2	24	1	10				
Solar - PV + BESS	20	2848										
Wind - Off Shore	1	400										
Wind On Shore	16	3303	20	2601	4	369	21	3776	8	862	10	1165
Wind + Winter Sys PPA	1	371										
Wind + Solar and/or BESS	2	464	4	339								
Storage - Battery ("BESS")	17	1265			2	251						
Storage - Pumped Hydro	2	900										
Biomass	2	72			3	61	9	590				
Biomass + BESS	1	15										
Natural Gas-fired Generation	4	1377			10	2624	18	5342	10	2588	17	4307
Geothermal	2	43									1	48
Hydro - Run of River	1	38	2	4	1	77	2	105	3	165	3	139
System PPA / Call Option	1	100			4	400	10	n/a	9	1675	7	400
Unbundled RECs	5						2	n/a				
Demand Response	6	154					1	80			1	34
Coal - Traditional + IGCC					1	500			1	100	6	4950
Cold Fusion					1	1880						
Distributed Generation												
Waste-to-Energy / Landfill Gas					1	23					1	5
<b>TOTAL</b>	<b>97</b>	<b>13,590</b>	<b>43</b>	<b>3,518</b>	<b>29</b>	<b>6,209</b>	<b>64</b>	<b>9,903</b>	<b>31</b>	<b>5,390</b>	<b>47</b>	<b>11,053</b>

[1] The 2017 RFP sought large and small (<5 MW) renewable resources to serve multiple voluntary green power programs.

[2] PSE also received two unsolicited proposals during Phase 1, a REC-only and a pumped storage hydro storage, which are not included in the table.



# Original Candidate list for Phase 2 (results are a snap shot in time, subject to change)

ID	Project Name	Resource Type	Nameplate	Counterparty	State
18100	SPI Industrial	Biomass	17 MW	SPI	WA
18201		Demand Response			WA
18169		MT Wind			MT
18173		MT Wind			MT
18176		MT Wind			MT
18163		REC Only			OR
18165		REC Only			OR
18190		REC Only			WA
18107		Run-of-River			ID
18135		Solar			WA
18111		Solar			WA
18122		Solar			WA
18131		Solar			WA
18127		Solar			WA
18114		Solar			WA
18112		Solar			WA
18125		Solar			WA
18139		Solar + BESS			OR
18105		Thermal			WA
18103		Thermal			OR
XXXXX		Transmission			N/A
18175		Wind			WA
18132		Wind			OR
18179		Wind			WA
18170	Golden Hill Wind - Shaped	Wind	200 MW	Avangrid	OR
18166		Wind			OR

\* Numbers shown are rounded to the nearest 5MW.

\*\* Reflects a redirect of MW of BPA transmission from [REDACTED] to PSEI, available January, 2022 for a 50-year term, and using Mid-C forecast for energy pricing. MW may be available for redirect on BPA's system, however it is likely only MW is possible for redirect to Mid-C. Redirects are assessed given the most current data and are a snap shot of the present system. The results are subject to change and may vary in the future based on updated ATC calculations and flow gate constraints within BPA's network. While redirect of the remaining MW is feasible, the location, source and cost of this redirect remains under review, therefore not included in this analysis.

Proposals shown here are best offers from each proposal.


REDACTED VERSION

## Appendix C: Detailed Phase 2 results



# Detailed RFP Phase 2 evaluation results

---

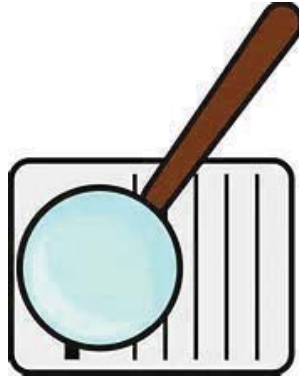



## 2018 RFP – Executive Summary\*

Quantitative results are the product of analysis performed in PSM III version 25.13.

### Phase 2 Candidate Short List: Proposals selected for contracting phase of RFP

Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18100</b> <b>SPI Burlington Biomass</b> Sierra Pacific Industries PPA Operational biomass 17 MW nameplate COD: 01/01/2021 Term: 17 years capacity	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$14.132 M Levelized PB/REC: [REDACTED] Peak capacity PB / kW-Yr: [REDACTED] Net cost PV: \$33.613 M Peak capacity contribution (MW): 16.4 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Existing/operating facility so no development risk</li> <li>Biomass project is REC producing</li> <li>High effective load-carrying capability (ELCC), i.e. contribution to peak capacity need</li> <li>Interconnected onto PSE's system</li> </ul>	<ul style="list-style-type: none"> <li>Sierra Pacific Industries is a privately held company, so less financial information is available than if it were public</li> <li>A disruption of mill operations would likely impact long-term operation of the facility</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18161</b> <b>BPA Peak Capacity</b> Bonneville Power Administration PPA** Operational portfolio of projects 100 MW** COD: 01/01/2022** Term: 5 years**	Levelized cost: [REDACTED] Portfolio benefit: (\$8,028 M) Peak capacity PB / kW-Yr: [REDACTED]** Net cost PV: \$25,426 M Peak capacity contribution (MW): 100 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Counterparty is well known with existing ties to PSE and, therefore, no risk for this proposal</li> <li>There are no permitting, real estate or community relations concerns as the proposal is based on currently operational projects</li> <li>As a response to data requests, Bonneville Power Administration (BPA) moved their delivery location from Mid-C to BPAT, PSEI</li> </ul>		<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be minimal.
<b>18169</b> [REDACTED] PPA** or 50% ownership+PPA Development wind 100 MW** COD: 12/31/2021** Term: 20 or 25** years	Levelized cost: \$[REDACTED] / MWh Portfolio benefit: \$417,294 M Levelized PB/REC: \$[REDACTED] Peak capacity PB / kW-Yr: [REDACTED] Net cost PV: \$24,422 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Relatively cost efficient way to contribute towards both the REC and contribution to peak capacity need</li> <li>Large and experienced counterparty</li> <li>Site control is reportedly achieved, but supporting documentation was not included in proposal</li> <li>Public has been notified of the project as at [REDACTED] MW facility</li> <li>Shape of wind based on 6 operating meteorological towers appears to fit well with PSE's needs</li> </ul>	<ul style="list-style-type: none"> <li>Lengthy gen-tie line for which site-control has not yet been fully obtained</li> <li>Transmission from [REDACTED] to PSE [REDACTED] is both schedule and cost risk to PSE as the energy offtaker</li> <li>There is a potential permitting issue with sage grouse habitat</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to [REDACTED] limitations between [REDACTED] the [REDACTED] projects are considered mutually exclusive.
<b>18170</b> <b>Golden Hills Wind</b> Avangrid Renewables PPA-shaped [REDACTED] Development wind 200 MW** COD: 12/31/2020** Term: 20 years**	Levelized cost: [REDACTED] / MWh Portfolio benefit: \$106,924 M Levelized PB/REC: [REDACTED]** Net cost PV: \$74,948 M Peak capacity contribution (MW): 51.6 Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Shaped product offers capacity contribution during peak winter months</li> <li>Site control is achieved</li> <li>Permitting well advanced with Oregon Energy Facility Siting Council (EFSC) permit application already amended</li> </ul>	<ul style="list-style-type: none"> <li>Complex energy delivery will require additional vetting</li> <li>Complexity of shaped product will require additional vetting</li> </ul>	<b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Summary Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<p>18173</p> <p>PPA** Development wind 1MW or 1 MW COD: 10/31/2022** Term: 20 years**</p>	<p>Levelized cost: \$ / MWh</p> <p>Portfolio benefit: \$280.504 M</p> <p>Levelized PB/REC: \$</p> <p>Peak capacity PB / kW-Yr: \$</p> <p>Net cost PV: \$116.358 M</p> <p>Peak capacity contribution (MW) ( )</p> <p>Annual REC contribution: ( )</p>	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Project may be sited on a single landowner's property, which would likely minimize real estate complexity</li> <li>Favorable state support; however, local level of support unknown</li> </ul>	<ul style="list-style-type: none"> <li>Project site may include Montana Department of Natural Resources and Conservation (DNRC) land, which could complicate site control and permitting</li> <li>Permitting is in a relatively early stage of development; risk of potential delay to scheduled COD</li> <li>Assumed use of under ongoing review and may be problematic</li> </ul>	<p><b>Selected</b> - Project selected during portfolio optimization and qualitative risks appear to be manageable. Due to available transmission capacity limitations between [REDACTED] and [REDACTED], [REDACTED] considered mutually exclusive.</p>

REDACTED VERSION

REDACTED VERSION

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.



Phase 2 proposals not selected for contracting phase of RFP

Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18103</b> [REDACTED] CTA** or asset transfer Operational repurchased cycle [REDACTED] MW Start: 06/01/2022 Term: 10 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: (\$29.120 M) Peak capacity PB / kW-Yr: (\$ [REDACTED]) Net cost PV: \$163.748 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Existing/operating facility (rather than new build) therefore no development risk</li> <li>Existing presence in the community with local opposition unlikely</li> </ul>	<ul style="list-style-type: none"> <li>High social cost of carbon adversely impacts project economics in certain quantitative scenarios</li> <li>In light of recently passed Clean Energy Transition Act (SB5116), advancement of this and other fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Lack of firm delivery of natural gas is a risk to the effective load-carrying capability (ELCC) of the project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18105</b> [REDACTED] CTA** or BTS Frederickson thermal expansion [REDACTED] MW COD: 01/01/2022 Term: 5, 15, or 20** years	Levelized cost: \$ [REDACTED] / MW Portfolio benefit: (\$16.898 M) Peak capacity PB / kW-Yr: (\$ [REDACTED]) Net cost PV: \$85.973 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Proposed expansion of [REDACTED] may bring O&amp;M cost savings on a per-kW basis (versus an entirely new thermal facility)</li> <li>Technology is relatively site-agnostic and can potentially be designed to integrate at other sites</li> <li>[REDACTED] MW proposal would likely be facilitated with firm gas supply from existing facilities</li> </ul>	<ul style="list-style-type: none"> <li>In light of recently passed Clean Energy Transition Act (Washington State Bill 5116), advancement of new fossil fuel-based projects represents considerable reputational and financial risk</li> <li>Proposed project would require extensive integration with existing PSE facility, the viability of which is unknown at this time</li> <li>Would require review and likely modification of air permit for co-located generation facility. Process expected to be exceedingly difficult and the outcome uncertain, with possible impacts to existing facility operational permits</li> <li>PSE will likely experience significant resistance from local governments, local stakeholders, environmental stakeholders, and native tribes for expansion of the company's CO<sub>2</sub> emitting portfolio</li> <li>Strong likelihood of considerable delays to COD due to expected public protest, litigation and permit process</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED  
VERSION

REDACTED  
VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18107</b> [Redacted] PPA** Operational hydro MW: [Redacted] Start: 1/1/2021 (assumed) Term: 20 years (assumed)	Levelized cost: \$ [Redacted] / MWh Portfolio benefit: (\$36.163 M) Levelized PB/REC: [Redacted] Net Cost PV: \$38.677 M Peak capacity contribution (MW): [Redacted] Annual REC contribution: [Redacted]	<ul style="list-style-type: none"> <li>No development risk, project is an existing operating facility</li> <li>Clean energy (although not RPS compliant)</li> <li>Run-of-river hydro can be less environmentally impactful than standard hydro</li> <li>Little to no permitting or real estate risk due to current operational status</li> </ul>	<ul style="list-style-type: none"> <li>Run-of-river asset provides little capacity value.</li> <li>Not RPS compliant (although clean energy)</li> <li>Energy delivery strategy has been left to PSE, and appears to be complex</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and did not show potential during standalone quantitative analysis.
<b>18111</b> [Redacted] PPA** Development solar Solar: [Redacted] MWac COD: 12/31/2022 Term: 20 years	Levelized cost: \$ [Redacted] / MWh Portfolio benefit: \$107.686 M Levelized PB/REC: [Redacted] Net cost PV: \$51.359 M Peak capacity contribution (MW): [Redacted] Annual REC contribution: [Redacted]	<ul style="list-style-type: none"> <li>Relatively high quantitative score for solar project</li> <li>Strong counterparty with extensive renewable energy development experience and existing contractual relationships with PSE</li> <li>Site control has been achieved</li> <li>Permitting status is sufficient at this stage</li> <li>Located on PSE's system in [Redacted] County</li> <li>avoids community concerns in [Redacted]</li> </ul>	<ul style="list-style-type: none"> <li>While on PSE's system, complex delivery due to available transmission capacity (ATC) constraints in area. Delivery is possible to Mid-C; however, may be difficult given project's proximity to [Redacted] (substation)</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18112</b> [Redacted] PPA** Development solar Solar: n/a COD: n/a Term: n/a	Levelized cost: [Redacted] Portfolio benefit: N/A Levelized PB/REC: [Redacted] Net cost PV: N/A Peak capacity contribution (MW): [Redacted] Annual REC contribution: [Redacted]	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<ul style="list-style-type: none"> <li>Project withdrawn by applicant</li> </ul>	<b>Not Selected</b> – Project withdrawn by applicant.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18114</b> PPA Solar generation (IMW) COD: 12/1/2021 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$45.772 M Levelized PB/REC: \$ ** Net Cost PV: \$36.011 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li> is assessed to be a relatively strong parent company</li> </ul>	<ul style="list-style-type: none"> <li>Environmental permitting not yet begun.</li> <li>Permitting will require the transfer of a Washington Energy Facility Site Evaluation Council (EFSEC) permit, which introduces a viability and reputational risk to the project and PSE</li> <li>Transmission and energy delivery may be overly expensive or otherwise infeasible</li> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Current site leases were executed for wind projects; it is not yet known whether or not land owners would be amenable to solar leases</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18122</b> PPA**, optional BESS Development/Wind (IMW) COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$32.877 M Levelized PB/REC: \$ ** Net Cost PV: \$35.687 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Large counterparty and promise of guaranty from an investment grade entity, a letter of credit, or cash</li> <li>Long-term site control for project site is secured</li> </ul>	<ul style="list-style-type: none"> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Solar development is viewed with skepticism in this area; history of active local opposition</li> <li>Site may block the view of a local real estate development</li> <li>Contribution to the peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18125</b> PPA Development/Solar (IMW) COD: 1/1/2023 Term: 15 or 20** years	Levelized cost: \$ / MWh Portfolio benefit: \$55.283 M Levelized PB/REC: \$ Net Cost PV: \$32.311 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> </ul>	<ul style="list-style-type: none"> <li>While interconnected to PSE's system, complex delivery due to available transmission capacity (ATC) constraints in the area</li> <li>Site permitting is in a relatively early stage of development</li> <li>Minimal information provided regarding community relations and or support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18127</b> PPA Development/solar (IMW) COD: 12/31/2022 Term: 15** or 20 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$119,579 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$60,272 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Extensive solar energy development experience; developed currently in Washington State</li> <li>Location on existing project site may provide economies of scale in developing and operating project</li> <li>County has expressed support for the project</li> </ul>	<ul style="list-style-type: none"> <li>Potential siting risks given proximity to wind turbines with required setbacks</li> <li>Assumes use of PSE site control</li> <li>Interconnection and energy delivery assume use of PSE existing infrastructure and analysis assumes no coincidental curtailment due to overproduction between existing wind and proposed solar</li> <li>Conditional Use Permit (CUP) required to permit project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18131</b> PPA** or BTS Development/wind (IMW** or IMW) COD: 12/31/2022 Term: 25 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$11,525 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$20,124 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Proposes to provide credit support in the form of a parent guarantee, letter of credit, or cash</li> <li>Long-term site control for most of the site is secured</li> <li>Community relations plan is strong compared to other proposals</li> </ul>	<ul style="list-style-type: none"> <li>Less experienced than other counterparties</li> <li>(IMW offer) configuration would likely exceed available transmission capacity</li> <li>tribe request compensation from project</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18132</b> PPA** Development/wind (IMW) COD: 01/01/2023 Term: 20 years	Levelized cost: \$ [REDACTED] // MWh [REDACTED] Portfolio benefit: \$61,479 M [REDACTED] Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$20,702 M [REDACTED] Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Repower of existing wind project; site control and community relations risks are unlikely</li> <li>Oregon Energy Facility Siting Council (EFSC) amendment secured during Phase 2 of the RFP</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION





Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18135</b> PPA** or BTS Development solar 1 MW or 1 MW solar Optional 25 MW, 4-hr BESS COD: 1/1/2023 Term: 20 years	Levelized cost: \$ / MWh Portfolio benefit: \$123.395 M Levelized PB/REC: \$** Net Cost PV: \$5,724 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Large counterparty with experience all over the world</li> <li>Letter of intent with an option to lease has been signed for project lands</li> </ul>	<ul style="list-style-type: none"> <li>Contribution to PSE's peak capacity need is negated due to Mid-C delivery</li> <li>Permitting plan is underdeveloped</li> <li>There is no site control for current generation-tie line alignment</li> <li>Project is on irrigated farmland--mitigation strategy not included in proposal, but developer has retained a PR support</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18139</b> PPA Development solar with optional 1 MW or 1 MW, 1-hr BESS COD: 1/1/2023 Term: 10 years	Levelized cost: \$ / MWh Portfolio benefit: \$26.120 M Levelized PB/REC: \$ Net Cost PV: \$15.659 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Large multi-national counterparty with greater-than-average renewable development experience</li> </ul>	<ul style="list-style-type: none"> <li>Site control not yet secured and copy of anticipated letter of intent has not been provided</li> <li>Energy delivery has been left to PSE, appears to be complicated, and may pose a feasibility risk</li> <li>Respondent provided little to no evidence of a successful permitting strategy</li> <li>Community relations matters were not covered sufficiently, and tribal support may be required</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18163</b> REC purchase Underlying solar projects REC year Start of term: 1/1/2022 Term: 18 years	Levelized cost: \$ / MWh Portfolio benefit: \$19.635 M Levelized PB/REC: \$ Net Cost PV: \$2,412 M Peak capacity contribution (MW): Annual REC contribution:	<ul style="list-style-type: none"> <li>Minimal risk regarding underlying projects</li> <li>Interconnection at distribution voltage dictates that each as-generated MWh produces two Washington State RECs</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facilities</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**  
 BESS Battery energy storage system  
 BTS Build to sell  
 COD Commercial operation date  
 CTA Capacity Tolling Agreement  
 PPA Power purchase agreement  
 REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18165</b> [REDACTED] REC purchase Underlying solar project [REDACTED] year Start of term: 1/1/2022** or 2024 Term: 16 or 18** years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$13.181 M Levelized PB/REC: \$ [REDACTED] ** Net Cost PV: \$1.755 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Minimal risk regarding underlying project</li> </ul>	<ul style="list-style-type: none"> <li>Little detail regarding underlying solar facility</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18166</b> [REDACTED] Development asset sale, BTS or PPA** Development wind [REDACTED] MW COD: 12/1/2020, 2021*, or 2022 Term: 25 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$114.836 M Levelized PB/REC: \$ [REDACTED] Net Cost PV: \$121.737 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Long-term site control established</li> </ul>	<ul style="list-style-type: none"> <li>Significant concerns regarding the counterparty's ability to develop, finance, and construct the facility</li> <li>Relatively small counterparty with inconclusive rights to the project's developmental assets</li> <li>Timing of project is contingent on Bonneville Power Administration (BPA) infrastructure upgrades to enable transmission capacity</li> <li>Project owner, [REDACTED] interested in furthering project development via first-hand experience at [REDACTED] pub [REDACTED]</li> <li>Timeline as-proposed is likely infeasible and pricing is likely contingent on timing due to production tax credit (PTC) safe harbor</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18175</b> [REDACTED] PPA, BTS**, or WSPSP shaped Development wind [REDACTED] MW COD: 1/1/2021 Term: 25 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$176.514 M Levelized PB/REC: \$ [REDACTED] Peak capacity PB / kW-Yr: \$ [REDACTED] Net Cost PV: \$177.135 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Long-term site control is secured</li> <li>Western Systems Power Pool (WSPP) schedule C delivery is a unique value</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty and financing details will require data requests</li> <li>Energy delivery has been left to PSE, appears to be complicated, and might pose a feasibility risk</li> <li>Mid-C delivery will likely be necessary, which would negate a contribution to PSE's peak capacity</li> <li>Permitting plan seems either underdeveloped or underrepresented in the proposal</li> <li>Outreach plan is underdeveloped</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.

\*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.

\*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18176</b> [REDACTED] PPA** Development wind IMW** of [REDACTED] MW COD: 12/31/2022 Term: 20	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$135,600 M Levelized PB/REC: \$ [REDACTED] Peak capacity PB / kW-Yr: [REDACTED] Net Cost PV: \$2,425,24 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Indications of strong local, state and environmental support</li> <li>Potential to partner with a local Native American tribe</li> <li>Located near [REDACTED] and [REDACTED] Time County</li> <li>Counterparty has indicated a plan to partner and/or otherwise engage an experienced renewable energy developer on the project</li> </ul>	<ul style="list-style-type: none"> <li>Counterparty does not have experience designing, financing, building, owning or operating a large scale renewable or other energy project</li> <li>Assumed use of [REDACTED] may be problematic for full proposed output</li> <li>Additional detail needed regarding the real estate and permitting considerations necessary for the site</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18179</b> [REDACTED] PPA** or DBS Development wind IMW** of [REDACTED] MW COD: 12/31/2021 Term: 20 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$70,371 M Levelized PB/REC: \$ [REDACTED] *** Net Cost PV: \$28,121 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Strong counterparty with extensive renewable energy development experience</li> <li>Real estate appears adequate and relatively low risk</li> <li>Project size has been altered to address some local viewshed concerns</li> </ul>	<ul style="list-style-type: none"> <li>History of considerable local and county-level opposition to the project</li> <li>Counterparty bypassed the County permitting process by pursuing permit approval through the state's Washington Energy Facility Site Evaluation Council (EFSEC) process</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.
<b>18190</b> [REDACTED] REC purchase 5 underlying proposed solar facilities REC COD: 01/01/2022 Term: 12, 15, or 20** years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$46,975 M Levelized PB/REC: \$ [REDACTED] ** Net Cost PV: \$5,948 M Peak capacity contribution (MW): [REDACTED] Annual REC contribution: [REDACTED]	<ul style="list-style-type: none"> <li>Inexpensive RECs</li> <li>Site control is secured</li> <li>Washington Energy Facility Site Evaluation Council (EFSEC) projects have been approved by Governor Inslee</li> </ul>	<ul style="list-style-type: none"> <li>Realizing full REC output of underlying projects is unlikely due to interconnection issues</li> <li>[REDACTED] is in litigation with PSE over interconnection issues with the underlying projects</li> <li>[REDACTED] Court [REDACTED] uses the EFSEC decision and has applied for judicial review</li> <li>Major feasibility concerns with some and schedule concerns for all of the underlying projects</li> <li>Projects sited on commercial agricultural land and many stakeholders in the county oppose development of these lands</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks.

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.

\*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with \$B100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.

\*\*\*Indicates primary ranking criteria for particular proposal category.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

REDACTED VERSION

REDACTED VERSION



Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>18201</b> [REDACTED] Direct load control Bring your own thermostat, smart water heater MW COD: 1/1/2023 Term: 6 years	Not applicable, please see selection recommendation & rational section to the right [REDACTED]	<ul style="list-style-type: none"> <li>Described as an industry leader by a recent study [REDACTED]</li> <li>[REDACTED] manages program implementation</li> <li>Excellent financial strength, Washington based</li> <li>The [REDACTED] MW opti[REDACTED] makes it a small scale project well suited for conceptual testing</li> </ul>	<ul style="list-style-type: none"> <li>Proposal schedule includes significant ramp up of customer participation in first program year (2023); unclear if this is feasible</li> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.
<b>18205</b> [REDACTED] Commercial & industrial curtailment MW COD: 1/1/2021 Term: 5 years	Not applicable, please see selection recommendation & rational section to the right [REDACTED]	<ul style="list-style-type: none"> <li>Winter peak experience</li> <li>Commercial and Industrial segment provides a diversification benefit</li> </ul>	<ul style="list-style-type: none"> <li>Concern about ability to integrate with PSE's in-development distributed energy resource management system (DERMS)</li> <li>Counterparty has only been established since 2016, and has not been financially profitable.</li> </ul>	<b>Not Selected</b> – Project not selected due to qualitative risks and because demand response was determined not to be cost effective in the 2018 RFP without identifiable deferred transmission and distribution costs.
<b>UP002</b> [REDACTED] REC purchase REC COD: 1/1/2020 Term: 15 years	Levelized cost: \$ [REDACTED] / MWh Portfolio benefit: \$4,502 M Levelized PB/REC: \$ [REDACTED] ** Net Cost PV: \$1,153 M Peak capacity contribution (MW): ( ) Annual REC contribution: ( )	<ul style="list-style-type: none"> <li>Not applicable</li> </ul>	<ul style="list-style-type: none"> <li>Price is higher and volume is smaller than other REC offers received in response this RFP.</li> </ul>	<b>Not Selected</b> – Project not selected during portfolio optimization process.

**Common acronyms:**

- BESS Battery energy storage system
- BTS Build to sell
- COD Commercial operation date
- CTA Capacity Tolling Agreement
- PPA Power purchase agreement
- REC Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No. C02 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED VERSION

REDACTED VERSION



**2018 RFP – HIGHLY CONFIDENTIAL**  
July 23, 2019

Project	Quantitative Results**	Qualitative Advantages (+)	Qualitative Risks (-)	Selection Recommendation & Rationale
<b>XXXXX</b> <b>Colstrip Transmission System Redirection</b> Puget Sound Energy N/A Transmission redirect 1,000 MW COD: 01/01/2022 Term: 56-year book life	Levelized cost: █ Portfolio benefit: \$57,274 M Peak Capacity PB / kW-Yr: █ Net Cost PV: \$27,905 M Peak capacity contribution (MW): █ Annual REC contribution: █	<ul style="list-style-type: none"> <li>If feasible, redirect to Mid-C would provide a strong capacity resource</li> </ul>	<ul style="list-style-type: none"> <li>Increased exposure to market prices (for redirect to Mid-C)</li> <li>Redirects require Available Transmission Capacity (ATC) between the new points of receipt and delivery. With no ATC between Mid-C and BPA, PSEI, a redirect to Mid-C is unfeasible.</li> <li>Redirecting elsewhere on BPA's system would require appropriate ATC, as well as an energy source at the redirect point, which may nullify contribution to peak capacity.</li> </ul>	<b>Not Selected</b> – Proposal withdrawn from consideration due to lack of Available Transmission Capacity (ATC).

**Common acronyms:**

BESS	Battery energy storage system
BTS	Build to sell
COD	Commercial operation date
CTA	Capacity Tolling Agreement
PPA	Power purchase agreement
REC	Renewable energy credit

\*This matrix summarizes key findings from PSE's Phase 2 analysis. A more detailed discussion of the merits and risks of each proposal is documented in individual project memos.  
 \*\*Represents best offer configuration from standalone quantitative analysis (PSM version 13, run 20190612) in No CO2 updated with SB100 scenario. See detailed Phase 2 standalone quantitative analysis results for individual offer results in all scenarios. Optimization analysis may select different best offer configuration based on best solution (offer or combination of offers) to meet resource need.  
 \*\*\*Indicates primary ranking criteria for particular proposal category.

REDACTED VERSION

REDACTED VERSION

# 2018 RFP Phase II Quantitative Results Summary- CAPACITY PROPOSALS

As of July 23, 2019

Primary Funding Classes  
Secondary Classes  
Credit Line

ID	Capacity Proposal Project Name	Technology	Term Start	Bank Contract Term	Bank Nameplate Capacity (MW)	Peak Capacity Credit	Levelized PE / (Peak Capacity kW - 1R)			Banking Levelized PE / (Peak Capacity kW - 1R)			Net Cost / (kW-yr)			Rising Light Cost / (kW-yr)		
							NO CO2 (Low Use)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Use)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Cost)	NO CO2 (Mid-Social)	NO CO2 (High-Social)	NO CO2 (Low Cost)	NO CO2 (Mid-Social)	NO CO2 (High-Social)
1	18170 Golden Hills Shared	WT	Dec-20	25	300 MW	78.8												
2	18107	WT	Dec-20	25	37 MW	16.4												
3	18100 SPI Industrial Biomass	Biomass	Jan-21	37	37 MW													
4	18173	MT Wind	Oct-22	20														
5	18173	MT Wind	Oct-22	20														
6	16161 BPA Peak Capacity Product	Capacity	Jan-22	5	100 MW	54.0												
7	18105	Thermal	Jan-22	20														
8	18105	Thermal	Jun-22	10														
9	18105	Thermal	Jan-22	20														
10	18201	DR	Jan-23	6														
11	18205	DR	Jan-21	5														
12	18205	WT Wind	Dec-22	20														
13	18XXX	Transmission Redirect																

- Notes:
- The metric shown - Levelized PE / (Peak Capacity kW - 1R) - is the portfolio benefit attributable to peak capacity service divided by the average peak capacity.
  - Generation Resources with a peak capacity contribution (as described by ELC, or Effective Load Carrying Contribution) of 30% or higher were considered "Capacity Resources".
  - Generation Resources with Mid-C delivery are not considered Capacity Resources regardless of ELC.
  - Capacity-specific contracts and products such as Demand Response, Transmission Redirect, and BPA Capacity are considered alongside generation resources.
  - None of the demand response projects in Phase II were selected, as there was no identifiable deferred TBD value that would have made it a cost effective solution. In addition, the providers' lack of experience in integrating with PG&E DERM (Distributed Energy Resource Management) system was deemed to be a critical hindrance to implementation.
  - Transmission Redirect has been eliminated as a viable option to meet capacity need.
  - All of the Demand Response projects were eliminated as viable options to meet capacity need.
  - Transmission Redirect was eliminated as a viable option due to various qualitative factors, including indeterminate production capacity figures.

REDACTED VERSION

REDACTED VERSION

# 2018 RFP Phase II Quantitative Results Summary- RENEWABLE PROPOSALS

As of July 23, 2019



ID	Renewable Proposal Project Name	Technology	Form Size (MW)	Renewable Capacity (MW)	Verified PPA REC			Renewable PPA REC			Levelized PPA REC			Renewable PPA REC			Renewable PPA REC							
					NO2 Low w/300	NO2 Medium w/300	NO2 High w/300	NO2 Low w/300	NO2 Medium w/300	NO2 High w/300	NO2 Low w/300	NO2 Medium w/300	NO2 High w/300	NO2 Low w/300	NO2 Medium w/300	NO2 High w/300	NO2 Low w/300	NO2 Medium w/300	NO2 High w/300					
1	181816	REC Only	Jan-22	18	1	1	3	24	34	36	1	1	3	15	26	32	31	8	3	15	26	32	31	
2	181816	REC Only	Jan-22	18	2	2	4	23	33	35	2	2	4	23	33	35	33	12	6	18	28	35	33	
3	181890	REC Only	Jan-20	20	3	3	3	1	20	33	31	3	3	3	1	20	33	31	7	2	13	24	31	29
4	181890	REC Only	Jan-21	25	24	4	6	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
5	181890	REC Only	Jan-20	15	19	5	14	26	32	32	21	6	1	20	31	31	31	9	4	16	27	33	32	
6	181900	REC Only	Jan-20	12	30	7	18	13	4	2	30	7	18	13	4	2	2	11	5	13	24	34	29	
7	181758	REC Only	Oct-21	20	5	8	10	15	20	19	13	13	13	13	13	13	13	13	13	13	13	13	13	
8	181890	REC Only	Jan-21	20	6	6	10	11	4	3	5	6	6	6	6	6	6	6	6	6	6	6	6	
9	181890	REC Only	Jan-21	20	6	6	10	11	4	3	5	6	6	6	6	6	6	6	6	6	6	6	6	
10	18117	Solar	Dec-22	20	11	11	24	6	8	7	8	12	7	9	9	8	7	10	10	10	10	10	10	
11	18132	Solar	Jan-23	20	8	12	7	9	9	8	7	8	12	7	9	9	8	7	10	10	10	10	10	
12	18135	Solar	Jan-23	20	10	10	13	8	10	10	11	10	10	10	10	10	10	11	10	10	10	10	10	
13	18125	Solar	Jan-23	20	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	
14	18127	Solar	Dec-21	15	15	14	16	13	14	12	15	14	16	13	14	12	15	14	16	13	14	12	15	
15	18132	Wind	Jan-23	20	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	
16	18125	Solar	Jan-23	15	14	16	13	14	12	15	14	16	13	14	12	15	14	16	13	14	12	15	14	
17	18179	MT Wind	Oct-21	20	27	17	23	19	14	13	21	17	21	17	21	17	21	17	21	17	21	17	21	
18	18111	Solar	Dec-21	20	12	18	9	7	2	2	18	9	7	2	2	18	9	7	2	2	18	9	7	
19	18139	Solar	Jan-21	10	18	19	17	17	15	18	18	19	17	17	15	18	18	19	17	17	15	18	18	
20	18132	Wind	Jan-21	20	9	20	15	5	13	14	20	15	5	13	14	20	15	5	13	14	20	15	5	
21	18144	Solar	Dec-21	20	18	21	16	16	18	9	21	16	16	18	9	21	16	16	18	9	21	16	16	
22	18144	Solar	Dec-21	20	18	21	16	16	18	9	21	16	16	18	9	21	16	16	18	9	21	16	16	
23	18152	Wind	Jan-21	25	20	23	25	26	21	21	23	25	26	21	21	23	25	26	21	21	23	25	26	
24	18170	Wind	Jan-21	20	13	24	20	11	16	17	17	13	24	20	11	16	17	17	13	24	20	11	16	
25	18170	Wind	Dec-20	20	22	26	29	8	6	3	22	26	29	8	6	3	22	26	29	8	6	3	22	
26	18170	Wind	Dec-20	20	22	26	29	8	6	3	22	26	29	8	6	3	22	26	29	8	6	3	22	
27	18166	Solar	Jan-23	25	17	27	21	18	19	20	17	27	21	18	19	20	17	27	21	18	19	20	17	
28	18166	Solar	Jan-23	25	23	28	30	30	26	26	23	28	30	30	26	26	23	28	30	30	26	26	23	
29	18139	Solar + BES	Jan-23	10	35	29	22	22	22	22	35	29	22	22	22	22	35	29	22	22	22	22	22	
30	18139	Solar + BES	Jan-23	10	26	30	28	27	24	25	26	30	28	27	24	25	26	30	28	27	24	25	26	
31	18176	Wind	Jan-21	25	27	27	27	27	27	27	27	27	27	27	27	27	27	27	27	27	27	27	27	
32	18166	Wind	Jan-21	25	25	32	32	32	27	27	25	32	32	32	27	27	25	32	32	32	27	27	25	
33	18170	Wind	Dec-20	20	29	33	19	28	17	16	29	33	19	28	17	16	29	33	19	28	17	16	29	
34	18100 JTI Industrial Biomass	Biomass	Jan-21	17	31	34	35	34	28	28	31	34	35	34	28	28	31	34	35	34	28	28	31	
35	18170	Wind	Dec-20	25	28	25	27	31	28	24	28	25	27	31	28	24	28	25	27	31	28	24	28	
36	18170	Wind	Dec-20	25	28	25	27	31	28	24	28	25	27	31	28	24	28	25	27	31	28	24	28	
37	18170	Wind	Dec-20	20	36	36	36	36	36	31	36	36	36	36	36	31	36	36	36	36	36	36	31	
38	18190	MT Wind	Jan-21	20	33	34	34	34	34	34	33	34	34	34	34	34	33	34	34	34	34	34	34	

Notes:  
 1. The metric shown--Levelized PPA / REC-- is the portfolio benefit attributable divided by RECs generated.  
 2. For generation resources with a peak capacity contribution (as described by ELCC, or Effective Load Carrying Contribution) of 3.2% or higher, the Renewable Portfolio Benefit was recomputed by isolating the portfolio benefit attributable to REC generation. Resources with Mid-C delivery are considered to have zero capacity value.  
 3. [REDACTED] was eliminated as a viable option due to various qualitative factors, including indeterminate production capacity figures.

REDACTED VERSION

REDACTED VERSION

# Portfolio Optimization Summary: as of 7.23.2019

(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)	(L)	(M)	(N)
List ID	Resource	Project	Nameplate	Peak Capacity Credit	RECs <sup>1</sup>	Preferred Optimized Portfolio: Renewables	As Proposed Optimized Portfolio: Renewables	Optimized Lowest Cost Portfolio to Deficit with Generic Battery	Backup Portfolio: Renewables	Contingency Portfolio: MT Wind	Optimized Lowest Cost Portfolio with NO In Costs Consideration	Optimized Lowest Cost Portfolio with Carbon Costs Consideration	
1	18100 Biomass	SPI	17 MW	16 MW		X	X	X	X	X	X	X	
2	18161 Call Option	BPA Peak Capacity Product	100 MW	53 MW		X	X	X	X	X	X	X	
3a	18169 MT Wind					X	X	X	X	X	X	X	
3b	18169 MT Wind					X	X	X	X	X	X	X	
4a	18173 MT Wind					X	X	X	X	X	X	X	
4b	18173 MT Wind					X	X	X	X	X	X	X	
5a	18170 Wind	Golden Hill Shaped	200 MW	77 MW		X	X	X	X	X	X	X	
5b	18170 Wind					X	X	X	X	X	X	X	
6	18132 Wind					X	X	X	X	X	X	X	
7	18179 Wind					X	X	X	X	X	X	X	
8	18166 Wind					X	X	X	X	X	X	X	
9	18175 Wind					X	X	X	X	X	X	X	
###	18125 Solar					X	X	X	X	X	X	X	
###	18111 Solar					X	X	X	X	X	X	X	
###	18127 Solar					X	X	X	X	X	X	X	
###	18135 Solar					X	X	X	X	X	X	X	
###	18139 Solar					X	X	X	X	X	X	X	
###	18131 Solar					X	X	X	X	X	X	X	
###	18114 Solar					X	X	X	X	X	X	X	
###	18122 Solar					X	X	X	X	X	X	X	
###	18163 REC-only					X	X	X	X	X	X	X	
###	18165 REC-only					X	X	X	X	X	X	X	
###	UP-002 REC-only					X	X	X	X	X	X	X	
###	18103 Thermal					X	X	X	X	X	X	X	
###	XXXXX Generic	Generic Peaker	237 MW	224 MW	N/A								
###	XXXXX Generic	Generic Battery	61 MW	23 MW	N/A								
###	Total Peak Capacity Credits - MWs												
###	Peak Capacity Surplus / (Deficit) in 2022 <sup>1</sup>												
###	Total Annual RECs												
###	Portfolio Benefits - \$M												
###	With Consideration of Social Cost of Carbon:												
###	Portfolio Benefits w/ Carbon Costs as an Adder - \$M <sup>5</sup>												
###	Portfolio Benefits w/ Carbon Costs in Dispatch Costs - \$M												

Peak Capacity and REC Need 2022-2025	2022	2023	2024	2025
Peak Capacity Need	299 MW	281 MW	325 MW	457 MW
REC Need	0	233,449	697,664	700,482

1. The annual project RECs in column 1 does not include 0.2X apprenticeship multiplier.  
 2. The optimization model chose a portfolio with MW from [REDACTED] and [REDACTED], but not MW. The size of [REDACTED] project is reduced from the proposed MW option [REDACTED] on available transmission capacity. The [REDACTED] MW option [REDACTED] in total PPA costs is [REDACTED].  
 3. The current project COD for [REDACTED] is [REDACTED]. There has been perceived timing risks [REDACTED] If the COD is delayed to Dec 2022 to mitigate this risk, NPV of [REDACTED] in total PPA costs is [REDACTED].  
 4. Final Portfolio ELCC reduce the sum of individual project peak capacity contribution by 8 MW. It could potentially be mitigated by 1) short-term capacity purchase for \$720k per year; 2) a 20MW battery for \$41M.  
 5. Social cost of carbon at \$60/metric ton in 2010 dollars plus escalation is added to total portfolio costs as fixed cost.

CONFIDENTIAL

REDACTED VERSION