

**EXHIBIT NO. ___(LEO-4)
DOCKET NO. UE-09___/UG-09___
2009 PSE GENERAL RATE CASE
WITNESS: LOUIS E. ODOM**

**BEFORE THE
WASHINGTON UTILITIES AND TRANSPORTATION COMMISSION**

**WASHINGTON UTILITIES AND
TRANSPORTATION COMMISSION,**

Complainant,

v.

PUGET SOUND ENERGY, INC.,

Respondent.

**Docket No. UE-09___
Docket No. UG-09___**

**THIRD EXHIBIT (NONCONFIDENTIAL) TO THE
PREFILED DIRECT TESTIMONY OF
LOUIS E. ODOM
ON BEHALF OF PUGET SOUND ENERGY, INC.**

MAY 8, 2009

GE Energy

Heavy-Duty Gas Turbine Operating and Maintenance Considerations

David Balevic

GE Energy
Atlanta, GA

Robert Burger

GE Energy
Atlanta, GA

David Forry

GE Energy
Greenville, SC



CONTENTS

Introduction	1
Maintenance Planning	1
Gas Turbine Design Maintenance Features	3
Borescope Inspections	4
Major Factors Influencing Maintenance and Equipment Life	4
Starts and Hours Criteria	5
Service Factors	6
Fuel	6
Firing Temperatures	9
Steam/Water Injection.....	10
Cyclic Effects	11
Hot Gas Path Parts	11
Rotor Parts	13
Combustion Parts	16
Off-Frequency Operation	17
Air Quality	19
Lube Oil Cleanliness.....	20
Moisture Intake	21
Maintenance Inspections	22
Standby Inspections	22
Running Inspections	22
Load vs. Exhaust Temperature.....	23
Vibration Level	23
Fuel Flow and Pressure	23
Exhaust Temperature and Spread Variation	23
Start-Up Time	24
Coast-Down Time	24
Rapid Cool-Down	24
Combustion Inspection	24
Hot Gas Path Inspection.....	25
Major Inspection	28
Parts Planning	30
Inspection Intervals	32
Hot Gas Path Inspection Interval	32
Rotor Inspection Interval.....	33
Combustion Inspection Interval	35

Manpower Planning36
Conclusion.....37
References.....37
Acknowledgments38
Appendix39
Revision History52
List of Figures53

INTRODUCTION

Maintenance costs and availability are two of the most important concerns to a heavy-duty gas turbine equipment owner. Therefore, a well thought out maintenance program that optimizes the owner's costs and maximizes equipment availability should be instituted. For this maintenance program to be effective, owners should develop a general understanding of the relationship between the operating plans and priorities for the plant, the skill level of operating and maintenance personnel, and all equipment manufacturer's recommendations regarding the number and types of inspections, spare parts planning, and other major factors affecting component life and proper operation of the equipment.

In this paper, operating and maintenance practices for heavy-duty gas turbines will be reviewed, with emphasis placed on types of inspections plus operating factors that influence maintenance schedules. A well-planned maintenance program will result in maximum equipment availability and optimization of maintenance costs.

Note:

- The operation and maintenance practices outlined in this document are based on full utilization of GE approved parts, repairs, and services.
- The operating and maintenance discussions presented in this paper are generally applicable to all GE heavy-duty gas turbines; i.e., MS3000, 5000, 6000, 7000 and 9000. For purposes of illustration, the MS7001EA was chosen. Specific questions on a given machine should be directed to the local GE Energy representative.

MAINTENANCE PLANNING

Advanced planning for maintenance is a necessity for utility, industrial, independent power producers and cogeneration plant operators in order to minimize downtime. Also the correct implementation of planned

maintenance and inspection provides direct benefits in reduced forced outages and increased starting reliability, which in turn can also reduce unscheduled repairs and downtime. The primary factors that affect the maintenance planning process are shown in *Figure 1* and the owners' operating mode and practices will determine how each factor is weighted.

Parts unique to a gas turbine requiring the most careful attention are those associated with the combustion process together with those exposed to high temperatures from the hot gases discharged from the combustion system. They are called the combustion section and hot gas path parts and will include combustion liners, end caps, fuel nozzle assemblies, crossfire tubes, transition pieces, turbine nozzles, turbine stationary shrouds and turbine buckets.

An additional area for attention, though a longer-term concern, is the life of the compressor and turbine rotors.

The basic design and recommended maintenance of GE heavy-duty gas turbines are oriented toward:

- Maximum periods of operation between inspection and overhauls
- In-place, on-site inspection and maintenance
- Use of local trade skills to disassemble, inspect and re-assemble

In addition to maintenance of the basic gas turbine, the control devices, fuel metering equipment, gas turbine auxiliaries, load package, and other station auxiliaries also require periodic servicing.

It is apparent from the analysis of scheduled outages and forced outages (*Figure 2*) that the primary maintenance effort is attributed to five basic systems: controls and accessories, combustion, turbine, generator and balance-of-plant. The unavailability of controls and accessories is generally composed of short-duration outages, whereas conversely the other four systems are composed of fewer, but usually longer-duration outages.

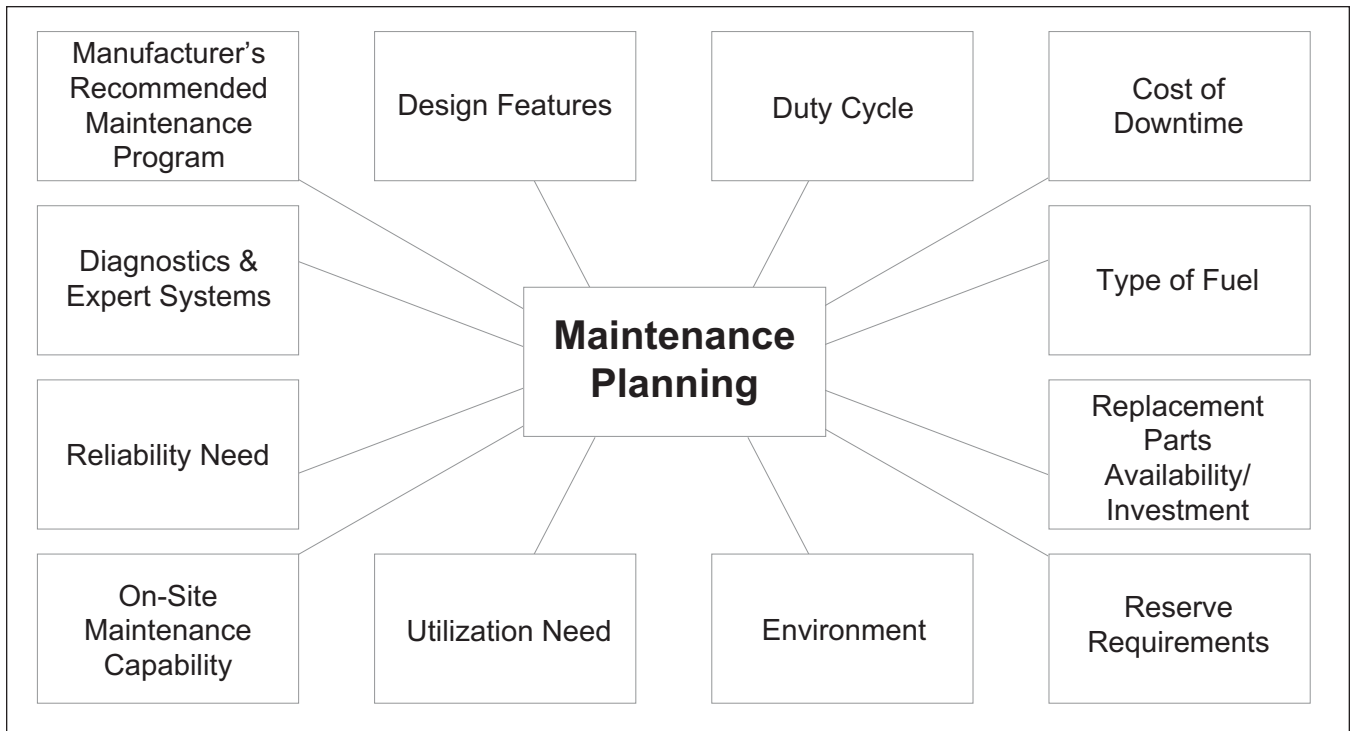


Figure 1. Key factors affecting maintenance planning

The inspection and repair requirements, outlined in the Operations and Maintenance Manual provided to each owner, lend themselves to establishing a pattern of inspections. In addition, supplementary information is provided through a system of Technical Information Letters. This updating of information, contained in the

Operations and Maintenance Manual, assures optimum installation, operation and maintenance of the turbine. Many of the Technical Information Letters contain advisory technical recommendations to help resolve issues (as they become known) and to help improve the operation, maintenance, safety, reliability

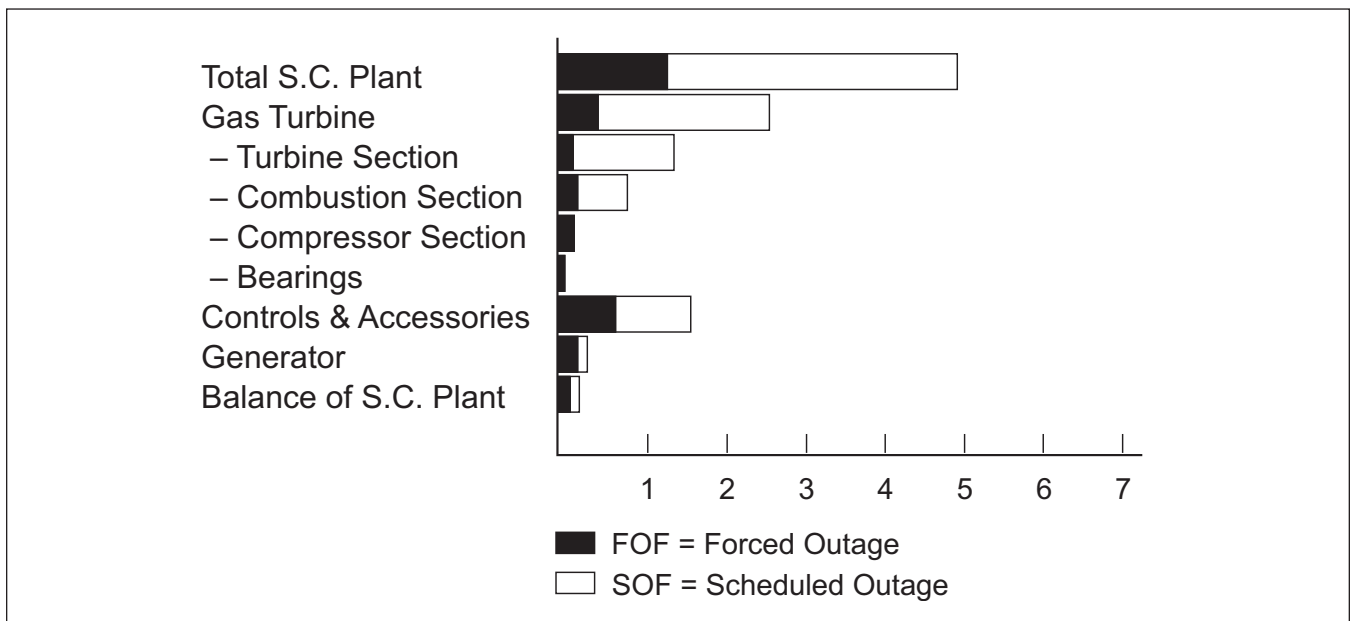


Figure 2. Plant level – top five systems contribution to downtime

or availability of the turbine. The recommendations contained in Technical Information Letters should be reviewed and factored into the overall maintenance planning program.

For a maintenance program to be effective, from both a cost and turbine availability standpoint, owners must develop a general understanding of the relationship between their operating plans and priorities for the plant and the manufacturer's recommendations regarding the number and types of inspections, spare parts planning, and other major factors affecting the life and proper operation of the equipment. Each of these issues will be discussed as follows in further detail.

GAS TURBINE DESIGN MAINTENANCE FEATURES

The GE heavy-duty gas turbine is designed to withstand severe duty and to be maintained onsite, with off-site repair required only on certain combustion components, hot-gas-path parts and rotor assemblies needing specialized shop service. The following features are designed into GE heavy-duty gas turbines to facilitate on-site maintenance:

- All casings, shells and frames are split on machine horizontal centerline. Upper halves may be lifted individually for access to internal parts.
- With upper-half compressor casings removed, all stator vanes can be slid circumferentially out of the casings for inspection or replacement without rotor removal. On most designs, the variable inlet guide vanes (VIGVs) can be removed radially with upper half of inlet casing removed.
- With the upper-half of the turbine shell lifted, each half of the first stage nozzle assembly can be removed for inspection, repair or replacement without rotor removal. On some units, upper-half, later-stage nozzle assemblies are lifted with the turbine shell, also allowing inspection and/or removal of the turbine buckets.

- All turbine buckets are moment-weighted and computer charted in sets for rotor spool assembly so that they may be replaced without the need to remove or rebalance the rotor assembly.
- All bearing housings and liners are split on the horizontal centerline so that they may be inspected and replaced, when necessary. The lower half of the bearing liner can be removed without removing the rotor.
- All seals and shaft packings are separate from the main bearing housings and casing structures and may be readily removed and replaced.
- On most designs, fuel nozzles, combustion liners and flow sleeves can be removed for inspection, maintenance or replacement without lifting any casings. All major accessories, including filters and coolers, are separate assemblies that are readily accessible for inspection or maintenance. They may also be individually replaced as necessary.

Inspection aid provisions have been built into GE heavy-duty gas turbines to facilitate conducting several special inspection procedures. These special procedures provide for the visual inspection and clearance measurement of some of the critical internal turbine gas-path components without removal of the gas turbine outer casings and shells. These procedures include gas-path borescope inspection and turbine nozzle axial clearance measurement.

A GE gas turbine is a fully integrated design consisting of stationary and rotating mechanical, fluid, thermal, and electrical systems. The turbine's performance, as well as the performance of each component within the turbine, is dependent upon the operating inter-relationship between internal components. GE's tollgated engineering process evaluates the impacts of design changes or repairs on the interaction between components and systems. This design, evaluation, testing, and approval process is predicated upon assuring the proper balance and interaction between all components and systems for safe, reliable, and economical operation.

Whether a part is new, repaired, or modified, failure to evaluate the full system impact may have unquantifiable negative impacts on the operation and reliability of the entire system. The use of non-GE approved parts, repairs, and maintenance practices represent a significant risk. Pursuant to the governing terms and conditions, warranties and performance guarantees are conditioned upon proper storage, installation, operation, and maintenance, as well as conformance to GE approved operating instruction manuals and repair/modification procedures.

Borescope Inspections

GE heavy-duty gas turbines incorporate provisions in both compressor casings and turbine shells for gas-path visual inspection of intermediate compressor rotor stages, first, second and third-stage turbine buckets and turbine nozzle partitions by means of the optical borescope. These provisions, consisting of radially aligned holes through the compressor casings, turbine shell and internal stationary turbine shrouds, are designed to allow the penetration of an optical borescope into the compressor or turbine flow path area, as shown in *Figure 3*. Borescope inspection access locations for F Class gas turbines can be found in Appendix E.

An effective borescope inspection program can result in removing casings and shells from a turbine unit

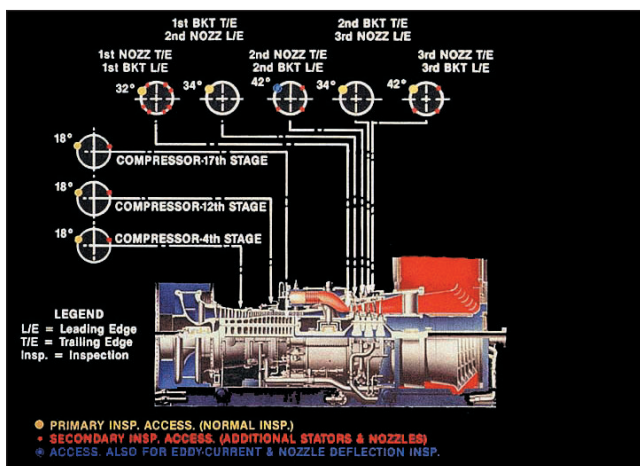


Figure 3. MS7001E gas turbine borescope inspection access locations

only when it is necessary to repair or replace parts. *Figure 4* provides a recommended interval for a planned borescope inspection program following initial base line inspections. It should be recognized that these borescope inspection intervals are based on average unit operating modes. Adjustment of these borescope intervals may be made based on operating experience and the individual unit mode of operation, the fuels used and the results of previous borescope inspections.

Borescope	Gas and Distillate Fuel Oil	At Combustion Inspection or Annually, Whichever Occurs First
	Heavy Fuel Oil	At Combustion Inspection or Semiannually, Whichever Occurs First

Figure 4. Borescope inspection programming

The application of a monitoring program utilizing a borescope will allow scheduling outages and pre-planning of parts requirements, resulting in lower maintenance costs and higher availability and reliability of the gas turbine.

MAJOR FACTORS INFLUENCING MAINTENANCE AND EQUIPMENT LIFE

There are many factors that can influence equipment life and these must be understood and accounted for in the owner's maintenance planning. As indicated in *Figure 5*, starting cycle, power setting, fuel and level of steam or water injection are key factors in determining the maintenance interval requirements as these factors directly influence the life of critical gas turbine parts.

- Cyclic Effects
- Firing Temperature
- Fuel
- Steam/Water Injection

Figure 5. Maintenance cost and equipment life are influenced by key service factors

In the GE approach to maintenance planning, a gas fuel unit operating continuous duty, with no water or steam injection, is established as the baseline condition which sets the maximum recommended maintenance intervals. For operation that differs from the baseline, maintenance factors are established that determine the increased level of maintenance that is required. For example, a maintenance factor of two would indicate a maintenance interval that is half of the baseline interval.

Starts and Hours Criteria

Gas turbines wear in different ways for different service-duties, as shown in *Figure 6*. Thermal mechanical fatigue is the dominant limiter of life for peaking machines, while creep, oxidation, and corrosion are the dominant limiters of life for continuous duty machines. Interactions of these mechanisms are considered in the GE design criteria, but to a great extent are second order effects. For that reason, GE bases gas turbine maintenance requirements on independent counts of starts and hours. Whichever criteria limit is first reached determines the maintenance interval. A graphical display of the GE approach is shown in *Figure 7*. In

• Continuous Duty Application

- Rupture
- Creep Deflection
- High-Cycle Fatigue
- Corrosion
- Oxidation
- Erosion
- Rubs/Wear
- Foreign Object Damage

• Cyclic Duty Application

- Thermal Mechanical Fatigue
- High-Cycle Fatigue
- Rubs/Wear
- Foreign Object Damage

Figure 6. Causes of wear – hot gas path components

this figure, the inspection interval recommendation is defined by the rectangle established by the starts and hours criteria. These recommendations for inspection fall within the design life expectations and are selected such that components verified to be acceptable for continued use at the inspection point will have low risk of failure during the subsequent operating interval.

An alternative to the GE approach, which is sometimes employed by other manufacturers, converts each start cycle to an equivalent number of operating hours (EOH) with inspection intervals based on the equivalent hours count. For the reasons previously stated, GE does not agree with this approach. This logic can create the impression of longer intervals; while in reality more frequent maintenance inspections are required. Referring again to *Figure 7*, the starts and hours inspection “rectangle” is reduced in half as defined by the diagonal line from the starts limit at the upper left hand corner to the hours limit at the lower right hand corner. Midrange duty applications, with hours per start ratios of 30-50, are particularly penalized by this approach.

This is further illustrated in *Figure 8* for the example of an MS7001EA gas turbine operating on gas fuel, at base load conditions with no steam or water injection or trips from load. The unit operates 4000 hours and 300 starts per year. Following GE’s recommendations, the operator would perform the hot gas path inspection after four years of operation, with starts being the limiting condition. Performing maintenance on this same unit based on an equivalent hours criteria would require a hot gas path inspection after 2.4 years. Similarly, for a continuous duty application operating 8000 hours and 160 starts per year, the GE recommendation would be to perform the hot gas path inspection after three years of operation with the operating hours being the limiting condition for this case. The equivalent hours criteria would set the hot gas path inspection after 2.1 years of operation for this application.

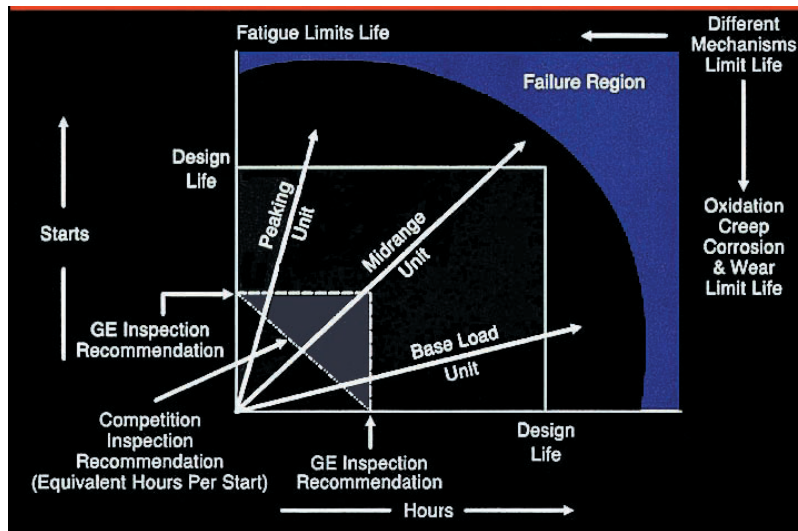


Figure 7. GE bases gas turbine maintenance requirements on independent counts of starts and hours

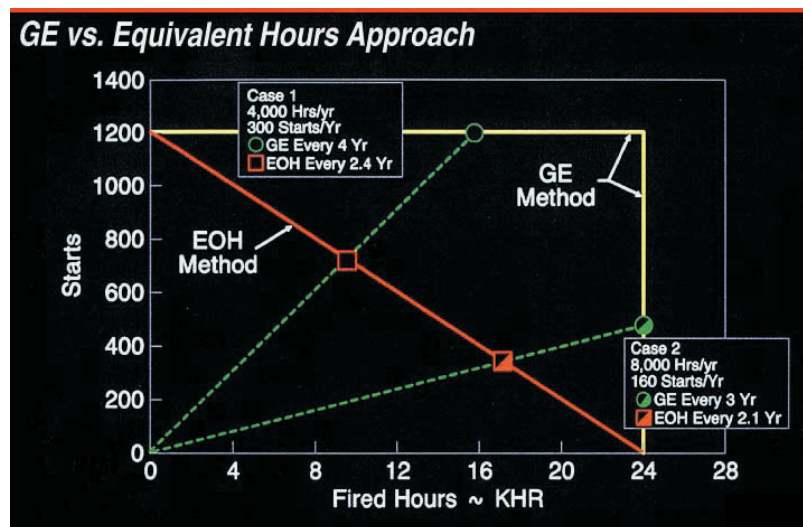


Figure 8. Hot gas path maintenance interval comparisons. GE method vs. EOH method

Service Factors

While GE does not ascribe to the equivalency of starts to hours, there are equivalencies within a wear mechanism that must be considered. As shown in *Figure 9*, influences such as fuel type and quality, firing temperature setting, and the amount of steam or water injection are considered with regard to the hours-based criteria. Startup rate and the number of trips are considered with regard to the starts-based criteria. In both cases, these influences may act to reduce the maintenance intervals. When these service or maintenance factors are involved in a unit's operating

profile, the hot-gas-path maintenance “rectangle” that describes the specific maintenance criteria for this operation is reduced from the ideal case, as illustrated in *Figure 10*. The following discussion will take a closer look at the key operating factors and how they can impact maintenance intervals as well as parts refurbishment/replacement intervals.

Fuel

Fuels burned in gas turbines range from clean natural gas to residual oils and impact maintenance, as illustrated in *Figure 11*. Heavier hydrocarbon fuels

Typical Max Inspection Intervals (MS6B/MS7EA)		
Hot Gas Path Inspection	24,000 hrs or 1200 starts	
Major Inspection	48,000 hrs or 2400 starts	
Criterion is Hours or Starts (Whichever Occurs First)		
Factors Impacting Maintenance		
Hours Factors		
• Fuel	Gas	1
	Distillate	1.5
	Crude	2 to 3
	Residual	3 to 4
• Peak Load	Injection	
	Dry Control	1 (GTD-222)
	Wet Control	1.9 (5% H ₂ O GTD-222)
• Water/Steam	Injection	
	Dry Control	1 (GTD-222)
	Wet Control	1.9 (5% H ₂ O GTD-222)
Starts Factors		
• Trip from Full Load		8
• Fast Load		2
• Emergency Start		20

Figure 9. Maintenance factors – hot gas path (buckets and nozzles)

have a maintenance factor ranging from three to four for residual fuel and two to three for crude oil fuels. These fuels generally release a higher amount of radiant thermal energy, which results in a subsequent reduction in combustion hardware life, and frequently contain corrosive elements such as sodium, potassium, vanadium and lead that can lead to accelerated hot corrosion of turbine nozzles and buckets. In addition, some elements in these fuels can cause deposits either directly or through compounds formed with inhibitors that are used to prevent corrosion. These deposits impact

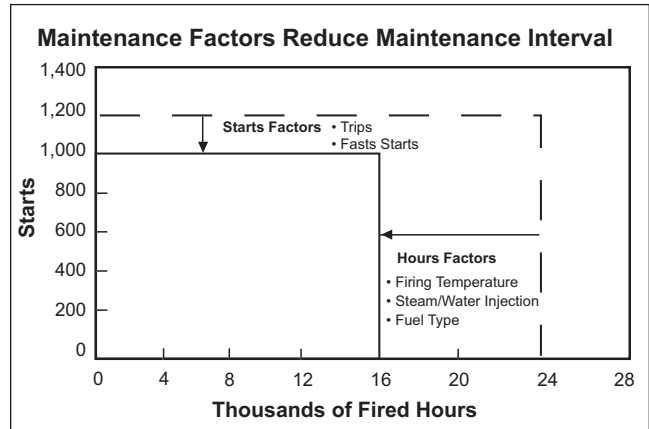


Figure 10. GE maintenance interval for hot-gas inspections

performance and can lead to a need for more frequent maintenance.

Distillates, as refined, do not generally contain high levels of these corrosive elements, but harmful contaminants can be present in these fuels when delivered to the site. Two common ways of contaminating number two distillate fuel oil are: salt water ballast mixing with the cargo during sea transport, and contamination of the distillate fuel when transported to site in tankers, tank trucks or pipelines that were previously used to transport contaminated fuel, chemicals or leaded gasoline. From Figure 11, it can be seen that GE's experience with distillate fuels indicates that the hot gas path maintenance factor can range from as low as one

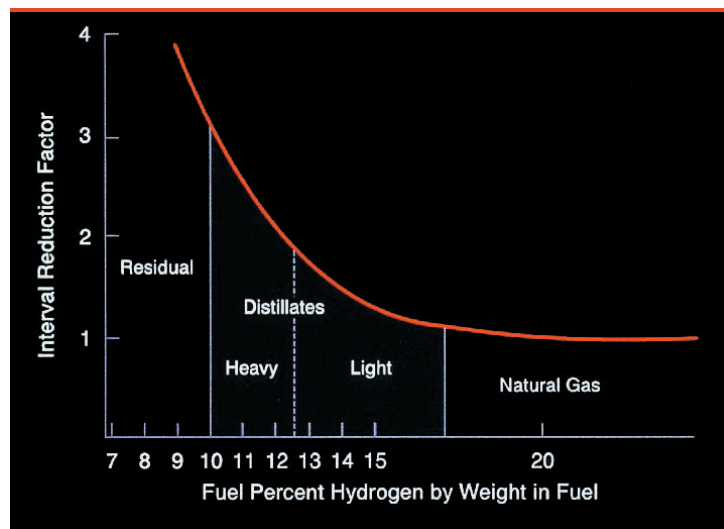


Figure 11. Estimated effect of fuel type on maintenance

(equivalent to natural gas) to as high as three. Unless operating experience suggests otherwise, it is recommended that a hot gas path maintenance factor of 1.5 be used for operation on distillate oil. Note also that contaminants in liquid fuels can affect the life of gas turbine auxiliary components such as fuel pumps and flow dividers.

As shown in *Figure 11*, gas fuels, which meet GE specifications, are considered the optimum fuel with regard to turbine maintenance and are assigned no negative impact. The importance of proper fuel quality has been amplified with Dry Low NO_x (DLN) combustion systems. Proper adherence to GE fuel specifications in GEI-41040 and GEI-41047 is required to allow proper combustion system operation, and to maintain applicable warranties. Liquid hydrocarbon carryover can expose the hot gas path hardware to severe overtemperature conditions and can result in significant reductions in hot gas path parts lives or repair intervals. Owners can control this potential issue by using effective gas scrubber systems and by superheating the gaseous fuel prior to use to provide a nominal 50°F (28°C) of superheat at the turbine gas control valve connection. Integral to the system, coalescing filters installed upstream of the performance gas heaters is a best practice and ensures the most efficient removal of liquids and vapor phase constituents.

The prevention of hot corrosion of the turbine buckets and nozzles is mainly under the control of the owner. Undetected and untreated, a single shipment of contaminated fuel can cause substantial damage to the gas turbine hot gas path components. Potentially high maintenance costs and loss of availability can be minimized or eliminated by:

- Placing a proper fuel specification on the fuel supplier. For liquid fuels, each shipment should include a report that identifies specific gravity, flash point, viscosity, sulfur content, pour point and ash content of the fuel.

- Providing a regular fuel quality sampling and analysis program. As part of this program, an online water in fuel oil monitor is recommended, as is a portable fuel analyzer that, as a minimum, reads vanadium, lead, sodium, potassium, calcium and magnesium.
- Providing proper maintenance of the fuel treatment system when burning heavier fuel oils and by providing cleanup equipment for distillate fuels when there is a potential for contamination.

In addition to their presence in the fuel, contaminants can also enter the turbine via the inlet air and from the steam or water injected for NO_x emission control or power augmentation. Carryover from evaporative coolers is another source of contaminants. In some cases, these sources of contaminants have been found to cause hot-gas-path degradation equal to that seen with fuel-related contaminants. GE specifications define limits for maximum concentrations of contaminants for fuel, air and steam/water.

In addition to fuel quality, fuel system operation is also a factor in equipment maintenance. Liquid fuel may remain unpurged and in contact with hot combustion components after shutdown, as well as stagnate in the fuel system when strictly gas fuel is run for an extended time. To minimize varnish and coke accumulation, dual fuel units (gas and liquid capable) should be shut down running gas fuel whenever possible. Likewise, during extended operation on gas, regular transfers from gas to liquid are recommended to exercise the system components and minimize coking.

Contamination and build-up may prevent the system from removing fuel oil and other liquids from the combustion, compressor discharge, turbine, and exhaust sections when the unit is shutdown or during startup. Liquid fuel oil trapped in the system piping also creates a safety risk. Correct functioning of the false start drain system (FSDS) should be ensured through proper maintenance and inspection per GE procedures.

Firing Temperatures

Significant operation at peak load, because of the higher operating temperatures, will require more frequent maintenance and replacement of hot-gas-path components. For an MS7001EA turbine, each hour of operation at peak load firing temperature (+100°F/56°C) is the same, from a bucket parts life standpoint, as six hours of operation at base load. This type of operation will result in a maintenance factor of six. *Figure 12* defines the parts life effect corresponding to changes in firing temperature. It should be noted that this is not a linear relationship, as a +200°F/111°C increase in firing temperature would have an equivalency of six times six, or 36:1.

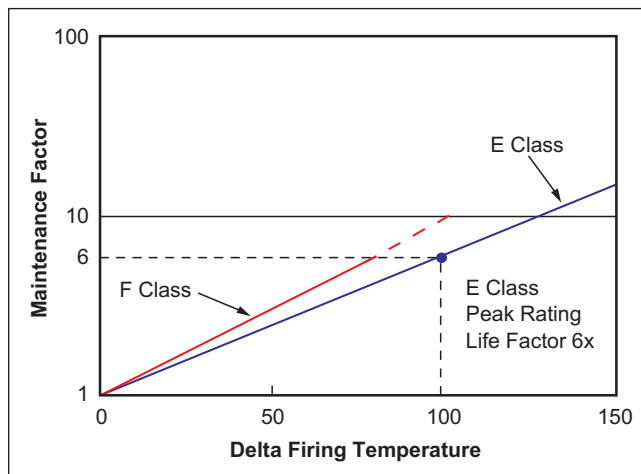


Figure 12. Bucket life firing temperature effect

Higher firing temperature reduces hot-gas-path parts lives while lower firing temperature increases parts lives. This provides an opportunity to balance the negative effects of peak load operation by periods of operation at part load. However, it is important to recognize that the nonlinear behavior described above will not result in a one for one balance for equal magnitudes of over and under firing operation. Rather, it would take six hours of operation at -100°F/56°C under base conditions to compensate for one hour operation at +100°F/56°C over base load conditions.

It is also important to recognize that a reduction in load does not always mean a reduction in firing temperature. In heat recovery applications, where steam generation drives overall plant efficiency, load is first reduced by closing variable inlet guide vanes to reduce inlet airflow while maintaining maximum exhaust temperature. For these combined cycle applications, firing temperature does not decrease until load is reduced below approximately 80% of rated output. Conversely, a turbine running in simple cycle mode maintains full open inlet guide vanes during a load reduction to 80% and will experience over a 200°F/111°C reduction in firing temperature at this output level. The hot-gas-path parts life effects for these different modes of operation are obviously quite different. This turbine control effect is illustrated in *Figure 13*. Similarly, turbines with DLN combustion systems utilize inlet guide vane turndown as well as inlet bleed heat to extend operation of low NO_x premix operation to part load conditions.

Firing temperature effects on hot gas path maintenance, as described above, relate to clean burning fuels, such as natural gas and light distillates, where creep rupture of hot gas path components is the primary life limiter and is the mechanism that determines the hot gas path maintenance interval impact. With ash-bearing heavy fuels, corrosion and deposits are the primary influence and a different

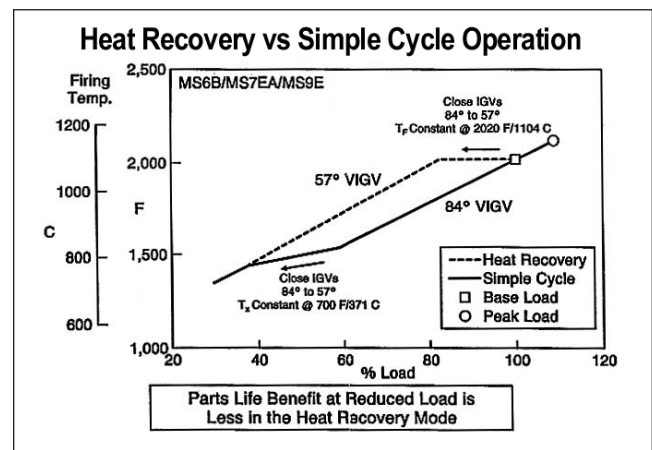


Figure 13. Firing temperature and load relationship – heat recovery vs. simple cycle operation

relationship with firing temperature exists. *Figure 14* illustrates the sensitivity of hot gas path maintenance factor to firing temperature for a heavy fuel operation. It can be seen that while the sensitivity to firing temperature is less, the maintenance factor itself is higher due to issues relating to the corrosive elements contained in these fuels.

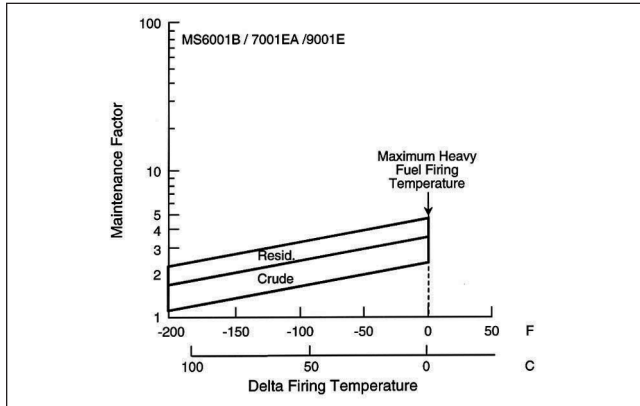


Figure 14. Heavy fuel maintenance factors

Steam/Water Injection

Water or steam injection for emissions control or power augmentation can impact parts lives and maintenance intervals even when the water or steam meets GE specifications. This relates to the effect of the added water on the hot-gas transport properties. Higher gas conductivity, in particular, increases the heat transfer to the buckets and nozzles and can lead to higher metal temperature and reduced parts life as shown in *Figure 15*.

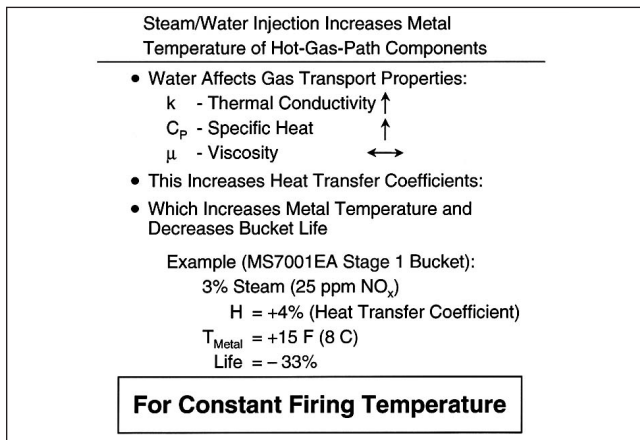


Figure 15. Steam/water injection and bucket/nozzle life

Parts life impact from steam or water injection is directly impacted by the way the turbine is controlled. The control system on most base load applications reduces firing temperature as water or steam is injected. This is known as dry control curve operation, which counters the effect of the higher heat transfer on the gas side, and results in no net impact on bucket life. This is the standard configuration for all gas turbines, both with and without water or steam injection. On some installations, however, the control system is designed to maintain firing temperature constant with water or steam injection level. This is known as wet control curve operation, which results in additional unit output, but decreases parts life as previously described. Units controlled in this way are generally in peaking applications where annual operating hours are low or where operators have determined that reduced parts lives are justified by the power advantage. *Figure 16* illustrates the wet and dry control curve and the performance differences that result from these two different modes of control.

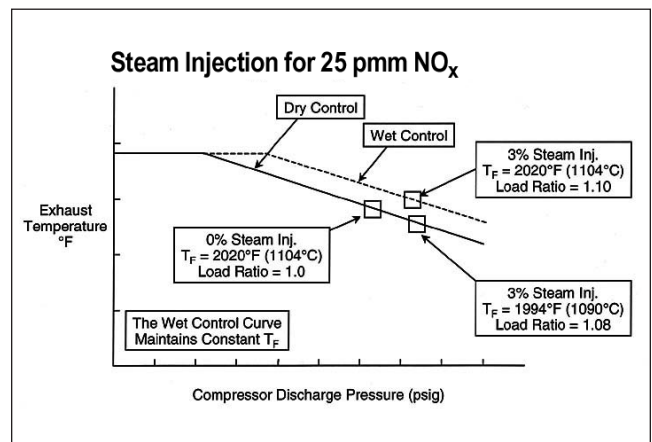


Figure 16. Exhaust temperature control curve – dry vs. wet control MS7001EA

An additional factor associated with water or steam injection relates to the higher aerodynamic loading on the turbine components that results from the injected water increasing the cycle pressure ratio. This additional loading can increase the downstream deflection rate of the second- and third-stage

nozzles, which would reduce the repair interval for these components. However, the introduction of GTD-222, a new high creep strength stage two and three nozzle alloy, has minimized this factor.

Maintenance factors relating to water injection for units operating on dry control range from one (for units equipped with GTD-222 second-stage and third-stage nozzles) to a factor of 1.5 for units equipped with FSX-414 nozzles and injecting 5% water. For wet control curve operation, the maintenance factor is approximately two at 5% water injection for GTD-222 and four for FSX-414.

Cyclic Effects

In the previous discussion, operating factors that impact the hours-based maintenance criteria were described. For the starts-based maintenance criteria, operating factors associated with the cyclic effects produced during startup, operation and shutdown of the turbine must be considered. Operating conditions other than the standard startup and shutdown sequence can potentially reduce the cyclic life of the hot gas path components and rotors, and, if present, will require more frequent maintenance and parts refurbishment and/or replacement.

Hot Gas Path Parts

Figure 17 illustrates the firing temperature changes occurring over a normal startup and shutdown cycle. Light-off, acceleration, loading, unloading and shutdown all produce gas temperature changes that produce corresponding metal temperature changes. For rapid changes in gas temperature, the edges of the bucket or nozzle respond more quickly than the thicker bulk section, as pictured in Figure 18. These gradients, in turn, produce thermal stresses that, when cycled, can eventually lead to cracking. Figure 19 describes the temperature strain history of an MS7001EA stage 1 bucket during a normal startup and shutdown cycle. Light-off and acceleration produce transient compressive strains in the bucket as the fast responding leading edge heats up more

quickly than the thicker bulk section of the airfoil. At full load conditions, the bucket reaches its maximum metal temperature and a compressive strain produced from the normal steady state temperature gradients that exist in the cooled part. At shutdown, the conditions reverse where the faster responding edges cool more quickly than the bulk section, which results in a tensile strain at the leading edge.

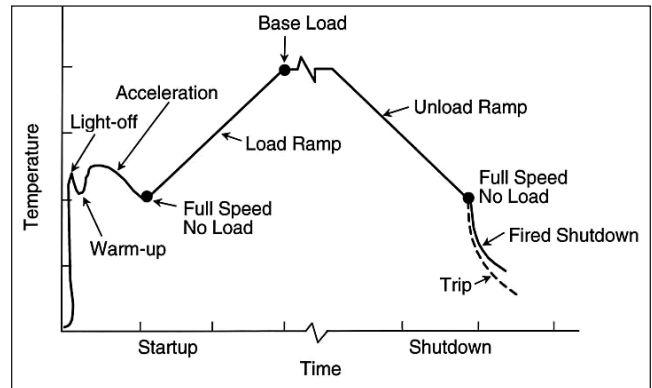


Figure 17. Turbine start/stop cycle – firing temperature changes

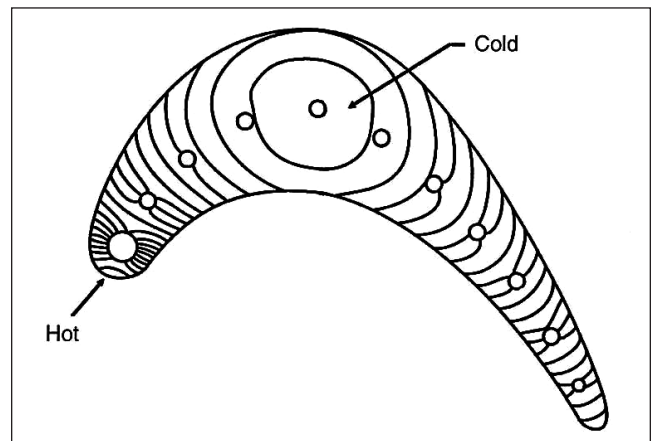


Figure 18. First stage bucket transient temperature distribution

Thermal mechanical fatigue testing has found that the number of cycles that a part can withstand before cracking occurs is strongly influenced by the total strain range and the maximum metal temperature experienced. Any operating condition that significantly increases the strain range and/or the maximum metal temperature over the normal cycle conditions will act to reduce the fatigue life and increase the starts-based maintenance factor. For example, Figure 20

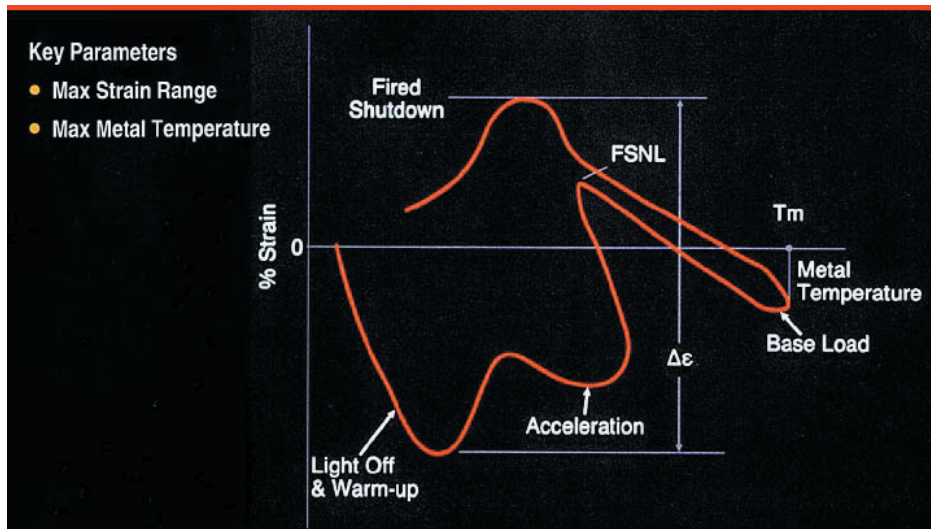


Figure 19. Bucket low cycle fatigue (LCF)

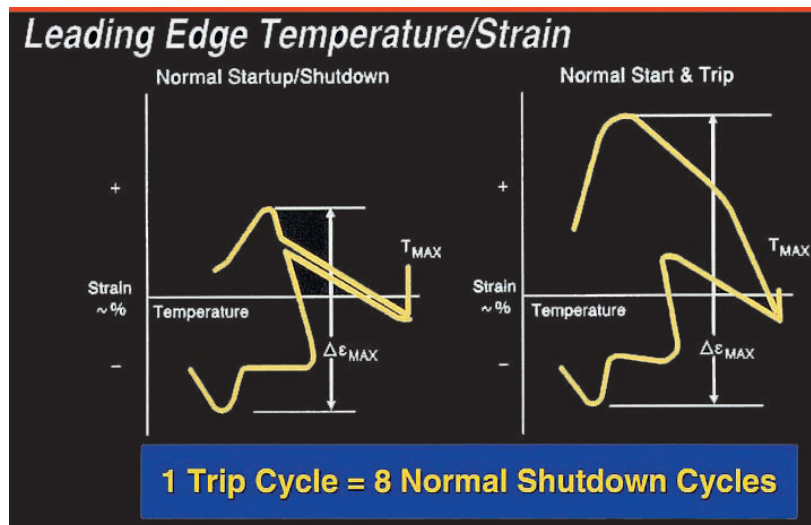


Figure 20. Low cycle fatigue life sensitivities – first stage bucket

compares a normal operating cycle with one that includes a trip from full load. The significant increase in the strain range for a trip cycle results in a life effect that equates to eight normal start/stop cycles, as shown. Trips from part load will have a reduced impact because of the lower metal temperatures at the initiation of the trip event. *Figure 21* illustrates that while a trip from between 80% and 100% load has an 8:1 maintenance factor, a trip from full speed no load has a maintenance factor of 2:1. Similarly, overfiring of the unit during peak load operation leads to increased component metal temperatures.

As a result, a trip from peak load has a maintenance factor of 10:1. Trips are to be assessed in addition to the regular startup/shutdown cycles (as starts adds). As such, in the factored starts equation of *Figure 44*, one is subtracted from the severity factor so that the net result of the formula (*Figure 44*) is the same as that dictated by the increased strain range. For example, a startup and trip from base load would count as eight total cycles (one cycle for startup to base load plus 8-1=7 cycles for trip from base load), just as indicated by the 8:1 maintenance factor.

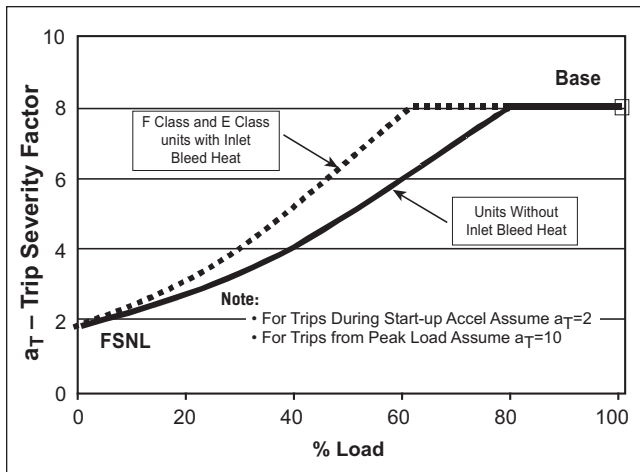


Figure 21. Maintenance factor – trips from load

Similarly to trips from load, emergency starts and fast loading will impact the starts-based maintenance interval. This again relates to the increased strain range that is associated with these events.

Emergency starts where units are brought from standstill to full load in less than five minutes will have a parts life effect equal to 20 additional cycles and a normal start with fast loading will have a parts life effect equal to 2 additional cycles. Like trips, the effects of a fast start or fast loading on the machine are considered separate from a normal cycle and their effects must be tabulated in addition to the normal start/stop cycle. However, there is no -1 applied to these factors, so an emergency start to base load would have a total impact of 21 cycles. Refer to Appendix A for factored starts examples.

While the factors described above will decrease the starts-based maintenance interval, part load operating cycles would allow for an extension of the maintenance interval. *Figure 22* is a guideline that could be used in considering this type of operation. For example, two operating cycles to maximum load levels of less than 60% would equate to one start to a load greater than 60% or, stated another way, would have a maintenance factor of 5. Factored starts calculations are based upon the maximum load achieved during operation. Therefore, if a unit is operated at part load for three weeks, and then

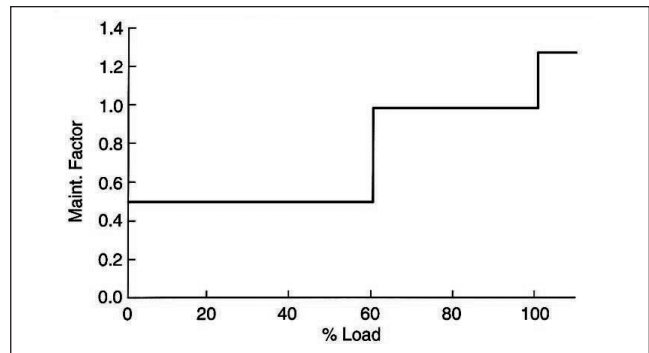


Figure 22. Maintenance factor – effect of start cycle maximum load level

ramped up to base load for the last ten minutes, then the unit's total operation would be described as a base load start/stop cycle.

Rotor Parts

In addition to the hot gas path components, the rotor structure maintenance and refurbishment requirements are impacted by the cyclic effects associated with startup, operation and shutdown, as well as loading and off-load characteristics. Maintenance factors specific to an application's operating profile and rotor design must be determined and incorporated into the operators maintenance planning. Disassembly and inspection of all rotor components is required when the accumulated rotor starts or hours reach the inspection limit. (See *Figure 45* and *Figure 46* in the Inspection Intervals Section.)

For the rotor, the thermal condition when the start-up sequence is initiated is a major factor in determining the rotor maintenance interval and individual rotor component life. Rotors that are cold when the startup commences develop transient thermal stresses as the turbine is brought on line. Large rotors with their longer thermal time constants develop higher thermal stresses than smaller rotors undergoing the same startup time sequence. High thermal stresses will reduce thermal mechanical fatigue life and the age for inspection.

The steam turbine industry recognized the need to adjust startup times in the 1950 to 1970 time period

when power generation market growth led to larger and larger steam turbines operating at higher temperatures. Similar to the steam turbine rotor size increases of the 1950s and 1960s, gas turbine rotors have seen a growth trend in the 1980s and 1990s as the technology has advanced to meet the demand for combined cycle power plants with high power density and thermal efficiency.

With these larger rotors, lessons learned from both the steam turbine experience and the more recent gas turbine experience should be factored into the start-up control for the gas turbine and/or maintenance factors should be determined for an application's duty cycle to quantify the rotor life reductions associated with different severity levels. The maintenance factors so determined are used to adjust the rotor component inspection, repair and replacement intervals that are appropriate to that particular duty cycle.

Though the concept of rotor maintenance factors is applicable to all gas turbine rotors, only F Class rotors will be discussed in detail. The rotor maintenance factor for a startup is a function of the downtime following a previous period of operation. As downtime increases, the rotor metal temperature approaches ambient conditions and thermal fatigue impact during a subsequent start-up increases. As such, cold starts are assigned a rotor maintenance factor of two and hot starts a rotor maintenance factor of less than one due to the lower thermal stress under hot conditions. This impact varies from one location in the rotor structure to another. Since the most limiting location determines the overall rotor impact, the rotor maintenance factor indicates the upper bound locus of the rotor maintenance factors at these various features.

Rotor starting thermal condition is not the only operating factor that influences rotor maintenance intervals and component life. Fast starts and fast loading, where the turbine is ramped quickly to load,

increase thermal gradients and are more severe duty for the rotor. Trips from load and particularly trips followed by immediate restarts reduce the rotor maintenance interval as do hot restarts within the first hour of a hot shutdown. *Figure 23* lists recommended operating factors that should be used to determine the rotor's overall maintenance factor for PG7241 and PG9351 design rotors. The factors to be used for other models are determined by applicable Technical Information Letters.

7241/9351* Designs		
	Rotor Maintenance Factors	
	Fast Start	Normal Start
Hot Start Factor (1–4 Hrs. Down)	1.0	0.5
Warm 1 Start Factor (4–20 Hrs. Down)	1.8	0.9
Warm 2 Start Factor (20–40 Hrs. Down)	2.8	1.4
Cold Start Factor (>40 Hrs. Down)	4.0	2.0
Trip from Load Factor	4.0	4.0
Hot Start Factor (0–1 Hr. Down)	4.0	2.0

*Other factors may apply to early 9351 units

- Factors Are a Function of Machine Thermal Condition at Start-Up
- Trips from Load, Fast Starts and >20-hour Restarts Reduce Maintenance Intervals

Figure 23. Operation-related maintenance factors

The significance of each of these factors to the maintenance requirements of the rotor is dependent on the type of operation that the unit sees. There are three general categories of operation that are typical of most gas turbine applications. These are peaking, cyclic and continuous duty as described below:

- Peaking units have a relatively high starting frequency and a low number of hours per start. Operation follows a seasonal demand. Peaking units will generally see a high percentage of cold starts.

- Cyclic duty units start daily with weekend shutdowns. Twelve to sixteen hours per start is typical which results in a warm rotor condition for a large percentage of the starts. Cold starts are generally seen only following a startup after a maintenance outage or following a two day weekend outage.
- Continuous duty applications see a high number of hours per start and most starts are cold because outages are generally maintenance driven. While the percentage of cold starts is high, the total number of starts is low. The rotor maintenance interval on continuous duty units will be determined by service hours rather than starts.

Figure 24 lists operating profiles on the high end of each of these three general categories of gas turbine applications.

As can be seen in Figure 24, these duty cycles have different combinations of hot, warm and cold starts with each starting condition having a different impact on rotor maintenance interval as previously discussed. As a result, the starts based rotor maintenance interval will depend on an applications specific duty cycle. In a later section, a method will be described that allows the turbine operator to determine a maintenance factor that is specific to the operation's duty cycle. The application's integrated maintenance factor uses the rotor maintenance factors described above in combination with the actual duty cycle of a specific application and can be used to determine rotor inspection intervals. In this calculation, the reference duty cycle that yields a starts based maintenance factor equal to one is defined in Figure 25. Duty cycles different from the Figure 25 definition, in particular duty cycles with more cold starts, or a high number of trips, will have a maintenance factor greater than one.

Turning gear or ratchet operation after shutdown, and before starting/restarting is a crucial part of normal operating procedure. Figure F-1 describes turning

gear/ratchet scenarios and operation guidelines (See Appendix). Relevant operating instructions and TILs should be adhered to where applicable. After a shutdown, turning of the warm rotor is essential to avoid bow, which could lead to high vibrations and excessive rubs if a start is initiated with the rotor in a bowed condition. As a best practice, units should remain on turning gear or ratchet following a planned shutdown until wheelspace temperatures have stabilized at near ambient temperature. If the unit is to see no further activity for 48 hours after cool-down is completed, then it may be taken off of turning gear.

Peaking – Cyclic – Continuous			
	Peaking	Cyclic	Continuous
Hot Start (Down <4 Hr.)	3%	1%	10%
Warm 1 Start (Down 4-20 hr.)	10%	82%	5%
Warm 2 Start (Down 20-40 Hr.)	37%	13%	5%
Cold Start (Down >40 Hr.)	50%	4%	80%
Hours/Start	4	16	400
Hours/Year	600	4800	8200
Starts per Year	150	300	21
Percent Trips	3%	1%	20%
Number of Trips per Year	5	3	4
Typical Maintenance Factor (Starts Based)	1.7	1.0	NA

- Operational Profile is Application Specific
- Inspection Interval is Application Specific

Figure 24. FA gas turbine typical operational profile

Baseline Unit			
Cyclic Duty			
6	Starts/Week		
16	Hours/Start		
4	Outage/Year Maintenance		
50	Weeks/Year		
4800	Hours/Year		
300	Starts/Year		
0	Trips/Year		
1	Maintenance Factor		
12	Cold Starts/Year (down >40 Hr.)		4%
39	Warm 2 Starts/Year (Down 20-40 Hr.)		13%
246	Warm Starts/Year (Down 4-20 Hr.)		82%
3	Hot Starts per Year		1%

Baseline Unit Achieves Maintenance Factor = 1

Figure 25. Baseline for starts-based maintenance factor definition

Further guidelines exist for hot restarts and cold starts. It is recommended that the rotor be placed on turning gear for one hour prior to restart following a trip from load, trip from full speed no load, or normal shutdown. This will allow transient thermal stresses to subside before superimposing a startup transient. If the machine must be restarted in less than one hour, then cold start factors will apply. Longer periods of turning gear operation may be necessary prior to a cold start or hot restart if the presence of bow is detected. Vibration data taken while at crank speed can be used to confirm that rotor bow is at acceptable levels and the start sequence can be initiated. Users should reference the Operation and Maintenance Manual and appropriate TILs for specific instructions and information for their units.

Combustion Parts

A typical combustion system contains transition pieces, combustion liners, flow sleeves, head-end assemblies containing fuel nozzles and cartridges, end caps and end covers, and assorted other hardware including cross-fire tubes, spark plugs and flame detectors. In addition, there can be various fuel and air delivery components such as purge or check valves and flex hoses. GE provides several types of combustion systems including standard combustors, Multi-Nozzle Quiet Combustors (MNQC), Integrated Gasification Combined Cycle (IGCC) combustors and Dry Low NO_x (DLN) combustors. Each of these combustion systems have unique operating characteristics and modes of operation with differing responses to operational variables affecting maintenance and refurbishment requirements.

The maintenance and refurbishment requirements of combustion parts are impacted by many of the same factors as hot gas path parts including start cycle, trips, fuel type and quality, firing temperature and use of steam or water injection for either emissions control or power augmentation. However, there are other factors specific to combustion systems. One of

these factors is operating mode, which describes the applied fueling pattern. The use of low load operating modes at high loads can reduce the maintenance interval significantly. An example of this is the use of DLN 1 extended lean-lean mode at high loads, which results in a maintenance factor of 10. Likewise, a maintenance factor of 10 should be applied to lean-lean operation on the DLN 2.0 units. Another factor that can impact combustion system maintenance is acoustic dynamics. Acoustic dynamics are pressure oscillations generated by the combustion system, which, if high enough in magnitude, can lead to significant wear and cracking. GE practice is to tune the combustion system to levels of acoustic dynamics low enough to ensure that the maintenance practices described here are not compromised.

Combustion maintenance is performed, if required, following each combustion inspection (or repair) interval. Inspection interval guidelines are included in *Figure 42*. It is expected and recommended that intervals be modified based on specific experience. Replacement intervals are usually defined by a recommended number of combustion (or repair) intervals and are usually combustion component specific. In general, the replacement interval as a function of the number of combustion inspection intervals is reduced if the combustion inspection interval is extended. For example, a component having an 8,000 hour combustion inspection (CI) interval and a 6(CI) or 48,000 hour replacement interval would have a replacement interval of 4(CI) if the inspection interval were increased to 12,000 hours to maintain a 48,000 hour replacement interval.

For combustion parts, the base line operating conditions that result in a maintenance factor of unity are normal fired start-up and shut-down to base load on natural gas fuel without steam or water injection. Factors that increase the hours-based maintenance factor include peaking duty, distillate or heavy fuels, and steam or water injection with dry or wet control curves. Factors that increase starts-based maintenance factor

include peaking duty, fuel type, steam or water injection, trips, emergency starts and fast loading.

Off-Frequency Operation

GE heavy-duty single shaft gas turbines are designed to operate over a 95% to 105% speed range. However, operation at other than rated speed has the potential to impact maintenance requirements. Depending on the industry code requirements, the specifics of the turbine design and the turbine control philosophy employed, operating conditions can result that will accelerate life consumption of hot gas path components. Where this is true, the maintenance factor associated with this operation must be understood and these speed events analyzed and recorded so as to include in the maintenance plan for this gas turbine installation.

Generator drive turbines operating in a power system grid are sometimes required to meet operational requirements that are aimed at maintaining grid stability under conditions of sudden load or capacity changes. Most codes require turbines to remain on line in the event of a frequency disturbance. For under-frequency operation, the turbine output decrease that will normally occur with a speed decrease is allowed and the net impact on the turbine as measured by a maintenance factor is minimal. In some grid systems, there are more stringent codes that require remaining on line while maintaining load on a defined schedule of load versus grid frequency. One example of a more stringent requirement is defined by the National Grid Company (NGC). In the NGC code, conditions under which frequency excursions must be tolerated and/or controlled are defined as shown in *Figure 26*.

With this specification, load must be maintained constant over a frequency range of +/- 1% (+/- 0.5Hz in a 50 Hz grid system) with a one percent load reduction allowed for every additional one percent frequency drop down to a minimum 94% speed. Requirements stipulate that operation between 95%

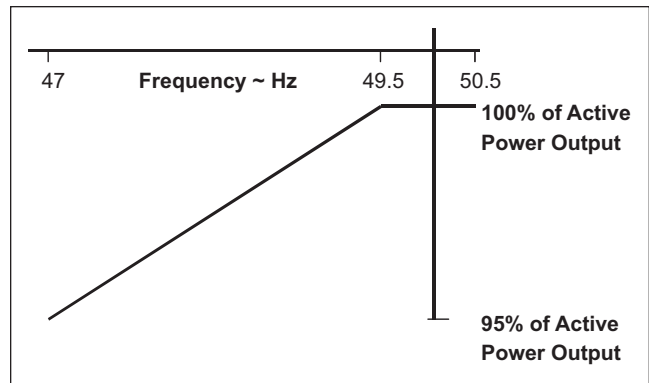


Figure 26. The NGC requirement for output versus frequency capability over all ambients less than 25°C (77°F)

to 104% speed can be continuous but operation between 94% and 95% is limited to 20 seconds for each event. These conditions must be met up to a maximum ambient temperature of 25°C (77°F).

Under-frequency operation impacts maintenance to the degree that nominally controlled turbine output must be exceeded in order to meet the specification defined output requirement. As speed decreases, the compressor airflow decreases, reducing turbine output. If this normal output fall-off with speed results in loads less than the defined minimum, power augmentation must be applied. Turbine overfiring is the most obvious augmentation option but other means such as utilizing gas turbine water wash have some potential as an augmentation action.

Ambient temperature can be a significant factor in the level of power augmentation required. This relates to compressor operating margin that may require inlet guide vane closure if compressor corrected speed reaches limiting conditions. For an FA class turbine, operation at 0°C (32°F) would require no power augmentation to meet NGC requirements while operation at 25°C (77°F) would fall below NGC requirements without a substantial amount of power augmentation. As an example, *Figure 27* illustrates the output trend at 25°C (77°F) for an FA class gas turbine as grid system frequency changes and where no power augmentation is applied.

In *Figure 27*, the gas turbine output shortfall at the low frequency end (47.5 Hz) of the NGC continuous operation compliance range would require a 160°F increase over base load firing temperature to be in compliance. At this level of over-fire, a maintenance factor exceeding 100x would be applied to all time spent at these conditions. Overfiring at this level would have implications on combustion operability and emissions compliance as well as have major impact on hot gas path parts life. An alternative power augmentation approach that has been utilized in FA gas turbines for NGC code compliance utilizes water wash in combination with increased firing temperature. As shown in *Figure 28*, with water wash on, 50°F overfiring is required to meet NGC code for operating conditions of 25°C (77°F) ambient temperature and grid frequency at 47.5 Hz. Under these conditions, the hours-based maintenance factor would be 3x as determined by *Figure 12*. It is important to understand that operation at over-frequency conditions will not trade one-for-one for periods at under-frequency conditions. As was discussed in the firing temperature section above, operation at peak firing conditions has a nonlinear logarithmic relationship with maintenance factor.

As described above, the NGC code limits operation to 20 seconds per event at an under-frequency condition between 94% to 95% speed. Grid events that expose the gas turbine to frequencies below the minimum continuous speed of 95% introduce additional maintenance and parts replacement considerations. Operation at speeds less than 95% requires increased over-fire to achieve compliance, but also introduces an additional concern that relates to the potential exposure of the blading to excitations that could result in blade resonant response and reduced fatigue life. Considering this potential, a starts-based maintenance factor of 60x is assigned to every 20 seconds of excursion for grid frequencies less than 95% speed.

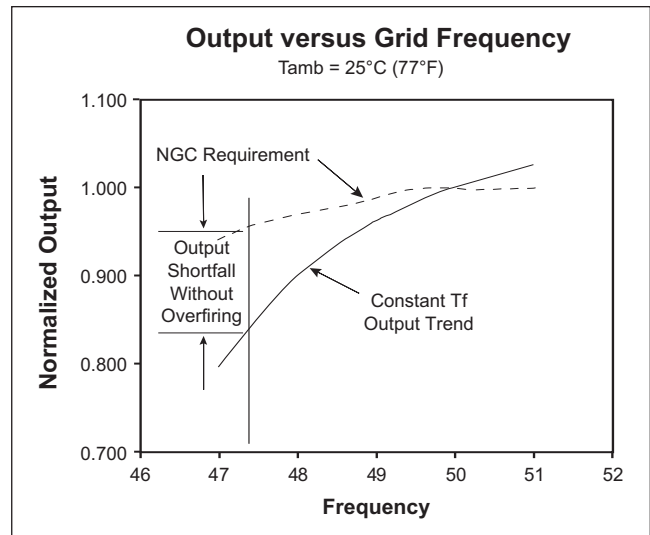


Figure 27. Turbine output at under-frequency conditions

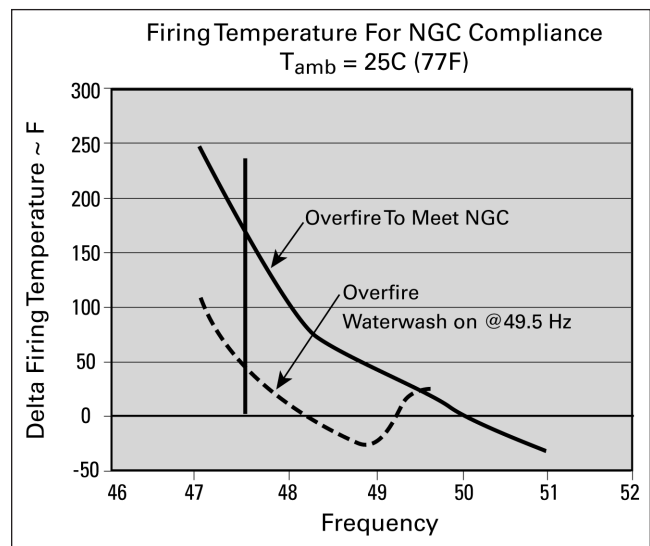


Figure 28. NGC code compliance TF required – FA class

Over-frequency or high speed operation can also introduce conditions that impact turbine maintenance and part replacement intervals. If speed is increased above the nominal rated speed, the rotating components see an increase in mechanical stress proportional to the square of the speed increase. If firing temperature is held constant at the overspeed condition, the life consumption rate of hot gas path rotating components will increase as illustrated in *Figure 29* where one hour of operation at 105% speed is equivalent to two hours at rated speed.

If overspeed operation represents a small fraction of a turbine's operating profile, this effect on parts life can sometimes be ignored. However, if significant operation at overspeed is expected and rated firing temperature is maintained, the accumulated hours must be recorded and included in the calculation of the turbine's overall maintenance factor and the maintenance schedule adjusted to reflect the overspeed operation. An option that mitigates this effect is to under fire to a level that balances the overspeed parts life effect. Some mechanical drive applications have employed that strategy to avoid a maintenance factor increase.

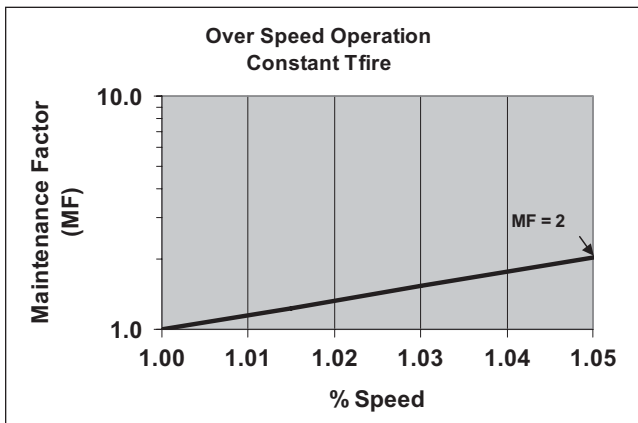


Figure 29. Maintenance factor for overspeed operation ~constant T_f

The frequency-sensitive discussion above describes code requirements related to turbine output capability versus grid frequency, where maintenance factors within the continuous operating speed range are hours-based. There are other considerations related to turbines operating in grid frequency regulation mode. In frequency regulation mode, turbines are dispatched to operate at less than full load and stand ready to respond to a frequency disturbance by rapidly picking up load. NGC requirements for units in frequency regulation mode include being equipped with a fast-acting proportional speed governor operating with an overall speed droop of 3-5%. With this control, a gas turbine will provide a load increase that is proportional to the size of the grid frequency change. For example, a turbine operating with five

percent droop would pick up 20% load in response to a .5 Hz (1%) grid frequency drop.

The rate at which the turbine picks up load in response to an under-frequency condition is determined by the gas turbine design and the response of the fuel and compressor airflow control systems, but would typically yield a less than ten-second turbine response to a step change in grid frequency. Any maintenance factor associated with this operation depends on the magnitude of the load change that occurs. A turbine dispatched at 50% load that responded to a 2% frequency drop would have parts life and maintenance impact on the hot gas path as well as the rotor structure. More typically, however, turbines are dispatched at closer to rated load where maintenance factor effects may be less severe. The NGC requires 10% plant output in 10 seconds in response to a .5 Hz (1%) under frequency condition. In a combined cycle installation where the gas turbine alone must pick up the transient loading, a load change of 15% in 10 seconds would be required to meet that requirement. Maintenance factor effects related to this would be minimal for the hot gas path but would impact the rotor maintenance factor. For an FA class rotor, each frequency excursion would be counted as an additional factored start in the numerator of the maintenance factor calculation described in *Figure 45*. A further requirement for the rotor is that it must be in hot running condition prior to being dispatched in frequency regulation mode.

Air Quality

Maintenance and operating costs are also influenced by the quality of the air that the turbine consumes. In addition to the deleterious effects of airborne contaminants on hot-gas-path components, contaminants such as dust, salt and oil can also cause compressor blade erosion, corrosion and fouling. Twenty-micron particles entering the compressor can cause significant blade erosion.

Fouling can be caused by submicron dirt particles entering the compressor as well as from ingestion of oil vapor, smoke, sea salt and industrial vapors.

Corrosion of compressor blading causes pitting of the blade surface, which, in addition to increasing the surface roughness, also serves as potential sites for fatigue crack initiation. These surface roughness and blade contour changes will decrease compressor airflow and efficiency, which in turn reduces the gas turbine output and overall thermal efficiency.

Generally, axial flow compressor deterioration is the major cause of loss in gas turbine output and efficiency. Recoverable losses, attributable to compressor blade fouling, typically account for 70 to 85 percent of the performance losses seen. As *Figure 30* illustrates, compressor fouling to the extent that airflow is reduced by 5%, will reduce output by 13% and increase heat rate by 5.5%. Fortunately, much can be done through proper operation and maintenance procedures to minimize fouling type losses. On-line compressor wash systems are available that are used to maintain compressor efficiency by washing the compressor while at load, before significant fouling has occurred. Off-line systems are used to clean heavily fouled compressors. Other procedures include maintaining the inlet filtration system and inlet evaporative coolers as well as periodic inspection and prompt repair of compressor blading.

There are also non-recoverable losses. In the compressor, these are typically caused by nondeposit-related blade surface roughness, erosion and blade tip rubs. In the turbine, nozzle throat area changes, bucket tip clearance increases and leakages are potential causes. Some degree of unrecoverable performance degradation should be expected, even on a well-maintained gas turbine.

The owner, by regularly monitoring and recording unit performance parameters, has a very valuable tool for diagnosing possible compressor deterioration.

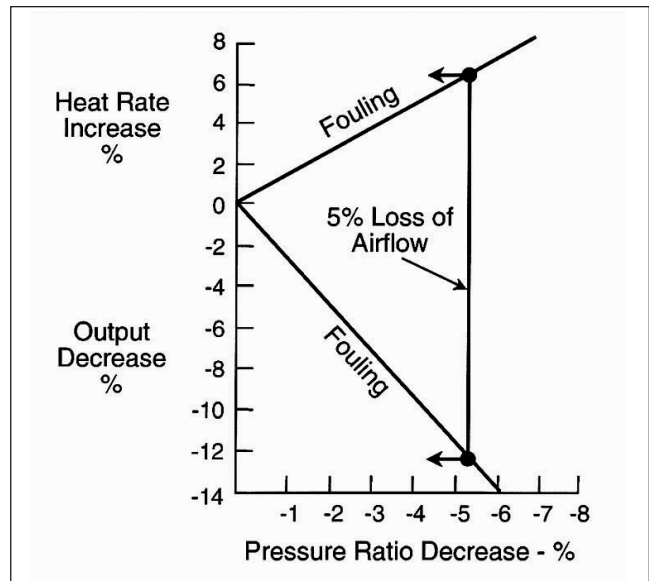


Figure 30. Deterioration of gas turbine performance due to compressor blade fouling

Lube Oil Cleanliness

Contaminated or deteriorated lube oil can cause wear and damage on bearing Babbitt surfaces. This can lead to extended outages and costly repairs. Routine sampling of the turbine lube oil for proper viscosity, chemical composition and contamination is an essential part of a complete maintenance plan.

Lube oil should be sampled and tested per GEK-32568, "Lubricating Oil Recommendations for Gas Turbines with Bearing Ambients Above 500°F (260°C)." Additionally, lube oil should be checked periodically for particulate and water contamination as outlined in GEK-110483, "Cleanliness Requirements for Power Plant Installation, Commissioning and Maintenance." At a minimum, the lube oil should be sampled on a quarterly basis; however, monthly sampling is recommended.

Moisture Intake

One of the ways some users increase turbine output is through the use of inlet foggers. Foggers inject a large amount of moisture in the inlet ducting, exposing the forward stages of the compressor

to potential water carry-over. Operation of a compressor in such an environment may lead to long-term degradation of the compressor due to corrosion and erosion, fouling, and material property degradation. Experience has shown that depending on the quality of water used, the inlet silencer and ducting material, and the condition of the inlet silencer, fouling of the compressor can be severe with inlet foggers. Similarly, carry-over from evaporative coolers and excessive water washing can degrade the compressor. *Figure 31* shows the long-term material property degradation resulting from operating the compressor in a wet environment. The water quality standard that should be adhered to is found in GEK-101944B, "Requirements for Water/Steam Purity in Gas Turbines."

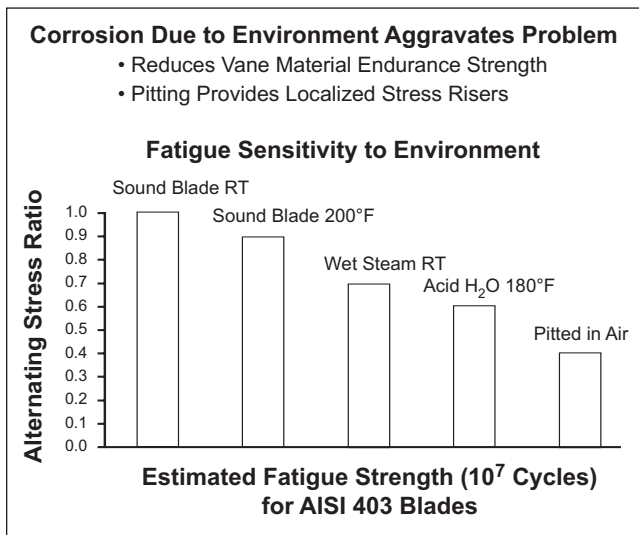


Figure 31. Long term material property degradation in a wet environment

For turbines with 403SS compressor blades, the presence of water carry-over will reduce blade fatigue strength by as much as 30% and increases the crack propagation rate in a blade if a flaw is present. The carry-over also subjects the blades to corrosion. Such corrosion might be accelerated by a saline environment (see GER-3419). Further reductions in fatigue strength will result if the environment is acidic and if pitting is present on the blade. Pitting is corrosion-induced and blades with pitting can see

material strength reduced to 40% of its virgin value. This condition is surpassed by downtime in humid environments, affecting wet corrosion.

Uncoated GTD-450 material is relatively resistant to corrosion while uncoated 403SS is quite susceptible. Relative susceptibility of various compressor blade materials and coatings is shown in *Figure 32*. As noted in GER-3569F, Al coatings are susceptible to erosion damage leading to unprotected sections of the blade. Because of this, the GECC-1 coating was created to combine the effects of an Al coating to prevent corrosion and a ceramic topcoat to prevent erosion.

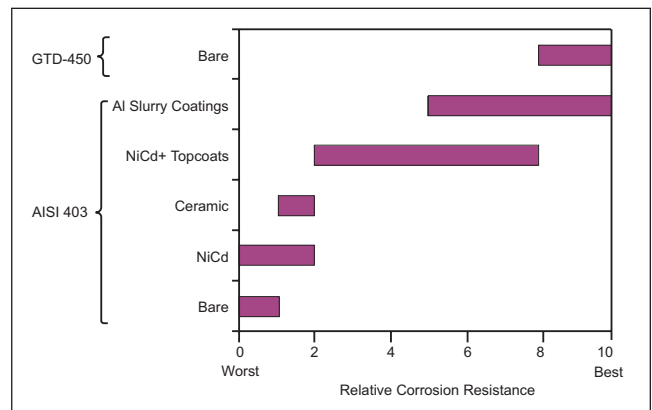


Figure 32. Susceptibility of compressor blade materials and coatings

Water droplets will cause leading edge erosion on the first few stages of the compressor. This erosion, if sufficiently developed, may lead to blade failure. Additionally, the roughened leading edge surface lowers the compressor efficiency and unit performance.

Utilization of inlet fogging or evaporative cooling may also introduce water carry-over or water ingestion into the compressor, resulting in R0 erosion. Although the design intent of evaporative coolers and inlet foggers should be to fully vaporize all cooling water prior to its ingestion into the compressor, evidence suggests that, on systems that were not properly commissioned, the water may not be fully vaporized (e.g., streaking discoloration on the inlet duct or bell mouth). If this is the case, then the unit should be inspected and maintained per instruction, as presented in applicable TILs.

MAINTENANCE INSPECTIONS

Maintenance inspection types may be broadly classified as standby, running and disassembly inspections. The standby inspection is performed during off-peak periods when the unit is not operating and includes routine servicing of accessory systems and device calibration. The running inspection is performed by observing key operating parameters while the turbine is running. The disassembly inspection requires opening the turbine for inspection of internal components and is performed in varying degrees. Disassembly inspections progress from the combustion inspection to the hot gas path inspection to the major inspection as shown in *Figure 33*. Details of each of these inspections are described below.

Standby Inspections

Standby inspections are performed on all gas turbines but pertain particularly to gas turbines used in peaking and intermittent-duty service where starting reliability is of primary concern. This inspection includes routinely servicing the battery system, changing filters, checking oil and water levels, cleaning relays and checking device calibrations. Servicing can be performed in off-peak periods without interrupting the availability of the turbine. A periodic startup test run is an essential part of the standby inspection.

The Operations and Maintenance Manual, as well as the Service Manual Instruction Books, contain information and drawings necessary to perform these periodic checks. Among the most useful drawings in the Service Manual Instruction Books for standby maintenance are the control specifications, piping schematic and electrical elementaries. These drawings provide the calibrations, operating limits, operating characteristics and sequencing of all control devices. This information should be used regularly by operating and maintenance personnel. Careful adherence to minor standby inspection maintenance can have a significant effect on reducing overall maintenance costs and maintaining high turbine reliability. It is essential that a good record be kept of all inspections made and of the maintenance work performed in order to ensure establishing a sound maintenance program.

Running Inspections

Running inspections consist of the general and continued observations made while a unit is operating. This starts by establishing baseline operating data during initial startup of a new unit and after any major disassembly work. This baseline then serves as a reference from which subsequent unit deterioration can be measured.

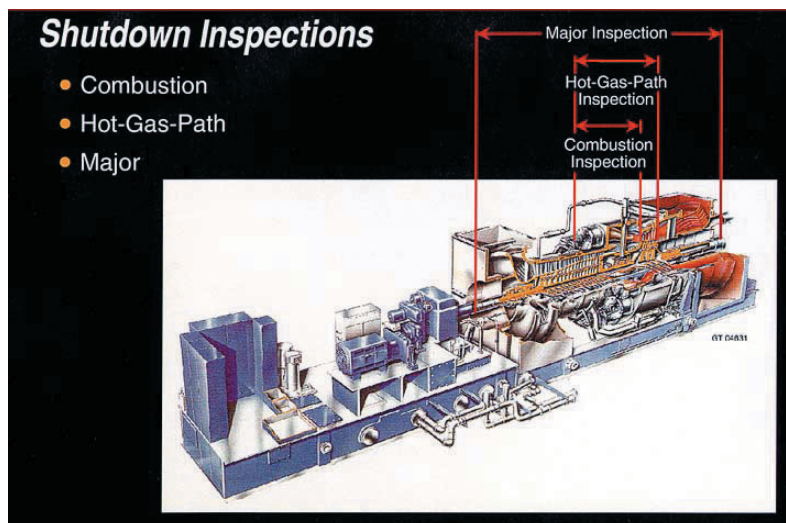


Figure 33. MS7001EA heavy-duty gas turbine – shutdown inspections

Exhibit No. ____ (LEO-4)
Page 26 of 60

Data should be taken to establish normal equipment start-up parameters as well as key steady state operating parameters. Steady state is defined as conditions at which no more than a 5°F/3°C change in wheelspace temperature occurs over a 15-minute time period. Data must be taken at regular intervals and should be recorded to permit an evaluation of the turbine performance and maintenance requirements as a function of operating time. This operating inspection data, summarized in *Figure 34*, includes: load versus exhaust temperature, vibration, fuel flow and pressure, bearing metal temperature, lube oil pressure, exhaust gas temperatures, exhaust temperature spread variation and startup time. This list is only a minimum and other parameters should be used as necessary. A graph of these parameters will help provide a basis for judging the conditions of the system. Deviations from the norm help pinpoint impending trouble, changes in calibration or damaged components.

Load vs. Exhaust Temperature

The general relationship between load and exhaust temperature should be observed and compared to previous data. Ambient temperature and barometric pressure will have some effect upon the absolute temperature level. High exhaust temperature can be

an indicator of deterioration of internal parts, excessive leaks or a fouled air compressor. For mechanical drive applications, it may also be an indication of increased power required by the driven equipment.

Vibration Level

The vibration signature of the unit should be observed and recorded. Minor changes will occur with changes in operating conditions. However, large changes or a continuously increasing trend give indications of the need to apply corrective action.

Fuel Flow and Pressure

The fuel system should be observed for the general fuel flow versus load relationship. Fuel pressures through the system should be observed. Changes in fuel pressure can indicate the fuel nozzle passages are plugged, or that fuel metering elements are damaged or out of calibration.

Exhaust Temperature and Spread Variation

The most important control function to be observed is the exhaust temperature fuel override system and the back-up over temperature trip system. Routine verification of the operation and calibration of these functions will minimize wear on the hot-gas-path parts.

<ul style="list-style-type: none"> • Speed • Load • Fired Starts • Fired Hours • Site Barometric Reading • Temperatures <ul style="list-style-type: none"> – Inlet Ambient – Compressor Discharge – Turbine Exhaust – Turbine Wheelspace – Lube Oil Header – Lube Oil Tank – Bearing Metal – Bearing Drains – Exhaust Spread 	<ul style="list-style-type: none"> • Pressures <ul style="list-style-type: none"> – Compressor Discharge – Lube Pump(s) – Bearing Header – Cooling Water – Fuel – Filters (Fuel, Lube, Inlet Air) • Vibration Data for Power Train • Generator <ul style="list-style-type: none"> – Output Voltage – Phase Current – VARS – Load • Start-Up Time • Coast-Down Time
	<ul style="list-style-type: none"> – Field Voltage – Field Current – Stator Temp. – Vibration

Figure 34. Operating inspection data parameters

The variations in turbine exhaust temperature spread should be measured and monitored on a regular basis. Large changes or a continuously increasing trend in exhaust temperature spread indicate combustion system deterioration or fuel distribution problems. If the problem is not corrected, the life of downstream hot-gas-path parts will be reduced.

Start-Up Time

Start-up time is an excellent reference against which subsequent operating parameters can be compared and evaluated. A curve of the starting parameters of speed, fuel signal, exhaust temperature and critical sequence bench marks versus time from the initial start signal will provide a good indication of the condition of the control system. Deviations from normal conditions help pinpoint impending trouble, changes in calibration or damaged components.

Coast-Down Time

Coast-down time is an excellent indicator of bearing alignment and bearing condition. The time period from when the fuel is shut off on a normal shutdown until the rotor comes to turning gear speed can be compared and evaluated.

Close observation and monitoring of these operating parameters will serve as the basis for effectively planning maintenance work and material requirements needed for subsequent shutdown periods.

Rapid Cool-Down

Prior to an inspection, it may be necessary to force cool the unit to speed the cool-down process and shorten outage time. Force cooling involves turning the unit at crank speed for an extended period of time to continue flowing ambient air through the machine. This is permitted, although a natural cool-down cycle on turning gear or ratchet is preferred for normal shutdowns when no outage is pending. Opening the compartment doors during any cool-down operation, however, is prohibited unless an emergency situation

requires immediate compartment inspection—which requires that the doors be opened. Cool-down times should not be accelerated by opening the compartment doors or lagging panels, since uneven cooling of the outer casings may result in excessive case distortion and blade rubs that could potentially lead to tip distress if the rubs are significant.

Combustion Inspection

The combustion inspection is a relatively short disassembly shutdown inspection of fuel nozzles, liners, transition pieces, crossfire tubes and retainers, spark plug assemblies, flame detectors and combustor flow sleeves. This inspection concentrates on the combustion liners, transition pieces, fuel nozzles and end caps which are recognized as being the first to require replacement and repair in a good maintenance program. Proper inspection, maintenance and repair (*Figure 35*) of these items will contribute to a longer life of the downstream parts, such as turbine nozzles and buckets.

Figure 33 illustrates the section of an MS7001EA unit that is disassembled for a combustion inspection. The combustion liners, transition pieces and fuel nozzle assemblies should be removed and replaced with new or repaired components to minimize downtime. The removed liners, transition pieces and fuel nozzles can then be cleaned and repaired after the unit is returned to operation and be available for the next combustion inspection interval. Typical combustion inspection requirements for MS6001B/7001EA/9001E machines are:

- Inspect and identify combustion chamber components.
- Inspect and identify each crossfire tube, retainer and combustion liner.
- Inspect combustion liner for TBC spallation, wear and cracks. Inspect combustion system and discharge casing for debris and foreign objects.
- Inspect flow sleeve welds for cracking.

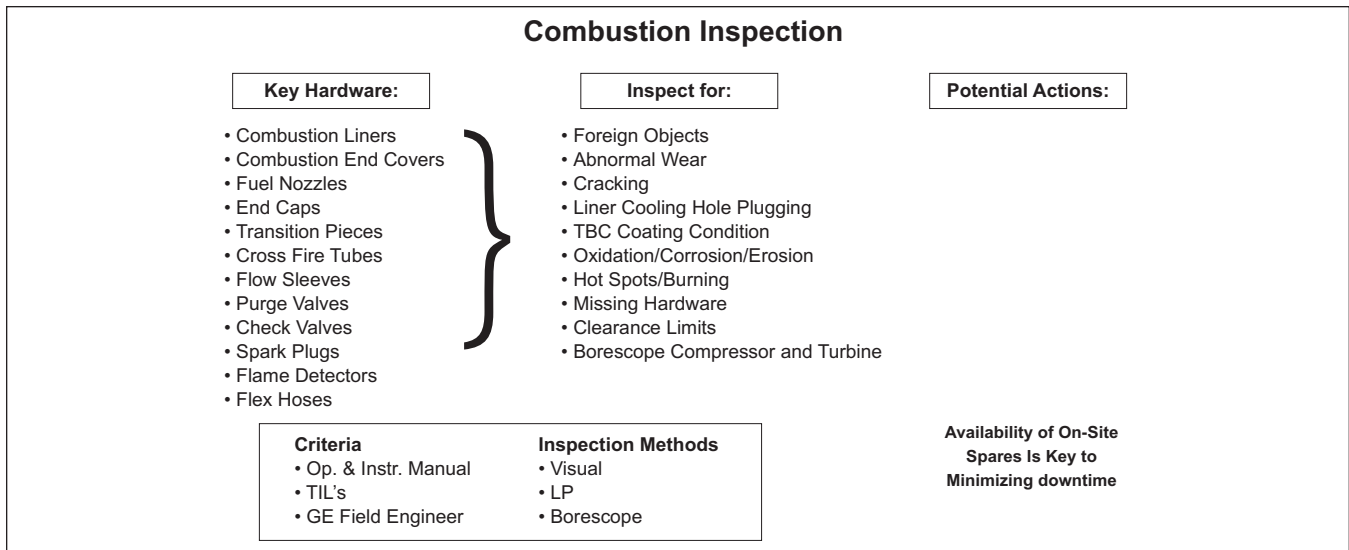


Figure 35. Combustion inspection – key elements

- Inspect transition piece for wear and cracks.
 - Inspect fuel nozzles for plugging at tips, erosion of tip holes and safety lock of tips.
 - Inspect all fluid, air, and gas passages in nozzle assembly for plugging, erosion, burning, etc.
 - Inspect spark plug assembly for freedom from binding; check condition of electrodes and insulators.
 - Replace all consumables and normal wear-and-tear items such as seals, lockplates, nuts, bolts, gaskets, etc.
 - Perform visual inspection of first-stage turbine nozzle partitions and borescope inspect (*Figure 3*) turbine buckets to mark the progress of wear and deterioration of these parts. This inspection will help establish the schedule for the hot-gas-path inspection.
 - Perform borescope inspection of compressor.
 - Enter the combustion wrapper and observe the condition of blading in the aft end of axial-flow compressor with a borescope.
 - Visually inspect the compressor inlet and turbine exhaust areas, checking condition of IGVs, IGV bushings, last-stage buckets and exhaust system components.
 - Verify proper operation of purge and check valves. Confirm proper setting and calibration of the combustion controls.
- After the combustion inspection is complete and the unit is returned to service, the removed combustion liners and transition pieces can be bench inspected and repaired, if necessary, by either competent on-site personnel, or off-site at a qualified GE Combustion Service Center. The removed fuel nozzles can be cleaned on-site and flow tested on-site, if suitable test facilities are available. For F Class gas turbines it is recommended that repairs and fuel nozzle flow testing be performed at qualified GE Service Centers.

Hot Gas Path Inspection

The purpose of a hot gas path inspection is to examine those parts exposed to high temperatures from the hot gases discharged from the combustion process. The hot gas path inspection outlined in *Figure 36* includes the full scope of the combustion inspection and, in addition, a detailed inspection of the turbine nozzles, stator shrouds and turbine buckets. To perform this inspection, the top half of the turbine shell must be removed. Prior to shell removal, proper machine centerline support using mechanical jacks is necessary to assure proper alignment of rotor

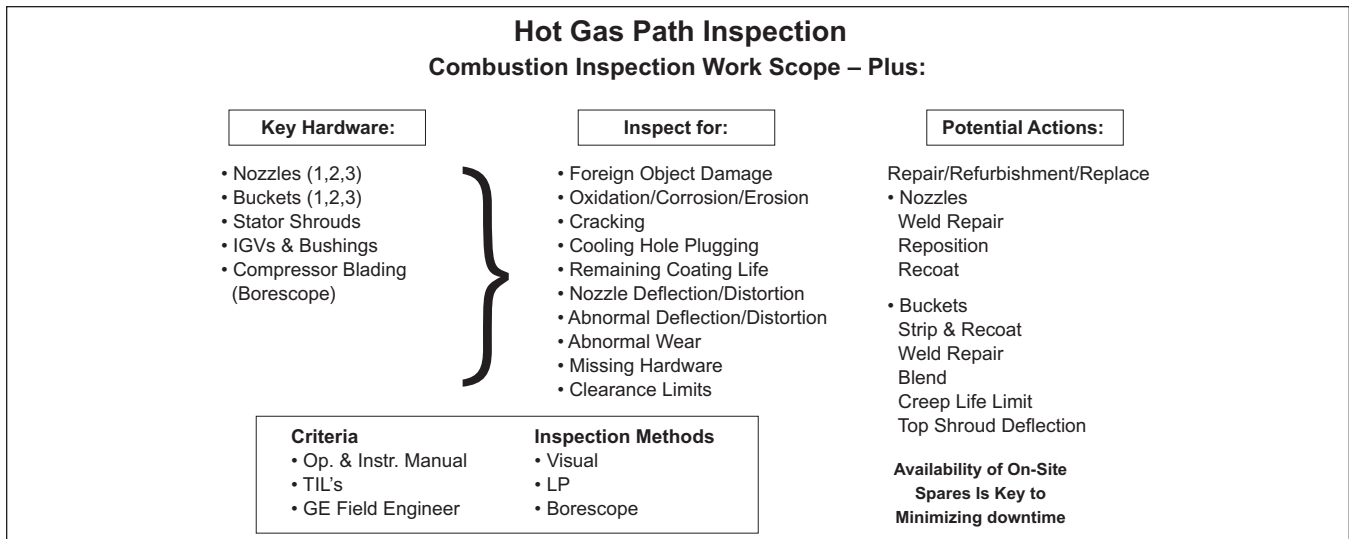


Figure 36. Hot gas path inspection – key elements

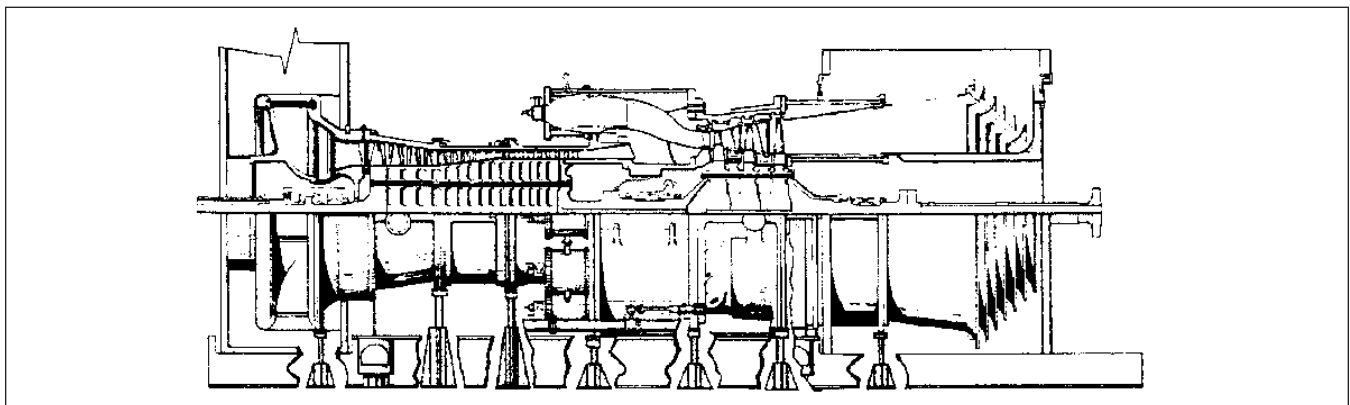


Figure 37. Stator tube jacking procedure – MS7001EA

to stator, obtain accurate half-shell clearances and prevent twisting of the stator casings. The MS7001EA jacking procedure is illustrated in *Figure 37*.

Special inspection procedures may apply to specific components in order to ensure that parts meet their intended life. These inspections may include, but are not limited to, dimensional inspections, Fluorescent Penetrant Inspection (FPI), Eddy Current Inspection (ECI) and other forms of non-destructive testing (NDT). The type of inspection required for specific hardware is determined on a part number and operational history basis, and can be attained from a service representative.

Similarly, repair action is taken on the basis of part number, unit operational history, and part condition. Repairs including (but not limited to) strip, chemical clean, HIP, heat treat, and recoat may also be necessary to ensure full parts life. Weld repair will be recommended when necessary, typically as determined by visual inspection and NDT. Failure to perform the required repairs may lead to retirement of the part before its life potential is fulfilled. In contrast, unnecessary repairs are an unneeded expenditure of time and resources. To verify the types of inspection and repair required, contact your service representative prior to an outage.

For inspection of the hot gas path (*Figure 33*), all combustion transition pieces and the first-stage turbine nozzle assemblies must be removed. Removal of the second- and third-stage turbine nozzle segment assemblies is optional, depending upon the results of visual observations, clearance measurements, and other required inspections. The buckets can usually be inspected in place. Fluorescent penetrant inspection (FPI) of the bucket vane sections may be required to detect any cracks. In addition, a complete set of internal turbine radial and axial clearances (opening and closing) must be taken during any hot gas path inspection. Re-assembly must meet clearance diagram requirements to ensure against rubs and to maintain unit performance. Typical hot gas-path inspection requirements for all machines are:

- Inspect and record condition of first-, second- and third-stage buckets. If it is determined that the turbine buckets should be removed, follow bucket removal and condition recording instructions. Buckets with protective coating should be evaluated for remaining coating life.
- Inspect and record condition of first-, second- and third-stage nozzles.
- Inspect and record condition of later-stage nozzle diaphragm packings.
- Check seals for rubs and deterioration of clearance.
- Record the bucket tip clearances.
- Inspect bucket shank seals for clearance, rubs and deterioration.
- Check the turbine stationary shrouds for clearance, cracking, erosion, oxidation, rubbing and build-up.
- Check and replace any faulty wheelspace thermocouples.
- Enter compressor inlet plenum and observe the condition of the forward section of the

compressor. Pay specific attention to IGVs, looking for corrosion, bushing wear evidenced by excessive clearance and vane cracking.

- Enter the combustion wrapper and, with a borescope, observe the condition of the blading in the aft end of the axial flow compressor.
- Visually inspect the turbine exhaust area for any signs of cracking or deterioration.

The first-stage turbine nozzle assembly is exposed to the direct hot-gas discharge from the combustion process and is subjected to the highest gas temperatures in the turbine section. Such conditions frequently cause nozzle cracking and oxidation and, in fact, this is expected. The second- and third-stage nozzles are exposed to high gas bending loads, which in combination with the operating temperatures, can lead to downstream deflection and closure of critical axial clearances. To a degree, nozzle distress can be tolerated and criteria have been established for determining when repair is required. These limits are contained in the Operations and Maintenance Manuals previously described. However, as a general rule, first stage nozzles will require repair at the hot gas path inspection. The second- and third-stage nozzles may require refurbishment to re-establish the proper axial clearances. Normally, turbine nozzles can be repaired several times to extend life and it is generally repair cost versus replacement cost that dictates the replacement decision.

Coatings play a critical role in protecting the buckets operating at high metal temperatures to ensure that the full capability of the high strength superalloy is maintained and that the bucket rupture life meets design expectations. This is particularly true of cooled bucket designs that operate above 1985°F (1085°C) firing temperature. Significant exposure of the base metal to the environment will accelerate the creep rate and can lead to premature replacement through a combination of increased temperature and stress and

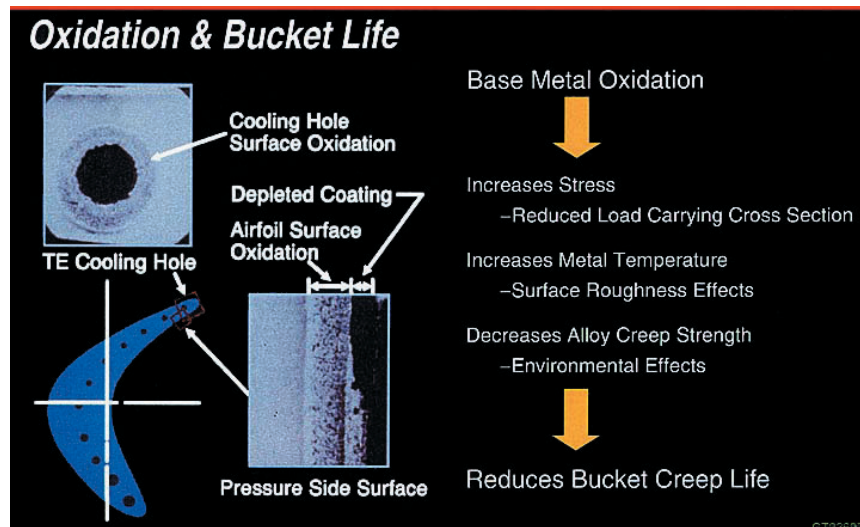


Figure 38. Stage 1 bucket oxidation and bucket life

a reduction in material strength, as described in *Figure 38*. This degradation process is driven by oxidation of the unprotected base alloy. In the past, on early generation uncooled designs, surface degradation due to corrosion or oxidation was considered to be a performance issue and not a factor in bucket life. This is no longer the case at the higher firing temperatures of current generation designs.

Given the importance of coatings, it must be recognized that even the best coatings available will have a finite life and the condition of the coating will play a major role in determining bucket replacement life. Refurbishment through stripping and recoating is an option for extending bucket life, but if recoating is selected, it should be done before the coating is breached to expose base metal. Normally, for turbines in the MS7001EA class, this means that recoating will be required at the hot gas path inspection. If recoating is not performed at the hot gas path inspection, the runout life of the buckets would generally extend to the major inspection, at which point the buckets would be replaced. For F class gas turbines recoating of the first stage buckets is recommended at each hot gas path inspection.

Visual and borescope examination of the hot gas path parts during the combustion inspections as well



as nozzle-deflection measurements will allow the operator to monitor distress patterns and progression. This makes part-life predictions more accurate and allows adequate time to plan for replacement or refurbishment at the time of the hot-gas-path inspection. It is important to recognize that to avoid extending the hot gas path inspection, the necessary spare parts should be on site prior to taking the unit out of service.

Major Inspection

The purpose of the major inspection is to examine all of the internal rotating and stationary components from the inlet of the machine through the exhaust. A major inspection should be scheduled in accordance with the recommendations in the owner's Operations and Maintenance Manual or as modified by the results of previous borescope and hot gas path inspection. The work scope shown in *Figure 39* involves inspection of all of the major flange-to-flange components of the gas turbine, which are subject to deterioration during normal turbine operation. This inspection includes previous elements of the combustion and hot gas path inspections, in addition to laying open the complete flange-to-flange gas turbine to the horizontal joints, as shown in *Figure 40*.

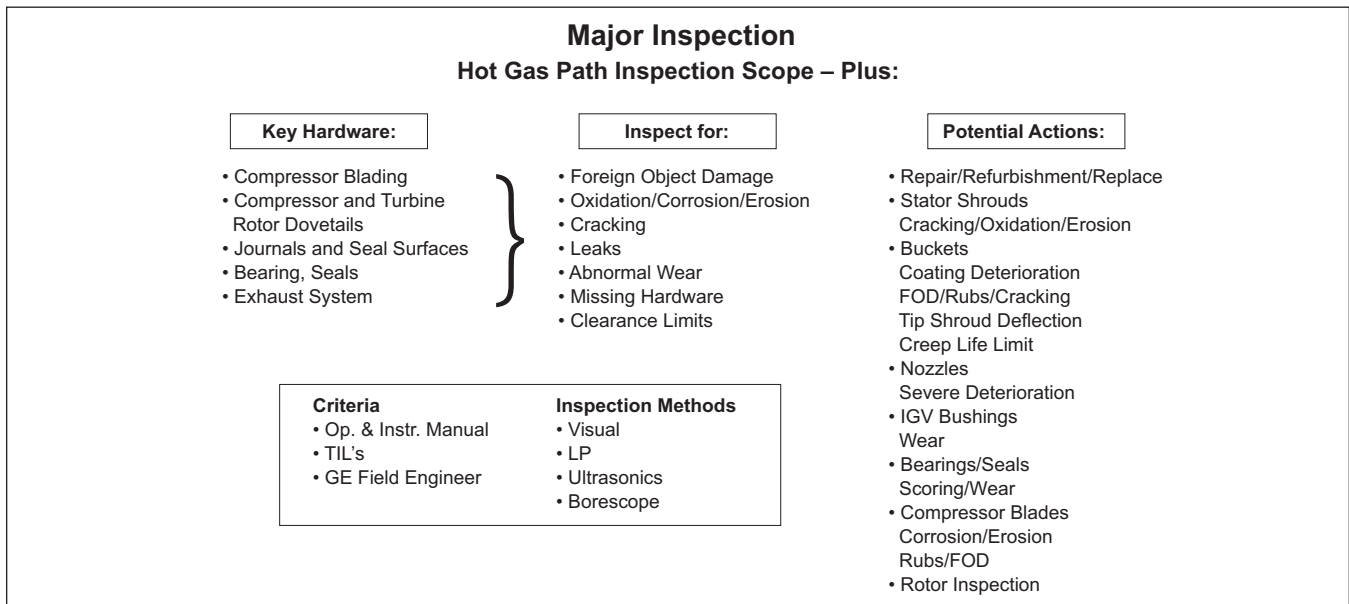


Figure 39. Gas turbine major inspection – key elements

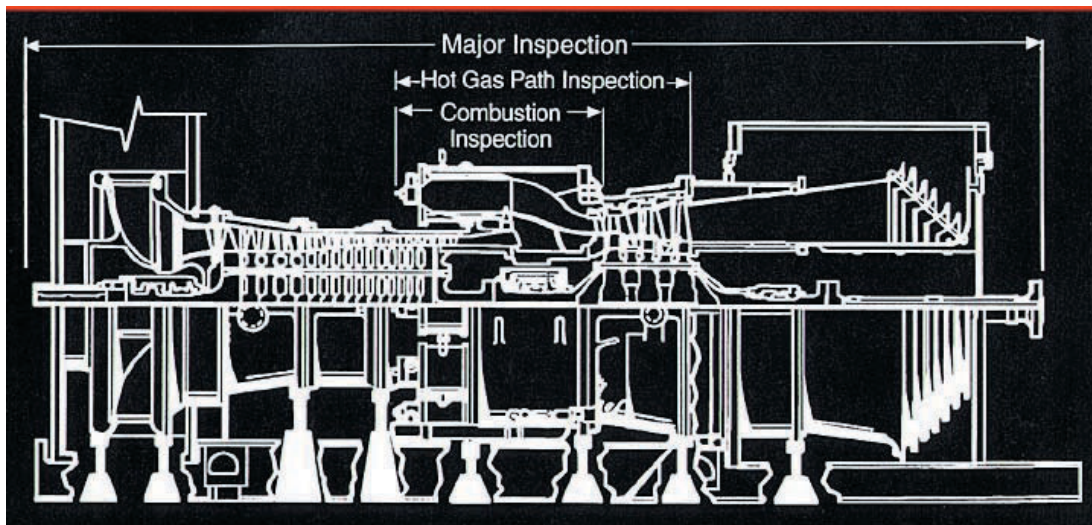


Figure 40. Major inspection work scope

Removal of all of the upper casings allows access to the compressor rotor and stationary compressor blading, as well as to the bearing assemblies. Prior to removing casings, shells and frames, the unit must be properly supported. Proper centerline support using mechanical jacks and jacking sequence procedures are necessary to assure proper alignment of rotor to stator, obtain accurate half shell clearances and to prevent twisting of the casings while on the half shell.

Typical major inspection requirements for all machines are:

- All radial and axial clearances are checked against their original values (opening and closing).
- Casings, shells and frames/diffusers are inspected for cracks and erosion.
- Compressor inlet and compressor flow-path are inspected for fouling, erosion, corrosion and

leakage. The IGVs are inspected, looking for corrosion, bushing wear and vane cracking.

- Rotor and stator compressor blades are checked for tip clearance, rubs, impact damage, corrosion pitting, bowing and cracking.
- Turbine stationary shrouds are checked for clearance, erosion, rubbing, cracking, and build-up.
- Seals and hook fits of turbine nozzles and diaphragms are inspected for rubs, erosion, fretting or thermal deterioration.
- Turbine buckets are removed and a non-destructive check of buckets and wheel dovetails is performed (first stage bucket protective coating should be evaluated for remaining coating life). Buckets that were not recoated at the hot gas path inspection should be replaced. Wheel dovetail fillets, pressure faces, edges, and intersecting features must be closely examined for conditions of wear, galling, cracking or fretting.
- Rotor inspections recommended in the maintenance and inspection manual or by Technical Information Letters should be performed.
- Bearing liners and seals are inspected for clearance and wear.
- Inlet systems are inspected for corrosion, cracked silencers and loose parts.
- Exhaust systems are inspected for cracks, broken silencer panels or insulation panels.
- Check alignment – gas turbine to generator/gas turbine to accessory gear.

Comprehensive inspection and maintenance guidelines have been developed by GE and are provided in the Operations and Maintenance Manual to assist users in performing each of the inspections previously described.

PARTS PLANNING

Lack of adequate on-site spares can have a major effect on plant availability; therefore, prior to a scheduled disassembly type of inspection, adequate spares should be on site. A planned outage such as a combustion inspection, which should only take two to five days, could take weeks. GE will provide recommendations regarding the types and quantities of spare parts needed; however, it is up to the owner to purchase these spare parts on a planned basis allowing adequate lead times.

Early identification of spare parts requirements ensures their availability at the time the planned inspections are performed. There are two documents which support the ordering of gas turbine parts by catalog number. The first is the Renewal Parts Catalog – Illustrations and Text. This document contains generic illustrations which are used for identifying parts. The second document, the Renewal Parts Catalog Ordering Data Manual, contains unit site-specific catalog ordering data.

Additional benefits available from the renewal parts catalog data system are the capability to prepare recommended spare parts lists for the combustion, hot-gas-path and major inspections as well as capital and operational spares.

Furthermore, interchangeability lists may be prepared for multiple units. The information contained in the Catalog Ordering Data Manual can be provided as a computer printout, on microfiche or on a computer disc. As the size of the database grows, and as generic illustrations are added, the usefulness of this tool will be continuously enhanced.

Typical expectations for estimated repair cycles for some of the major components are shown in *Appendix D*. These tables assume that operation of the unit has been in accordance with all of the manufacturer's specifications and instructions. Maintenance inspections

and repairs are also assumed to be done in accordance with the manufacturer's specifications and instructions. The actual repair and replacement cycles for any particular gas turbine should be based on the user's operating procedures, experience, maintenance practices and repair practices. The maintenance factors previously described can have a major impact on both the component repair interval and service life. For this reason, the intervals given in *Appendix D* should only be used as guidelines and not certainties for long range parts planning. Owners may want to include contingencies in their parts planning.

The expected repair and replacement cycle values reflect current production hardware.

To achieve these lives, current production parts with design improvements and newer coatings are required. With earlier production hardware, some of these lives may not be achieved. Operating factors and experience gained during the course of recommended inspection and maintenance procedures will be a more accurate predictor of the actual intervals.

Appendix D shows expected repair and replacement intervals based on the recommended inspection intervals shown in *Figure 42*. The application of inspection (or repair) intervals other than those shown in *Figure 42* can result in different replacement

intervals (as a function of the number of repair intervals) than those shown in *Appendix D*. See your GE representative for details on a specific system.

It should be recognized that, in some cases, the service life of a component is reached when it is no longer economical to repair any deterioration as opposed to replacing at a fixed interval. This is illustrated in *Figure 41* for a first stage nozzle, where repairs continue until either the nozzle cannot be restored to minimum acceptance standards or the repair cost exceeds or approaches the replacement cost. In other cases, such as first-stage buckets, repair options are limited by factors such as irreversible material damage. In both cases, users should follow GE recommendations regarding replacement or repair of these components.

While the parts lives shown in *Appendix D* are guidelines, the life consumption of individual parts within a parts set can have variations. The repair versus replacement economics shown in *Figure 41* may lead to a certain percentage of "fallout," or scrap, of parts being repaired. Those parts that fallout during the repair process will need to be replaced by new parts. The amount of fallout of parts depends on the unit operating environment history, the specific part design, and the current state-of-the-art for repair technology.

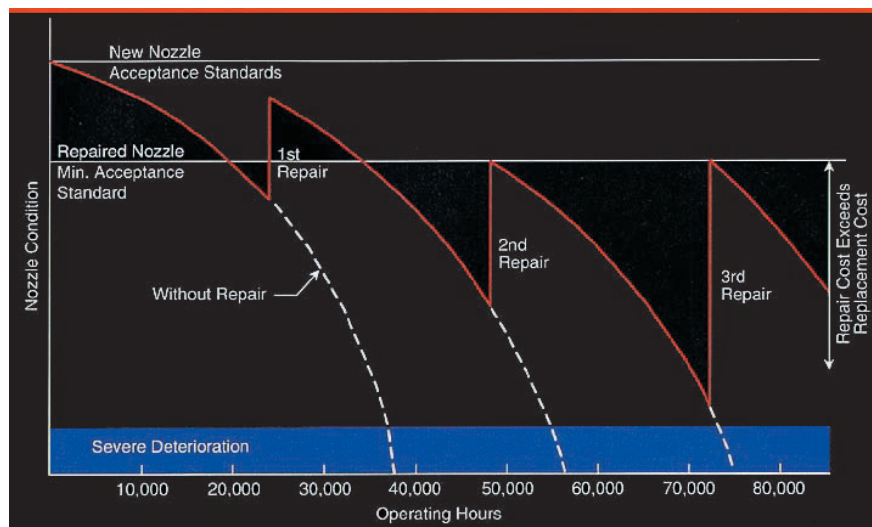


Figure 41. First-stage nozzle wear-preventive maintenance gas fired – continuous dry – base load

Type of Inspection	Combustion System	Factored Hours / Factored Starts										
		MS3002K	MS5001PA/ MS5002C,D	MS6B	MS7E/EA	MS9E	MS6FA	MS7F/FA/FA+	MS7FA+e	MS9F/FA/FA+	MS9FA+e	MS7FB
Combustion	Non-DLN	24,000/400	12,000/800 ⁽¹⁾⁽³⁾	12,000/1,200 ⁽²⁾⁽³⁾	8,000/900 ⁽³⁾	8,000/900 ⁽³⁾	–	–	–	–	–	–
	DLN	–	8,000/400	12,000/450	12,000/450	12,000/450	8,000/450	8,000/450	12,000/450	8,000/450	8,000/450	8,000/450
Hot Gas Path		24,000/1,200	Eliminated/1,200	24,000/1,200	24,000/1,200	24,000/900	24,000/900	24,000/900	24,000/900	24,000/900	24,000/900	24,000/900
Major		48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400	48,000/2,400

Factors That Can Reduce Maintenance Intervals

- Fuel
- Load Setting
- Steam/water injection
- Peak Load TF Operation
- Trips
- Start Cycle
- Hardware Design

(1) Units with Lean Head End liners have a 400 starts combustion inspection interval.
 (2) Machines with 6581 and 6BeV combustion hardware have a 12,000/600 combustion inspection interval.
 (3) Multiple Non-DLN configurations exist (Standard, MNQC, IGCC). The most limiting case is shown, however different quoting limits may exist on a machine and hardware basis. Contact a GE Energy representative for further information.

NOTE: Factored Hours/Starts intervals include an allowance for nominal trip maintenance factor effects.
 Hours/Starts intervals for Major Inspection are quoted in Actual Hours and Actual Starts.

Figure 42. Base line recommended inspection intervals: base load – gas fuel – dry

INSPECTION INTERVALS

Figure 42 lists the recommended combustion, hot-gas-path and major inspection intervals for current production GE turbines operating under ideal conditions of gas fuel, base load, and no water or steam injection. Considering the maintenance factors discussed previously, an adjustment from these maximum intervals may be necessary, based on the specific operating conditions of a given application. Initially, this determination is based on the expected operation of a turbine installation, but this should be reviewed and adjusted as actual operating and maintenance data are accumulated. While reductions in the maximum intervals will result from the factors described previously, increases in the maximum interval can also be considered where operating experience has been favorable. The condition of the hot-gas-path parts provides a good basis for customizing a program of inspection and maintenance; however, the condition of the compressor and bearing assemblies is the key driver in planning a Major Inspection.

GE can assist operators in determining the appropriate maintenance intervals for their particular application. Equations have been developed that account for the factors described earlier and can be

used to determine application specific hot gas path and major inspection intervals.

Hot Gas Path Inspection Interval

The hours-based hot gas path criterion is determined from the equation given in Figure 43. With this equation, a maintenance factor is determined that is the ratio of factored operating hours and actual operating hours. The factored hours consider the specifics of the duty cycle relating to fuel type, load setting and steam or water injection. Maintenance factors greater than one reduce the hot gas path inspection interval from the 24,000 hour ideal case for continuous base load, gas fuel and no steam or water injection. To determine the application specific maintenance interval, the maintenance factor is divided into 24,000, as shown in Figure 43.

The starts-based hot-gas-path criterion is determined from the equation given in Figure 44. As with the hours-based criteria, an application specific starts-based hot gas path inspection interval is calculated from a maintenance factor that is determined from the number of trips typically being experienced, the load level and loading rate.

As previously described, the hours and starts operating spectrum for the application is evaluated

Hours-Based HGP Inspection

$$\text{Maintenance Interval (Hours)} = \frac{24000}{\text{Maintenance Factor}}$$

Where:

$$\text{Maintenance Factor} = \frac{\text{Factored Hours}}{\text{Actual Hours}}$$

$$\text{Factored Hours} = (K + M \times I) \times (G + 1.5D + A_f H + 6P)$$

$$\text{Actual Hours} = (G + D + H + P)$$

G = Annual Base Load Operating hours on Gas Fuel

D = Annual Base Load Operating hours on Distillate Fuel

H = Annual Operating Hours on Heavy Fuel

A_f = Heavy Fuel Severity Factor

(Residual A_f = 3 to 4, Crude A_f = 2 to 3)

P = Annual Peak Load Operating Hours

I = Percent Water/Steam Injection Referenced to Inlet Air Flow

M&K = Water/Steam Injection Constants

M	K	Control	Steam Injection	N2/N3 Material
0	1	Dry	<2.2%	GTD-222/FSX-414
0	1	Dry	>2.2%	GTD-222
.18	.6	Dry	>2.2%	FSX-414
.18	1	Wet	>0%	GTD-222
.55	1	Wet	>0%	FSX-414

Figure 43. Hot gas path maintenance interval: hours-based criterion

against the recommended hot gas path intervals for starts and for hours. The limiting criterion (hours or starts) determines the maintenance interval. An example of the use of these equations for the hot gas path is contained in *Appendix A*.

Rotor Inspection Interval

Like HGP components, the unit rotor has a maintenance interval involving removal, disassembly and thorough inspection. This interval indicates the serviceable life of the rotor and is generally considered to be the teardown inspection and repair/replacement interval for the rotor. Customers should contact GE when their rotor has reached the end of its serviceable life for technical advisement.

The starts-based rotor maintenance interval is determined from the equation given in *Figure 45*. Adjustments to the rotor maintenance interval are determined from rotor-based operating factors as were described previously. In the calculation for the starts-based rotor maintenance interval, equivalent starts are determined for cold, warm, and hot starts

Starts-Based HGP Inspection

$$\text{Maintenance Interval (Starts)} = \frac{S}{\text{Maintenance Factor}}$$

Where:

$$\text{Maintenance Factor} = \frac{\text{Factored Starts}}{\text{Actual Starts}}$$

$$\text{Factored Starts} = 0.5N_A + N_B + 1.3N_P + 20E + 2F + \sum_{i=1}^{\eta} (a_{Ti} - 1) T_i$$

$$\text{Actual Starts} = (N_A + N_B + N_P)$$

S = Maximum Starts-Based Maintenance Interval (Model Size Dependent)

N_A = Annual Number of Part Load Start/Stop Cycles (<60% Load)

N_B = Annual Number of Base Load Start/Stop Cycles

N_P = Annual Number of Peak Load Start/Stop Cycles (>100% Load)

E = Annual Number of Emergency Starts

F = Annual Number of Fast Load Starts

T = Annual Number of Trips

a_T = Trip Severity Factor = f(Load) (See Figure 21)

η = Number of Trip Categories (i.e. Full Load, Part Load, etc.)

Model Series	S	Model Series	S
MS6B/MS7EA	1,200	MS9E	900
MS6FA	900	7/9 F Class	900

Figure 44. Hot gas path maintenance interval: starts-based criterion

Starts-Based Rotor Inspection

$$\text{Rotor Maintenance Interval} = \frac{5000^{(1)}}{\text{Maintenance Factor}} \quad (\text{Not to exceed 5000 starts})$$

MF >= 1

$$\text{Maintenance Factor} = \frac{F_h \cdot N_h + F_{w1} \cdot N_{w1} + F_{w2} \cdot N_{w2} + F_c \cdot N_c + F_t \cdot N_t}{N_h + N_{w1} + N_{w2} + N_c}$$

Number of Starts

- N_h = Number of hot starts
- N_{w1} = Number of Warm1 starts
- N_{w2} = Number of Warm2 starts
- N_c = Number of cold starts
- N_t = Number of trips

Start Factors

- F_h = Hot start factor (Down 1-4 hr)*
- F_{w1} = Warm1 start factor (Down 4-20 hr)
- F_{w2} = Warm2 start factor (Down 20-40 hr)
- F_c = Cold start factor (Down >40 hr)
- F_t = Trip from load factor

(1) F class

Note: Start factors for 7/9 FA+e machines are tabulated in Figure 23.
For other F Class machines, refer to applicable TILs.

Figure 45. Rotor maintenance interval: starts-based criterion

over a defined time period by multiplying the appropriate cold, warm and hot start operating factors by the number of cold, warm and hot starts respectively. In this calculation, the classification of start is key. Additionally, equivalent starts for trips from load are added. The total equivalent starts are divided by the actual number of starts to yield the maintenance factor. The rotor starts-based maintenance interval for a specific application is determined by dividing the baseline rotor maintenance interval of 5000 starts by the calculated maintenance factor. As indicated in *Figure 45*, the baseline rotor maintenance interval is also the maximum interval, since calculated maintenance factors less than one are not considered.

Figure 46 describes the procedure to determine the hours-based maintenance criterion. Peak load operation is the primary maintenance factor for the F class rotors and will act to increase the hours-based maintenance factor and to reduce the rotor maintenance interval.

When the rotor reaches the limiting inspection interval determined from the equations described in *Figures 45 and 46*, a disassembly of the rotor is required so that a complete inspection of the rotor components in

both the compressor and turbine can be performed. It should be expected that some rotor components will require replacement at this inspection point, and depending on the extent of refurbishment and part replacement, subsequent inspections may be required at a reduced interval.

As with major inspections, the rotor repair interval should include thorough dovetail inspections for wear and cracking. The baseline rotor life is predicated upon sound inspection results at the majors.

The baseline intervals of 144,000 hours and 5000

Hours-Based Rotor Inspection

$$\text{Rotor Maintenance Interval} = \frac{144000^{(1)}}{\text{Maintenance Factor}}$$

$$\text{Maintenance Factor} = \frac{H + 2 \cdot P^{(2)}}{H + P}$$

Where:

- H ~ Base load hours
- P ~ Peak load hours

(1) F class

(2) For E-class, MF = (H + 2*P + 2*TG) / (H + P), where TG is hours on turning gear.

Note: To diminish potential turning gear impact, Major Inspections must include a thorough visual examination of the turbine dovetails for signs of wearing, galling, fretting, or cracking.

Figure 46. Rotor maintenance interval: hours-based criterion

starts in *Figures 45 and 46* pertain to F class rotors. For rotors other than F class, rotor maintenance should be performed at intervals recommended by GE through issued Technical Information Letters (TILs). Where no recommendations have been made, rotor inspection should be performed at 5,000 factored starts or 200,000 factored hours.

Combustion Inspection Interval

Equations have been developed that account for the earlier mentioned factors affecting combustion maintenance intervals. These equations represent a generic set of maintenance factors that provide general guidance on maintenance planning. As such, these equations do not represent the specific capability of any given combustion system. They do provide, however, a generalization of combustion system experience. See your GE Energy representative for maintenance factors and limitations of specific combustion systems. For combustion parts, the base line operating conditions that result in a maintenance factor of unity are normal fired start-up and shut-down (no trip) to base load on natural gas fuel without steam or water injection. Application of the Extendor™ Combustion System Wear Kit has the potential to significantly increase maintenance intervals.

An hours-based combustion maintenance factor can be determined from the equations given in *Figure 47* as the ratio of factored-hours to actual operating hours. Factored-hours considers the effects of fuel type, load setting and steam or water injection. Maintenance factors greater than one reduce recommended combustion inspection intervals from those shown in *Figure 42* representing baseline operating conditions. To obtain a recommended inspection interval for a specific application, the maintenance factor is divided into the recommended base line inspection interval.

A starts-based combustion maintenance factor can be determined from the equations given in *Figure 48* and considers the effect of fuel type, load setting, emergency starts, fast loading rates, trips and steam or water injection. An application specific recommended inspection interval can be determined from the baseline inspection interval in *Figure 42* and the maintenance factor from *Figure 48*.

Appendix B shows six example maintenance factor calculations using the above hours and starts maintenance factors equations.

Maintenance Factor = (Factored Hours)/(Actual Hours)
 Factored Hours = $\sum (K_i \times A_{f_i} \times A_{p_i} \times t_i)$, $i = 1$ to n Operating Modes
 Actual Hours = $\sum (t_i)$, $i = 1$ to n Operating Modes
 Where:

- i = Discrete Operating mode (or Operating Practice of Time Interval)
- t_i = Operating hours at Load in a Given Operating mode
- A_{p_i} = Load Severity factor
 - $A_p = 1.0$ up to Base Load
 - $A_p = \exp(0.018 \times \text{Peak Firing Temp Adder in deg F})$ for Peak Load
- A_{f_i} = Fuel Severity Factor (dry)
 - $A_f = 1.0$ for Gas Fuel ⁽¹⁾
 - $A_f = 1.5$ for Distillate Fuel, Non-DLN (2.5 for DLN)
 - $A_f = 2.5$ for Crude (Non-DLN)
 - $A_f = 3.5$ for Residual (Non-DLN)
- K_i = Water/Steam Injection Severity Factor
 (% Steam Referenced to Inlet Air Flow, w/f = Water to Fuel Ratio)
 - $K = \text{Max}(1.0, \exp(0.34(\% \text{Steam} - 2.00\%)))$ for Steam, Dry Control Curve
 - $K = \text{Max}(1.0, \exp(0.34(\% \text{Steam} - 1.00\%)))$ for Steam, Wet Control Curve
 - $K = \text{Max}(1.0, \exp(1.80(w/f - 0.80)))$ for Water, Dry Control Curve
 - $K = \text{Max}(1.0, \exp(1.80(w/f - 0.40)))$ for Water, Wet Control Curve

(1) $A_f = 10$ for DLN 1 extended lean-lean and DLN 2.0 lean-lean operating modes.

Figure 47. Combustion inspection hours-based maintenance factors

$$\text{Maintenance Factor} = (\text{Factored starts})/(\text{Actual Starts})$$

$$\text{Factored Starts} = \sum (K_i \times A_f_i \times A_t_i \times A_p_i \times A_s_i \times N_i), i = 1 \text{ to } n \text{ Start/Stop Cycles}$$

$$\text{Actual Starts} = \sum (N_i), i = 1 \text{ to } n \text{ Start/Stop Cycles}$$

Where:

- i = Discrete Start/Stop Cycle (or Operating Practice)
- N_i = Start/Stop Cycles in a Given Operating Mode
- A_{s_i} = Start Type Severity Factor
 - $A_s = 1.0$ for Normal Start
 - $A_s = 1.2$ for Start with Fast Load
 - $A_s = 3.0$ for Emergency Start
- A_{p_i} = Load Severity Factor
 - $A_p = 1.0$ up to Base Load
 - $A_p = \exp(0.009 \times \text{Peak Firing Temp Adder in deg F})$ for Peak Load
- A_{t_i} = Trip Severity Factor
 - $A_t = 0.5 + \exp(0.0125 \times \% \text{Load})$ for Trip
- A_{f_i} = Fuel Severity Factor (Dry, at Load)
 - $A_f = 1.0$ for Gas Fuel
 - $A_f = 1.25$ for Non-DLN (or 1.5 for DLN) for Distillate Fuel
 - $A_f = 2.0$ for Crude (Non-DLN)
 - $A_f = 3.0$ for Residual (Non-DLN)
- K_i = Water/Steam Injection Severity Factor
 - (%Steam Referenced to Inlet Air Flow, w/f = Water to Fuel Ratio)
 - $K = \text{Max}(1.0, \exp(0.34(\% \text{Steam} - 1.00\%)))$ for Steam, Dry Control Curve
 - $K = \text{Max}(1.0, \exp(0.34(\% \text{Steam} - 0.50\%)))$ for Steam, Wet Control Curve
 - $K = \text{Max}(1.0, \exp(1.80(w/f - 0.40)))$ for Water, Dry Control Curve
 - $K = \text{Max}(1.0, \exp(1.80(w/f - 0.20)))$ for Water, Wet Control Curve

Figure 48. Combustion inspection starts-based maintenance factors

MANPOWER PLANNING

It is essential that advanced manpower planning be conducted prior to an outage. It should be understood that a wide range of experience, productivity and working conditions exist around the world. However, based upon maintenance inspection man-hour assumptions, such as the use of an average crew of workers in the United States with trade skill (but not necessarily direct gas turbine experience), with all needed tools and replacement parts (no repair time) available, an estimate can be made. These estimated craft labor man-hours should include controls and accessories and the generator. In addition to the craft labor, additional resources are needed for technical direction of the craft labor force, specialized tooling, engineering reports, and site mobilization/de-mobilization.

Inspection frequencies and the amount of downtime varies within the gas turbine fleet due to different duty cycles and the economic need for a unit to be in a state of operational readiness. It can be demonstrated that an 8000-hour interval for a

combustion inspection with minimum downtime can be achievable based on the above factors. Contact your local GE Energy representative for the specific man-hours and recommended crew size for your specific unit.

Depending upon the extent of work to be done during each maintenance task, a cooldown period of 4 to 24 hours may be required before service may be performed. This time can be utilized productively for job move-in, correct tagging and locking equipment out-of-service and general work preparations. At the conclusion of the maintenance work and systems check out, a turning gear time of two to eight hours is normally allocated prior to starting the unit. This time can be used for job clean-up and arranging for any repairs required on removed parts.

Local GE field service representatives are available to help plan your maintenance work to reduce downtime and labor costs. This planned approach will outline the renewal parts that may be needed and the projected work scope, showing which tasks can be accomplished in parallel and which tasks must be

sequential. Planning techniques can be used to reduce maintenance cost by optimizing lifting equipment schedules and manpower requirements. Precise estimates of the outage duration, resource requirements, critical-path scheduling, recommended replacement parts, and costs associated with the inspection of a specific installation may be obtained from the local GE field services office.

CONCLUSION

GE heavy-duty gas turbines are designed to have an inherently high availability. To achieve maximum gas turbine availability, an owner must understand not only the equipment, but the factors affecting it. This includes the training of operating and maintenance personnel, following the manufacturer's recommendations, regular periodic inspections and the stocking of spare parts for immediate replacement. The recording of operating data, and analysis of these data, are essential to preventative and planned maintenance. A key factor in achieving this goal is a commitment by the owner to provide effective outage management and full utilization of published instructions and the available service support facilities.

It should be recognized that, while the manufacturer provides general maintenance recommendations, it is the equipment user who has the major impact upon the proper maintenance and operation of equipment. Inspection intervals for optimum turbine service are not fixed for every installation, but rather are developed through an interactive process by each user, based on past experience and trends indicated by key turbine factors. In addition, through application of a Contractual Service Agreement to a particular turbine, GE can work with a user to establish a maintenance program that may differ from general recommendations but will be consistent with contractual responsibilities.

The level and quality of a rigorous maintenance

program have a direct impact on equipment reliability and availability. Therefore, a rigorous maintenance program which optimizes both maintenance cost and availability is vital to the user. A rigorous maintenance program will minimize overall costs, keep outage downtimes to a minimum, improve starting and running reliability and provide increased availability and revenue earning ability for GE gas turbine users.

REFERENCES

- Jarvis, G., "Maintenance of Industrial Gas Turbines," GE Gas Turbine State of the Art Engineering Seminar, paper SOA-24-72, June 1972.
- Patterson, J. R., "Heavy-Duty Gas Turbine Maintenance Practices," GE Gas Turbine Reference Library, GER-2498, June 1977.
- Moore, W. J., Patterson, J.R, and Reeves, E.F., "Heavy-Duty Gas Turbine Maintenance Planning and Scheduling," GE Gas Turbine Reference Library, GER-2498; June 1977, GER 2498A, June 1979.
- Carlstrom, L. A., et al., "The Operation and Maintenance of General Electric Gas Turbines," numerous maintenance articles/authors reprinted from Power Engineering magazine, General Electric Publication, GER-3148; December 1978.
- Knorr, R. H., and Reeves, E. F., "Heavy-Duty Gas Turbine Maintenance Practices," GE Gas Turbine Reference Library, GER-3412; October 1983; GER-3412A, September 1984; and GER-3412B, December 1985.
- Freeman, Alan, "Gas Turbine Advance Maintenance Planning," paper presented at Frontiers of Power, conference, Oklahoma State University, October 1987.
- Hopkins, J. P, and Osswald, R. F., "Evolution of the Design, Maintenance and Availability of a Large Heavy-Duty Gas Turbine," GE Gas Turbine Reference Library, GER-3544, February 1988 (never printed).
- Freeman, M. A., and Walsh, E. J., "Heavy-Duty Gas

Turbine Operating and Maintenance Considerations,”
GE Gas Turbine Reference Library, GER-3620A.

GEI-41040E, “Fuel Gases for Combustion in Heavy-
Duty Gas Turbines.”

GEI-41047K, “Gas Turbine Liquid Fuel Specifications.”

GEK-101944B, “Requirements for Water/Steam
Purity in Gas Turbines.”

GER-3419A, “Gas Turbine Inlet Air Treatment.”

GER-3569F, “Advanced Gas Turbine Materials
and Coatings.”

GEK-32568, “Lubricating Oil Recommendations
for Gas Turbines with Bearing Ambients Above
500°F (260°C).”

GEK-110483, “Cleanliness Requirements for Power
Plant Installation, Commissioning and Maintenance.”

ACKNOWLEDGMENTS

Tim Lloyd and Michael Hughes dedicated many hours to the detailed development of this document and their hard work is sincerely appreciated. Keith Belsom, Durell Benjamin, Mark Cournoyer, Richard Elliott, Tom Farrell, Jeff Hamilton, Steve Hartman, Jack Hess, Bob Hoeft, Patrick Mathieu, Stephen Norcross, Eric Smith, and Bert Stuck are also acknowledged for significant contributions.

APPENDIX

A.1) Example 1 – Hot Gas Path Maintenance Interval Calculation

An MS7001EA user has accumulated operating data since the last hot gas path inspection and would like to estimate when the next one should be scheduled. The user is aware from GE publications that the normal HGP interval is 24,000 hours if operating on natural gas, with no water or steam injection, and at base load. It is also understood that the nominal starts interval is 1200, based on normal startups, no trips, no emergency starts. The actual operation of the unit since the last hot gas path inspection is much different from the GE “baseline case.”

Annual hours on natural gas, base load
= G = 3200 hr/yr

Annual hours on light distillate
= D = 350 hr/yr

Annual hours on peak load
= P = 120 hr/yr

Steam injection rate
= I = 2.4%

Also, since the last hot gas path inspection,

140 Normal start-stop cycles:

40 Part load

100 Base load

0 Peak load

In addition,

E = 2 Emergency Starts w / ramp to base load

F = 5 Fast loads ending in a normal shut down from base load

T = 20 Starts with trips from base load
($a_{Ti} = 8$)

For this particular unit, the second and third-stage nozzles are FSX-414 material. The unit operates on “dry control curve.”

From *Figure 43*, at a steam injection rate of 2.4%, the value of “M” is .18, and “K” is .6.

From the hours-based criteria, the maintenance factor is determined from *Figure 43*.

$$MF = \frac{[K + M(I)] \times [G + 1.5(D) + Af(H) + 6(P)]}{(G + D + H + P)}$$

$$MF = \frac{[.6 + .18(2.4)] \times [3200 + 1.5(350) + 0 + 6(120)]}{(3200 + 350 + 0 + 120)}$$

$$MF = 1.25$$

The hours-based adjusted inspection interval is therefore,

$$H = 24,000/1.25$$

H = 19,200 hours [Note, since total annual operating hours is 3670, the estimated time to reach 19,200 hours is 5.24 years (19,200/3670).]

From the starts-based criteria, the maintenance factor is determined from *Figure 44*.

The total number of part load starts is

$$N_A = 40/\text{yr}$$

The total number of base load starts is

$$N_B = 100 + 2 + 5 + 20 = 127/\text{yr}$$

The total number of peak load starts is

$$N_P = 0/\text{yr}$$

$$MF = \frac{[0.5 (N_A) + (N_B) + 1.3(N_P) + 20(E) + 2(F) + \sum_{i=1}^n (a_{Ti} - 1) T_i]}{N_A + N_B + N_P}$$

$$MF = \frac{0.5(40) + (127) + 1.3(0) + 20(2) + 2(5) + (8-1)20}{40 + 127 + 0}$$

$$MF = 2$$

The adjusted inspection interval based on starts is

$$S = 1200/2.0$$

$S = 600$ starts [Note, since the total annual number of starts is 167, the estimated time to reach 600 starts is $600/167 = 3.6$ years.]

In this case, the starts-based maintenance factor is greater than the hours maintenance factor and therefore the inspection interval is set by starts. The hot gas path inspection interval is 600 starts (or 3.6 years).

A.2) Example 2 – Hot Gas Path Factored Starts Calculation

An MS7001EA user has accumulated operating data for the past year of operation. This data shows number of trips from part, base, and peak load, as well as emergency starting and fast loading. The user would like to calculate the total number of factored starts in order to plan the next HGP outage. *Figure 44* is used to calculate the total number of factored starts as shown below.

Operational history:

150 Start-stop cycles per year:

40 Part load

60 Base load

50 Peak load

50 ending in trips:

10 from 105% load

5 from 50% load (part load)

35 from 65% load (base load)

In addition,

3 Emergency Starts w / ramp to base load:

2 ended in a trip from full load

1 ended in a normal shutdown

4 Fast loads:

1 tripped during loading at 50% load

3 achieved base load and ended in a normal shutdown

Total Starts

Part Load, $N_A = 40 + 1 = 41$

Base Load, $N_B = 60 + 3 + 3 = 66$

Peak Load, $N_P = 50$

Total Trips

1. 50% load ($aT_1=6.5$), $T_1 = 5 + 1 = 6$

2. Full load ($aT_2=8$), $T_2 = 35 + 2 = 37$

3. Peak load ($aT_3=10$), $T_3 = 10$

Additional Cycles

Emergency starting, $E = 3$

Fast loading, $F = 4$

From the starts-based criteria, the total number of factored starts is determined from *Figure 44*.

$$FS = 0.5(NA) + (NB) + 1.3(NP) + 20(E) + 2(F) + \sum_{i=1}^n (a_{T_i} - 1) T_i$$

$$FS = 0.5(41) + (66) + 1.3(50) + 20(3) + 2(4) + [(6.5 - 1)6 + (8 - 1)37 + (10 - 1)10] = 601.50$$

$$AS = 41 + 66 + 50 = 157$$

$$MF = \frac{601.5}{157} = 3.8$$

B) Examples – Combustion Maintenance Interval Calculations (reference Figures 47 and 48)

7EA DLN 1 Peaking Duty with Power Augmentation

+50F Tfire Increase	Gas Fuel
3.5% Steam Augmentation	6 Hours/Start
Start with Fast Load	Wet Control Curve
Normal Shut Down (No Trip)	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 34.5 Hours	
Hours Maintenance Factor =	5.8
Where	
Ki =	2.34 Max(1.0, exp(0.34(3.50-1.00))) Wet
Afi =	1.00 Gas Fuel
Api =	2.46 exp(0.018(50)) Peaking
ti =	6.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 5.2 Starts	
Starts Maintenance Factor =	5.2
Where	
Ki =	2.77 Max(1.0, exp(0.34(3.50-0.50))) Wet
Afi =	1.00 Gas Fuel
Ati =	1.00 No Trip at Load
Api =	1.57 exp(0.009(50)) Peaking
Asi =	1.20 Start with Fast Load
Ni =	1.0 Considering Each Start

7EA Standard Combustor Baseload on Crude Oil

No Tfire Increase	Crude Oil Fuel
1.0 Water/Fuel Ratio	220 Hours/Start
Normal Start and Load	Dry Control Curve
Normal Shut Down (No Trip)	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 788.3 Hours	
Hours Maintenance Factor =	3.6
Where	
Ki =	1.43 Max(1.0, exp(1.80(1.00-0.80))) Dry
Afi =	2.50 Crude Oil, Std (Non-DLN)
Api =	1.00 Baseload
ti =	220.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 5.9 Starts	
Starts Maintenance Factor =	5.9
Where	
Ki =	2.94 Max(1.0, exp(1.80(1.00-0.40))) Dry
Afi =	2.00 Crude Oil, Std (Non-DLN)
Ati =	1.00 No Trip at Load
Api =	1.00 Baseload
Asi =	1.00 Normal Start
Ni =	1.0 Considering Each Start

7FA+e DLN 2.6 Baseload on Distillate

No Tfire Increase	Distillate Fuel
1.1 Water/Fuel Ratio	220 Hours/Start
Normal Start	Dry Control Curve
Normal Shut Down (No Trip)	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 943.8 Hours	
Hours Maintenance Factor =	4.3
Where	
Ki =	1.72 Max(1.0, exp(1.80(1.10-0.80))) Dry
Afi =	2.50 Distillate Fuel, DLN
Api =	1.00 Baseload
ti =	220.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 5.3 Starts	
Starts Maintenance Factor =	5.3
Where	
Ki =	3.53 Max(1.0, exp(1.80(1.10-0.40))) Dry
Afi =	1.50 Distillate Fuel, DLN
Ati =	1.00 No Trip at Load
Api =	1.00 Baseload
Asi =	1.00 Normal Start
Ni =	1.0 Considering Each Start

7FA+e DLN 2.6 Baseload on Gas with Trip @ Load

No Tfire Increase	Gas Fuel
No Steam/Water Injection	168 Hours/Start
Normal Start and Load	Dry Control Curve
Trip @ 60% Load	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 168.0 Hours	
Hours Maintenance Factor =	1.0
Where	
Ki =	1.00 No Injection
Afi =	1.00 Gas Fuel
Api =	1.00 Baseload
ti =	168.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 2.6 Starts	
Starts Maintenance Factor =	2.6
Where	
Ki =	1.00 No Injection
Afi =	1.00 Gas Fuel
Ati =	2.62 0.5+exp(0.0125*60) for Trip
Api =	1.00 Baseload
Asi =	1.00 Normal Start
Ni =	1.0 Considering Each Start

7EA DLN 1 Combustor Baseload on Distillate

No Tfire Increase	Distillate Fuel
0.9 Water/Fuel Ratio	500 Hours/Start
Normal Start	Dry Control Curve
Normal Shut Down (No Trip)	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 1496.5 Hours	
Hours Maintenance Factor =	3.0
Where	
Ki =	1.20 Max(1.0, exp(1.80(0.90-0.80))) Dry
Afi =	2.50 Distillate Fuel, DLN 1
Api =	1.00 Partload
ti =	500.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 3.7 Starts	
Starts Maintenance Factor =	3.7
Where	
Ki =	2.46 Max(1.0, exp(1.80(0.90-0.40))) Dry
Afi =	1.50 Distillate Fuel, DLN
Ati =	1.00 No Trip at Load
Api =	1.00 Part Load
Asi =	1.00 Normal Start
Ni =	1.0 Considering Each Start

7FA+e DLN 2.6 Peak Load on Gas with Emergency Starts

+35F Tfire Increase	Gas Fuel
3.5% Steam Augmentation	4 Hours/Start
Emergency Start	Dry Control Curve
Normal Shut Down (No Trip)	
Factored Hours = $K_i * A_{fi} * A_{pi} * t_i =$ 12.5 Hours	
Hours Maintenance Factor =	3.1
Where	
Ki =	1.67 Max(1.0, exp(0.34(3.50-2.00)))
Afi =	1.00 Gas Fuel
Api =	1.88 exp(0.018(35)) Peaking
ti =	4.0 Hours/Start
Factored Starts = $K_i * A_{fi} * A_{ti} * A_{pi} * A_{si} * N_i =$ 9.6 Starts	
Starts Maintenance Factor =	9.6
Where	
Ki =	2.34 Max(1.0, exp(0.34(3.50-1.00))) Dry
Afi =	1.00 Gas Fuel
Ati =	1.00 No Trip at Load
Api =	1.37 exp(0.009(35)) Peaking
Asi =	3.00 Emergency Start
Ni =	1.0 Considering Each Start

Figure B-1. Combustion maintenance interval calculations

C) Definitions

Reliability: Probability of not being forced out of service when the unit is needed — includes forced outage hours (FOH) while in service, while on reserve shutdown and while attempting to start normalized by period hours (PH) — units are %.

$$\begin{aligned} \text{Reliability} &= (1-\text{FOH}/\text{PH}) (100) \\ \text{FOH} &= \text{total forced outage hours} \\ \text{PH} &= \text{period hours} \end{aligned}$$

Availability: Probability of being available, independent of whether the unit is needed – includes all unavailable hours (UH) – normalized by period hours (PH) – units are %:

$$\begin{aligned} \text{Availability} &= (1-\text{UH}/\text{PH}) (100) \\ \text{UH} &= \text{total unavailable hours (forced outage, failure to start, scheduled maintenance hours, unscheduled maintenance hours)} \\ \text{PH} &= \text{period hours} \end{aligned}$$

Equivalent Reliability: Probability of a multi-shaft combined-cycle power plant not being totally forced out of service when the unit is required includes the effect of the gas and steam cycle MW output contribution to plant output – units are %.

Equivalent Reliability =

$$\left[1 - \left[\frac{\text{GT FOH}}{\text{GT PH}} + B \left(\frac{\text{HRSG FOH}}{B \text{ PH}} + \frac{\text{ST FOH}}{\text{ST PH}} \right) \right] \right] \times 100$$

$$\begin{aligned} \text{GT FOH} &= \text{Gas Turbine Forced Outage Hours} \\ \text{GT PH} &= \text{Gas Turbine Period Hours} \\ \text{HRSG FOH} &= \text{HRSG Forced Outage Hours} \\ B \text{ PH} &= \text{HRSG Period Hours} \\ \text{ST FOH} &= \text{Steam Turbine Forced Outage Hours} \\ \text{ST PH} &= \text{Steam Turbine Period Hours} \\ B &= \text{Steam Cycle MW Output Contribution (normally 0.30)} \end{aligned}$$

Equivalent Availability: Probability of a multi-shaft combined-cycle power plant being available for power generation — independent of whether the unit is needed — includes all unavailable hours — includes the effect of the gas and steam cycle MW output contribution to plant output; units are %.

Equivalent Availability =

$$\left[1 - \left[\frac{\text{GT UH}}{\text{GT PH}} + B \left(\frac{\text{HRSG UH}}{\text{GT PH}} + \frac{\text{ST UH}}{\text{ST PH}} \right) \right] \right] \times 100$$

$$\begin{aligned} \text{GT UH} &= \text{Gas Turbine Unavailable Hours} \\ \text{GT PH} &= \text{Gas Turbine Period Hours} \\ \text{HRSG UH} &= \text{HRSG Total Unavailable Hours} \\ \text{ST UH} &= \text{Steam Turbine Unavailable Hours} \\ \text{ST PH} &= \text{Steam Turbine Forced Outage Hours} \\ B &= \text{Steam Cycle MW Output Contribution (normally 0.30)} \end{aligned}$$

MTBF—Mean Time Between Failure: Measure of probability of completing the current run. Failure events are restricted to forced outages (FO) while in service – units are service hours.

$$\text{MTBF} = \text{SH}/\text{FO}$$

$$\text{SH} = \text{Service Hours}$$

$$\text{FO} = \text{Forced Outage Events from a Running (On-line) Condition}$$

Service Factor: Measure of operational use, usually expressed on an annual basis – units are %.

$$\text{SF} = \text{SH}/\text{PH} \times 100$$

$$\text{SH} = \text{Service Hours on an annual basis}$$

$$\text{PH} = \text{Period Hours (8760 hours per year)}$$

Operating Duty Definition:

Duty	Service Factor	Fired
		Hours/Start
Stand-by	< 1%	1 to 4
Peaking	1% – 17%	3 to 10
Cycling	17% – 50%	10 to 50
Continuous	> 90%	>> 50

D) Repair and Replacement Cycles

MS3002K Parts			
	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	2 (CI)	4 (CI)
Transition Pieces	CI, HGPI	2 (CI)	2 (HGPI)
Stage 1 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Nozzles	MI	2 (MI)	2 (MI)
Stage 1 Shrouds	MI	2 (MI)	2 (MI)
Stage 2 Shrouds	MI	2 (MI)	2 (MI)
Stage 1 Bucket	–	1 (MI) ⁽¹⁾	3 (HGPI)
Stage 2 Bucket	–	1 (MI)	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.
 CI = Combustion Inspection Interval
 HGPI = Hot Gas Path Inspection Interval
 MI = Major Inspection Interval
 (1) GE approved repair at 24,000 hours may extend life to 72,000 hours.

Figure D-1. Estimated repair and replacement cycles

MS5001PA / MS5002C,D Parts			
	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	4 (CI)	3 (CI) / 4 (CI) ⁽¹⁾
Transition Pieces	CI, HGPI	4 (CI) ⁽²⁾	2 (HGPI)
Stage 1 Nozzles	HGPI, MI	2 (MI)	2 (HGPI)
Stage 2 Nozzles	HGPI, MI	2 (MI)	2 (HGPI) / 2 (MI) ⁽³⁾
Stage 1 Shrouds	MI	2 (MI)	2 (MI)
Stage 2 Shrouds	–	2 (MI)	2 (MI)
Stage 1 Bucket	–	1 (MI) ⁽⁴⁾	3 (HGPI)
Stage 2 Bucket	–	1 (MI)	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.
 CI = Combustion Inspection Interval
 HGPI = Hot Gas Path Inspection Interval
 MI = Major Inspection Interval
 (1) 3 (CI) for non-DLN units, 4 (CI) for DLN units
 (2) Repair interval is every 2 (CI)
 (3) 2 (HGPI) for MS5001PA, 2 (MI) for MS5002C, D
 (4) GE approved repair at 24,000 hours will extend life to 72,000 hours

Figure D-2. Estimated repair and replacement cycles

PG6541-61 (6B)

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 1 Bucket	HGPI	2 (HGPI) ⁽¹⁾ / 3 (HGPI) ⁽²⁾	3 (HGPI)
Stage 2 Bucket	HGPI	3 (HGPI) ⁽³⁾	4 (HGPI)
Stage 3 Bucket	HGPI	3 (HGPI)	4 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

HGPI = Hot Gas Path Inspection Interval

(1) 2 (HGPI) with no repairs at 24k hours.

(2) 3 (HGPI) with Strip, HIP Rejuvenation, and Re-coat at 24k hours.

(3) May require meeting tip shroud engagement criteria at prior HGP repair intervals.

3 (HGPI) for current design only. Consult your GE Energy representative for replace intervals by part number.

Figure D-3. Estimated repair and replacement cycles

PG6571-81 (6BU) / 6BeV Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	4 (CI)	4 (CI) / 5 (CI) ⁽¹⁾
Caps	CI	4 (CI)	5 (CI)
Transition Pieces	CI	4 (CI)	4 (CI) / 5 (CI) ⁽¹⁾
Fuel Nozzles	CI	2 (CI)	2 (CI) / 3 (CI) ⁽²⁾
Crossfire Tubes	CI	2 (CI)	2 (CI) / 3 (CI) ⁽²⁾
Flow Divider (Distillate)	CI	3 (CI)	3 (CI)
Fuel Pump (Distillate)	CI	3 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 1 Bucket	HGPI	3 (HGPI) ⁽³⁾ / 2 (HGPI) ⁽⁴⁾	3 (HGPI)
Stage 2 Bucket	HGPI	3 (HGPI) ⁽⁵⁾	4 (HGPI)
Stage 3 Bucket	HGPI	3 (HGPI)	4 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) 4 (CI) for non-DLN / 5 (CI) for DLN

(2) 2 (CI) for non-DLN / 3 (CI) for DLN

(3) 3 (HGPI) for 6BU with strip & recoat at first HGPI

(4) 2 HGPI for 6BeV

(5) 3 (HGPI) for current design only. Consult your GE Energy representative for replace intervals by part number.

Figure D-4. Estimated repair and replacement cycles

PG7001(EA) / PG9001(E) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	3 (CI) / 5 (CI) ⁽¹⁾	5 (CI)
Caps	CI	3 (CI)	5 (CI)
Transition Pieces	CI	4 (CI) / 6 (CI) ⁽²⁾	6 (CI)
Fuel Nozzles	CI	2 (CI) / 3 (CI) ⁽³⁾	3 (CI)
Crossfire Tubes	CI	2 (CI) / 3 (CI) ⁽³⁾	3 (CI)
Flow Divider (Distillate)	CI	3 (CI)	3 (CI)
Fuel Pump (Distillate)	CI	3 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	4 (HGPI)
Stage 1 Bucket	HGPI	3 (HGPI) ⁽⁴⁾⁽⁵⁾	3 (HGPI)
Stage 2 Bucket	HGPI	3 (HGPI) ⁽⁶⁾	4 (HGPI)
Stage 3 Bucket	HGPI	3 (HGPI)	4 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) 3 (CI) for DLN / 5 (CI) for non-DLN

(2) 4 (CI) for DLN / 6 (CI) for non-DLN

(3) 2 (CI) for DLN / 3 (CI) for non-DLN

(4) Strip and Recoat is required at first HGPI to achieve 3 HGPI replace interval for all E-Class.

(5) Uprated 7EA machines (2055 Tfire) require HIP rejuvenation at first HGPI to achieve 3 HGPI replace interval.

(6) 3 (HGPI) interval requires meeting tip shroud engagement criteria at prior HGP repair intervals. Consult your GE Energy representative for details.

Figure D-5. Estimated repair and replacement cycles

PG6101(FA) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	5 (CI)	5 (CI)
Caps	CI	5 (CI)	5 (CI)
Transition Pieces	CI	5 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	2 (CI)	2 (CI)
End Covers		6 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	2 (HGPI)	2 (HGPI) ⁽¹⁾
Stage 2 Bucket	HGPI	1 (HGPI) ⁽³⁾	3 (HGPI) ⁽²⁾
Stage 3 Bucket	HGPI	3 (HGPI) ⁽²⁾	3 (HGPI) ⁽²⁾

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) GE approved repair operations may be needed to meet expected life. Consult your GE Energy representative for details.

(2) With welded hardface on shroud, recoating at 1st HGPI is required to achieve replacement life.

(3) Repair may be required on non-scalloped-from-birth parts. Redesigned bucket is capable of 3 (HGPI).

Figure D-6. Estimated repair and replacement cycles

PG7211(F) / PG9301(F) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	5 (CI)	5 (CI)
Caps	CI	5 (CI)	5 (CI)
Transition Pieces	CI	5 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	1 (CI) / 2 (CI) ⁽¹⁾	1 (CI) / 2 (CI) ⁽¹⁾
End Covers		6 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Bucket	HGPI	3 (HGPI) ⁽²⁾	3 (HGPI) ⁽²⁾
Stage 3 Bucket	HGPI	3 (HGPI) ⁽²⁾	3 (HGPI) ⁽²⁾

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) 2 (CI) for 7211 / 1 (CI) for 9301.

(2) With welded hardface on shroud, recoating at 1st HGPI is required to achieve replacement life.

Figure D-7. Estimated repair and replacement cycles

PG7221(FA) / PG9311(FA) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	5 (CI)	5 (CI)
Caps	CI	5 (CI)	5 (CI)
Transition Pieces	CI	5 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	1 (CI) / 2 (CI) ⁽¹⁾	1 (CI) / 2 (CI) ⁽¹⁾
End Covers		6 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	2 (HGPI)	2 (HGPI) ⁽²⁾
Stage 2 Bucket	HGPI	2 (HGPI)	3 (HGPI)
Stage 3 Bucket	HGPI	3 (HGPI) ⁽³⁾	3 (HGPI) ⁽³⁾

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) 2 (CI) for 7221 / 1 (CI) for 9311.

(2) GE approved repair operations may be needed to meet expected life. Consult your GE Energy representative for details.

(3) With welded hardface on shroud, recoating at 1st HGPI may be required to achieve replacement life.

Figure D-8. Estimated repair and replacement cycles

PG7231(FA) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	5 (CI)	5 (CI)
Caps	CI	5 (CI)	5 (CI)
Transition Pieces	CI	5 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	2 (CI)	2 (CI)
End Covers		6 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	2 (HGPI)	2 (HGPI) ⁽¹⁾
Stage 2 Bucket	HGPI	1 (HGPI) ⁽²⁾	3 (HGPI) ⁽³⁾
Stage 3 Bucket	HGPI	3 (HGPI)	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) Periodic inspections are recommended within each HGPI. GE approved repair operations may be needed to meet 2 (HGPI) replacement. Consult your GE Energy representative for details on both.

(2) Interval can be increased to 2 (HGPI) by performing a repair operation. Consult your GE Energy representative for details.

(3) Recoating at 1st HGPI may be required to achieve 3 HGPI replacement life.

Figure D-9. Estimated repair and replacement cycles

PG7241(FA) Parts

	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	2 (CI)	5 (CI)
Caps	CI	3 (CI)	5 (CI)
Transition Pieces	CI	3 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	2 (CI)	2 (CI)
End Covers		4 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	3 (HGPI) ⁽²⁾	2 (HGPI) ⁽⁴⁾
Stage 2 Bucket	HGPI	3 (HGPI) ⁽¹⁾	3 (HGPI) ⁽¹⁾
Stage 3 Bucket	HGPI	3 (HGPI) ⁽³⁾	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.

CI = Combustion Inspection Interval

HGPI = Hot Gas Path Inspection Interval

(1) 3 (HGPI) for current design. Consult your GE Energy representative for replacement intervals by part number.

(2) GE approved repair procedure required at first HGPI for designs without platform cooling.

(3) GE approved repair procedure at 2nd HGPI is required to meet 3 (HGPI) replacement life.

(4) 2 (HGPI) for current design with GE approved repair at first HGPI. 3 (HGPI) is possible for redesigned bucket with platform undercut and cooling modifications.

Figure D-10. Estimated repair and replacement cycles

PG9351(FA) Parts			
	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	5 (CI)	5 (CI)
Caps	CI	5 (CI)	5 (CI)
Transition Pieces	CI	5 (CI)	5 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	1 (CI)	1 (CI)
End Covers		6 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	2 (HGPI) ⁽¹⁾	2 (HGPI) ⁽³⁾
Stage 2 Bucket	HGPI	1 (HGPI)	3 (HGPI) ⁽²⁾
Stage 3 Bucket	HGPI	3 (HGPI) ⁽⁴⁾	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.
 CI = Combustion Inspection Interval
 HGPI = Hot Gas Path Inspection Interval
 (1) 2 (HGPI) for current design with GE approved repair at first HGPI. 3 (HGPI) is possible for redesigned bucket with platform undercut and cooling modifications.
 (2) Recoating at 1st HGPI may be required to achieve 3 HGPI replacement life.
 (3) GE approved repair procedure at 1 (HGPI) is required to meet 2 (HGPI) replacement life.
 (4) GE approved repair procedure is required at second HGPI to meet 3 (HGPI) replacement life.

Figure D-11. Estimated repair and replacement cycles

PG7251(FB) Parts			
	Repair Interval	Replace Interval (Hours)	Replace Interval (Starts)
Combustion Liners	CI	3 (CI)	3 (CI)
Caps	CI	3 (CI)	3 (CI)
Transition Pieces	CI	3 (CI)	3 (CI)
Fuel Nozzles	CI	3 (CI)	3 (CI)
Crossfire Tubes	CI	3 (CI)	3 (CI)
End Covers		3 (CI)	3 (CI)
Stage 1 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Nozzles	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Nozzles	HGPI	3 (HGPI)	3 (HGPI)
Stage 1 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 2 Shrouds	HGPI	2 (HGPI)	2 (HGPI)
Stage 3 Shrouds	HGPI	3 (HGPI)	3 (HGPI)
Exhaust Diffuser	HGPI		
Stage 1 Bucket	HGPI	3 (HGPI)	3 (HGPI)
Stage 2 Bucket	HGPI	3 (HGPI)	3 (HGPI)
Stage 3 Bucket	HGPI	3 (HGPI)	3 (HGPI)

Note: Repair/replace cycles reflect current production hardware, unless otherwise noted, and operation in accordance with manufacturer specifications.
 CI = Combustion Inspection Interval
 HGPI = Hot Gas Path Inspection Interval

Figure D-12. Estimated repair and replacement cycles

E) Borescope Inspection Ports

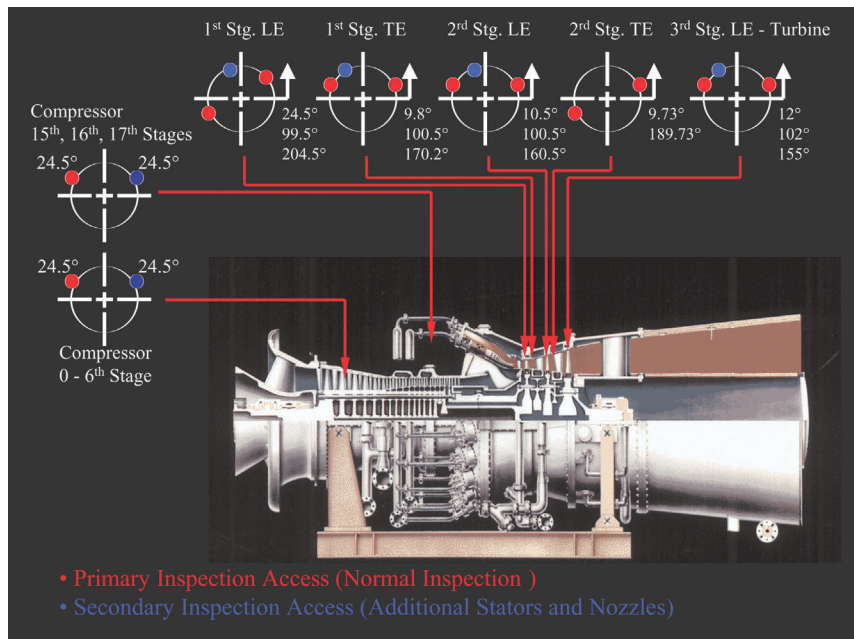


Figure E-1. Borescope inspection access locations for 6F machines

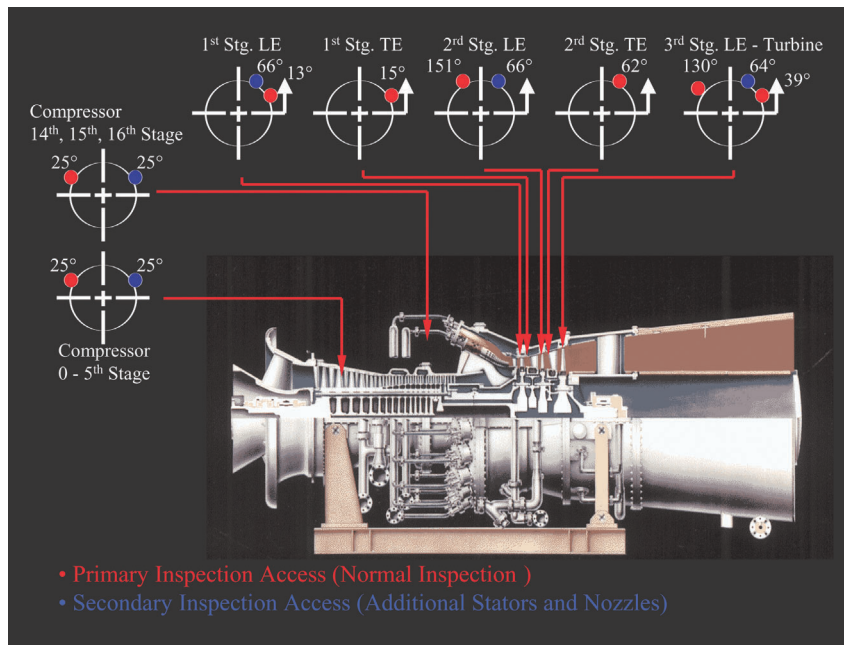


Figure E-2. Borescope inspection access locations for 7/9F machines

F) Turning Gear/Ratchet Running Guidelines

Scenario	Turning Gear (or Ratchet) Duration
Following Shutdown:	
Case A.1 – Normal. Restart anticipated for >48 hours	Until wheelspace temperatures <150F. ⁽¹⁾ Rotor classified as unbowed. Minimum 24 hours. ⁽²⁾
Case A.2 – Normal. Restart anticipated for <48 hours	Continuously until restart. Rotor unbowed.
Case B – Immediate rotor stop necessary. (Stop >20 minutes) Suspected rotating hardware damage or unit malfunction	None. Classified as bowed.
Before Startup:	
Case C – Hot rotor, <20 minutes after rotor stop	0–1 hour ⁽³⁾
Case D – Warm rotor, >20 minutes & <6 hours after rotor stop	4 hours
Case E.1 – Cold rotor, unbowed, off TG <48 hours	4 hours
Case E.2 – Cold rotor, unbowed, off TG >48 hours	6 hours
Case F – Cold rotor, bowed	8 hours ⁽⁴⁾
During Extended Outage:	
Case G – When idle	1 hour/day
Case H – Alternative	No TG; 1 hour/week at full speed (no load). ⁽⁵⁾

(1) Time depends on frame size and ambient environment.
 (2) Cooldown cycle may be accelerated using starting device for forced cooldown. Turning gear, however, is recommended method.
 (3) 1 hour on turning gear is recommended following a trip, before restarting. For normal shutdowns, use discretion.
 (4) Follow bowed rotor startup procedure. See Operation and Maintenance Manual.
 (5) Avoids high cycling of lube oil pump during long outages.

Figure F-1. Turning Gear Guidelines

Revision History

9/89	Original	
8/91	Rev A	
9/93	Rev B	
3/95	Rev C	<ul style="list-style-type: none"> • Nozzle Clearances section removed • Steam/Water Injection section added • Cyclic Effects section added
5/96	Rev D	<ul style="list-style-type: none"> • Estimated Repair and Replacement Cycles added for F/FA
11/96	Rev E	
11/98	Rev F	<ul style="list-style-type: none"> • Rotor Parts section added • Estimated Repair and Replace Cycles added for FA+E • Starts and hours-based rotor maintenance interval equations added
9/00	Rev G	
11/02	Rev H	<ul style="list-style-type: none"> • Estimated Repair and Replace Cycles updated and moved to Appendix D • Combustion Parts section added • Inlet Fogging section added
1/03	Rev J	<ul style="list-style-type: none"> • Off Frequency Operation section added
10/04	Rev K	<ul style="list-style-type: none"> • GE design intent and predication upon proper components and use added • Added recommendation for coalescing filters installation upstream of gas heaters • Added recommendations for shutdown on gas fuel, dual fuel transfers, and FSDS maintenance
		<ul style="list-style-type: none"> • Trip from peak load maintenance factor added • Lube Oil Cleanliness section added • Inlet Fogging section updated to Moisture Intake • Best practices for turning gear operation added • Rapid Cool-down section added • Procedural clarifications for HGP inspection added • Added inspections for galling/fretting in turbine dovetails to major inspection scope • HGP factored starts calculation updated for application of trip factors • Turning gear maintenance factor removed for F-class hours-based rotor life • Removed reference to turning gear impacts on cyclic customers' rotor lives • HGP factored starts example added • F-class borescope inspection access locations added • Various HGP parts replacement cycles updated and additional 6B table added • Revision History added

List of Figures

- Figure 1. Key factors affecting maintenance planning
- Figure 2. Plant level – top five systems contribution to downtime
- Figure 3. MS7001E gas turbine borescope inspection access locations
- Figure 4. Borescope inspection programming
- Figure 5. Maintenance cost and equipment life are influenced by key service factors
- Figure 6. Causes of wear – hot-gas-path components
- Figure 7. GE bases gas turbine maintenance requirements on independent counts of starts and hours
- Figure 8. Hot gas path maintenance interval comparisons. GE method vs. EOH method
- Figure 9. Maintenance factors – hot gas path (buckets and nozzles)
- Figure 10. GE maintenance interval for hot-gas inspections
- Figure 11. Estimated effect of fuel type on maintenance
- Figure 12. Bucket life firing temperature effect
- Figure 13. Firing temperature and load relationship – heat recovery vs. simple cycle operation
- Figure 14. Heavy fuel maintenance factors
- Figure 15. Steam/water injection and bucket/nozzle life
- Figure 16. Exhaust temperature control curve – dry vs. wet control MS7001EA
- Figure 17. Turbine start/stop cycle – firing temperature changes
- Figure 18. First stage bucket transient temperature distribution
- Figure 19. Bucket low cycle fatigue (LCF)
- Figure 20. Low cycle fatigue life sensitivities – first stage bucket
- Figure 21. Maintenance factor – trips from load
- Figure 22. Maintenance factor – effect of start cycle maximum load level
- Figure 23. Operation-related maintenance factors
- Figure 24. FA gas turbine typical operational profile
- Figure 25. Baseline for starts-based maintenance factor definition
- Figure 26. The NGC requirement for output versus frequency capability over all ambients less than 25°C (77°F)
- Figure 27. Turbine output at under-frequency conditions
- Figure 28. NGC code compliance TF required – FA class
- Figure 29. Maintenance factor for overspeed operation ~constant TF
- Figure 30. Deterioration of gas turbine performance due to compressor blade fouling
- Figure 31. Long term material property degradation in a wet environment
- Figure 32. Susceptibility of compressor blade materials and coatings
- Figure 33. MS7001EA heavy-duty gas turbine – shutdown inspections

- Figure 34. Operating inspection data parameters
- Figure 35. Combustion inspection – key elements
- Figure 36. Hot gas path inspection – key elements
- Figure 37. Stator tube jacking procedure – MS7001EA
- Figure 38. Stage 1 bucket oxidation and bucket life
- Figure 39. Gas turbine major inspection – key elements
- Figure 40. Major inspection work scope
- Figure 41. First-stage nozzle wear-preventive maintenance gas fired – continuous dry – base load
- Figure 42. Base line recommended inspection intervals: base load – gas fuel – dry
- Figure 43. Hot gas path inspection: hours-based criterion
- Figure 44. Hot gas path inspection starts-based condition
- Figure 45. F Class rotor maintenance factor for starts-based criterion
- Figure 46. F Class rotor maintenance factor for hours-based criterion
- Figure 47. Combustion inspection hours-based maintenance factors
- Figure 48. Combustion inspection starts-based maintenance factors
- Figure B-1. Combustion maintenance interval calculations
- Figure D-1. Estimated repair and replacement cycles
- Figure D-2. Estimated repair and replacement cycles
- Figure D-3. Estimated repair and replacement cycles
- Figure D-4. Estimated repair and replacement cycles
- Figure D-5. Estimated repair and replacement cycles
- Figure D-6. Estimated repair and replacement cycles
- Figure D-7. Estimated repair and replacement cycles
- Figure D-8. Estimated repair and replacement cycles
- Figure D-9. Estimated repair and replacement cycles
- Figure D-10. Estimated repair and replacement cycles
- Figure D-11. Estimated repair and replacement cycles
- Figure D-12. Estimated repair and replacement cycles
- Figure E-1. Borescope inspection access locations for 6F machines
- Figure E-2. Borescope inspection access locations for 7/9F machines
- Figure F-1. Turning Gear Guidelines

