

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	1

---

Factory Data and Meter Status

<u>Factory Data</u>		<u>Register Status</u>				
Manufacturer Serial Number	165444844	Active Mode	Normal Mode			
Manufacturer Catalog Number	HGA10X7Z-0AKS-400	Current Season	1			
Firmware/DSP Revision	05.68.00/21.06	Active Rate	A			
Form and Class	FM 2 CL 200	Date & Time	11/29/2022 12:01:38 PM			
True Kh	7.2	Daylight Savings Time	Standard Time			
Load Profile Size	82K	Time on Battery	0 Days 0:00			
Expected Service Info		Battery Test	[n/d]	Suppressed		
		Unprogrammed	[1]	No		
		Memory Test	[1]	Pass		
		Overload Exceeded	[n/d]	No		
Line Frequency (Actual)	60 Hz (60.0 Hz)	Stuck Switch Test	[n/d]	Pass		
Voltage	240 V	Phase Error	[n/d]	No		
Service Type	Single Phase	Meas. Diag. Failure	[n/d]	No		
Rotation						
Service Detection						
Service Disconnect		<u>Calibration Data</u>				
			3 Elem.	Left	Center	Right
		Full Load	100.004	000.000	000.000	000.000
		Power Factor	100.014	000.000	000.000	000.000
		Light Load	099.996			
Switch Present	Yes	Voltage	240.000			
Switch State	Closed	Temperature	23.6°C / 74.5°F			
Switch Operation	Enabled					
Sensor Present	No					

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	2

---

 Meter Configuration
 

---

Program Information

Reader/Programmer	CustProg
Programmer Version	5.13
Program ID	0501
Date Programmed	5/14/2021

Measurement Units

Reactive Metric	Requires RX Upgrade
Demand Metric	kW

Network Address	1
Last Calendar Date	11/5/2045

TOU Battery Options

Suppress Battery Errors	Enabled
Allow Stand By Mode	Enabled
Load Profile Integration	Enabled

Program Data

Programmed Kh	7.2
True Kh	7.2
K Factor	0.6
Cal. Pulses	1 per Kh
Scale Factor	1
Negative kWh	Detent
Transformer Factor	1
Meter Multiplier	1
Synch time to line frequency	Yes
Top/Bottom Feed	N/A

Demand Measurement

Demand Calculation	15/5 Block/Roll
Demand Reset Mode	Type II
Power on Delay Time	Disabled
PODT Trigger Time	Immediate
Outage Length	1 sec
Overload kW Value	0.000
Clear Overload on Reset	No
Demand Peak Window	00:05
Demand Reset Lockout	1 min

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	3

## Meter Configuration 2

<u>Display Configuration</u>		<u>Season Change Configuration</u>		<u>Load Profile Configuration</u>
Display Time	5	Delayed Season Change	No	3 Channels
Date Display Format	MMDDYY	Reset on Season Change	No	15 min Intervals
kWh Display Format	#####			1. +kWh
kW Display Format	###.###	<u>Self Read Configuration</u>		2. -kWh
Cumulative kW Display Fmt.	#####.#			3. Vh Ph. A
		Daily at Midnight		
Phase Error Lock	No	Number of Self Reads	12	
EOI Annunciator	Disabled	Number to Display	N/A	
Reed Switch	Enabled			
		Self Read Causes Dmd. Reset	Yes	
<u>Test Mode Configuration</u>		Dmd. Reset Causes Self Read	No	
Test Mode Interval	5	<u>Threshold Configuration</u>		
Test Mode Timeout	15 min			
Test Mode Kh	7.2	Sag Threshold	90%	
Test Mode K Factor	0.6	Swell Threshold	110%	
		Sag/Swell Calc. Based On	Avg. Volts	
<u>Real Time Configuration</u>		Phase Error Threshold	50%	
Real Time Rate	A	Temperature Alert Threshold	95°C / 203°F	
		Leading Current Thresholds	Enabled	
Stand By Rate	E	Threshold Phase A	35.00 Degrees	0.000 Amps
		Threshold Phase B	35.00 Degrees	0.000 Amps
		Threshold Phase C	35.00 Degrees	0.000 Amps

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	4

## Relay Status

<u>Relay Configuration</u>	<u>Normal</u>	<u>Real-Time</u>	<u>Test</u>	<u>Pol</u>	<u>Parameters</u>
1. Not Used	Not Used	Not Used	Not Used		

Service Disconnect Switch

Closed	
Operation	Manual or Comm
Trigger Current	N/A
Open Time	N/A
After Open Time	N/A
Trigger Threshold Interval	N/A
Trigger Retry Window	N/A
Trigger Retries	N/A
Operation Retries	None
Switch Operation Counter	0
Load Side Voltage(s)	249.45 V
Line Side Voltage(s)	249.00 V
Threshold to Prevent Close	40% of Nominal Voltage

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	5

---

### Security Configuration

---

<u>Meter Functions</u>	<u>Read/Write</u>	<u>General Programming</u>	
Change Battery	L0/L3		
Test Mode	L0/L3	Comm. Board or AMR Device	L0/L3
Real Time	L0/L3	GyrBox Diagnostics	L0/L3
Service Disconnect Switch	L0/L3		
Clear Errors	L2/L3	Relays	L0/L3
Demand Reset	L0/L2	Load Profile	L0/L3
Master Reset	L2/L3	Measurement	L2/L3
Cold Start	L2/L3		
Firmware Upgrade	L0/L3	<u>Security Access Programming</u>	
Prepay Configuration and Data	N/A/N/A		
		Meter Data	L2/L3
<u>TOU Meter Programming</u>		Meter ID	L0/L3
Date / Time	L0/L2		
TOU Schedule	L0/L3	Security	L3/L3
<u>Display Programming</u>		<u>Security Lock</u>	
Displays	L0/L3	L5 Requires Unlock	NO
		AMR Requires Unlock	NO
		Lockout Attempts/Timeout	10/5 min

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	6

## Display Table

<u>ID</u>	<u>Name</u>	<u>Normal</u>	<u>Alternate</u>	<u>Test Mode</u>	<u>User Displays</u>
888	Segment Check	Yes	Yes	Yes	1. 15
DAT	Current Date	No	Yes	No	2.
TME	Current Time	No	Yes	No	3.
DIS	Service Disconnect State	Yes	Yes	No	4.
001	Delivered kWh	Yes	Yes	No	5.
002	Received kWh	Yes	Yes	No	6.
003	Max Demand	No	Yes	No	7.
PGM	Program ID	No	Yes	Yes	8.
KH	Kh	No	Yes	No	Extended Displays
DIL	User Display 1	No	Yes	No	#@
PHA	Phase A Average Voltage	No	Yes	No	#A
VPA	V Angle Phase A	No	Yes	No	#B
PHC	Phase C Average Voltage	No	Yes	No	#C
VPC	V Angle Phase C	No	Yes	No	#D
TMT	Test Mode Timeout	No	No	Yes	#E
TKH	Test Mode Kh	No	No	Yes	#F
FWV	Firmware Version	No	Yes	Yes	#G
					#H
					#I
					#J
					#K
					#L
					#M
					#N
					#O

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	7

---


Demand Interval

---

<u>Interval Data</u>	<u>Previous Interval</u>	<u>Present Interval</u>
Time Remaining		03:25
kW	000000.046	000000.036

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	8

Instantaneous Data

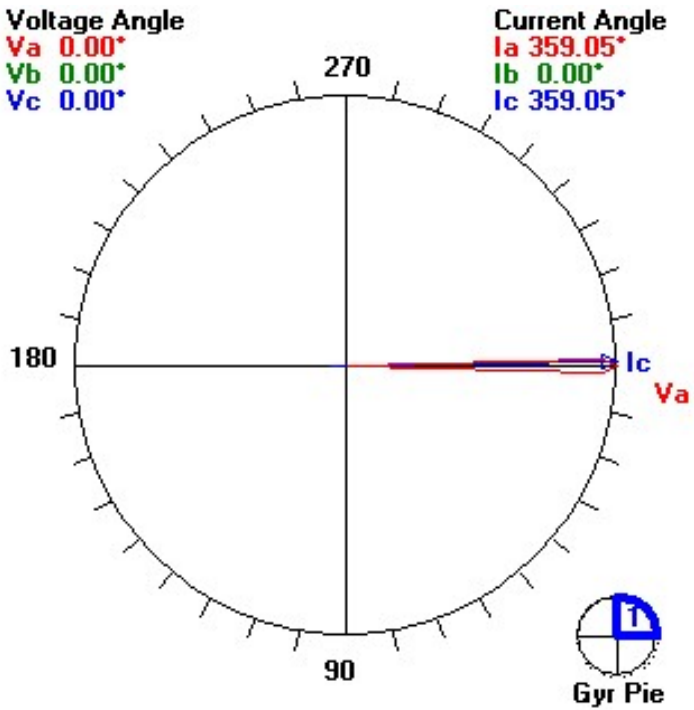

Phase Data	Form: 2	Expected Values (Service)
Phase A Voltage	249.000	Single Phase Service
Phase B Voltage	0.000	Single Phase Service
Phase C Voltage	0.000	Single Phase Service
Phase A Current	0.188	
Phase B Current	0.000	Note - For some meter forms
Phase C Current	0.188	Phase B values are derived
Frequency	60.0 Hz	from other phases.
Demand Data		Lagging VAR assumed in Gyr Pie
kW	0.045	
kVA	-0.045	
kVAR	0.000	
Power Factor	1.000	
Diagnostic Values		
Meter Temperature	5°C / 41°F	
Current Feed		
Top/Bottom Feed	N/A	



---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	9

---

## Gyrbox Diagnostics

---

<u>GyrBox Diagnostic Configuration</u>		<u>LCD Display</u>	<u>Counters</u>
Voltage Phase Angle (D1)		No Display	0
Voltage Phase Deviation (D2)		No Display	0
Voltage Deviation Threshold	10.000%		
Inactive Phase Current (D3)		No Display	0
Phase A Current Threshold	0.125 Amps		
Phase B Current Threshold	0.125 Amps		
Phase C Current Threshold	0.125 Amps		
Current Phase Angle (D4)		No Display	0
Disp. Angle (Leading)	90.000 Degrees		
Disp. Angle (Lagging)	90.000 Degrees		
Current Imbalance (D6)		No Display	0
Current Imbalance Threshold	10.000%		
Energy Polarity (D7)		No Display	0

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	10

---

Energy and Demand

---

<u>Active Energy</u>		Max kW	Time and Date
		0.046	11/29/2022 12:15 AM
Total kWh	10560.323	0.046	11/29/2022 12:20 AM
Total Wh	10560322.800	0.046	11/29/2022 12:30 AM
Cumulative kW	1079.777		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	11

## TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10560.319	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10560.319	0.000	0.000	0.000	0.004
Max kW	0.046	0.000	0.000	0.000	0.000
Date/Time Max	11/29/2022 12:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/29/22 12:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/29/22 12:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.777	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	12

---

## Demand Reset Data

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/28/2022 8:10 PM
Total kWh	10559.783	0.048	11/28/2022 9:30 PM
Total Wh	10559782.800	0.048	11/28/2022 9:55 PM
Cumulative kW	1079.729		
Negative kWh	0.000		

Counters

Reset Counter	197
Power Outage Counter	18
Program Counter	1
Manual Test Mode Counter	0
Optical Test Mode Counter	0
Resets in Previous Season	219
Invalid Login Attempts	1

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	13

## Demand Reset TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10559.779	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10559.779	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 8:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 9:30 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 9:55 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.729	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	14

---

Previous Season Energy and Demand

---

<u>Active Energy</u>		Max kW	Time and Date
		3.631	4/9/2022 12:35 PM
Total kWh	6360.209	3.610	4/9/2022 12:40 PM
Total Wh	6360209.400	3.245	4/9/2022 12:30 PM
Cumulative kW	595.730		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	15

## Previous Season TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	6360.205	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	6360.205	0.000	0.000	0.000	0.004
Max kW	3.631	0.000	0.000	0.000	0.000
Date/Time Max	4/9/2022 12:35 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	3.610	0.000	0.000	0.000	0.000
Date/Time Max 2	04/09/22 12:40 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	3.245	0.000	0.000	0.000	0.000
Date/Time Max 3	04/09/22 12:30 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	595.730	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	16

## Event Log

## Event Notification

AMR Event Notification Enabled

## Event Logging

<u>Events</u>	<u>Time</u>	<u>Initiated By:</u>
Power Loss (Up)	Nov-27-22 03:23:40	Meter Action
Power Loss (Down)	Nov-27-22 03:23:37	Meter Action
Daylight Savings Time end	Nov-06-22 01:00:00	Meter Action
Power Loss (Up)	Nov-04-22 06:15:53	Meter Action
Power Loss (Down)	Nov-04-22 06:15:22	Meter Action
TimeChange (New Time)	Sep-28-22 01:23:02	Manual Action
TimeChange (Old Time)	Sep-28-22 01:22:41	Manual Action
TimeChange (New Time)	Jun-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Jun-15-22 01:23:25	Manual Action
TimeChange (New Time)	May-21-22 01:23:02	Manual Action
TimeChange (Old Time)	May-21-22 01:23:23	Manual Action
TimeChange (New Time)	May-04-22 01:23:02	Manual Action
TimeChange (Old Time)	May-04-22 01:23:25	Manual Action
TimeChange (New Time)	Apr-21-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-21-22 01:22:37	Manual Action
TimeChange (New Time)	Apr-16-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-16-22 01:22:38	Manual Action
Power Loss (Up)	Apr-10-22 13:26:23	Meter Action
Power Loss (Down)	Apr-10-22 13:25:32	Meter Action
TimeChange (New Time)	Apr-10-22 05:26:24	Manual Action
TimeChange (Old Time)	Apr-10-22 05:26:03	Manual Action
Power Loss (Up)	Apr-10-22 05:25:59	Meter Action
Power Loss (Down)	Apr-10-22 05:25:27	Meter Action
Daylight Savings Time start	Mar-13-22 03:00:00	Meter Action
TimeChange (New Time)	Mar-03-22 01:23:02	Manual Action
TimeChange (Old Time)	Mar-03-22 01:22:38	Manual Action
Power Loss (Up)	Feb-28-22 05:50:00	Meter Action
Power Loss (Down)	Feb-28-22 05:49:47	Meter Action
Power Loss (Up)	Feb-28-22 04:38:39	Meter Action
Power Loss (Down)	Feb-28-22 04:38:26	Meter Action
Power Loss (Up)	Feb-19-22 15:10:32	Meter Action
Power Loss (Down)	Feb-19-22 15:10:19	Meter Action
TimeChange (New Time)	Feb-19-22 01:23:02	Manual Action
TimeChange (Old Time)	Feb-19-22 01:23:28	Manual Action
TimeChange (New Time)	Jan-18-22 01:23:02	Manual Action
TimeChange (Old Time)	Jan-18-22 01:22:37	Manual Action



Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	16

Power Loss (Up)	Jan-06-22 16:39:53	Meter Action
Power Loss (Down)	Jan-06-22 05:16:43	Meter Action
Power Loss (Up)	Jan-06-22 02:36:20	Meter Action
Power Loss (Down)	Jan-06-22 02:35:49	Meter Action
Power Loss (Up)	Jan-03-22 02:50:23	Meter Action
Power Loss (Down)	Jan-03-22 02:49:51	Meter Action
Power Loss (Up)	Dec-29-21 12:18:32	Meter Action
Power Loss (Down)	Dec-29-21 12:18:00	Meter Action
TimeChange (New Time)	Dec-27-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-27-21 01:23:26	Manual Action
Power Loss (Up)	Dec-24-21 12:42:12	Meter Action
Power Loss (Down)	Dec-24-21 12:41:41	Meter Action
Power Loss (Up)	Dec-22-21 02:32:13	Meter Action
Power Loss (Down)	Dec-22-21 02:31:42	Meter Action
Power Loss (Up)	Dec-20-21 14:39:29	Meter Action
Power Loss (Down)	Dec-20-21 14:39:26	Meter Action
Power Loss (Up)	Dec-18-21 19:02:12	Meter Action
Power Loss (Down)	Dec-18-21 19:01:59	Meter Action
TimeChange (New Time)	Dec-12-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-12-21 01:22:38	Manual Action
Power Loss (Up)	Dec-11-21 05:54:10	Meter Action
Power Loss (Down)	Dec-11-21 05:53:38	Meter Action
Power Loss (Up)	Dec-11-21 05:48:35	Meter Action
Power Loss (Down)	Dec-11-21 05:48:22	Meter Action
TimeChange (New Time)	Dec-07-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-07-21 01:22:39	Manual Action
TimeChange (New Time)	Nov-17-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-17-21 01:22:38	Manual Action
TimeChange (New Time)	Nov-08-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-08-21 01:22:41	Manual Action
Daylight Savings Time end	Nov-07-21 01:00:00	Meter Action
TimeChange (New Time)	Nov-02-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-02-21 01:22:39	Manual Action
TimeChange (New Time)	Oct-05-21 01:23:02	Manual Action
TimeChange (Old Time)	Oct-05-21 01:22:36	Manual Action
TimeChange (New Time)	Sep-09-21 01:23:02	Manual Action
TimeChange (Old Time)	Sep-09-21 01:22:35	Manual Action
Reset Load Profile	Sep-02-21 09:00:38	Meter Action
Stand By Mode Exited	Sep-02-21 09:00:38	Meter Action
TimeChange (New Time)	Sep-02-21 09:00:38	Manual Action
TimeChange (Old Time)	Jan-01-00 00:00:20	Manual Action
Reset Load Profile Data Set 2	Jan-01-00 00:00:00	Meter Action
Stand By Mode Entered	Jan-01-00 00:00:00	Meter Action
Power Loss (Up)	Jan-01-00 00:00:00	Meter Action
Power Loss (Down)	May-14-21 12:36:24	Meter Action
Daylight Savings Time start	May-14-21 12:34:23	Meter Action

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	16

Reset Load Profile Data Set 2	May-14-21 12:34:20	Meter Action
Reset Load Profile	May-14-21 12:34:20	Meter Action
Reset Self Reads	May-14-21 12:34:20	Meter Action
Event Log Cleared	May-14-21 12:34:20	Meter Action
History Log Cleared	May-14-21 12:34:20	Meter Action

#### Optional Events

Power Loss (Up)	Nov-27-22 03:23:40	Meter Action
Power Loss (Down)	Nov-27-22 03:23:37	Meter Action
Daylight Savings Time end	Nov-06-22 01:00:00	Meter Action
Power Loss (Up)	Nov-04-22 06:15:53	Meter Action
Power Loss (Down)	Nov-04-22 06:15:22	Meter Action
TimeChange (New Time)	Sep-28-22 01:23:02	Manual Action
TimeChange (Old Time)	Sep-28-22 01:22:41	Manual Action
TimeChange (New Time)	Jun-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Jun-15-22 01:23:25	Manual Action
TimeChange (New Time)	May-21-22 01:23:02	Manual Action
TimeChange (Old Time)	May-21-22 01:23:23	Manual Action
TimeChange (New Time)	May-04-22 01:23:02	Manual Action
TimeChange (Old Time)	May-04-22 01:23:25	Manual Action
TimeChange (New Time)	Apr-21-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-21-22 01:22:37	Manual Action
TimeChange (New Time)	Apr-16-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-16-22 01:22:38	Manual Action
Power Loss (Up)	Apr-10-22 13:26:23	Meter Action
Power Loss (Down)	Apr-10-22 13:25:32	Meter Action
Sag on Phase A Started	Apr-10-22 13:25:32	Meter Action
TimeChange (New Time)	Apr-10-22 05:26:24	Manual Action
TimeChange (Old Time)	Apr-10-22 05:26:03	Manual Action
Power Loss (Up)	Apr-10-22 05:25:59	Meter Action
Power Loss (Down)	Apr-10-22 05:25:27	Meter Action
Sag on Phase A Started	Apr-10-22 05:25:27	Meter Action
Daylight Savings Time start	Mar-13-22 03:00:00	Meter Action
TimeChange (New Time)	Mar-03-22 01:23:02	Manual Action
TimeChange (Old Time)	Mar-03-22 01:22:38	Manual Action
Sag on Phase A Stopped	Feb-28-22 06:03:54	Meter Action
Sag on Phase A Started	Feb-28-22 06:03:54	Meter Action
Power Loss (Up)	Feb-28-22 05:50:00	Meter Action
Power Loss (Down)	Feb-28-22 05:49:47	Meter Action
Power Loss (Up)	Feb-28-22 04:38:39	Meter Action
Power Loss (Down)	Feb-28-22 04:38:26	Meter Action
Power Loss (Up)	Feb-19-22 15:10:32	Meter Action
Power Loss (Down)	Feb-19-22 15:10:19	Meter Action
TimeChange (New Time)	Feb-19-22 01:23:02	Manual Action
TimeChange (Old Time)	Feb-19-22 01:23:28	Manual Action

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	16

TimeChange (New Time)	Jan-18-22 01:23:02	Manual Action
TimeChange (Old Time)	Jan-18-22 01:22:37	Manual Action
Power Loss (Up)	Jan-06-22 16:39:53	Meter Action
Power Loss (Down)	Jan-06-22 05:16:43	Meter Action
Sag on Phase A Stopped	Jan-06-22 03:53:16	Meter Action
Sag on Phase A Started	Jan-06-22 03:53:16	Meter Action
Power Loss (Up)	Jan-06-22 02:36:20	Meter Action
Power Loss (Down)	Jan-06-22 02:35:49	Meter Action
Sag on Phase A Started	Jan-06-22 02:35:48	Meter Action
Sag on Phase A Stopped	Jan-03-22 14:15:10	Meter Action
Sag on Phase A Started	Jan-03-22 14:15:10	Meter Action
Sag on Phase A Stopped	Jan-03-22 14:14:59	Meter Action
Sag on Phase A Started	Jan-03-22 14:14:59	Meter Action
Power Loss (Up)	Jan-03-22 02:50:23	Meter Action
Power Loss (Down)	Jan-03-22 02:49:51	Meter Action
Sag on Phase A Stopped	Dec-29-21 14:26:31	Meter Action
Sag on Phase A Started	Dec-29-21 14:26:30	Meter Action
Power Loss (Up)	Dec-29-21 12:18:32	Meter Action
Power Loss (Down)	Dec-29-21 12:18:00	Meter Action
TimeChange (New Time)	Dec-27-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-27-21 01:23:26	Manual Action
Power Loss (Up)	Dec-24-21 12:42:12	Meter Action
Power Loss (Down)	Dec-24-21 12:41:41	Meter Action
Sag on Phase A Stopped	Dec-23-21 08:04:15	Meter Action
Sag on Phase A Started	Dec-23-21 08:04:15	Meter Action
Power Loss (Up)	Dec-22-21 02:32:13	Meter Action
Power Loss (Down)	Dec-22-21 02:31:42	Meter Action
Sag on Phase A Stopped	Dec-21-21 22:11:26	Meter Action
Sag on Phase A Started	Dec-21-21 22:11:26	Meter Action
Power Loss (Up)	Dec-20-21 14:39:29	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:39:29	Meter Action
Power Loss (Down)	Dec-20-21 14:39:26	Meter Action
Sag on Phase A Started	Dec-20-21 14:39:26	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:01:41	Meter Action
Sag on Phase A Started	Dec-20-21 14:01:41	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:01:30	Meter Action
Sag on Phase A Started	Dec-20-21 14:01:30	Meter Action
Power Loss (Up)	Dec-18-21 19:02:12	Meter Action
Power Loss (Down)	Dec-18-21 19:01:59	Meter Action
TimeChange (New Time)	Dec-12-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-12-21 01:22:38	Manual Action
Power Loss (Up)	Dec-11-21 05:54:10	Meter Action
Power Loss (Down)	Dec-11-21 05:53:38	Meter Action
Power Loss (Up)	Dec-11-21 05:48:35	Meter Action
Power Loss (Down)	Dec-11-21 05:48:22	Meter Action
TimeChange (New Time)	Dec-07-21 01:23:02	Manual Action

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	16

---

TimeChange (Old Time)	Dec-07-21 01:22:39	Manual Action
TimeChange (New Time)	Nov-17-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-17-21 01:22:38	Manual Action
Sag on Phase A Stopped	Nov-14-21 09:05:00	Meter Action
Sag on Phase A Started	Nov-14-21 09:05:00	Meter Action
TimeChange (New Time)	Nov-08-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-08-21 01:22:41	Manual Action
Daylight Savings Time end	Nov-07-21 01:00:00	Meter Action
TimeChange (New Time)	Nov-02-21 01:23:02	Manual Action
TimeChange (Old Time)	Nov-02-21 01:22:39	Manual Action
TimeChange (New Time)	Oct-05-21 01:23:02	Manual Action
TimeChange (Old Time)	Oct-05-21 01:22:36	Manual Action
TimeChange (New Time)	Sep-09-21 01:23:02	Manual Action
TimeChange (Old Time)	Sep-09-21 01:22:35	Manual Action
Reset Load Profile	Sep-02-21 09:00:38	Meter Action
Stand By Mode Exited	Sep-02-21 09:00:38	Meter Action
TimeChange (New Time)	Sep-02-21 09:00:38	Manual Action
TimeChange (Old Time)	Jan-01-00 00:00:20	Manual Action
Reset Load Profile Data Set 2	Jan-01-00 00:00:00	Meter Action
Stand By Mode Entered	Jan-01-00 00:00:00	Meter Action
Power Loss (Up)	Jan-01-00 00:00:00	Meter Action
Power Loss (Down)	May-14-21 12:36:24	Meter Action
Meter Insertion Detected	May-14-21 12:36:24	Meter Action
Daylight Savings Time start	May-14-21 12:34:23	Meter Action
Meter Programmed	May-14-21 12:34:21	Communication - User ID: 2
Reset Load Profile Data Set 2	May-14-21 12:34:20	Meter Action
Reset Load Profile	May-14-21 12:34:20	Meter Action
Reset Self Reads	May-14-21 12:34:20	Meter Action
Event Log Cleared	May-14-21 12:34:20	Meter Action
History Log Cleared	May-14-21 12:34:20	Meter Action

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	21

## Errors

<u>Standard Errors</u>	<u>Status</u>	<u>Display</u>	<u>Manufacturer Errors</u>	<u>Status</u>	<u>Display</u>
Unprogrammed	FALSE	No Display	SD Switch Error (LS Voltage)	FALSE	No Display
Unconfigured	FALSE	No Display	60 Hz Out of Range	FALSE	No Display
			Phase Error	FALSE	No Display
Ram Failure	FALSE	No Display	SD Switch Error (Sensor)	FALSE	No Display
			Stuck Switch Error	FALSE	No Display
Non-Vol Mem Failure	FALSE	No Display	Temperature Error	FALSE	No Display
Clock Error	FALSE	No Display	Phase A Out	FALSE	No Display
Measurement Error	FALSE	No Display	Phase B Out	FALSE	No Display
Low Battery Error	FALSE	No Display	Phase C Out	FALSE	No Display
			Invalid Service	FALSE	No Display
Demand Overload Error	FALSE	No Display	Standby Energy Accumulation	FALSE	No Display
			Overheat Warning	FALSE	No Display
Tamper Detection	FALSE	No Display	Overheat Alarm	FALSE	No Display
Reverse Rotation	FALSE	No Display	Excessive Leading Current on Phase A	FALSE	No Display
			Excessive Leading Current on Phase B	FALSE	No Display
			Excessive Leading Current on Phase C	FALSE	No Display
			GyrBox D1 Voltage Phase Angle Error	FALSE	No Display
			GyrBox D2 Voltage Phase Deviation Error	FALSE	No Display
			GyrBox D3 Inactive Phase Current Error	FALSE	No Display
			GyrBox D4 Current Phase Angle Error	FALSE	No Display
			GyrBox D6 Current Imbalance Error	FALSE	No Display
			GyrBox D7 Energy Polarity Error	FALSE	No Display

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	22

Stand By Data

Stand By Data

Stand By Log

Duration	0:00:00:20	Entry 1 Standby Period	9/2/2021 9:00:18 AM to 9/2/2021 9:00:38 AM
kWh	0.004	kWh	0.004
-kWh	0.000	-kWh	0.000
Manipulated kWh	0.004	Manipulated kWh	0.004
		Entry 2 Standby Period	Not in Use
		kWh	0.000
		-kWh	0.000
		Manipulated kWh	0.000
		Entry 3 Standby Period	Not in Use
		kWh	0.000
		-kWh	0.000
		Manipulated kWh	0.000
		Entry 4 Standby Period	Not in Use
		kWh	0.000
		-kWh	0.000
		Manipulated kWh	0.000

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	23

## Voltage Log

## Voltage Data

Sample Interval 5 min

Average Voltage	Phase A	Phase B	Phase C
	245.2 V	0.0 V	0.0 V

Date	Min Voltage	Time	Max Voltage	Time	Average Voltage
1. 11/29/2022					
Phase A	244.3 V	6:15 AM	249.2 V	11:35 AM	245.2 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
2. 11/28/2022					
Phase A	243.8 V	6:15 AM	250.6 V	10:20 PM	245.5 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
3. 11/27/2022					
Phase A	243.9 V	12:05 PM	251.3 V	11:10 PM	245.6 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	24

## LCD Display Report

## Normal

<u>Display ID</u>	<u>Display Name</u>	<u>Value</u>
888	Segment Check	*
DIS	Service Disconnect State	*
001	Delivered kWh	10560
002	Received kWh	00000
	* - Reporting not available in this software version.	

## Alternate

<u>Display ID</u>	<u>Display Name</u>	<u>Value</u>
888	Segment Check	*
DAT	Current Date	*
TME	Current Time	*
DIS	Service Disconnect State	*
001	Delivered kWh	10560
002	Received kWh	00000
003	Max Demand	000.045
PGM	Program ID	*
KH	Kh	*
DIL	User Display 1	*
PHA	Phase A Average Voltage	*
VPA	V Angle Phase A	*
PHC	Phase C Average Voltage	*
VPC	V Angle Phase C	*
FWV	Firmware Version	*
	* - Reporting not available in this software version.	

## Test

<u>Display ID</u>	<u>Display Name</u>	<u>Value</u>
888	Segment Check	*
PGM	Program ID	*
TMT	Test Mode Timeout	*
TKH	Test Mode Kh	*
FWV	Firmware Version	*
	* - Reporting not available in this software version.	



---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	25

---

Energy and Demand Self Read 1 11/29/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/28/2022 8:10 PM
Total kWh	10559.783	0.048	11/28/2022 9:30 PM
Total Wh	10559782.800	0.048	11/28/2022 9:55 PM
Cumulative kW	1079.729		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	26

---

TOU Data Self Read 1 11/29/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10559.779	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10559.779	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 8:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 9:30 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 9:55 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.729	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	27

---

Energy and Demand Self Read 2 11/28/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.046	11/27/2022 5:15 AM
Total kWh	10559.050	0.046	11/27/2022 5:20 AM
Total Wh	10559049.600	0.046	11/27/2022 5:30 AM
Cumulative kW	1079.683		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	28

---

TOU Data Self Read 2 11/28/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10559.045	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10559.045	0.000	0.000	0.000	0.004
Max kW	0.046	0.000	0.000	0.000	0.000
Date/Time Max	11/27/2022 5:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/27/22 5:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/27/22 5:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.683	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	29

---

Energy and Demand Self Read 3 11/27/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.029	11/26/2022 1:15 AM
Total kWh	10558.418	0.029	11/26/2022 2:10 AM
Total Wh	10558417.800	0.029	11/26/2022 4:10 AM
Cumulative kW	1079.654		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	30

---

TOU Data Self Read 3 11/27/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10558.414	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10558.414	0.000	0.000	0.000	0.004
Max kW	0.029	0.000	0.000	0.000	0.000
Date/Time Max	11/26/2022 1:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.029	0.000	0.000	0.000	0.000
Date/Time Max 2	11/26/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.029	0.000	0.000	0.000	0.000
Date/Time Max 3	11/26/22 4:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.654	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	31

---

Energy and Demand Self Read 4 11/26/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/25/2022 1:20 AM
Total kWh	10558.101	0.048	11/25/2022 3:55 AM
Total Wh	10558101.000	0.046	11/25/2022 12:20 AM
Cumulative kW	1079.606		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	32

---

TOU Data Self Read 4 11/26/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10558.097	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10558.097	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/25/2022 1:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/25/22 3:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/25/22 12:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.606	0.000	0.000	0.000	0.000



---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	33

---

Energy and Demand Self Read 5 11/25/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/24/2022 3:35 PM
Total kWh	10557.526	0.046	11/24/2022 12:35 AM
Total Wh	10557526.200	0.046	11/24/2022 12:40 AM
Cumulative kW	1079.558		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	34

TOU Data Self Read 5 11/25/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10557.522	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10557.522	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/24/2022 3:35 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/24/22 12:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/24/22 12:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.558	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	35

---

Energy and Demand Self Read 6 11/24/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.046	11/23/2022 12:35 AM
Total kWh	10556.770	0.046	11/23/2022 12:40 AM
Total Wh	10556770.200	0.046	11/23/2022 1:15 AM
Cumulative kW	1079.513		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	36

TOU Data Self Read 6 11/24/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10556.766	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10556.766	0.000	0.000	0.000	0.004
Max kW	0.046	0.000	0.000	0.000	0.000
Date/Time Max	11/23/2022 12:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/23/22 12:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/23/22 1:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.513	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	37

---

Energy and Demand Self Read 7 11/23/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/22/2022 9:10 PM
Total kWh	10556.321	0.048	11/22/2022 10:00 PM
Total Wh	10556320.800	0.046	11/22/2022 12:15 AM
Cumulative kW	1079.465		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	38

---

TOU Data Self Read 7 11/23/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10556.317	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10556.317	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/22/2022 9:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/22/22 10:00 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/22/22 12:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.465	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	39

---

Energy and Demand Self Read 8 11/22/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/21/2022 11:05 AM
Total kWh	10555.319	0.048	11/21/2022 12:00 PM
Total Wh	10555319.400	0.048	11/21/2022 12:40 PM
Cumulative kW	1079.417		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	40

---

TOU Data Self Read 8 11/22/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10555.315	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10555.315	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/21/2022 11:05 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/21/22 12:00 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/21/22 12:40 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.417	0.000	0.000	0.000	0.000



---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	41

---

Energy and Demand Self Read 9 11/21/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.046	11/20/2022 12:15 AM
Total kWh	10554.509	0.046	11/20/2022 12:20 AM
Total Wh	10554508.800	0.046	11/20/2022 12:25 AM
Cumulative kW	1079.371		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	42

---

TOU Data Self Read 9 11/21/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10554.505	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10554.505	0.000	0.000	0.000	0.004
Max kW	0.046	0.000	0.000	0.000	0.000
Date/Time Max	11/20/2022 12:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/20/22 12:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/20/22 12:25 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.371	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	43

---

Energy and Demand Self Read 10 11/20/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/19/2022 12:45 PM
Total kWh	10553.657	0.048	11/19/2022 3:10 PM
Total Wh	10553656.800	0.046	11/19/2022 12:15 AM
Cumulative kW	1079.323		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	44

---

TOU Data Self Read 10 11/20/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10553.653	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10553.653	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/19/2022 12:45 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/19/22 3:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/19/22 12:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.323	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	45

---

Energy and Demand Self Read 11 11/19/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/18/2022 1:10 AM
Total kWh	10552.687	0.048	11/18/2022 2:50 AM
Total Wh	10552687.200	0.048	11/18/2022 12:00 PM
Cumulative kW	1079.275		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	46

---

TOU Data Self Read 11 11/19/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10552.683	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10552.683	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/18/2022 1:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/18/22 2:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/18/22 12:00 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.275	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	47

---

Energy and Demand Self Read 12 11/18/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/17/2022 12:30 AM
Total kWh	10551.778	0.048	11/17/2022 9:30 AM
Total Wh	10551778.200	0.048	11/17/2022 10:50 AM
Cumulative kW	1079.227		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	48

---

TOU Data Self Read 12 11/18/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10551.774	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10551.774	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/17/2022 12:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/17/22 9:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/17/22 10:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.227	0.000	0.000	0.000	0.000



---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	49

---

Energy and Demand Snapshot 1 11/29/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/28/2022 8:10 PM
Total kWh	10559.783	0.048	11/28/2022 9:30 PM
Total Wh	10559782.800	0.048	11/28/2022 9:55 PM
Cumulative kW	1079.729		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	50

---

TOU Data Snapshot 1 11/29/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10559.779	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10559.779	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 8:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 9:30 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.048	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 9:55 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.729	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	51

---

Energy and Demand Snapshot 2 11/28/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.046	11/27/2022 5:15 AM
Total kWh	10559.050	0.046	11/27/2022 5:20 AM
Total Wh	10559049.600	0.046	11/27/2022 5:30 AM
Cumulative kW	1079.683		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	52

---

TOU Data Snapshot 2 11/28/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10559.045	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10559.045	0.000	0.000	0.000	0.004
Max kW	0.046	0.000	0.000	0.000	0.000
Date/Time Max	11/27/2022 5:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.046	0.000	0.000	0.000	0.000
Date/Time Max 2	11/27/22 5:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/27/22 5:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.683	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	53

---

Energy and Demand Snapshot 3 11/27/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.029	11/26/2022 1:15 AM
Total kWh	10558.418	0.029	11/26/2022 2:10 AM
Total Wh	10558417.800	0.029	11/26/2022 4:10 AM
Cumulative kW	1079.654		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	54

---

TOU Data Snapshot 3 11/27/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10558.414	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10558.414	0.000	0.000	0.000	0.004
Max kW	0.029	0.000	0.000	0.000	0.000
Date/Time Max	11/26/2022 1:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.029	0.000	0.000	0.000	0.000
Date/Time Max 2	11/26/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.029	0.000	0.000	0.000	0.000
Date/Time Max 3	11/26/22 4:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.654	0.000	0.000	0.000	0.000

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	55

---

Energy and Demand Snapshot 4 11/26/2022 12:00:00 AM

---

<u>Active Energy</u>		Max kW	Time and Date
		0.048	11/25/2022 1:20 AM
Total kWh	10558.101	0.048	11/25/2022 3:55 AM
Total Wh	10558101.000	0.046	11/25/2022 12:20 AM
Cumulative kW	1079.606		
Negative kWh	0.000		

---

Device Type	FAXR	Device ID	X16544484 4
Report Date	11/29/2022 12:09	Page	56

---

TOU Data Snapshot 4 11/26/2022 12:00:00 AM

---

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	10558.097	0.000	0.000	0.000	0.004
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	10558.097	0.000	0.000	0.000	0.004
Max kW	0.048	0.000	0.000	0.000	0.000
Date/Time Max	11/25/2022 1:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	0.048	0.000	0.000	0.000	0.000
Date/Time Max 2	11/25/22 3:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	0.046	0.000	0.000	0.000	0.000
Date/Time Max 3	11/25/22 12:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1079.606	0.000	0.000	0.000	0.000