

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	1

Factory Data and Meter Status

<u>Factory Data</u>		<u>Register Status</u>				
Manufacturer Serial Number	157749635	Active Mode	Normal Mode			
Manufacturer Catalog Number	HGA10X7Z-0AKS-400	Current Season	1			
Firmware/DSP Revision	05.68.00/21.06	Active Rate	A			
Form and Class	FM 2 CL 200	Date & Time	11/29/2022 12:04:27 PM			
True Kh	7.2	Daylight Savings Time	Standard Time			
Load Profile Size	82K	Time on Battery	0 Days 0:00			
		Battery Test	[n/d]	Suppressed		
Expected Service Info		Unprogrammed	[1]	No		
		Memory Test	[1]	Pass		
Line Frequency (Actual)	60 Hz (60.1 Hz)	Overload Exceeded	[n/d]	No		
Voltage	240 V	Stuck Switch Test	[n/d]	Pass		
Service Type	Single Phase	Phase Error	[n/d]	No		
Rotation		Meas. Diag. Failure	[n/d]	No		
Service Detection						
		<u>Calibration Data</u>				
Service Disconnect			3 Elem.	Left	Center	Right
		Full Load	100.016	000.000	000.000	000.000
Switch Present	Yes	Power Factor	099.929	000.000	000.000	000.000
Switch State	Closed	Light Load	100.057			
Switch Operation	Enabled	Voltage	240.000			
Sensor Present	No	Temperature	25.3°C / 77.5°F			

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	2

Meter Configuration

Program Information

Reader/Programmer	CustProg
Programmer Version	5.13
Program ID	0501
Date Programmed	1/21/2020
Network Address	1
Last Calendar Date	11/6/2044

Measurement Units

Reactive Metric	Requires RX Upgrade
Demand Metric	kW

Program Data

Programmed Kh	7.2
True Kh	7.2
K Factor	0.6
Cal. Pulses	1 per Kh
Scale Factor	1
Negative kWh	Detent
Transformer Factor	1
Meter Multiplier	1
Synch time to line frequency	Yes
Top/Bottom Feed	N/A

TOU Battery Options

Suppress Battery Errors	Enabled
Allow Stand By Mode	Enabled
Load Profile Integration	Enabled

Demand Measurement

Demand Calculation	15/5 Block/Roll
Demand Reset Mode	Type II
Power on Delay Time	Disabled
PODT Trigger Time	Immediate
Outage Length	1 sec
Overload kW Value	0.000
Clear Overload on Reset	No
Demand Peak Window	00:05
Demand Reset Lockout	1 min

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	3

Meter Configuration 2

Display Configuration

Display Time	5
Date Display Format	MMDDYY
kWh Display Format	#####
kW Display Format	### . ###
Cumulative kW Display Fmt.	##### . #
Phase Error Lock	No
EOI Annunciator	Disabled
Reed Switch	Enabled

Season Change Configuration

Delayed Season Change	No
Reset on Season Change	No
<u>Self Read Configuration</u>	
Daily at Midnight	
Number of Self Reads	12
Number to Display	N/A
Self Read Causes Dmd. Reset	Yes
Dmd. Reset Causes Self Read	No

Load Profile Configuration

3 Channels
15 min Intervals
1. +kWh
2. -kWh
3. Vh Ph. A

Test Mode Configuration

Test Mode Interval	5
Test Mode Timeout	15 min
Test Mode Kh	7.2
Test Mode K Factor	0.6

Threshold Configuration

Sag Threshold	90%
Swell Threshold	110%
Sag/Swell Calc. Based On	Avg. Volts
Phase Error Threshold	50%
Temperature Alert Threshold	95°C / 203°F
Leading Current Thresholds	Enabled
Threshold Phase A	35.00 Degrees 0.000 Amps
Threshold Phase B	35.00 Degrees 0.000 Amps
Threshold Phase C	35.00 Degrees 0.000 Amps

Real Time Configuration

Real Time Rate	A
Stand By Rate	E

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	4

Relay Status

<u>Relay Configuration</u>	<u>Normal</u>	<u>Real-Time</u>	<u>Test</u>	<u>Pol</u>	<u>Parameters</u>
1. Not Used	Not Used	Not Used	Not Used		

Service Disconnect Switch

Closed	
Operation	Manual or Comm
Trigger Current	N/A
Open Time	N/A
After Open Time	N/A
Trigger Threshold Interval	N/A
Trigger Retry Window	N/A
Trigger Retries	N/A
Operation Retries	None
Switch Operation Counter	0
Load Side Voltage(s)	249.14 V
Line Side Voltage(s)	249.20 V
Threshold to Prevent Close	40% of Nominal Voltage

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	5

Security Configuration

<u>Meter Functions</u>	<u>Read/Write</u>	<u>General Programming</u>	
Change Battery	L0/L3		
Test Mode	L0/L3	Comm. Board or AMR Device	L0/L3
Real Time	L0/L3	GyrBox Diagnostics	L0/L3
Service Disconnect Switch	L0/L3		
Clear Errors	L2/L3	Relays	L0/L3
Demand Reset	L0/L2	Load Profile	L0/L3
Master Reset	L2/L3	Measurement	L2/L3
Cold Start	L2/L3		
Firmware Upgrade	L0/L3	<u>Security Access Programming</u>	
Prepay Configuration and Data	N/A/N/A		
		Meter Data	L2/L3
<u>TOU Meter Programming</u>		Meter ID	L0/L3
Date / Time	L0/L2		
TOU Schedule	L0/L3	Security	L3/L3
<u>Display Programming</u>		<u>Security Lock</u>	
Displays	L0/L3	L5 Requires Unlock	NO
		AMR Requires Unlock	NO
		Lockout Attempts/Timeout	10/5 min

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	6

Display Table

ID	Name	Normal	Alternate	Test Mode	User Displays
888	Segment Check	Yes	Yes	Yes	1. 15
DAT	Current Date	No	Yes	No	2.
TME	Current Time	No	Yes	No	3.
DIS	Service Disconnect State	Yes	Yes	No	4.
001	Delivered kWh	Yes	Yes	No	5.
002	Received kWh	Yes	Yes	No	6.
003	Max Demand	No	Yes	No	7.
PGM	Program ID	No	Yes	Yes	8.
KH	Kh	No	Yes	No	Extended Displays
DIL	User Display 1	No	Yes	No	#@
PHA	Phase A Average Voltage	No	Yes	No	#A
VPA	V Angle Phase A	No	Yes	No	#B
PHC	Phase C Average Voltage	No	Yes	No	#C
VPC	V Angle Phase C	No	Yes	No	#D
TMT	Test Mode Timeout	No	No	Yes	#E
TKH	Test Mode Kh	No	No	Yes	#F
FWV	Firmware Version	No	Yes	Yes	#G
					#H
					#I
					#J
					#K
					#L
					#M
					#N
					#O

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	7


Demand Interval

<u>Interval Data</u>	<u>Previous Interval</u>	<u>Present Interval</u>
Time Remaining		00:36
kW	000000.706	000000.679

|

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	8

Instantaneous Data

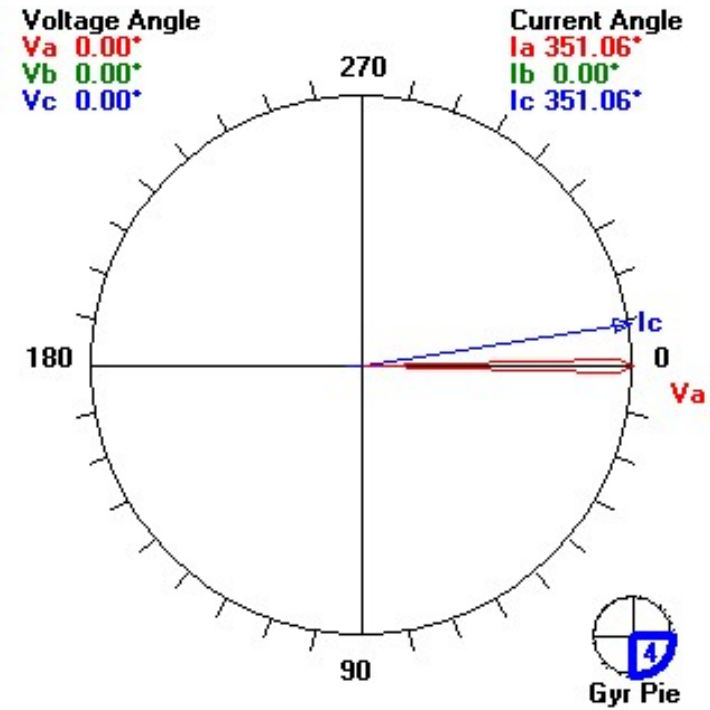

Phase Data	Form: 2	Expected Values (Service)
Phase A Voltage	249.203	Single Phase Service
Phase B Voltage	0.000	Single Phase Service
Phase C Voltage	0.000	Single Phase Service
Phase A Current	3.234	
Phase B Current	0.000	Note - For some meter forms
Phase C Current	3.234	Phase B values are derived
Frequency	60.1 Hz	from other phases.

Demand Data

kW	0.737
kVA	-0.746
kVAR	-0.116
Power Factor	0.988

Diagnostic Values

Meter Temperature 6°C / 42.8°F

Current Feed

Top/Bottom Feed N/A

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	9

Gyrbox Diagnostics

<u>GyrBox Diagnostic Configuration</u>		<u>LCD Display</u>	<u>Counters</u>
Voltage Phase Angle (D1)		No Display	0
Voltage Phase Deviation (D2)		No Display	0
Voltage Deviation Threshold	10.000%		
Inactive Phase Current (D3)		No Display	0
Phase A Current Threshold	0.125 Amps		
Phase B Current Threshold	0.125 Amps		
Phase C Current Threshold	0.125 Amps		
Current Phase Angle (D4)		No Display	0
Disp. Angle (Leading)	90.000 Degrees		
Disp. Angle (Lagging)	90.000 Degrees		
Current Imbalance (D6)		No Display	0
Current Imbalance Threshold	10.000%		
Energy Polarity (D7)		No Display	0

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	10

Energy and Demand

<u>Active Energy</u>		Max kW	Time and Date
		24.406	11/29/2022 2:15 AM
Total kWh	53592.610	24.072	11/29/2022 1:55 AM
Total Wh	53592609.600	23.143	11/29/2022 2:10 AM
Cumulative kW	4005.552		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	11

TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53592.610	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53592.610	0.000	0.000	0.000	0.000
Max kW	24.406	0.000	0.000	0.000	0.000
Date/Time Max	11/29/2022 2:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	24.072	0.000	0.000	0.000	0.000
Date/Time Max 2	11/29/22 1:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	23.143	0.000	0.000	0.000	0.000
Date/Time Max 3	11/29/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	4005.552	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	12

Demand Reset Data

<u>Active Energy</u>		Max kW	Time and Date
		22.788	11/28/2022 3:35 AM
Total kWh	53504.261	22.680	11/28/2022 2:10 AM
Total Wh	53504260.800	22.558	11/28/2022 4:50 AM
Cumulative kW	3982.764		
Negative kWh	0.000		

Counters

Reset Counter	99
Power Outage Counter	21
Program Counter	1
Manual Test Mode Counter	1
Optical Test Mode Counter	0
Resets in Previous Season	121
Invalid Login Attempts	1

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	13

Demand Reset TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53504.261	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53504.261	0.000	0.000	0.000	0.000
Max kW	22.788	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 3:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	22.680	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	22.558	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3982.764	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	14

Previous Season Energy and Demand

<u>Active Energy</u>		Max kW	Time and Date
		20.988	4/9/2022 11:35 PM
Total kWh	31615.799	20.976	4/9/2022 12:40 AM
Total Wh	31615798.800	20.969	4/9/2022 12:45 AM
Cumulative kW	1409.779		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	15

Previous Season TOU Data

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	31615.799	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	31615.799	0.000	0.000	0.000	0.000
Max kW	20.988	0.000	0.000	0.000	0.000
Date/Time Max	4/9/2022 11:35 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	20.976	0.000	0.000	0.000	0.000
Date/Time Max 2	04/09/22 12:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	20.969	0.000	0.000	0.000	0.000
Date/Time Max 3	04/09/22 12:45 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	1409.779	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	16

Event Log

Event Notification

AMR Event Notification Enabled

Event Logging

<u>Events</u>	<u>Time</u>	<u>Initiated By:</u>
Power Loss (Up)	Nov-27-22 03:23:40	Meter Action
Power Loss (Down)	Nov-27-22 03:23:37	Meter Action
Daylight Savings Time end	Nov-06-22 01:00:00	Meter Action
Power Loss (Up)	Nov-04-22 06:15:53	Meter Action
Power Loss (Down)	Nov-04-22 06:15:22	Meter Action
TimeChange (New Time)	Sep-28-22 01:23:02	Manual Action
TimeChange (Old Time)	Sep-28-22 01:22:40	Manual Action
TimeChange (New Time)	Jun-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Jun-15-22 01:23:23	Manual Action
TimeChange (New Time)	May-24-22 01:23:02	Manual Action
TimeChange (Old Time)	May-24-22 01:23:22	Manual Action
TimeChange (New Time)	May-10-22 01:23:02	Manual Action
TimeChange (Old Time)	May-10-22 01:23:23	Manual Action
Power Loss (Up)	May-06-22 14:10:39	Meter Action
Power Loss (Down)	May-06-22 14:08:37	Meter Action
Test Mode end	May-06-22 14:08:27	Manual Action
Test Mode start	May-06-22 14:04:34	Manual Action
Power Loss (Up)	May-06-22 14:04:02	Meter Action
Power Loss (Down)	May-06-22 14:01:17	Meter Action
TimeChange (New Time)	Apr-20-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-20-22 01:22:39	Manual Action
TimeChange (New Time)	Apr-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-15-22 01:22:38	Manual Action
Power Loss (Up)	Apr-10-22 13:26:17	Meter Action
Power Loss (Down)	Apr-10-22 13:25:26	Meter Action
Power Loss (Up)	Apr-10-22 05:26:13	Meter Action
Power Loss (Down)	Apr-10-22 05:25:41	Meter Action
TimeChange (New Time)	Mar-30-22 01:23:02	Manual Action
TimeChange (Old Time)	Mar-30-22 01:22:40	Manual Action
Daylight Savings Time start	Mar-13-22 03:00:00	Meter Action
Power Loss (Up)	Feb-28-22 05:50:15	Meter Action
Power Loss (Down)	Feb-28-22 05:50:02	Meter Action
Power Loss (Up)	Feb-28-22 04:38:54	Meter Action
Power Loss (Down)	Feb-28-22 04:38:41	Meter Action
Power Loss (Up)	Feb-19-22 15:10:47	Meter Action
Power Loss (Down)	Feb-19-22 15:10:34	Meter Action

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	16
Power Loss (Up)		Jan-06-22 16:40:04	Meter Action
Power Loss (Down)		Jan-06-22 05:16:54	Meter Action
Power Loss (Up)		Jan-06-22 02:36:31	Meter Action
Power Loss (Down)		Jan-06-22 02:35:59	Meter Action
Power Loss (Up)		Jan-03-22 14:15:11	Meter Action
Power Loss (Down)		Jan-03-22 14:15:09	Meter Action
Power Loss (Up)		Jan-03-22 02:50:34	Meter Action
Power Loss (Down)		Jan-03-22 02:50:02	Meter Action
Power Loss (Up)		Dec-29-21 12:18:43	Meter Action
Power Loss (Down)		Dec-29-21 12:18:11	Meter Action
TimeChange (New Time)		Dec-25-21 01:23:02	Manual Action
TimeChange (Old Time)		Dec-25-21 01:23:26	Manual Action
Power Loss (Up)		Dec-24-21 12:42:23	Meter Action
Power Loss (Down)		Dec-24-21 12:41:52	Meter Action
Power Loss (Up)		Dec-22-21 02:32:24	Meter Action
Power Loss (Down)		Dec-22-21 02:31:53	Meter Action
Power Loss (Up)		Dec-20-21 14:39:40	Meter Action
Power Loss (Down)		Dec-20-21 14:39:37	Meter Action
Power Loss (Up)		Dec-18-21 19:02:24	Meter Action
Power Loss (Down)		Dec-18-21 19:02:11	Meter Action
TimeChange (New Time)		Dec-16-21 01:23:02	Manual Action
TimeChange (Old Time)		Dec-16-21 01:22:39	Manual Action
Power Loss (Up)		Dec-11-21 05:54:26	Meter Action
Power Loss (Down)		Dec-11-21 05:53:54	Meter Action
Power Loss (Up)		Dec-11-21 05:48:51	Meter Action
Power Loss (Down)		Dec-11-21 05:48:38	Meter Action
Reset Load Profile		Dec-09-21 09:50:44	Meter Action
Stand By Mode Exited		Dec-09-21 09:50:44	Meter Action
TimeChange (New Time)		Dec-09-21 09:50:44	Manual Action
TimeChange (Old Time)		Jan-01-00 00:00:25	Manual Action
Reset Load Profile Data Set 2		Jan-01-00 00:00:00	Meter Action
Stand By Mode Entered		Jan-01-00 00:00:00	Meter Action
Power Loss (Up)		Jan-01-00 00:00:00	Meter Action
Power Loss (Down)		Jan-21-20 23:27:19	Meter Action
Reset Load Profile Data Set 2		Jan-21-20 23:25:53	Meter Action
Reset Load Profile		Jan-21-20 23:25:53	Meter Action
Reset Self Reads		Jan-21-20 23:25:53	Meter Action
Event Log Cleared		Jan-21-20 23:25:53	Meter Action
History Log Cleared		Jan-21-20 23:25:53	Meter Action

Optional Events

Power Loss (Up)		Nov-27-22 03:23:40	Meter Action
Power Loss (Down)		Nov-27-22 03:23:37	Meter Action
Daylight Savings Time end		Nov-06-22 01:00:00	Meter Action
Power Loss (Up)		Nov-04-22 06:15:53	Meter Action

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	16

Power Loss (Down)	Nov-04-22 06:15:22	Meter Action
TimeChange (New Time)	Sep-28-22 01:23:02	Manual Action
TimeChange (Old Time)	Sep-28-22 01:22:40	Manual Action
TimeChange (New Time)	Jun-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Jun-15-22 01:23:23	Manual Action
TimeChange (New Time)	May-24-22 01:23:02	Manual Action
TimeChange (Old Time)	May-24-22 01:23:22	Manual Action
TimeChange (New Time)	May-10-22 01:23:02	Manual Action
TimeChange (Old Time)	May-10-22 01:23:23	Manual Action
Meter Insertion Detected	May-06-22 14:10:45	Meter Action
Power Loss (Up)	May-06-22 14:10:39	Meter Action
Power Loss (Down)	May-06-22 14:08:37	Meter Action
Meter Removal Detected	May-06-22 14:08:37	Meter Action
Test Mode start	May-06-22 14:04:34	Manual Action
Power Loss (Up)	May-06-22 14:04:02	Meter Action
Power Loss (Down)	May-06-22 14:01:17	Meter Action
Meter Removal Detected	May-06-22 14:01:17	Meter Action
TimeChange (New Time)	Apr-20-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-20-22 01:22:39	Manual Action
TimeChange (New Time)	Apr-15-22 01:23:02	Manual Action
TimeChange (Old Time)	Apr-15-22 01:22:38	Manual Action
Power Loss (Up)	Apr-10-22 13:26:17	Meter Action
Power Loss (Down)	Apr-10-22 13:25:26	Meter Action
Sag on Phase A Started	Apr-10-22 13:25:26	Meter Action
Power Loss (Up)	Apr-10-22 05:26:13	Meter Action
Power Loss (Down)	Apr-10-22 05:25:41	Meter Action
Sag on Phase A Started	Apr-10-22 05:25:41	Meter Action
TimeChange (New Time)	Mar-30-22 01:23:02	Manual Action
TimeChange (Old Time)	Mar-30-22 01:22:40	Manual Action
Daylight Savings Time start	Mar-13-22 03:00:00	Meter Action
Sag on Phase A Stopped	Feb-28-22 06:04:09	Meter Action
Sag on Phase A Started	Feb-28-22 06:04:09	Meter Action
Power Loss (Up)	Feb-28-22 05:50:15	Meter Action
Power Loss (Down)	Feb-28-22 05:50:02	Meter Action
Power Loss (Up)	Feb-28-22 04:38:54	Meter Action
Power Loss (Down)	Feb-28-22 04:38:41	Meter Action
Power Loss (Up)	Feb-19-22 15:10:47	Meter Action
Power Loss (Down)	Feb-19-22 15:10:34	Meter Action
Power Loss (Up)	Jan-06-22 16:40:04	Meter Action
Power Loss (Down)	Jan-06-22 05:16:54	Meter Action
Power Loss (Up)	Jan-06-22 02:36:31	Meter Action
Power Loss (Down)	Jan-06-22 02:35:59	Meter Action
Sag on Phase A Started	Jan-06-22 02:35:59	Meter Action
Sag on Phase A Stopped	Jan-03-22 14:15:20	Meter Action
Sag on Phase A Started	Jan-03-22 14:15:20	Meter Action
Power Loss (Up)	Jan-03-22 14:15:11	Meter Action

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	16

Power Loss (Down)	Jan-03-22 14:15:09	Meter Action
Sag on Phase A Started	Jan-03-22 14:15:09	Meter Action
Power Loss (Up)	Jan-03-22 02:50:34	Meter Action
Power Loss (Down)	Jan-03-22 02:50:02	Meter Action
Sag on Phase A Stopped	Dec-29-21 14:26:42	Meter Action
Sag on Phase A Started	Dec-29-21 14:26:41	Meter Action
Power Loss (Up)	Dec-29-21 12:18:43	Meter Action
Power Loss (Down)	Dec-29-21 12:18:11	Meter Action
TimeChange (New Time)	Dec-25-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-25-21 01:23:26	Manual Action
Power Loss (Up)	Dec-24-21 12:42:23	Meter Action
Power Loss (Down)	Dec-24-21 12:41:52	Meter Action
Sag on Phase A Stopped	Dec-23-21 08:04:27	Meter Action
Sag on Phase A Started	Dec-23-21 08:04:27	Meter Action
Power Loss (Up)	Dec-22-21 02:32:24	Meter Action
Power Loss (Down)	Dec-22-21 02:31:53	Meter Action
Sag on Phase A Stopped	Dec-21-21 22:11:37	Meter Action
Sag on Phase A Started	Dec-21-21 22:11:36	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:39:40	Meter Action
Power Loss (Up)	Dec-20-21 14:39:40	Meter Action
Power Loss (Down)	Dec-20-21 14:39:37	Meter Action
Sag on Phase A Started	Dec-20-21 14:39:37	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:01:52	Meter Action
Sag on Phase A Started	Dec-20-21 14:01:52	Meter Action
Sag on Phase A Stopped	Dec-20-21 14:01:41	Meter Action
Sag on Phase A Started	Dec-20-21 14:01:41	Meter Action
Power Loss (Up)	Dec-18-21 19:02:24	Meter Action
Power Loss (Down)	Dec-18-21 19:02:11	Meter Action
TimeChange (New Time)	Dec-16-21 01:23:02	Manual Action
TimeChange (Old Time)	Dec-16-21 01:22:39	Manual Action
Power Loss (Up)	Dec-11-21 05:54:26	Meter Action
Power Loss (Down)	Dec-11-21 05:53:54	Meter Action
Power Loss (Up)	Dec-11-21 05:48:51	Meter Action
Power Loss (Down)	Dec-11-21 05:48:38	Meter Action
Reset Load Profile	Dec-09-21 09:50:44	Meter Action
Stand By Mode Exited	Dec-09-21 09:50:44	Meter Action
TimeChange (New Time)	Dec-09-21 09:50:44	Manual Action
TimeChange (Old Time)	Jan-01-00 00:00:25	Manual Action
Reset Load Profile Data Set 2	Jan-01-00 00:00:00	Meter Action
Stand By Mode Entered	Jan-01-00 00:00:00	Meter Action
Power Loss (Up)	Jan-01-00 00:00:00	Meter Action
Power Loss (Down)	Jan-21-20 23:27:19	Meter Action
Meter Programmed	Jan-21-20 23:25:54	Communication - User ID: 2
Reset Load Profile Data Set 2	Jan-21-20 23:25:53	Meter Action
Reset Load Profile	Jan-21-20 23:25:53	Meter Action
Reset Self Reads	Jan-21-20 23:25:53	Meter Action

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	16

Event Log Cleared	Jan-21-20 23:25:53	Meter Action
History Log Cleared	Jan-21-20 23:25:53	Meter Action

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	21

Errors

<u>Standard Errors</u>	<u>Status</u>	<u>Display</u>	<u>Manufacturer Errors</u>	<u>Status</u>	<u>Display</u>
Unprogrammed	FALSE	No Display	SD Switch Error (LS Voltage)	FALSE	No Display
Unconfigured	FALSE	No Display	60 Hz Out of Range	FALSE	No Display
			Phase Error	FALSE	No Display
Ram Failure	FALSE	No Display	SD Switch Error (Sensor)	FALSE	No Display
			Stuck Switch Error	FALSE	No Display
Non-Vol Mem Failure	FALSE	No Display	Temperature Error	FALSE	No Display
Clock Error	FALSE	No Display	Phase A Out	FALSE	No Display
Measurement Error	FALSE	No Display	Phase B Out	FALSE	No Display
Low Battery Error	FALSE	No Display	Phase C Out	FALSE	No Display
			Invalid Service	FALSE	No Display
Demand Overload Error	FALSE	No Display	Standby Energy Accumulation	FALSE	No Display
			Overheat Warning	FALSE	No Display
Tamper Detection	FALSE	No Display	Overheat Alarm	FALSE	No Display
Reverse Rotation	FALSE	No Display	Excessive Leading Current on Phase A	FALSE	No Display
			Excessive Leading Current on Phase B	FALSE	No Display
			Excessive Leading Current on Phase C	FALSE	No Display
			GyrBox D1 Voltage Phase Angle Error	FALSE	No Display
			GyrBox D2 Voltage Phase Deviation Error	FALSE	No Display
			GyrBox D3 Inactive Phase Current Error	FALSE	No Display
			GyrBox D4 Current Phase Angle Error	FALSE	No Display
			GyrBox D6 Current Imbalance Error	FALSE	No Display
			GyrBox D7 Energy Polarity Error	FALSE	No Display

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	22

Stand By Data

Stand By Data

Duration	0:00:00:25
kWh	0.000
-kWh	0.000
Manipulated kWh	0.000

Stand By Log

Entry 1 Standby Period	12/9/2021 9:50:19 AM to 12/9/2021 9:50:44 AM
kWh	0.000
-kWh	0.000
Manipulated kWh	0.000

Entry 2 Standby Period	Not in Use
kWh	0.000
-kWh	0.000
Manipulated kWh	0.000

Entry 3 Standby Period	Not in Use
kWh	0.000
-kWh	0.000
Manipulated kWh	0.000

Entry 4 Standby Period	Not in Use
kWh	0.000
-kWh	0.000
Manipulated kWh	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	23

Voltage Log

Voltage Data

Sample Interval	5 min				
Average Voltage	Phase A	Phase B	Phase C		
	245.1 V	0.0 V	0.0 V		
Date	Min Voltage	Time	Max Voltage	Time	Average Voltage
1. 11/29/2022					
Phase A	243.1 V	6:50 AM	249.3 V	11:35 AM	245.1 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
2. 11/28/2022					
Phase A	242.0 V	6:15 AM	250.8 V	10:15 PM	245.6 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
3. 11/27/2022					
Phase A	244.1 V	12:05 PM	251.6 V	11:05 PM	245.7 V
Phase B	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V
Phase C	0.0 V	--:-- AM	0.0 V	--:-- AM	0.0 V

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	24

LCD Display Report

Normal

Display ID	Display Name	Value
888	Segment Check	*
DIS	Service Disconnect State	*
001	Delivered kWh	53592
002	Received kWh	00000
* - Reporting not available in this software version.		

Alternate

Display ID	Display Name	Value
888	Segment Check	*
DAT	Current Date	*
TME	Current Time	*
DIS	Service Disconnect State	*
001	Delivered kWh	53592
002	Received kWh	00000
003	Max Demand	024.405
PGM	Program ID	*
KH	Kh	*
DIL	User Display 1	*
PHA	Phase A Average Voltage	*
VPA	V Angle Phase A	*
PHC	Phase C Average Voltage	*
VPC	V Angle Phase C	*
FWV	Firmware Version	*
* - Reporting not available in this software version.		

Test

Display ID	Display Name	Value
888	Segment Check	*
PGM	Program ID	*
TMT	Test Mode Timeout	*
TKH	Test Mode Kh	*
FWV	Firmware Version	*
* - Reporting not available in this software version.		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	25

Energy and Demand Self Read 1 11/29/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		22.788	11/28/2022 3:35 AM
Total kWh	53504.261	22.680	11/28/2022 2:10 AM
Total Wh	53504260.800	22.558	11/28/2022 4:50 AM
Cumulative kW	3982.764		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	26

TOU Data Self Read 1 11/29/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53504.261	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53504.261	0.000	0.000	0.000	0.000
Max kW	22.788	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 3:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	22.680	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	22.558	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3982.764	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	27

Energy and Demand Self Read 2 11/28/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		14.462	11/27/2022 7:35 AM
Total kWh	53442.980	12.986	11/27/2022 7:40 AM
Total Wh	53442980.400	12.038	11/27/2022 5:40 AM
Cumulative kW	3968.302		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	28

TOU Data Self Read 2 11/28/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53442.980	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53442.980	0.000	0.000	0.000	0.000
Max kW	14.462	0.000	0.000	0.000	0.000
Date/Time Max	11/27/2022 7:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	12.986	0.000	0.000	0.000	0.000
Date/Time Max 2	11/27/22 7:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	12.038	0.000	0.000	0.000	0.000
Date/Time Max 3	11/27/22 5:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3968.302	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	29

Energy and Demand Self Read 3 11/27/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		14.945	11/26/2022 4:55 AM
Total kWh	53388.325	12.254	11/26/2022 5:00 AM
Total Wh	53388325.200	10.783	11/26/2022 4:50 AM
Cumulative kW	3953.357		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	30

TOU Data Self Read 3 11/27/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53388.325	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53388.325	0.000	0.000	0.000	0.000
Max kW	14.945	0.000	0.000	0.000	0.000
Date/Time Max	11/26/2022 4:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	12.254	0.000	0.000	0.000	0.000
Date/Time Max 2	11/26/22 5:00 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	10.783	0.000	0.000	0.000	0.000
Date/Time Max 3	11/26/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3953.357	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	31

Energy and Demand Self Read 4 11/26/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		20.926	11/25/2022 7:20 AM
Total kWh	53332.901	17.880	11/25/2022 7:25 AM
Total Wh	53332901.400	14.422	11/25/2022 7:15 AM
Cumulative kW	3932.431		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	32

TOU Data Self Read 4 11/26/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53332.901	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53332.901	0.000	0.000	0.000	0.000
Max kW	20.926	0.000	0.000	0.000	0.000
Date/Time Max	11/25/2022 7:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	17.880	0.000	0.000	0.000	0.000
Date/Time Max 2	11/25/22 7:25 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	14.422	0.000	0.000	0.000	0.000
Date/Time Max 3	11/25/22 7:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3932.431	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	33

Energy and Demand Self Read 5 11/25/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		23.674	11/24/2022 8:10 AM
Total kWh	53295.796	23.474	11/24/2022 6:20 AM
Total Wh	53295795.600	22.262	11/24/2022 4:40 AM
Cumulative kW	3908.758		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	34

TOU Data Self Read 5 11/25/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53295.796	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53295.796	0.000	0.000	0.000	0.000
Max kW	23.674	0.000	0.000	0.000	0.000
Date/Time Max	11/24/2022 8:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	23.474	0.000	0.000	0.000	0.000
Date/Time Max 2	11/24/22 6:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	22.262	0.000	0.000	0.000	0.000
Date/Time Max 3	11/24/22 4:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3908.758	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	35

Energy and Demand Self Read 6 11/24/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		16.030	11/23/2022 5:45 AM
Total kWh	53217.455	13.594	11/23/2022 5:50 AM
Total Wh	53217455.400	13.006	11/23/2022 3:25 AM
Cumulative kW	3892.728		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	36

TOU Data Self Read 6 11/24/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53217.455	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53217.455	0.000	0.000	0.000	0.000
Max kW	16.030	0.000	0.000	0.000	0.000
Date/Time Max	11/23/2022 5:45 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	13.594	0.000	0.000	0.000	0.000
Date/Time Max 2	11/23/22 5:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	13.006	0.000	0.000	0.000	0.000
Date/Time Max 3	11/23/22 3:25 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3892.728	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	37

Energy and Demand Self Read 7 11/23/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		21.780	11/22/2022 4:45 AM
Total kWh	53169.185	19.318	11/22/2022 4:40 AM
Total Wh	53169185.400	15.701	11/22/2022 4:50 AM
Cumulative kW	3870.948		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	38

TOU Data Self Read 7 11/23/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53169.185	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53169.185	0.000	0.000	0.000	0.000
Max kW	21.780	0.000	0.000	0.000	0.000
Date/Time Max	11/22/2022 4:45 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	19.318	0.000	0.000	0.000	0.000
Date/Time Max 2	11/22/22 4:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	15.701	0.000	0.000	0.000	0.000
Date/Time Max 3	11/22/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3870.948	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	39

Energy and Demand Self Read 8 11/22/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		20.818	11/21/2022 6:15 AM
Total kWh	53110.198	19.721	11/21/2022 6:20 AM
Total Wh	53110197.600	17.009	11/21/2022 2:30 AM
Cumulative kW	3850.130		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	40

TOU Data Self Read 8 11/22/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53110.198	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53110.198	0.000	0.000	0.000	0.000
Max kW	20.818	0.000	0.000	0.000	0.000
Date/Time Max	11/21/2022 6:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	19.721	0.000	0.000	0.000	0.000
Date/Time Max 2	11/21/22 6:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	17.009	0.000	0.000	0.000	0.000
Date/Time Max 3	11/21/22 2:30 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3850.130	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	41

Energy and Demand Self Read 9 11/21/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		24.902	11/20/2022 3:00 AM
Total kWh	53051.369	24.893	11/20/2022 3:05 AM
Total Wh	53051368.800	24.876	11/20/2022 3:10 AM
Cumulative kW	3825.228		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	42

TOU Data Self Read 9 11/21/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53051.369	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53051.369	0.000	0.000	0.000	0.000
Max kW	24.902	0.000	0.000	0.000	0.000
Date/Time Max	11/20/2022 3:00 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	24.893	0.000	0.000	0.000	0.000
Date/Time Max 2	11/20/22 3:05 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	24.876	0.000	0.000	0.000	0.000
Date/Time Max 3	11/20/22 3:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3825.228	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	43

Energy and Demand Self Read 10 11/20/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		26.237	11/19/2022 5:20 PM
Total kWh	52931.096	25.853	11/19/2022 5:15 PM
Total Wh	52931095.800	25.642	11/19/2022 5:10 PM
Cumulative kW	3798.991		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	44

TOU Data Self Read 10 11/20/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	52931.096	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	52931.096	0.000	0.000	0.000	0.000
Max kW	26.237	0.000	0.000	0.000	0.000
Date/Time Max	11/19/2022 5:20 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	25.853	0.000	0.000	0.000	0.000
Date/Time Max 2	11/19/22 5:15 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	25.642	0.000	0.000	0.000	0.000
Date/Time Max 3	11/19/22 5:10 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3798.991	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	45

Energy and Demand Self Read 11 11/19/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		24.881	11/18/2022 7:55 AM
Total kWh	52815.844	24.684	11/18/2022 7:50 AM
Total Wh	52815844.200	24.516	11/18/2022 8:00 AM
Cumulative kW	3774.110		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	46

TOU Data Self Read 11 11/19/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	52815.844	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	52815.844	0.000	0.000	0.000	0.000
Max kW	24.881	0.000	0.000	0.000	0.000
Date/Time Max	11/18/2022 7:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	24.684	0.000	0.000	0.000	0.000
Date/Time Max 2	11/18/22 7:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	24.516	0.000	0.000	0.000	0.000
Date/Time Max 3	11/18/22 8:00 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3774.110	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	47

Energy and Demand Self Read 12 11/18/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		26.417	11/17/2022 4:45 PM
Total kWh	52708.013	26.369	11/17/2022 11:50 AM
Total Wh	52708012.800	26.342	11/17/2022 11:45 AM
Cumulative kW	3747.694		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	48

TOU Data Self Read 12 11/18/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	52708.013	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	52708.013	0.000	0.000	0.000	0.000
Max kW	26.417	0.000	0.000	0.000	0.000
Date/Time Max	11/17/2022 4:45 PM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	26.369	0.000	0.000	0.000	0.000
Date/Time Max 2	11/17/22 11:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	26.342	0.000	0.000	0.000	0.000
Date/Time Max 3	11/17/22 11:45 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3747.694	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	49

Energy and Demand Snapshot 1 11/29/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		22.788	11/28/2022 3:35 AM
Total kWh	53504.261	22.680	11/28/2022 2:10 AM
Total Wh	53504260.800	22.558	11/28/2022 4:50 AM
Cumulative kW	3982.764		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	50

TOU Data Snapshot 1 11/29/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53504.261	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53504.261	0.000	0.000	0.000	0.000
Max kW	22.788	0.000	0.000	0.000	0.000
Date/Time Max	11/28/2022 3:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	22.680	0.000	0.000	0.000	0.000
Date/Time Max 2	11/28/22 2:10 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	22.558	0.000	0.000	0.000	0.000
Date/Time Max 3	11/28/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3982.764	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	51

Energy and Demand Snapshot 2 11/28/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		14.462	11/27/2022 7:35 AM
Total kWh	53442.980	12.986	11/27/2022 7:40 AM
Total Wh	53442980.400	12.038	11/27/2022 5:40 AM
Cumulative kW	3968.302		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	52

TOU Data Snapshot 2 11/28/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53442.980	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53442.980	0.000	0.000	0.000	0.000
Max kW	14.462	0.000	0.000	0.000	0.000
Date/Time Max	11/27/2022 7:35 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	12.986	0.000	0.000	0.000	0.000
Date/Time Max 2	11/27/22 7:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	12.038	0.000	0.000	0.000	0.000
Date/Time Max 3	11/27/22 5:40 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3968.302	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	53

Energy and Demand Snapshot 3 11/27/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		14.945	11/26/2022 4:55 AM
Total kWh	53388.325	12.254	11/26/2022 5:00 AM
Total Wh	53388325.200	10.783	11/26/2022 4:50 AM
Cumulative kW	3953.357		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	54

TOU Data Snapshot 3 11/27/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53388.325	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53388.325	0.000	0.000	0.000	0.000
Max kW	14.945	0.000	0.000	0.000	0.000
Date/Time Max	11/26/2022 4:55 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	12.254	0.000	0.000	0.000	0.000
Date/Time Max 2	11/26/22 5:00 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	10.783	0.000	0.000	0.000	0.000
Date/Time Max 3	11/26/22 4:50 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3953.357	0.000	0.000	0.000	0.000

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	55

Energy and Demand Snapshot 4 11/26/2022 12:00:00 AM

<u>Active Energy</u>		Max kW	Time and Date
		20.926	11/25/2022 7:20 AM
Total kWh	53332.901	17.880	11/25/2022 7:25 AM
Total Wh	53332901.400	14.422	11/25/2022 7:15 AM
Cumulative kW	3932.431		
Negative kWh	0.000		

Device Type	FAXR	Device ID	X15774963 5
Report Date	11/29/2022 12:08	Page	56

TOU Data Snapshot 4 11/26/2022 12:00:00 AM

	<u>Rate A</u>	<u>Rate B</u>	<u>Rate C</u>	<u>Rate D</u>	<u>Rate E</u>
kWh	53332.901	0.000	0.000	0.000	0.000
Received kWh	0.000	0.000	0.000	0.000	0.000
Total kWh	53332.901	0.000	0.000	0.000	0.000
Max kW	20.926	0.000	0.000	0.000	0.000
Date/Time Max	11/25/2022 7:20 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #2	17.880	0.000	0.000	0.000	0.000
Date/Time Max 2	11/25/22 7:25 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Max kW #3	14.422	0.000	0.000	0.000	0.000
Date/Time Max 3	11/25/22 7:15 AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM	--/-- --:-- AM
Cumulative kW	3932.431	0.000	0.000	0.000	0.000