

***Annual Energy and Emissions Intensity (“EEI”) Metrics Report***  
***Pursuant to WAC 480-109-300***  
***June 1, 2022***

**Table of Contents**

**Section 1 – Executive Summary**

**Section 2 – Metrics**

**Section 3 – Trend Analysis**

**Section 4 – Appendices**

**Appendix 1: Estimation of PSE Service Territory Population**

**Appendix 2: Emissions Reporting Methodology**

**Attachment A – EEI Raw Data and Charts**

# Energy and Emissions Intensity (EEI) Metrics Report

## Section 1: Executive Summary

Compared to the 2020 operating year, Puget Sound Energy's (PSE's) CO<sub>2</sub> equivalent (CO<sub>2</sub>e) emissions intensity from total electricity delivered to customers from 888.9 lb/MWh to 886.9 lb/MWh. This report provides the metrics, analyses, and descriptions behind that change. Further, it demonstrates that PSE delivers electricity to customers from a combination of sources that the Company owns and purchases from other providers via firm contracts or the spot market.

Per the requirements of WAC 480-109-300, PSE submits the following report outlining its energy and emissions intensity metrics for the previous ten years (reporting period). This report includes the following metrics for all PSE generating resources serving customers:

- Average megawatt-hours (aMWh) per residential customer
- Average megawatt-hours (aMWh) per commercial customer
- Megawatt-hours (MWh) per capita
- Annual carbon dioxide equivalent (CO<sub>2</sub>e) emissions measured in metric tons
- Comparison of annual CO<sub>2</sub>e emissions to CO<sub>2</sub> emissions in 1990

PSE and the other utilities purchase a percentage of their energy to serve native load from the spot market. The generation sources from purchases made on the spot market are unknown. Therefore, this report also includes a subset of metrics for spot market purchases based on the unspecified emission rate factor provided by the Washington State Department of Ecology ("Ecology"). Those metrics include:

- Annual CO<sub>2</sub>e emissions (metric tons) from unknown generation sources
- Annual megawatt-hours (MWh) delivered to retail customers from unknown generation sources
- Percentage of load served by unknown generation sources

In addition to the raw data included in Attachment A to this report, the tables and sections below provide trend analysis, narrative descriptions, and graphics to help contextualize PSE's data and trends for the reporting period. Table 1 below summarizes PSE's greenhouse gas (GHG) emissions intensity and energy metrics for the calendar year 2021. Summaries of the previous nine years in the reporting period are included in Attachment A to this report. Section 2 below provides a 10-year "lookback" analysis of the reporting period (to the operating year 2012) of the metrics mentioned above and benchmarks those metrics to a 1990 emissions baseline. Section 3 provides a discussion of the trends observed in the metrics and the broader

regional market. Section 4 includes appendices that provide more detail on the methodologies used in this report.

Summarized in Table 1 and narrative below are PSE’s 2021 energy and intensity metrics. Staff requested in its compliance letter to PSE’s 2017 EEI report that the Company explains the difference between “total load served” and the sum of “Busbar MWh” included in Table 1. The energy intensity metrics represent the metered sale of energy to customers (by class) as reported under the Federal Energy Regulatory Commission (FERC) Form-1 protocols, i.e., Total Load Served. Busbar energy tallies represent the total load PSE served (to Washington) generated and purchased, net of bilateral sales, as reported in PSE’s Energy Accounting (EA) database, i.e., Busbar MWh.

**Table 1. 2021 Energy and Intensity Metrics**  
**Summary Energy and Emissions Intensity Report**

Utility :	Puget Sound Energy	
Reporting for year :	2021	<b>MWh per Capita</b>
Population Served :	2,616,642	<b>8.04</b>

*Energy Intensity Metrics*

	MWh at Meter	MWh Proportion	Customer Count	MWh per Customer
	Residential Customers	11,479,045		
Commercial Customers	8,402,057	39.9%	132,581	63.4
Industrial Customers	1,082,718	5.1%		
Other Customers	79,998	0.4%		
Total Load Served	21,043,818	100.0%		

*Emissions Intensity Metrics*


	Busbar MWh	Percent of Total Load	Metric Tons CO <sub>2</sub> e	% of 1990 CO <sub>2</sub>
	<b>Known Resources Serving WA</b>			
<i>EPA Methodology</i>	21,242,996	95.0%	8,461,673	
<i>EIA Methodology</i>	0	0.0%	0	
Unknown Resources Serving WA	1,123,057	5.0%	556,530	
Total Busbar MWh	22,366,052	Total Metric Tons:	9,018,203	143.1%

1990 Metric Tons CO<sub>2</sub> 6,301,363

## Section 2: Prior 10-year annual metrics for all generating resources serving Washington customers

Figure 1 provides a comparison of annual PSE CO<sub>2</sub>e emissions measured in metric tons from generation sources for the previous 10 years. Figure 1 also includes a 1990 emissions baseline.

Until 2020, WAC 480-109-300 specified that the EEI report only include CO<sub>2</sub> output. In 2020, as a result of rulemaking conducted to implement the Clean Energy Transformation Act (CETA), revised WAC 480-109-300 now requires all greenhouse gas emissions in the EEI report be based on CO<sub>2</sub>e. This change means the inclusion of methane (CH<sub>4</sub>) and nitrous oxide (N<sub>2</sub>O) as CO<sub>2</sub>e<sup>1</sup>.

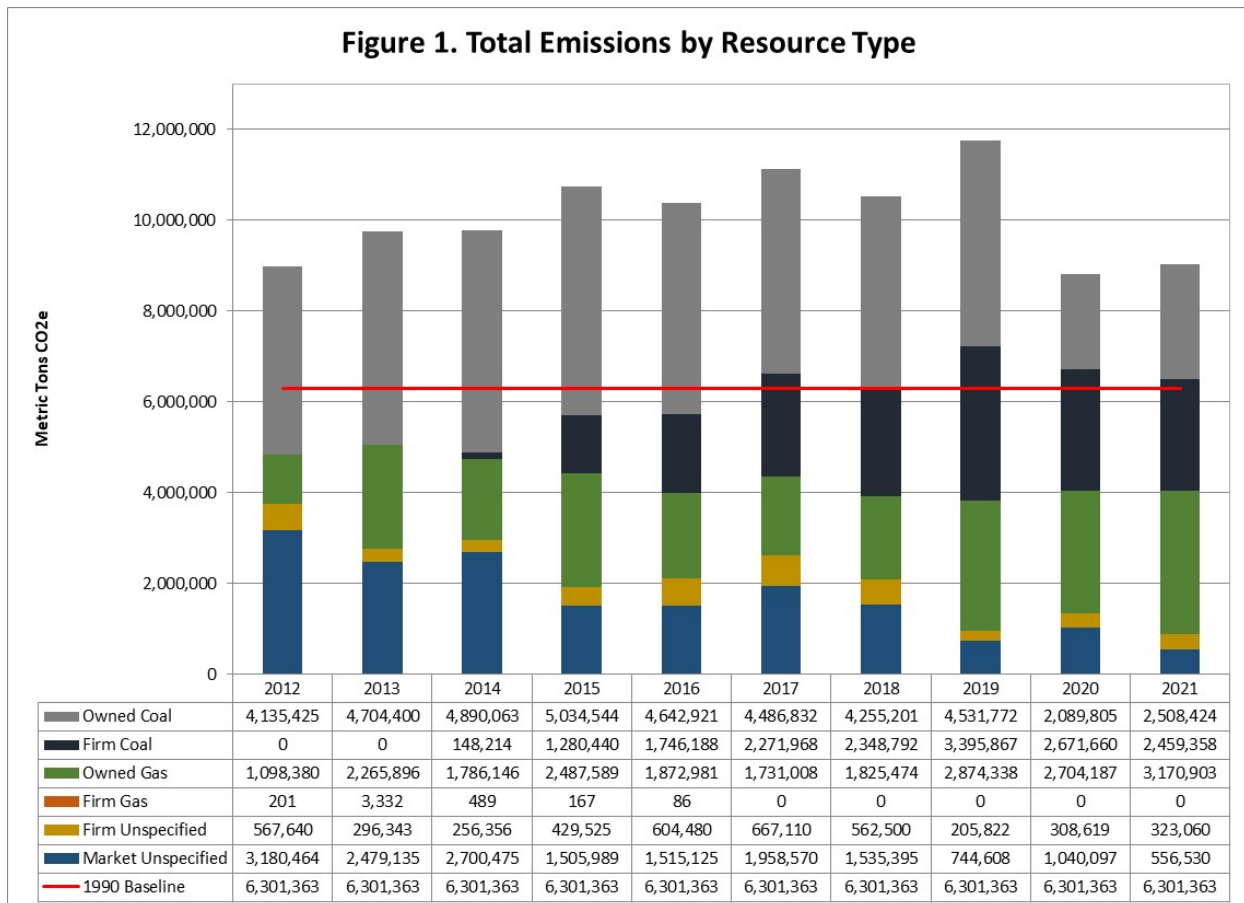

<sup>1</sup> Principle combustible constituents in natural gas and coal are carbon, hydrogen, and their compounds, and in the combustion process, these compounds and elements oxidize to CO<sub>2</sub> and water vapor. However, small amounts of methane (CH<sub>4</sub>) result from incomplete fuel combustion, and nitrous oxide (N<sub>2</sub>O) formation results from post-combustion thermal reactions.

Figure 2 provides a comparison of the average MWh per residential customer, average MWh per commercial customer, and MWh per capita delivered in each of the years during the reporting period in PSE’s service territory.

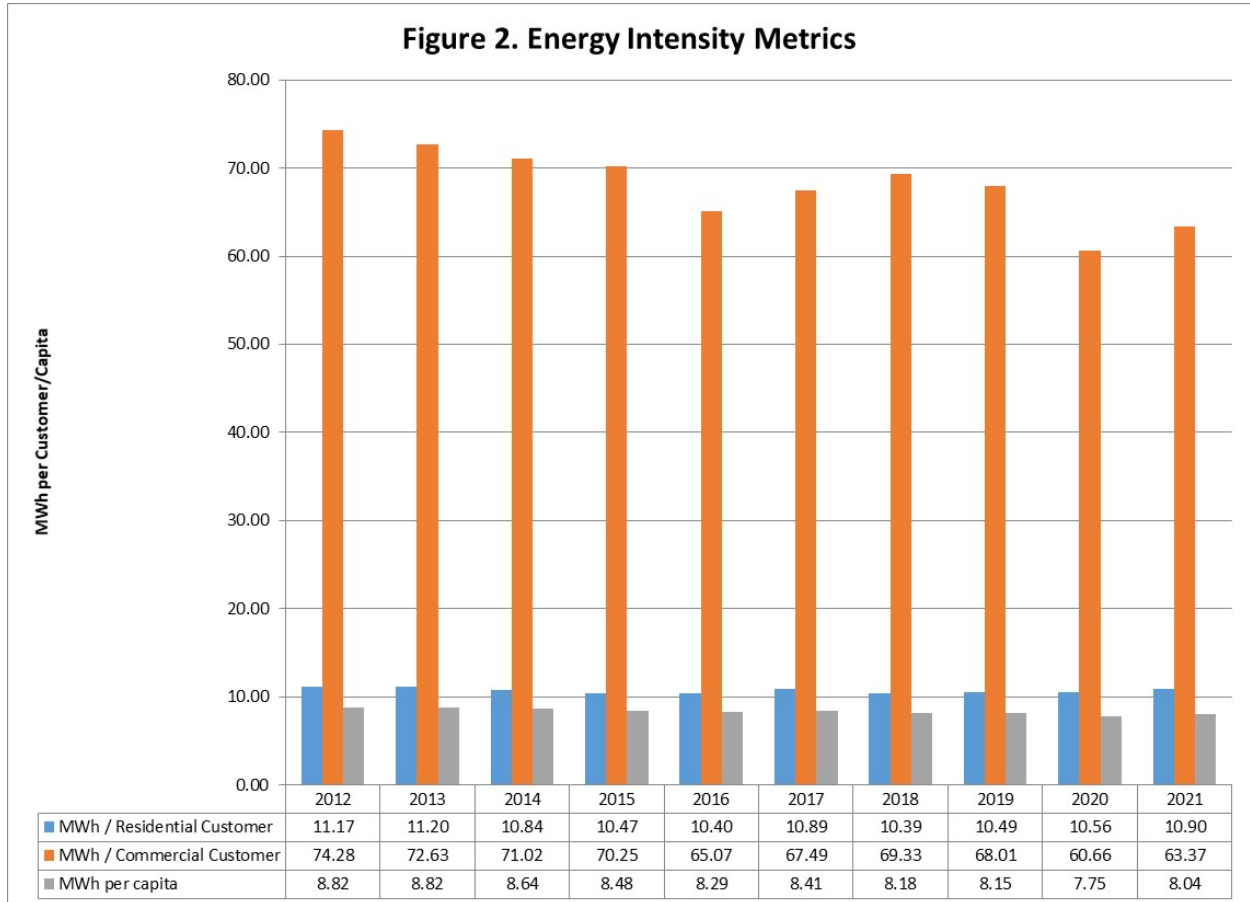


Figure 3 provides a comparison of the ratios of PSE’s annual CO2e emissions from known sources for the reporting period compared to CO2 emission in 1990.


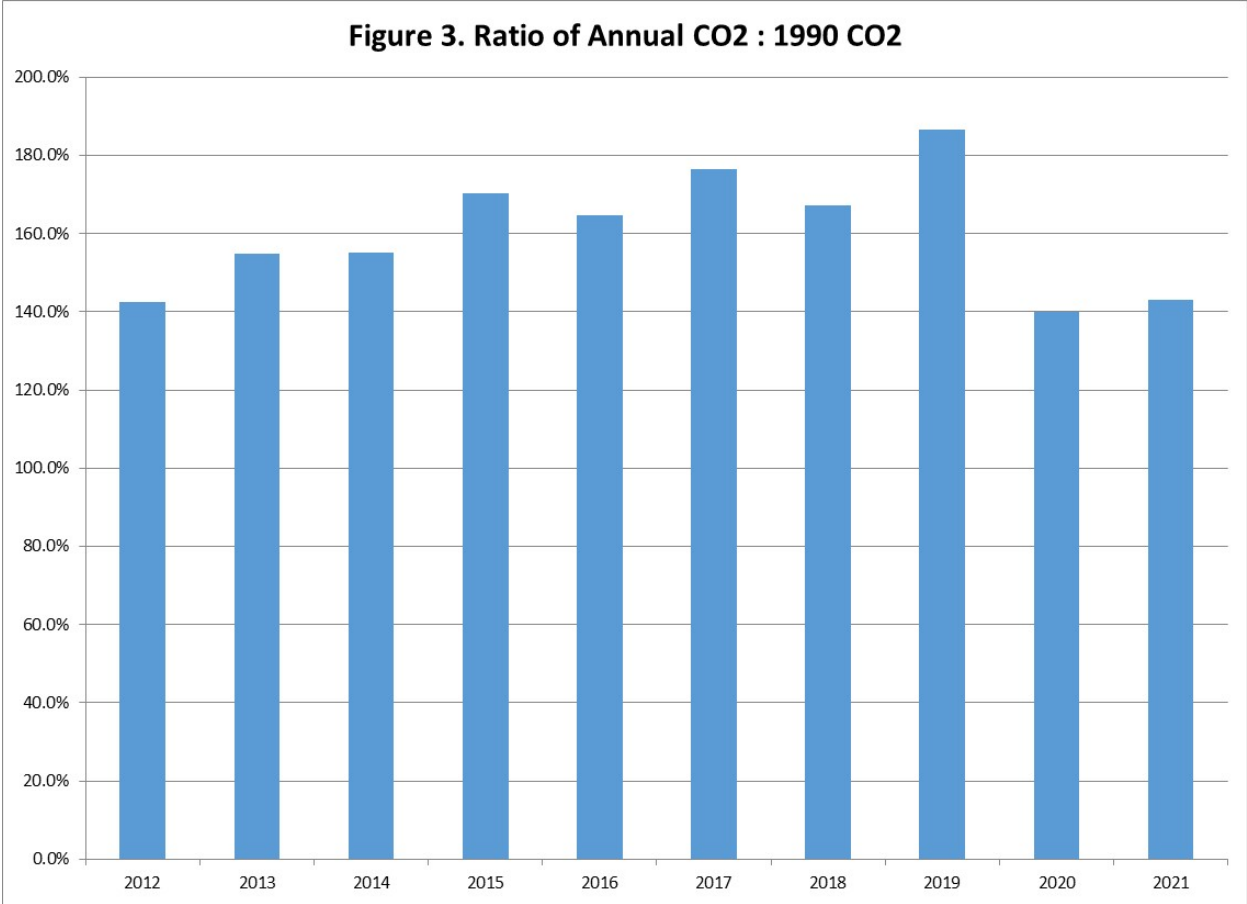


Figure 4 provides a 10-year comparison of generation delivered to PSE from unknown sources and the attributed emissions. Those metrics include annual CO<sub>2</sub>e emissions (metric tons), annual MWh delivered to retail customers, and the percentage of load served. As discussed in the executive summary, the generation sources and attributed emissions for spot market purchases are unknown. Therefore, emissions factors for each of the previous ten years in the reporting period were applied according to methodology provided by the Department of Ecology.

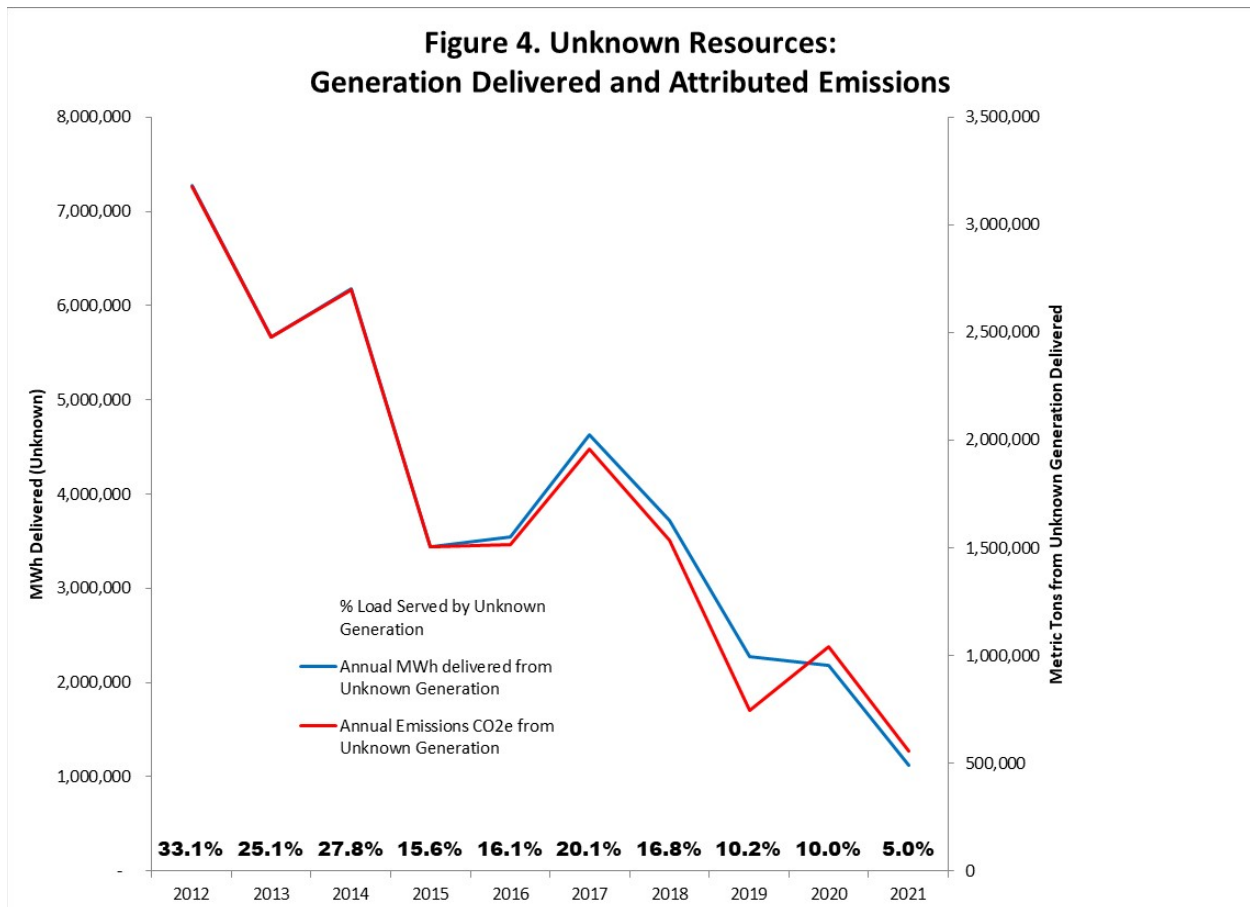

### **Section 3: Trend Analysis**

This section addresses the requirement in WAC 480-109-300(5) to include narrative text describing trends and an analysis of the likely causes of changes, or lack of changes, in the metrics.

#### *Electric Supply*

In 2021, PSE's electric power resources, which include company-owned or controlled resources and those under long-term contract, had a total capacity of approximately 4,809 megawatts (MW). PSE purchases electric energy under long-term firm-purchased power contracts with other utilities and marketers in the western interconnect. PSE is generally not obligated to make payments under these contracts unless power is delivered.

Energy supply and demand across the Western Interconnection is maintained on a second-to-second basis, and PSE dispatches its resources based on market prices in the Interconnect. When the dispatch cost of a specific PSE-owned unit is lower than the market price, the unit runs, and the net revenue credits back to customers to reduce rates. When the cost to run the PSE-owned unit is greater than the market price, the units are not dispatched. Dispatch decisions are independent of the demand by PSE's customers. If PSE's customers need power when its units are uneconomic to run, PSE purchases the energy from wholesale markets – other utilities or registered power marketers with energy to sell. If PSE's generation is dispatched and there is a surplus above PSE's customers' needs, that surplus will be sold in the wholesale market (net revenue from such sales is credited back to customers through rates), meaning whatever is happening to PSE's load is unrelated. The primary driver of generation dispatch is whether a generator's variable cost of dispatch is lower than the market price.

PSE tracks its firm and non-firm power transactions in its Energy Accounting (EA) database. Table 2 shows all firm energy transactions made in 2021, including the total dispatch of all of PSE-owned units. Emissions from PSE's units and from each firm purchase are calculated using the methodologies described in Appendix 2.1 and 2.2, respectively. For all firm BPA transactions and "non-unit-specific" purchases, PSE defaults to the Ecology emissions intensity metric according to WAC 480-109-300(4). PSE employed Commission staff's net-by-counterparty approach to calculate emissions from its non-firm (unspecified) power transactions. Details of these transactions are presented in Table 3, and the calculation methodology is described in Appendix 2.3. Staff requested in its compliance letter to PSE's 2017 EEI report that the Company explain how PSE determines whether a source is known or unknown. Staff correctly assumes that PSE classifies non-unit specific purchases as unknown sources. PSE also classifies



firm deliveries from the BPA and BC Hydro systems as unknown resources because the system mix of energy behind the delivery can vary at any moment in time. PSE-owned resources and unit-specific firm deliveries are classified as known sources because their fuel source is known and reported in EIA databases, described in Appendix 2.1 and 2.2.

**Table 2. Known Resources Serving WA Customers**

Resource	WA MWh	Metric	Type	Fuel
		Tons CO <sub>2</sub> equiv.		
Lower Baker	376,417	-	Own	Hydro
Snoqualmie Falls #1	32,622	-	Own	Hydro
Snoqualmie Falls #2	178,081	-	Own	Hydro
Upper Baker	370,699	-	Own	Hydro
Colstrip Unit 3	1,177,765	1,168,530	Own	Coal
Colstrip Unit 4	1,398,937	1,339,894	Own	Coal
Crystal Mountain	527	439.29	Own	Diesel
Encogen 1	173,872	81,205	Own	Gas
Encogen 2	178,560	88,105	Own	Gas
Encogen 3	179,809	88,262	Own	Gas
Ferndale 1	701,364	322,398	Own	Gas
Ferndale 2	683,611	314,855	Own	Gas
Frederickson 1	22,471	16,454	Own	Gas
Frederickson 2	34,421	25,082	Own	Gas
Fredonia 1	85,250	61,799	Own	Gas
Fredonia 2	120,143	86,204	Own	Gas
Fredonia 3	83,077	53,691	Own	Gas
Fredonia 4	88,846	48,965	Own	Gas
Frederickson Unit 1	642,904	245,907	Own	Gas
Goldendale	2,036,337	745,008	Own	Gas
Mint Farm	1,860,018	731,688	Own	Gas
Sumas	528,410	246,883	Own	Gas
Whitehorn 2	16,428	12,162	Own	Gas
Whitehorn 3	1,985	1,725	Own	Gas
Wild Horse (W183)	714,024	-	Own	Wind
Lower Snake River	941,517	-	Own	Wind
Hopkins Ridge (W184)	418,246	-	Own	Wind
Bio Energy Washington (BEW)	3	-	Firm	Biogas
Blocks Dairy Farm	19,232	-	Firm	Biogas
Edaleen Dairy LLC	3,815	-	Firm	Biogas
Emerald City Renewables	27,196	-	Firm	Biogas
Farm Power Rexville LLC	3,144	-	Firm	Biogas
Lake Washington -- Finn Hill	98	-	Firm	Biogas
Rainier Bio Gas	2,918	-	Firm	Biogas
Transalta Centralia Generation LLC	2,357,979	2,459,358	Firm	Coal
Black Creek Hydro Inc	11,168	-	Firm	Hydro
Chelan PUD - RI & RR	2,026,865	-	Firm	Hydro
Chelan PUD - Rock Island Syst #2	-38,626	-	Firm	Hydro

<b>Resource</b>	<b>WA MWh</b>	<b>Metric Tons CO<sub>2</sub>equiv.</b>	<b>Type</b>	<b>Fuel</b>
Chelan PUD - Rocky Reach	-80,185	-	Firm	Hydro
Douglas PUD - Wells Project	1,119,214	-	Firm	Hydro
Grant PUD - Priest Rapids Project	431,728	-	Firm	Hydro
KERR DAM-ENERGY KEEPER	350,624	-	Firm	Hydro
Koma Kulshan Associates	40,459	-	Firm	Hydro
Nooksack	22,657	-	Firm	Hydro
Skookumchuck Hydro	4,313	-	Firm	Hydro
Twin Falls Hydro	78,613	-	Firm	Hydro
Weeks Falls	14,405	-	Firm	Hydro
CC Solar 1 and CC Solar 2	29	-	Firm	Solar
Port of Coupeville	114	-	Firm	Solar
Ikea Solar	61	-	Firm	Solar
BC Hydro (Point Roberts)	18,119	7,918	Firm	System
BPA	7,000	3,059	Firm	System
Transalta Centralia Generation LLC - Bookout Source Other Adjustment	714,149	312,083	Firm	System
3 Bar G Wind Turbine #3 LLC	153	-	Firm	Wind
Klondike Wind Power III	141,582	-	Firm	Wind
Knudsen Wind Turbine #1	139	-	Firm	Wind
Lund Hill Solar, LLC	366,671	-	Firm	Solar
Penstemon Solar	2	-	Firm	Solar
Sierra Pacific Industries	126,931	-	Firm	Biomass
Skookumchuck Wind PPA	414,302	-	Firm	Wind
Swauk Wind	11,786	-	Firm	Wind

**Table 3. Unknown Resources Serving WA Customers**

Resource	Net-by-Counterparty MWh	Fuel Mix lbs CO <sub>2</sub> /MWh	Metric Tons CO <sub>2</sub> equiv.
Avista Corp. WWP Division	-18,821	869	-7,417
Avista Nichols Pump	18,032	963	7,880
Black Hills Power	-1,620	869	-638
BP Energy Co.	-53,878	869	-21,233
BPA	56,483	963	24,683
BPA - NWPP Reserve Sharing Energy	-116	869	-46
British Columbia Transmission Corp	-287	869	-113
Brookfield Energy Marketing	4,724	963	2,064
California ISO	12,638	963	5,523
Chelan County PUD #1	59,152	963	25,849
Citigroup Energy Inc	389,285	963	170,118
City of Roseville	-800	869	-315
Clatskanie PUD	-20,940	869	-8,252
Conoco, Inc.	658,853	963	287,919
CONSTELLATION ENERGY	4,464	963	1,951
CP Energy Marketing (Epcor)	335	963	146
Deviation	-232,291	869	-91,544
DTE Energy Trading	-97,000	869	-38,227
EDF Trading NA LLC	-40,825	869	-16,089
Energy Keepers Inc.	-47,993	869	-18,914
Eugene Water & Electric	-48,452	869	-19,095
Grant County PUD #2	2,398	963	1,048
GRIDFORCE ENERGY MANAGEMENT, LLC.	-378	869	-149
Iberdrola Renewables (PPM Energy)	671,524	963	293,456
Idaho Power Company	-39,715	869	-15,651
Morgan Stanley CG	46,966	963	20,524
Natur Ener USA	-206	869	-81
NextEra Energy Power Marketing	31,440	963	13,739
Northwestern Energy	-22,905	869	-9,027
Pacificorp	-235,970	869	-92,994
Portland General Electric	-215,518	869	-84,934
Powerex Corp.	-110,638	869	-43,602
Public Service of Colorado	30,800	963	13,460
Rainbow Energy Marketing	-11,733	869	-4,624
Sacramento Municipal	-15	869	-6
Seattle City Light Marketing	-11,883	869	-4,683
Shell Energy (Coral Pwr)	429,369	963	187,634

Resource	Net-by-Counterparty MWh	Fuel Mix lbs CO <sub>2</sub> /MWh	Metric Tons CO <sub>2</sub> equiv.
Snohomish County PUD #1	-60,755	869	-23,943
Tacoma Power	32,700	963	14,290
Tenaska Power Services Co.	-400	869	-158
The Energy Authority	-68,824	869	-27,123
TransAlta Energy Marketing	-5,356	869	-2,111
TransCanada Energy Sales Ltd	-38,654	869	-15,233
Turlock Irrigation District	936	963	409
Vitol Inc.	600	963	262
CAISO EESC Load Undistributed Costs	6,489	963	2,836
CAISO PRSC Undistributed Costs	-3,560	869	-1,403
Chelan PUD - RI & RR	-66,208	869	-26,092
Colstrip - Energy Imbalance Market	31,361	963	13,705
Douglas PUD - Wells Project	-4,585	869	-1,807
Encogen	25,047	963	10,945
Ferndale Co-Generation	38,638	963	16,885
Freddie #1	2,074	963	906
Fredonia - Energy Imbalance Market	23,119	963	10,103
Fredrickson 1 & 2	5,054	963	2,209
Goldendale	-2,177	869	-858
Grant PUD - Priest Rapids Project	-4,872	869	-1,920
Lower Baker	1,918	963	838
Mint Farm	14,181	963	6,197
Sierra Pacific Industries	-2,972	869	-1,171
Skookumchuck Wind PPA	-44,768	869	-17,643
Snoqualmie-Energy Imbalance Market	-772	869	-304
Sumas	22,609	963	9,880
Upper Baker	32,489	963	14,198
Whitehorn 2&3	1,817	963	794
Wild Horse (W183)	-16,550	869	-6,522

### *Columbia River Energy Supply Contracts*

During 2021, approximately 15.5 percent of PSE's energy supply requirement was obtained through long-term contracts with three Washington Public Utility Districts (PUDs) that own and operate hydroelectric projects on the Columbia River (Mid-Columbia). PSE's portion of the power output of the PUD projects is shown in Table 4.

**Table 4. Columbia River Electric Energy Supply Contracts**

Project	Contract Expiration	Percent of Output (PSE Share)	MW Capacity (PSE Share, approx.)
Rock Island Project (Chelan County PUD)	2031	25%	156
Rocky Reach Project (Chelan County PUD)	2031	25%	325
Wells Project (Douglas County PUD)	2028	27.1%	228
Priest Rapids Development (Grant County PUD)	2052	0.6%	6
Wanapum Development (Grant County PUD)	2052	0.6%	7

### *Energy Imbalance Market (EIM)*

Staff requested in its compliance letter to PSE’s 2017 EEI report that the Company clarify how its participation in the Energy Imbalance Market (EIM), operated by the California Independent System Operator (CAISO), is represented in this EEI report. For several reasons described below, it would be premature to make any assumptions in this report regarding the emissions impact to PSE from participation in the EIM because there is simply not enough information available from the market operator at this time to make any reasonable conclusions.

PSE joined the EIM in October 2016 and has realized significant benefits from participation in this real-time energy imbalance trading market operated by the CAISO that automatically finds the lowest-cost energy to serve intra-hour incremental changes across a wide geographic area of the western United States. PSE is reliant upon the CAISO market model’s identification of sources and sinks in the EIM and, therefore, must look to the CAISO to calculate any state-specific emissions impacts of the EIM. At the current time, the CAISO calculates and publishes GHG emission impacts across the entire EIM footprint, but does not calculate state-specific or utility-specific emissions impacts for EIM participants. The CAISO’s calculation of emissions is based on “avoided renewable curtailments” across the entire EIM footprint and it assumes that those avoided renewable curtailments displace generation from a resource with a default emissions rate of 0.428 metric tons CO<sub>2</sub>/MWh. Currently, the CAISO’s model cannot provide PSE with the information necessary to make its own state- or utility-specific emissions impact calculation. The CAISO only calculates the sink point for generators dispatched to the state of California, and this calculation is not based on physical dispatch, but is based on a least-cost dispatch run by the market model.

### *2021 Carbon Dioxide Emissions - Results & Discussion*

Overall, PSE's CO<sub>2</sub>e emissions intensity from total electricity delivered to customers decreased from 888.9 lb/MWh to 886.9 lb/MWh. In 2021, 58.3 percent of electricity delivered to PSE customers was generated by the company, 41.7 percent of electricity was purchased via firm contracts 36.65%) and non-firm contracts, i.e., spot market (5.0%). Of the CO<sub>2</sub>e emissions associated with electric delivery, 63.0 percent were from electricity generated by PSE, and 37.0 percent were from purchased electricity (30.8 percent via firm contracts and 6.2 percent via non-firm contracts).

It is important to remember that CO<sub>2</sub>e emissions vary based on the fuel source or technology used to generate the electricity. Some sources are more emissions intense than others. "Intensity" is the relationship between emissions and production, and utilities can measure that intensity using a metric called pounds of CO<sub>2</sub>e per megawatt-hour (lb/MWh) of electricity produced. For instance, about 11.5 percent of the electricity generated by PSE came from coal combustion, but this fuel source represented about 27.8 percent of the CO<sub>2</sub>e emissions from electricity generated by PSE. Natural gas accounted for 33.3 percent of the electricity generated by PSE; however, this fuel source represented 27.3 percent of the CO<sub>2</sub>e emissions from electricity generated by PSE. Renewable energy accounted for 13.6 percent of the electricity generated by PSE and produced zero CO<sub>2</sub>e emissions.

Compared to 2020, total electricity delivered to customers in 2021 decreased slightly, by just 0.2 percent, while total emissions increased slightly, by 2.3 percent. This trend is due primarily to an increase in output from Colstrip 3 & 4 (by 22.6%) and an increase in output from the natural gas thermal fleet (by 14.3%). This increase was needed to supplant a decrease in PSE renewables and market deliveries. PSE discusses these trends in more detail below.

In 2021, firm deliveries increased by 3.5 percent, and unspecified deliveries (i.e., spot market) decreased by 48.5 percent as compared to 2020. Firm thermal purchases come from three contracted sources: BC Hydro, BPA, and Centralia ("Market & Coal"). Firm deliveries from BC Hydro, BPA, and "Centralia Market" are assigned a system emissions rate due to a market option in the contract structure. PSE assigns calculated rates to the firm deliveries from "Centralia Coal" according to the WAC 177-44-040 methodology described in Appendix 2.

### *Trends Discussion*

The relative amount of GHG emissions from the electricity sources did not align with the amount of power produced from each electricity source. This trend is due to factors related to the intensity<sup>2</sup> of emissions from each source.

---

<sup>2</sup> Emission intensity is the relationship between CO<sub>2</sub>e emissions and power production, i.e., pounds CO<sub>2</sub>e/kWh.

For example, about 19.8 percent of the electricity generated by PSE came from coal combustion, which has a high CO<sub>2</sub>e emission intensity compared to natural gas and oil combustion sources. Of CO<sub>2</sub>e emissions from electricity generated by PSE (direct emissions), about 44.2 percent were from coal-combustion generation. The high CO<sub>2</sub>e emission intensity of coal-combustion generation made the overall CO<sub>2</sub>e emission intensity of PSE’s electric operations high.

Another example highlighting this trend occurs in purchased electricity. Roughly 62.0 percent of firm contract electricity purchased by PSE came from renewable plants in the Pacific Northwest (primarily hydroelectric), while the remaining purchases were sourced from thermal plants. Since hydroelectric generation is considered a non-GHG emitting source, almost all of the CO<sub>2</sub>e emissions generated from firm contract purchased electricity come from coal and natural gas generated electric operations.

A third example relates to how emissions are calculated for electricity purchased by PSE on the spot market (i.e. non-firm contracted electricity purchases). Again, these purchases are sourced from different utilities and non-utilities via the “grid” system of electric distribution, making the source of energy challenging to track and measure. Therefore, regional average emission factors were used to estimate non-firm contract purchased electricity. For instance, electricity purchased by a utility from an energy trader could have been purchased by the energy trader from a hydroelectric facility near the utility's operational territory or from a utility generating electricity using coal outside the utility's operational territory. The emissions associated with the generation are not known because they could be significantly different for each source. Therefore, the emissions associated with non-firm contract purchased electricity were calculated using the unspecified emission rate factor provided by Ecology that generally reflects the suite of generation sources that produced the purchased electricity.

**2021**

<b>Summary of Total Energy Delivered, Total Emissions (CO<sub>2</sub>e)</b>								
Source	MWh Total	MWh % of PSE All-owned Total	MWh % of PSE Thermal Only	MWh % of Total	Metric Ton Total	Metric Ton % of PSE All-owned Total	Metric Ton % of PSE Thermal Only	Metric Ton % of Total
PSE Owned Coal	2,576,702	19.8%	25.7%	11.7%	2,508,424	44.2%	44.2%	27.9%
PSE Owned Gas	7,438,031	57.0%	74.3%	33.9%	3,170,903	55.8%	55.8%	35.2%
PSE Owned Renewable	3,031,606	23.2%		13.8%	0	0.0%		0.0%
Firm Coal	2,357,979			10.7%	2,459,358			27.3%
Firm Renewable	4,714,831			21.5%	0			0.0%
Firm Unspecified	706,221			3.2%	308,619			3.4%
Unspecified	1,123,057			5.1%	556,530			6.2%
Total (from energy)	21,948,427				9,003,834			
PSE Own plus Firm PPA	20,825,370				8,447,304			
Total PSE Only	13,046,339			59.441%	5,679,328			63.1%
Total Firm Only	7,779,031			35.442%	2,767,976			30.7%
Total Unspecified Only	1,123,057			5.117%	556,530			6.2%

**Comparison to Previous Year (Emissions in CO2e)**

	2021					2020				
	Energy MWh	%	Emissions Metric Ton	%	Intensity (lb/MWh)	Energy MWh	%	Emissions Metric Ton	%	Intensity (lb/MWh)
PSE Owned Coal	2,576,702	11.5%	2,508,424	27.8%	2,146.2	2,102,338	10%	2,089,805	24%	2,191.5
Firm Coal	2,357,979	10.5%	2,459,358	27.3%	2,299.4	2,500,968	11%	2,671,660	30%	2,355.1
PSE Owned Gas	7,438,031	33.3%	3,170,903	35.2%	939.9	6,506,752	30%	2,704,187	31%	916.2
PSE Owned All Other	3,031,606	13.6%	0	0.0%	0.0	3,195,933	15%	0	0%	0.0
Firm All Other	5,838,677	26.1%	323,060	3.6%	122.0	5,421,052	25%	308,619	4%	125.5
Unspecified	1,123,057	5.0%	556,530	6.2%	1,092.5	2,182,678	10%	1,040,097	12%	1,050.6
PSE Owned Plus Firm PPA	21,242,996		8,461,745		878.2	19,727,043		7,774,271		868.8
PSE Owned	13,046,339	58.3%	5,679,328	62.98%	959.7	11,805,023	53.9%	4,793,992	54.4%	895.3
Firm	8,196,656	36.65%	2,782,418	30.85%	748.4	7,922,020	36.2%	2,980,279	33.8%	829.4
Unspecified	1,123,057	5.02%	556,530	6.17%	1,092.5	2,182,678	10.0%	1,040,097	11.8%	1,050.6
Total (Own, Firm, Unspecified)	22,366,052		9,018,275		888.9	21,909,720		8,814,369		886.9

**Comparison to Previous Year (Emissions in CO2e)**

	2021 v. 2020				
	Energy MWh	%	Emissions Metric Ton	%	Intensity (lb/MWh)
PSE Owned Coal	474,364	22.6%	418,619	20.0%	-45.3
Firm Coal	-142,989	-5.7%	-212,303	-7.9%	-55.7
PSE Owned Gas	931,280	14.3%	466,716	17.3%	23.6
PSE Owned All Other	-164,327	-5.1%	0	0.0%	0.0
Firm All Other	417,626	7.7%	14,441	4.7%	-3.5
Unspecified	-1,059,621	-48.5%	-483,568	-46.5%	41.9
PSE Owned	1,241,316	10.5%	885,335	18.5%	64.4
Firm	274,637	3.5%	-197,861	-6.6%	-81.0
Unspecified	-1,059,621	-48.5%	-483,568	-46.5%	41.9
Total (Own, Firm Unspecified)	456,332	2.1%	203,906	2.3%	2.0

**Centralia Coal Transition Power**

It is important to distinguish between emissions from PSE’s owned thermal resources above and the contract PSE signed with TransAlta for coal transition power from the Centralia power station (“Centralia”). In this report, PSE incorporates a breakdown of energy and emissions from Centralia and differentiates Centralia generation and Centralia supply, which is power purchased by the owner of Centralia (i.e., TransAlta), and supplied to PSE. PSE’s report will apply different emissions factors for energy supplied versus generated from Centralia to reflect known sources of emissions more accurately.

PSE reports the difference between supplied and generated power each year from Centralia in its Annual Report of Energy Delivery to PSE from TransAlta-Centralia Transition Coal in Docket No. UE-121373 (“Coal Transition Report”).

PSE’s sources of Centralia generation and supply in this report are consistent with its Coal Transition Report.



For power generated from Centralia coal, PSE applied the emission factor following the methodology and data reported to EPA. For power supplied by Centralia, PSE applied the Ecology unspecified rate, 963 lbs per CO<sub>2</sub>e/MWh. PSE determined the Ecology unspecified rate was reasonable because it provides consistency given the uncertainty of sources purchased by TransAlta from other Balancing Authority Areas. PSE plans to use this same methodology to differentiate Centralia generation and supply in this report for the Centralia coal transition contract duration.

### *Population Data*

PSE tracks customers served by class of service but does not track the number of people (population) served. Therefore, population data in this report is estimated based upon methodology agreed to by PSE, UTC Staff, and the other utilities.

The total service area population was estimated by multiplying the total residential customers in PSE's service area by the average household size (AHS) of occupied homes, using data from the most recent five-year estimates from the U.S. Census Bureau's American Community Survey (ACS).

### *Unspecified Market Purchases*

This report includes energy that PSE has purchased from the spot market associated with the corresponding generation year where the actual generating unit is unknown (unspecified). As stipulated in this rule, PSE uses an unspecified emissions rate for these spot market purchases where the energy source is unknown (WAC 480-109-300(3)). The net system mix emissions rates for PSE and the other utilities during the reporting period have been calculated and provided by Ecology.

## Section 4. Appendices

### Appendix 1: Estimation of PSE Service Territory Population

This appendix documents how PSE estimated the population within its service territory to meet the reporting requirement of WAC 480-109-300(2)(c): Megawatt-hours per capita. The estimated population for each reporting year is the product of PSE residential customer count for the year multiplied by the weighted average household size of the counties that PSE provides electric service. The methodology is consistent with the preferred Per Capita Methodology described in the UTC Staff’s final report<sup>3</sup> and the Commission’s Final Order<sup>4</sup> on the estimation of population in an electric utility service territory. As prescribed in the Commission’s Final Order paragraph 17, “To produce the reports required by WAC 480-109-300(2)(c), the utilities should use the methodology agreed upon by stakeholders and described in the final report and this order.”<sup>5</sup>

PSE’s customer information system is the ultimate source of the annual residential customer count data, which represents the number of households within PSE service territory. These customer count data are as reported in PSE’s FERC financial reporting Form No. 1: Annual Report of Major Electric Utilities, Licensees, and Others. Not all residents in a multi-family or mixed-use commercial and residential building are included in PSE’s residential customer count at this time. PSE does not have reliable data to make a separate adjustment to account for the persons residing in master-metered residential buildings.

The average household size used in PSE’s WAC 480-109-300: Energy and emissions intensity metrics is 2.49. This number is the overall average of persons per household for PSE’s service territory weighted by the population size for each county.

The source of the five-year average of county-level data is the United States Census Bureau’s American Communities Survey, which can be accessed using the Bureau’s web-based application QuickFacts at [www.census.gov/quickfacts/table/PST045215/00](http://www.census.gov/quickfacts/table/PST045215/00).

The following table details the data and the calculation of the 2.49 persons average household size that used in the determination of PSE service territory population for megawatt hours per capita (WAC 480-109-300(3)(c)).

---

<sup>3</sup> UE-131732 Proposed EE Metrics Workgroup Results – Final Report, August 7, 2015, (Report at 2-3).

<sup>4</sup> UE-131732, Final Order, General Order R-581: Order Adopting Rule Permanently, September, 10, 2015, (Order at 6 §17).

<sup>5</sup> UE-131732, Final Order, General Order R-581: Order Adopting Rule Permanently, September, 10, 2015, (Order at 6 §17).

*2016-2020 Census Bureau, Updated July 2021*

<u>County</u>	<u>Population</u>	<u>Per House</u>	<u>Total</u>
Skagit	130,696	2.55	333,275
Pierce	925,708	2.64	2,443,869
Island	87,432	2.31	201,968
King	2,252,305	2.43	5,473,101
Kitsap	274,314	2.46	674,812
Kittitas	45,499	2.32	105,558
Thurston	297,977	2.5	744,943
Whatcom	228,831	2.47	565,213
	Weighted Average		2.48

## Appendix 2: Emissions Reporting Methodology

### 1. Owned Thermal Resources

PSE wholly owns three dual-fuel combustion turbine generation facilities (Frederickson, Fredonia, and Whitehorn), five natural gas combined cycle generation facilities (Encogen, Goldendale, Mint Farm, Ferndale and Sumas), and one internal diesel combustion generation facility (Crystal Mountain). Also, PSE partially owns one coal-combustion generation facility (Colstrip) and one natural gas combined cycle generation facility (Freddy 1).

PSE's CO<sub>2</sub>e emissions from electric operations are calculated using the EPA GHG Mandatory Reporting Rule Subparts C and D (Tiers 2 & 4) calculation methodologies. Utilizing Subparts C & D, carbon dioxide mass is calculated based on the amount of fuel consumed by each generation facility.

Thermal facilities utilizing the Subpart C method include Frederickson, Fredonia Units 1 & 2 and Whitehorn. Annual CO<sub>2</sub>e mass emissions using Subpart C are calculated with these plant measurements: 1) fuel heat content (HHV), 2) the amount of fuel burned (volume) and, 3) a default specific emission factor. An example calculation is provided below.

Example = Volume gas x fuel heat content HHV x EF =

(334,172,000 scf natural gas measured) x (0.0010920 MMBtu/scf measured) x  
(53.06 kg CO<sub>2</sub>/MMBtu) = 21,343 short ton CO<sub>2</sub>

Thermal facilities utilizing the Subpart D method include Encogen, Goldendale, Mint Farm, Ferndale, Sumas, Fredonia Units 3 & 4, Freddy 1 and Colstrip. This method utilizes direct continuous emissions measurement systems (CEMS) as prescribed in Part 75 of the EPA Acid Rain Program. Stack gas and flow measurements are measured continuously, and this data is used in prescribed equations (via the CEMS system) to determine total CO<sub>2</sub> mass. Part 75 also includes certification and QA/QC requirements to ensure that data validity is confirmed at the beginning of a monitoring program.

### 2. Firm Contract Purchases

PSE calculated firm contract purchased emissions using the Ecology methodology outlined in WAC 177-444-040(2).

- Step 1: Obtain plant GHG emissions. GHG emissions for this method are defined as the sum of all Subpart C and Subpart D emissions from the individual power plant as published by EPA based on 40 CFR Part 98 reporting consistent with the methods adopted in WAC 173-441-120. Emissions are on a calendar year basis and in units of

metric tons CO2e. Use emissions values specific to the calendar year in the calculation.

- Step 2: Obtain plant net electric generation. Net electric generation is the sum of all annual net generation (MWh) from Form EIA-923 for the power plant for the calendar year for all reported fuel type codes.
- Step 3: Calculate transmission losses using the following method as directed by the regulatory agency. Transmission losses are zero MWh if utility claims are reported on a plant net output basis, like utility claims measured at the busbar.
- Step 4: Obtain cogeneration correction factor. Account for nonelectric heat use at the power plant by dividing the sum of annual electric fuel consumption (MMBtu) by the sum of annual total fuel consumption MMBtu from Form EIA-923.
- Step 5, Firm Contract Plant Emission Rate Equation (Ecology Method) =

$$\frac{\text{EPA plant GHG emissions} \times \text{cogeneration correction factor}}{\text{plant net electric generation}} \times (\text{utility claims} + \text{transmission losses})$$

### 3. Non-Firm Contract Purchases

PSE's emissions from non-firm contract purchased electricity were estimated using the net-by-counterparty methodology for purchases and sales of non-firm contract purchased electricity pursuant to the Staff directive described below:

*“ 3. Unknown Sources – Purchase and sales reporting methodology: After several rounds of discussion last year and after reviewing analysis performed by the utilities, Staff believes the appropriate methodology for reporting purchases and sales is the net-by-counterparty approach:*

*(a) for each transaction partner whose generation is from an unknown resource, subtract the total annual sales to this party from the total annual purchases from this party;*

*(b) if the result is positive, apply the Ecology unspecified intensity factor to calculate emissions associated with the net purchase;*

*(c) if the result is negative, apply an aggregate, fleet-wide emissions intensity factor for the utility's known sources to calculate emissions associated with the net sale.*

*Staff understands that this approach has largely been implemented by PSE in prior reports. Staff contends that the net-by-counterparty approach represents an optimal balance among the three competing priorities of accuracy, consistency, and burden on company and commission resources.”*

### 4. Non-Firm Purchases in the EIM

#### 1. For non-PSE units:

- Apply net-by-counterparty calculus described in 3) above

2. For PSE units:

- If end-of-year net (by plant) is greater than zero, then PSE was a net purchaser (from CAISO); assign Commerce rate. If end-of-year net (by plant) is less than zero, then PSE had excess generation.
- For excess generation from PSE units, will assign “zero” emission rate because emissions are accounted for under “Generation” (to avoid double counting)