


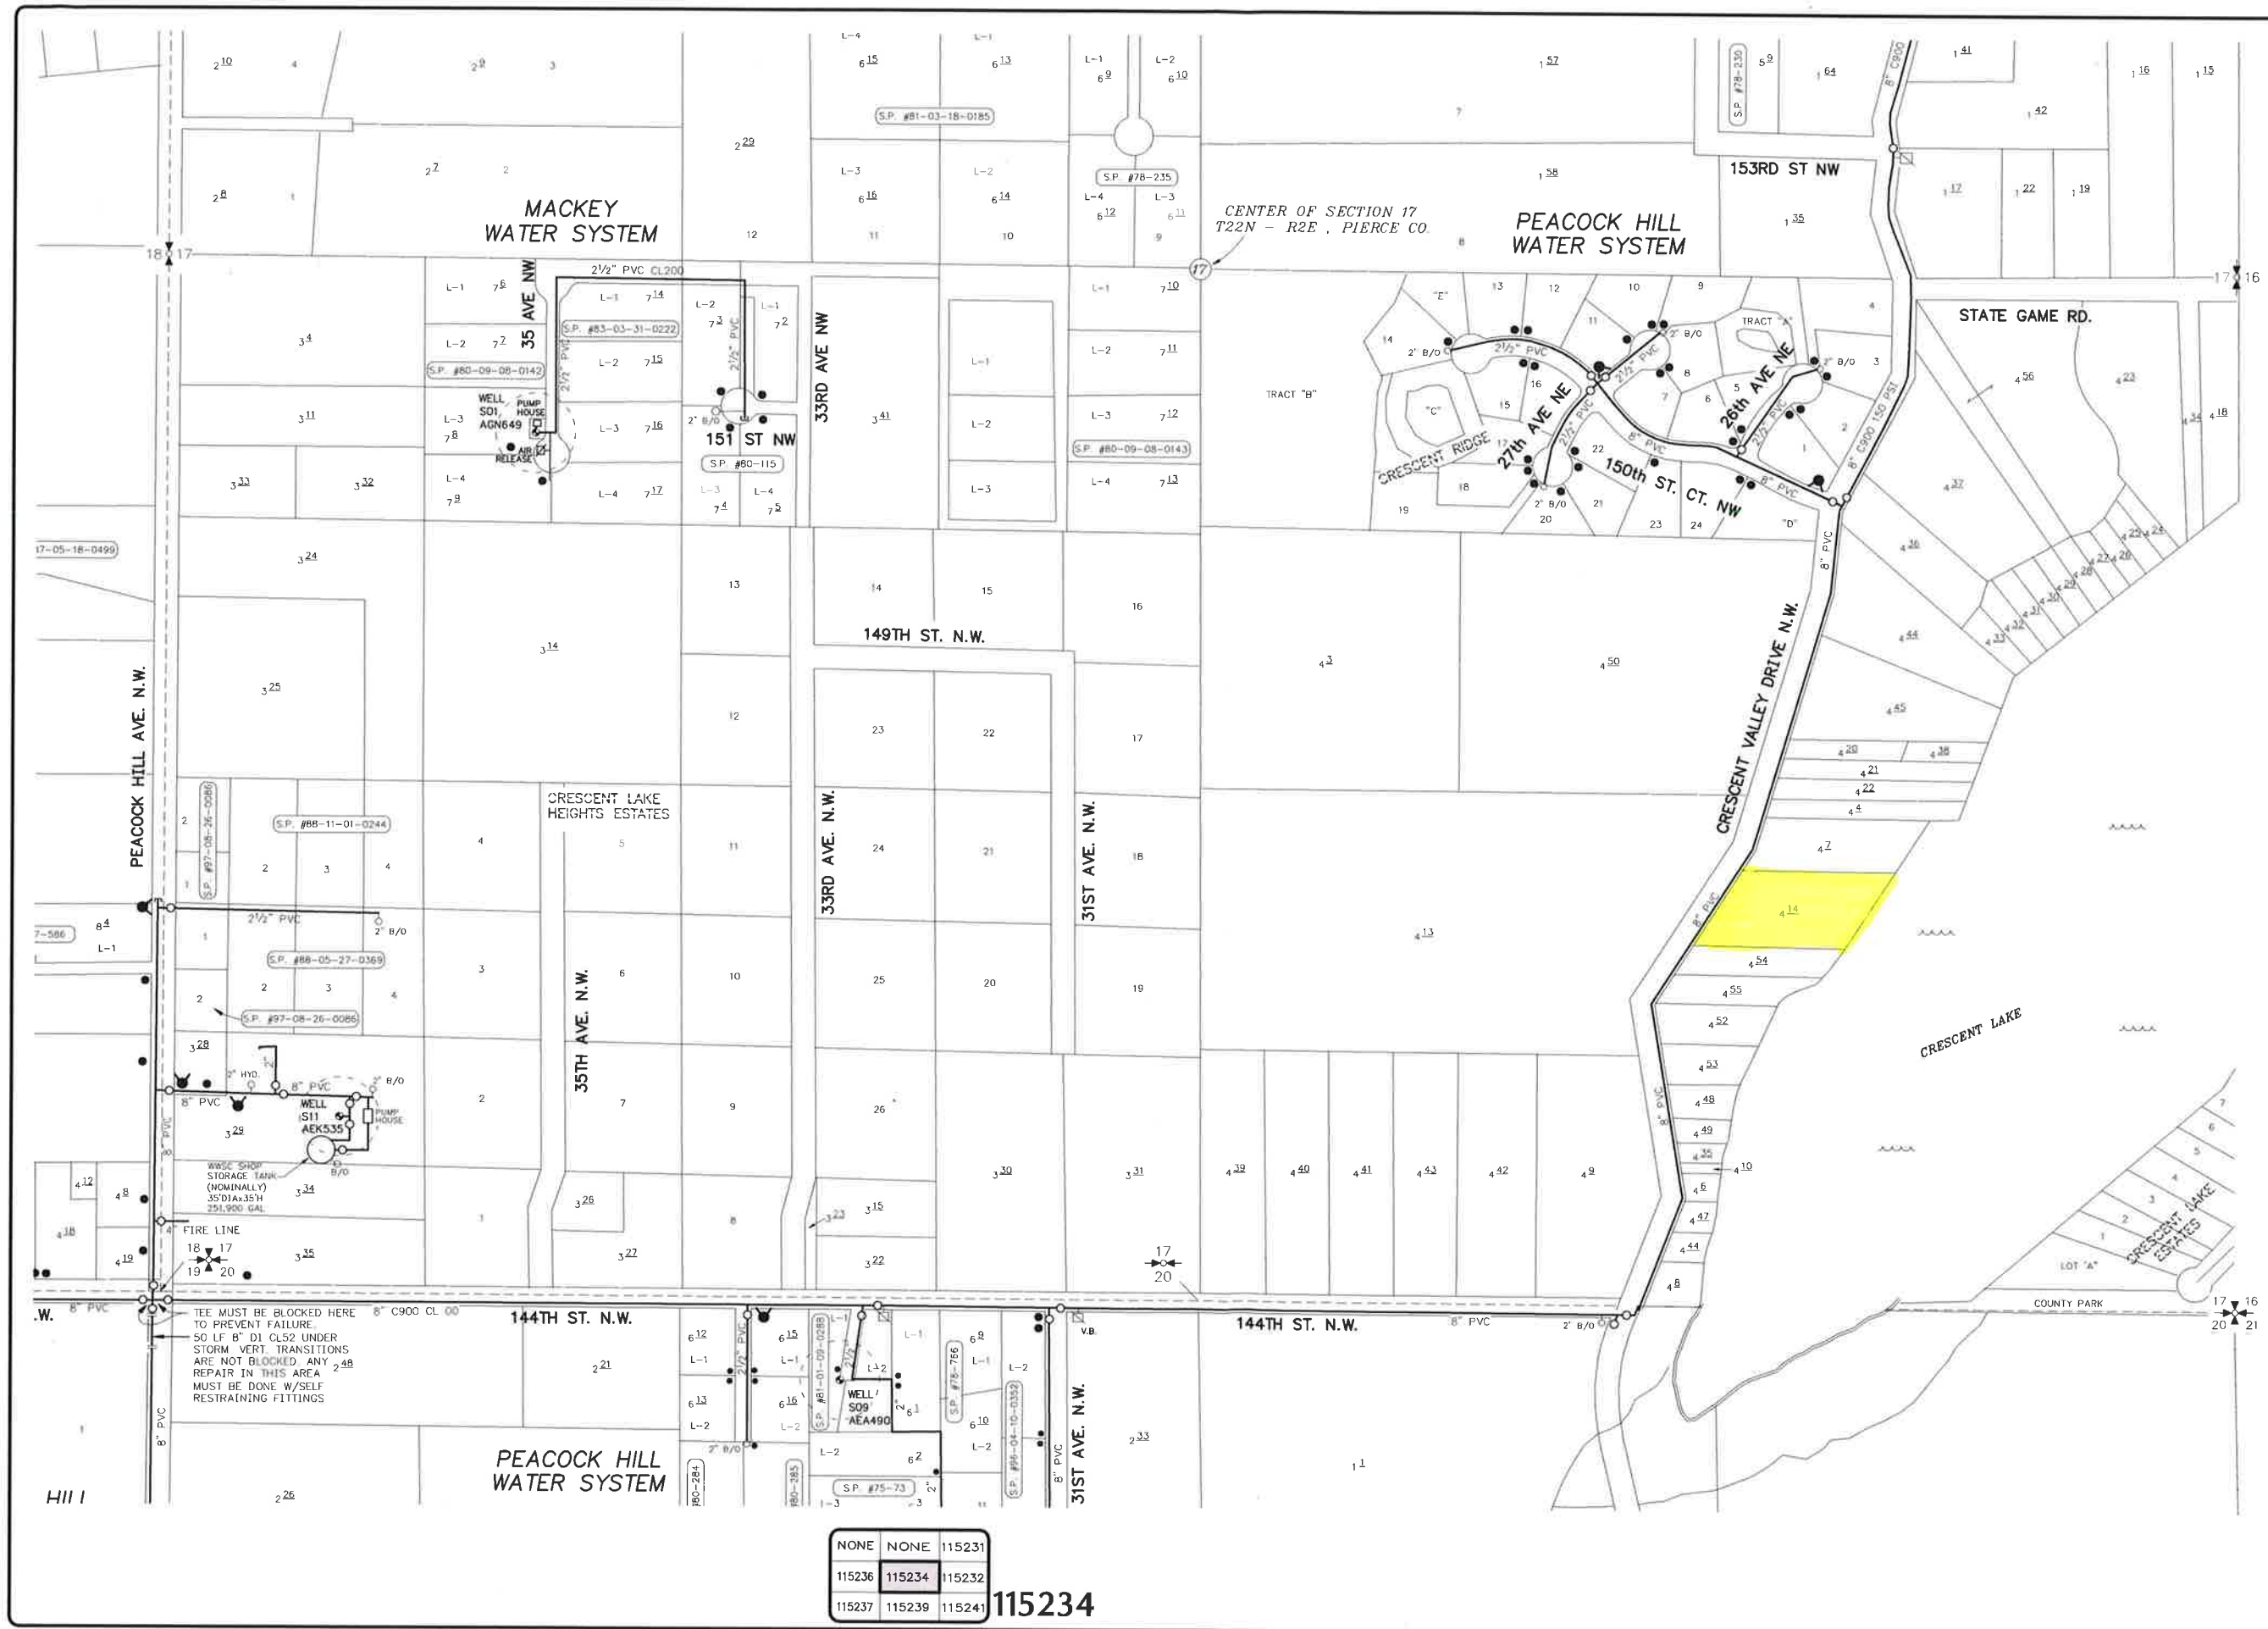


- LEGEND
- SINGLE SERVICE
 - I.D. OF PROPERTY SERVED
 - DOUBLE SERVICE
 - HALF DOUBLE (CONVERTIBLE)
 - VALVED DOUBLE (CONVERTED HALF)
 - CHANGES IN MAINLINE SIZE OR TYPE
 - MAINLINE VALVE
 - NORMALLY CLOSED VALVE
 - HANDWHEEL GATE
 - CORP / CURB / OR PLUG VALVE
 - 2", 1" OR U.G. B/O
 - 2" OR 1" V.B. VACUUM BREAKER
 - FIRE HYDRANT
 - WELL
 - PRESSURE REGULATED AT SERVICE
 - EQUIPPED FOR RESIDENTIAL FIRE SPRINKLERS
- STANDARDIZED BASE MAP PIPE
- DUCTILE IRON PIPE = C900 OR AAS
IPS SIZED PVC = PVC C, XXX
TUBE SIZED POLY = PE1
ABS = ABSORPTIVE OR ABSORPTIVE
GALVANIZED STEEL = GALV
ASBESTOS CEMENT = AC
DUCTILE = DI

WASHINGTON WATER SERVICE CO.
HARBOR DISTRICT
P.O. BOX 336 / BIG HARBOR, WA 98335
253-851-4060

SOUTH HALF SEC. 17, T22N - R2E
PIERCE COUNTY

DRAWN BY: D. BROOKS
CHECKED BY: D. BROOKS
APPROVED BY: M. BROWN



NONE	NONE	115231
115236	115234	115232
115237	115239	115241

DATE OF ISSUE:
JUNE 4, 2014

115234

NONE	NONE	115231
115236	115234	115232
115237	115239	115241

115234